

Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

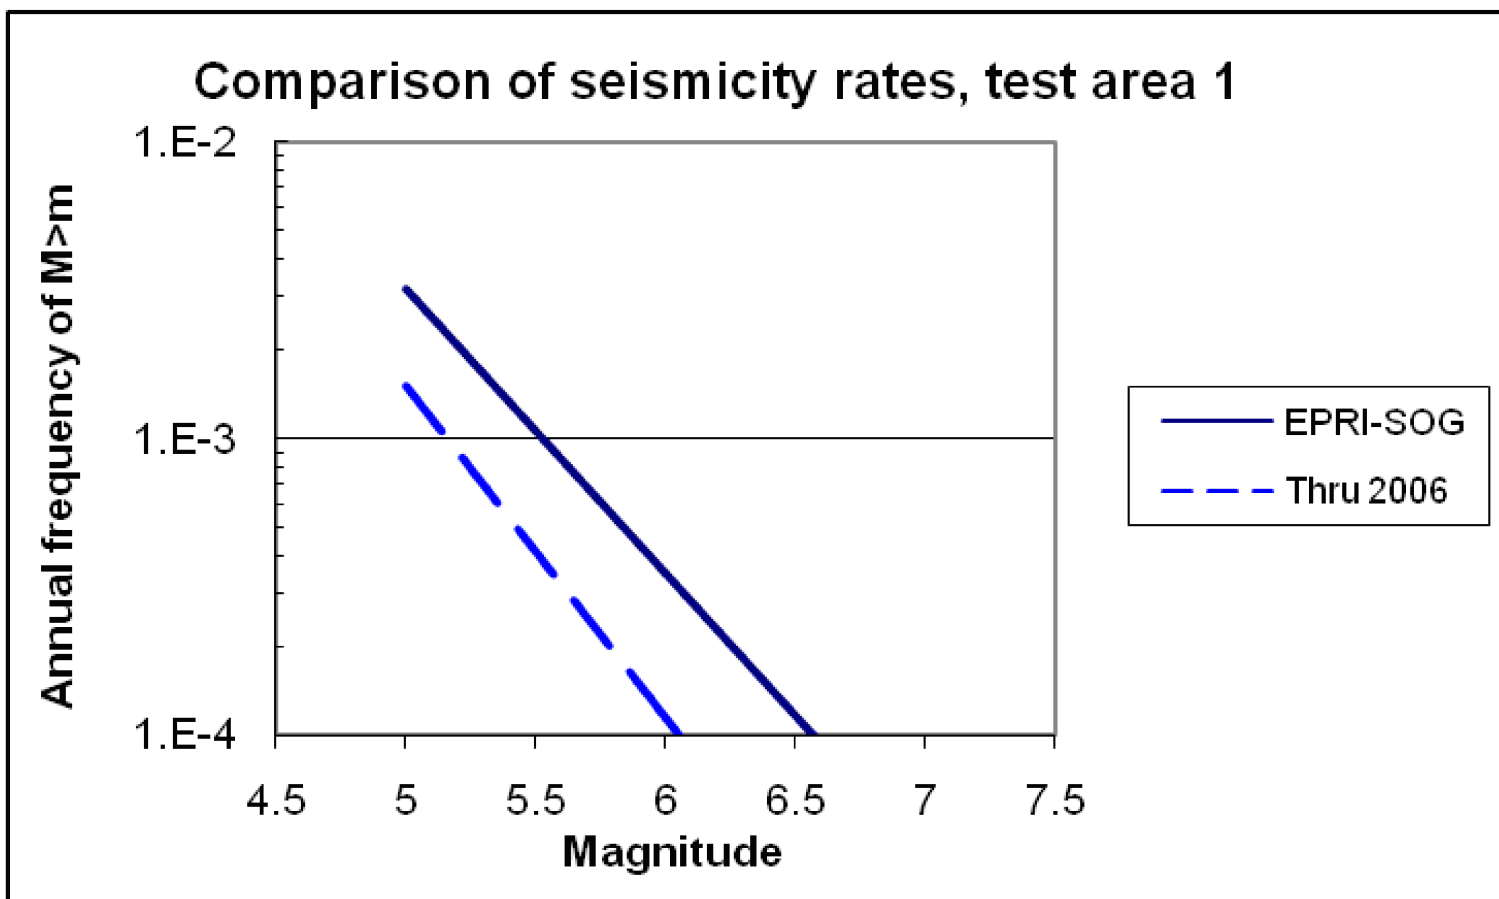


Figure 2.5.2-210 Comparison of Seismicity Rates for Test Area 1 Shown in Figure 2.5.2-209