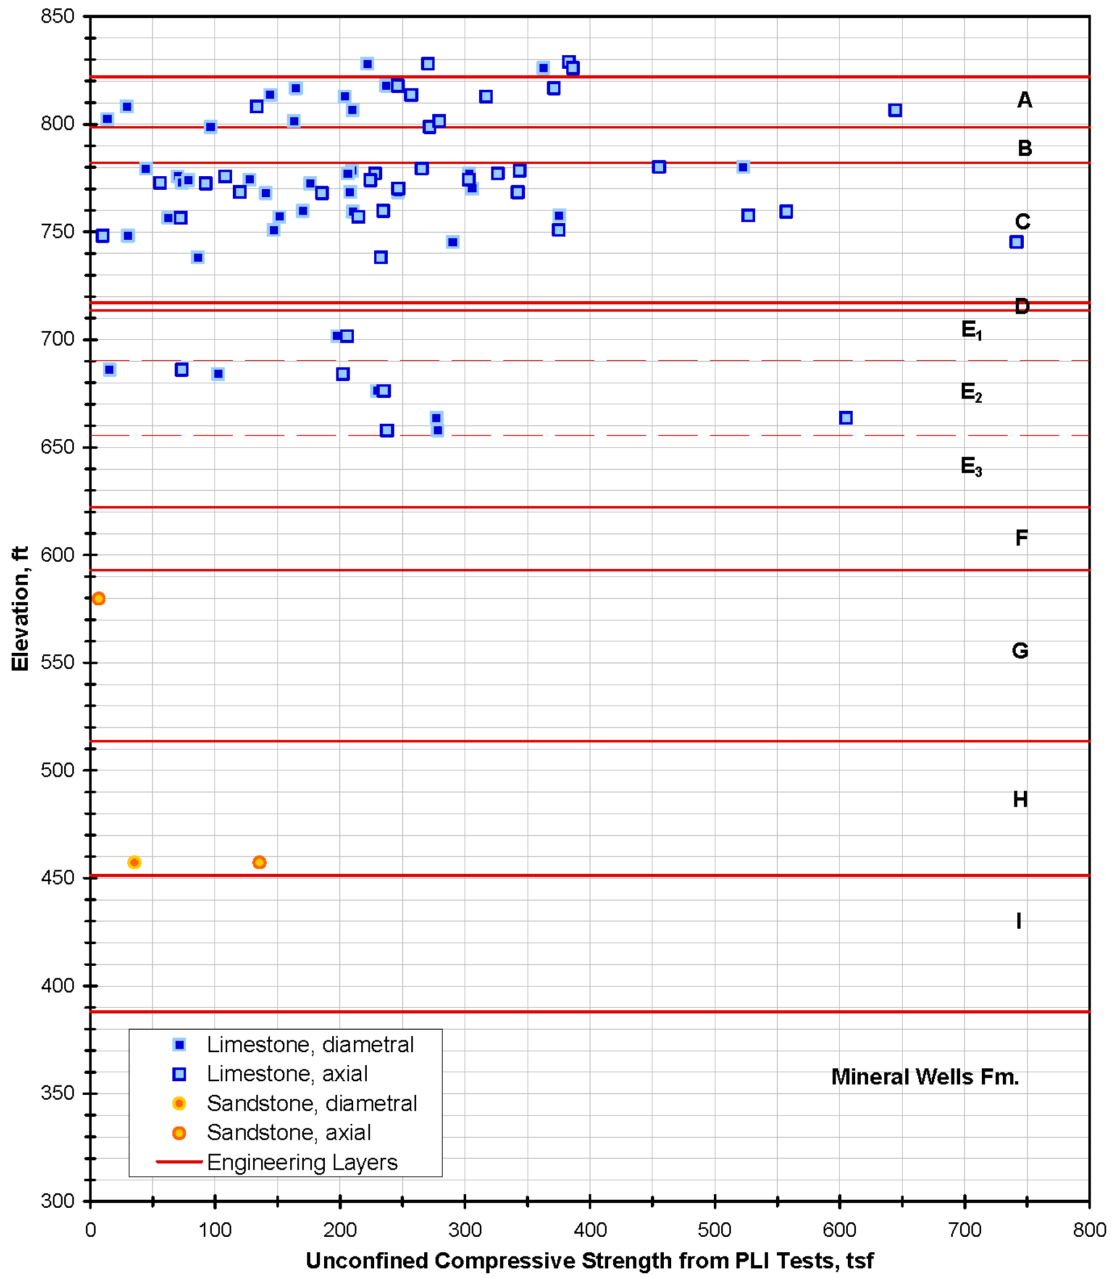


**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR**



**Figure 2.5.4-229 Estimated Unconfined Compressive Strength from Point Load Index Tests vs. Elevation**