


Bellefonte Nuclear Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

NOTES

1. SEE SHEET 2 FOR TRASH RAKE, TRAVELING SCREEN AND SCREEN WASH PUMP.

ABBREVIATIONS

DTS DEMINERALIZED WATER TREATMENT SYSTEM  
FPS FIRE PROTECTION SYSTEM  
RWS RAW WATER SYSTEM  
SWS SERVICE WATER SYSTEM

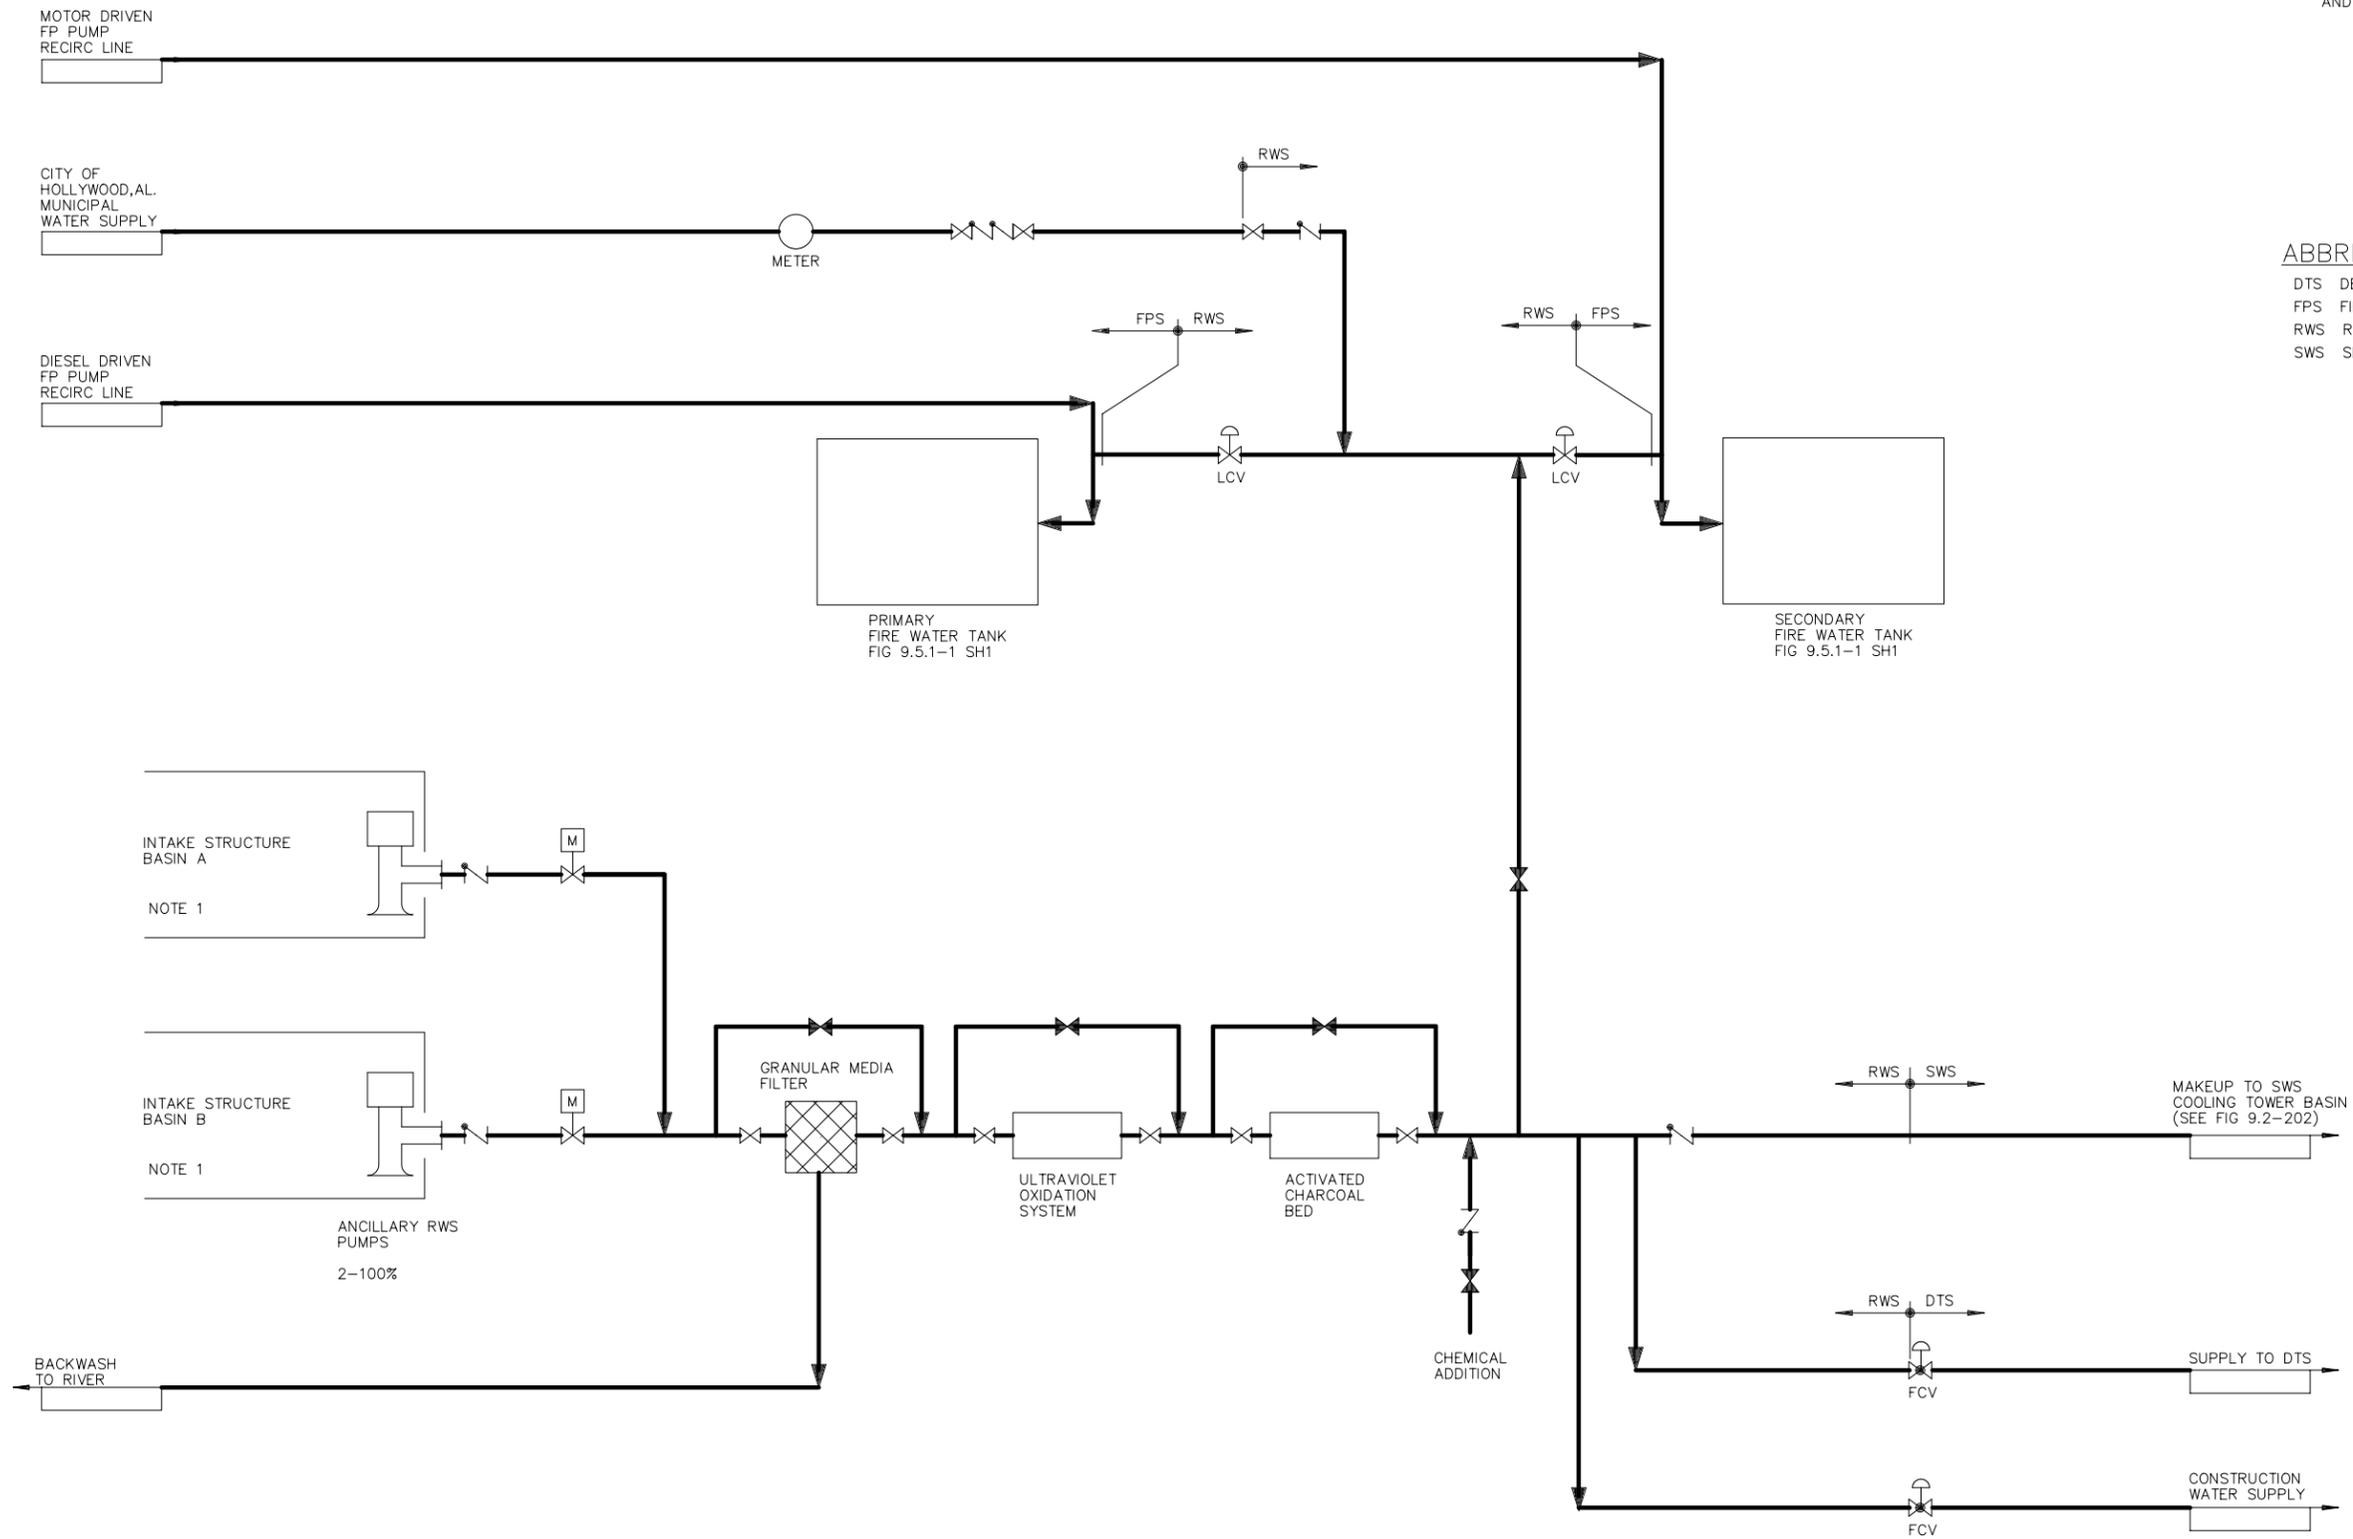

NOTES

ABBREVIATIONS  
 CWS CIRCULATING WATER SYSTEM  
 RWS RAW WATER SYSTEM  
 TCS TURBINE BUILDING CLOSED COOLING WATER SYSTEM

