




REACTOR BUILDINGS

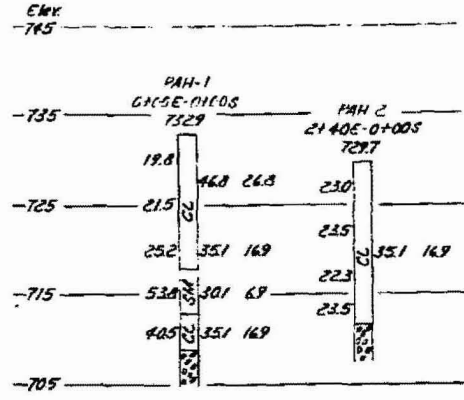


PLANT BUILDINGS

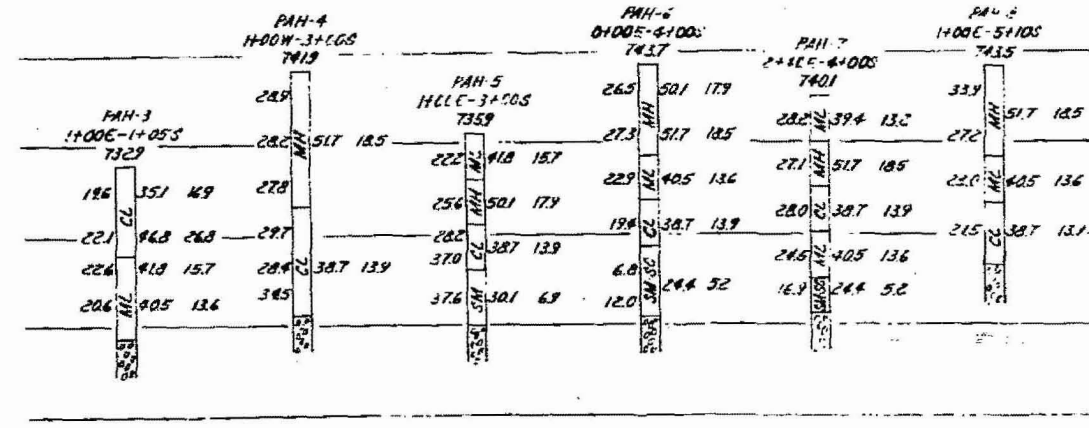


TRANSFORMER YARD & 500 KV SWITCHYARD

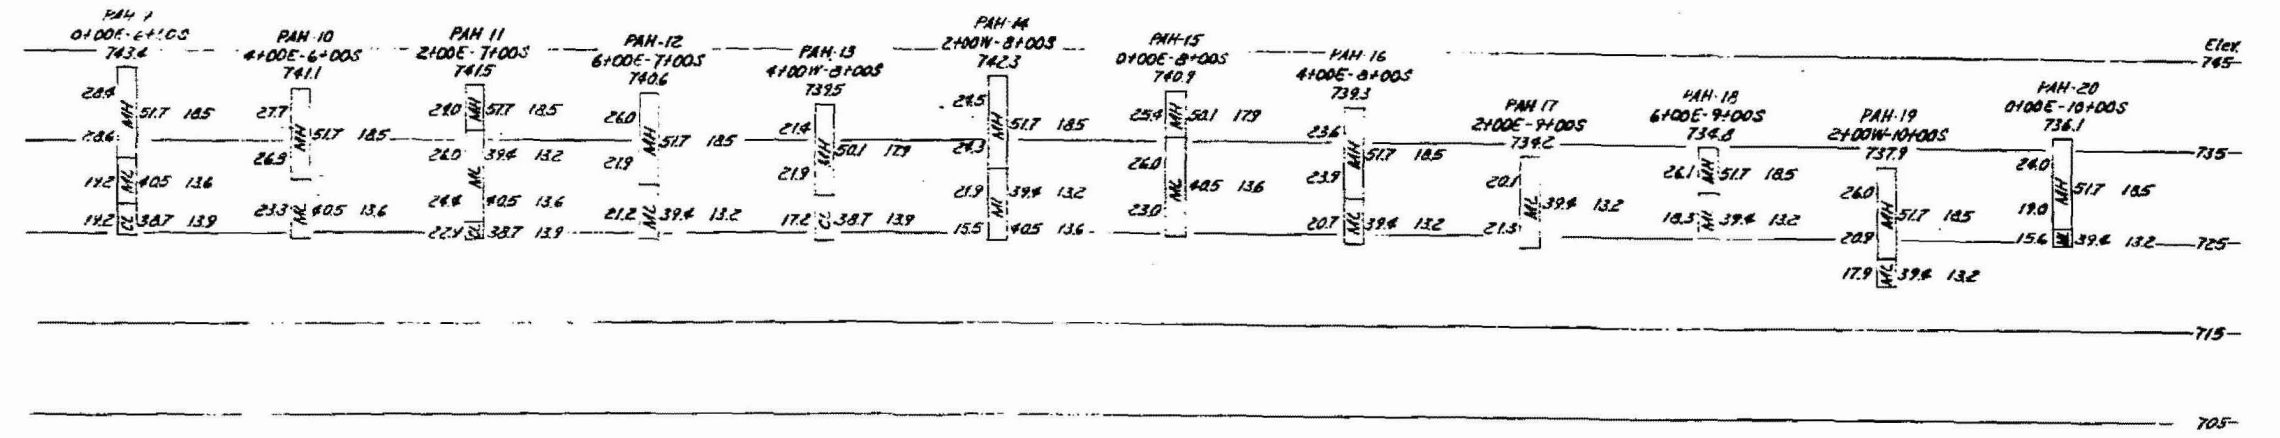

COOLING TOWERS

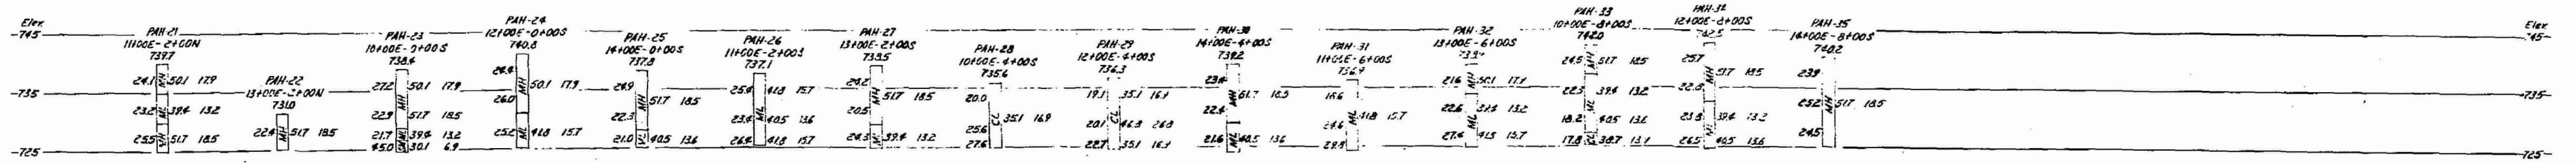

INTAKE CHANNEL

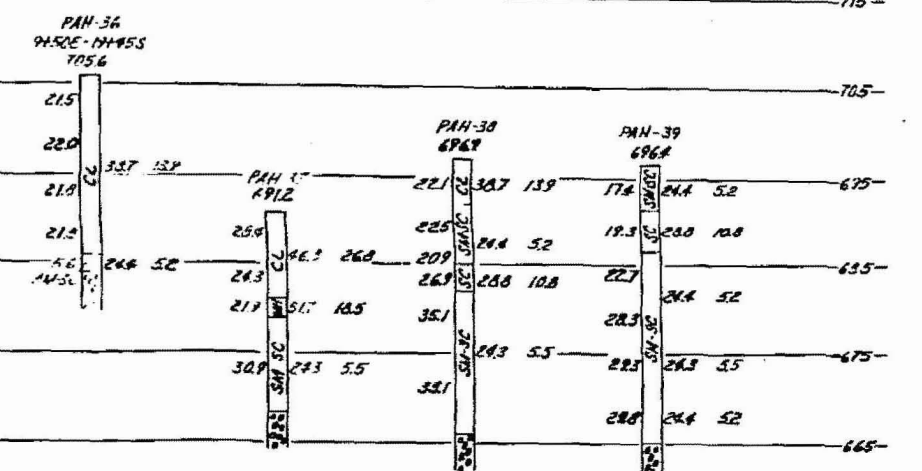

SYMBOLS
 Ground

LEGEND

- Liquid Contaminant
- Plasticity Index

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

BORROW INVESTIGATION

Figure 2.5-222