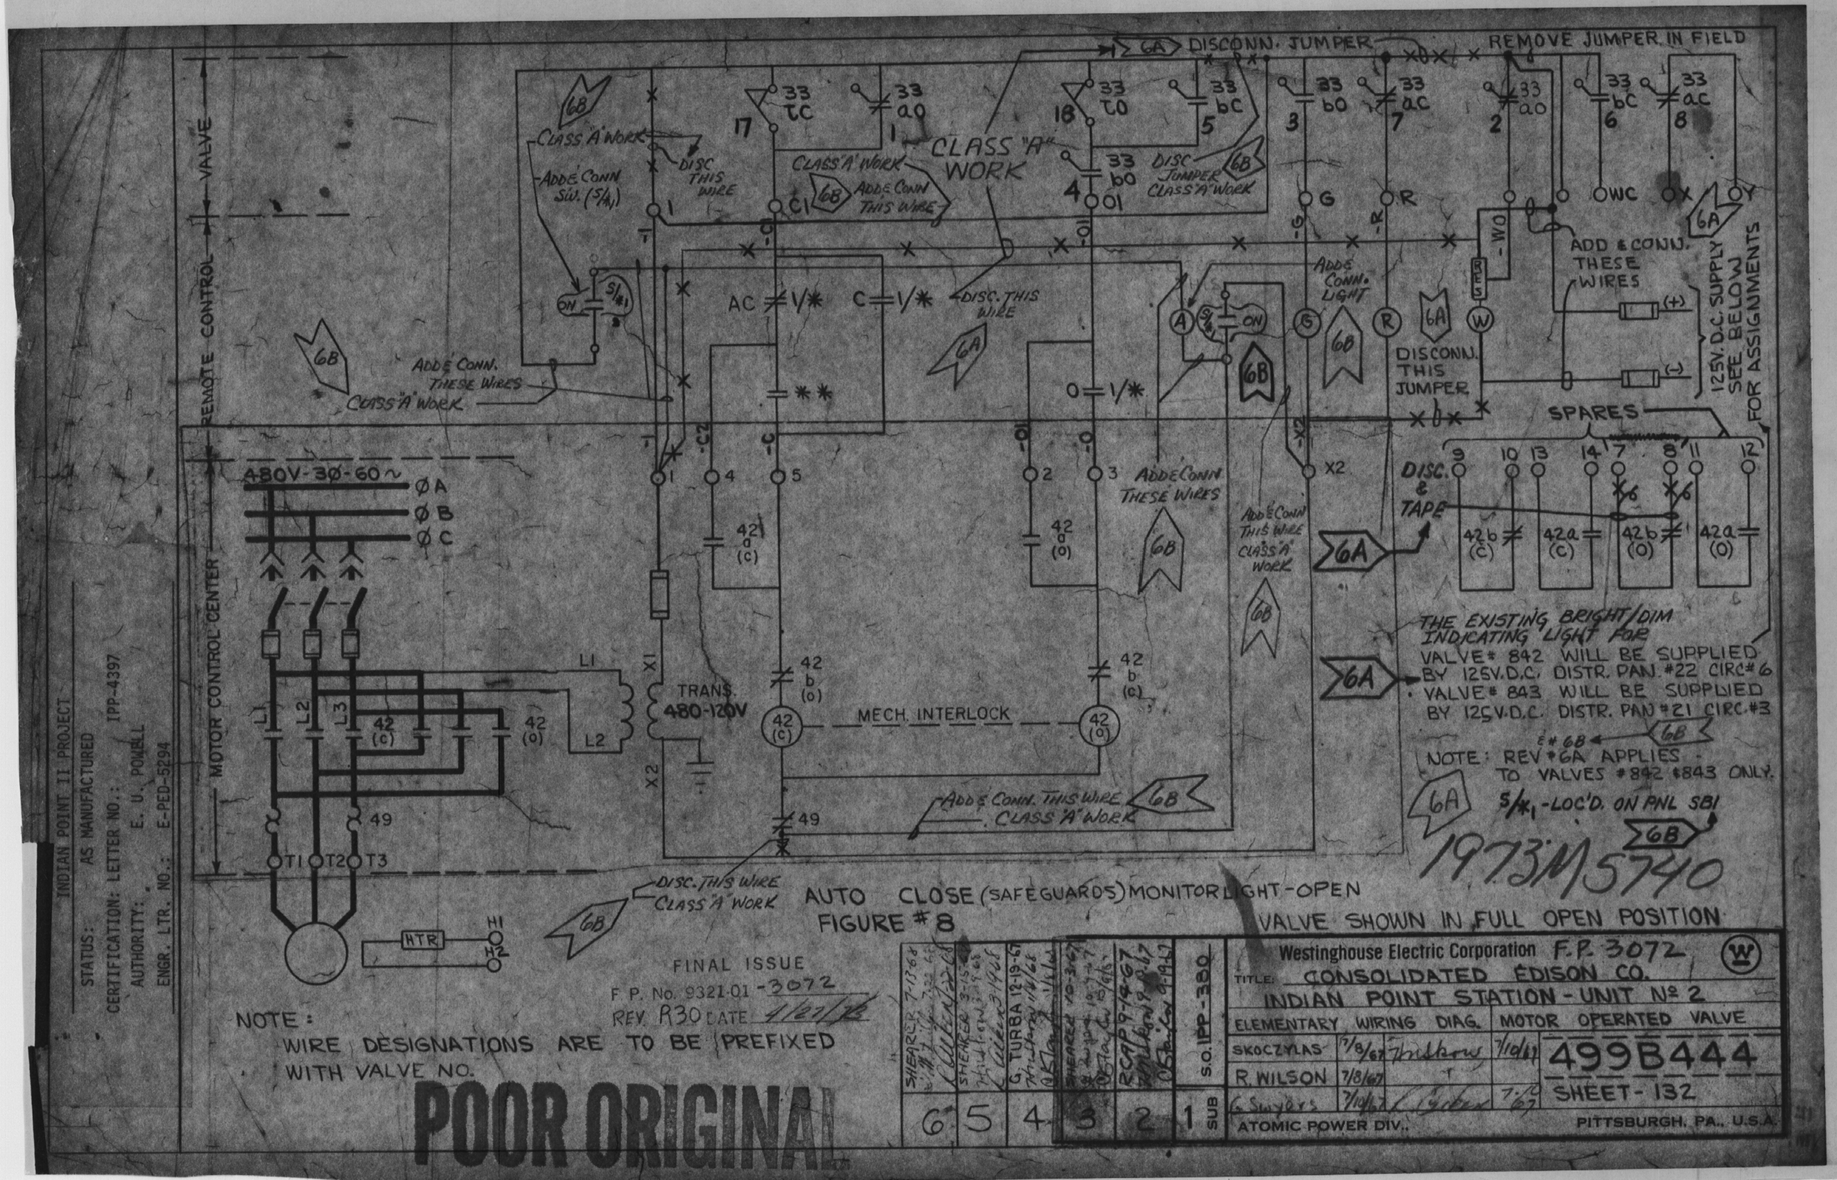

AUTO CLOSE (SAFEGUARDS) MONITOR LIGHT - OPEN
FIGURE # 8

VALVE SHOWN IN FULL OPEN POSITION

INDIAN POINT II PROJECT
STATUS: AS MANUFACTURED
CERTIFICATION: LETTER NO.: IPP-4397
AUTHORITY: E. U. POWELL
ENGR. LTR. NO.: E-PED-5294

FINAL ISSUE
F. P. No. 9321-01-3072
REV. R30 DATE 4/27/73

NOTE:
WIRE DESIGNATIONS ARE TO BE PREFIXED WITH VALVE NO.

POOR ORIGINAL

SUB						
6	SHEARER 7-13-68	SHEARER 3-15-68	G. TURBA 12-19-67	SHEARER 10-3-67	RCAP 9-14-67	S.O. IPP-380
5						
4						
3						
2						
1						

Westinghouse Electric Corporation F.P. 3072
TITLE: CONSOLIDATED EDISON CO.
INDIAN POINT STATION - UNIT № 2

ELEMENTARY WIRING DIAG.			MOTOR OPERATED VALVE
SKOCZYLAS	7/8/67	7/10/67	499B444
R. WILSON	7/8/67		SHEET - 132
G. Swyers	7/10/67	7/10/67	

ATOMIC POWER DIV., PITTSBURGH, PA., U.S.A.

INSERT "A"

FOR OTHER VALVE L.S.'s IN THESE CIRC. LOOPS BELOW SEE SHEET #160

DE-ENERGIZED SI VALVES CORRECT POSITION INDIC. (LOOP #1)
VALVE 842
L.S. OPEN WHEN VALVE POSITION IS OTHER THAN ITS NORMAL OPERATING POSITION.

DE-ENERGIZED SI VALVES CORRECT POSITION INDIC. (LOOP #2)
VALVE 843
L.S. OPEN WHEN VALVE POSITION IS OTHER THAN ITS NORMAL OPERATING POSITION.

THIS DRAWING CONTAINS
"CLASS A" ITEMS
AS DEFINED BY CORPORATE INSTRUCTION
CI - 240 - 1

CON. ED. REVISION
LAKBL 4/9/72 6A
THIS REV. IS CLASS "A" PER CI-240-1. IN CONN WITH MODIF OF ECC SYSTEM VALVE CIRCUITRY (PHASE I), MAKE CHANGES AS SHOWN. RELEASED PER CON. EDISON CO. MODIF. PROC # ESG-76-2-07

THIS REVISION IS NON-CLASS "A" AS PER CI-240-1 IN CONN. WITH MODIF. OF ECC SYSTEM VALVE CIRCUITRY (PHASE I). MAKE CHANGES AS SHOWN.
THIS REV. APPLIES FOR VALVES 842 & 843 ONLY
P/N-6039 RB/BTM

Con Edison clean energy
REVISIONS
6B
THIS REVISION IS CLASS "A" PER CI-240-1 IN CONN. WITH MODIF OF ECC SYSTEM VALVE CIRCUITRY (PHASE 2A) ADD & CONN. CONT. PWR. SW (S/#1) & MAKE CHANGES AS SHOWN. RELEASED PER CON. EDISON CO. MODIF PROC # ESG-76-2-07

THIS REV. IS NON-CLASS "A" PER CI-240-1 IN CONN. WITH MODIF OF ECC SYS. VALVE CIRCUITRY (PHASE 2A) ADD & CONN (AMBER) LIGHT & MAKE CHANGES AS SHOWN.
THIS REV. APPLIES FOR VALVES 842 & 843 ONLY.
P/N-6039 J.H./

NOT FOR FABRICATION OR INSTALLATION

ITERA APERTURE CARD
PRC APERTURE CARD

8111110307