

REGULATORY DOCKET FILE COPY




Consolidated Edison Company of New York, Inc.  
4 Irving Place, New York, NY 10003

February 24, 1978

Re: Indian Point Unit No. 3  
Docket No. 50-286

Mr. Boyce Grier, Director  
Office of Inspection and Enforcement  
Region 1  
U. S. Nuclear Regulatory Commission  
631 Park Avenue  
King of Prussia, Pennsylvania 19406

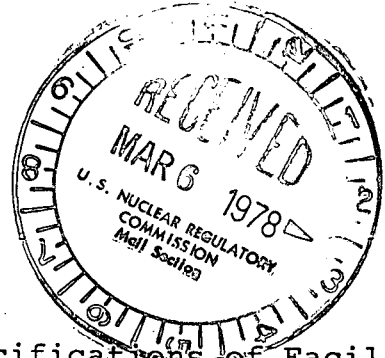

Dear Mr. Grier:

In accordance with the Technical Specifications of Facility Operating License No. DPR-64, the following confirms telephone notification to Mr. Bert Davis of your office on February 23, 1978, of Reportable Occurrence LER-78-004/01T-0. This event is the type defined in Technical Specifications Section 6.9.1.7.1(b).

On February 23, 1978, a review of the calibration methodology for accumulator level instrumentation resulted in a determination that an error had been introduced into the calculations, such that the actual level in the accumulators was approximately 5" higher than indicated, thus exceeding the limit in Technical Specification 3.3.A.3.c for all four accumulators.

Upon determination of this condition, a shutdown was initiated concurrent with adjustment of all four accumulator levels. When the accumulators were returned to within Technical Specification limits, the shutdown activities were terminated.

Consolidated Edison believes that this report also satisfies the requirements of 10CFR Part 21.

Very truly yours,

Eugene R. McGrath  
Manager  
Nuclear Power Generation  
Department  
Indian Point Station  
Buchanan, New York 10511

Copy to: Director of Nuclear Reactor Regulation  
Attn: Mr. William McDonald, Director (2 copies)  
Office of Management Information and  
Program Control  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

A002  
S  
110

8111070190 780224  
PDR ADOCK 05000286  
S PDR

780660018