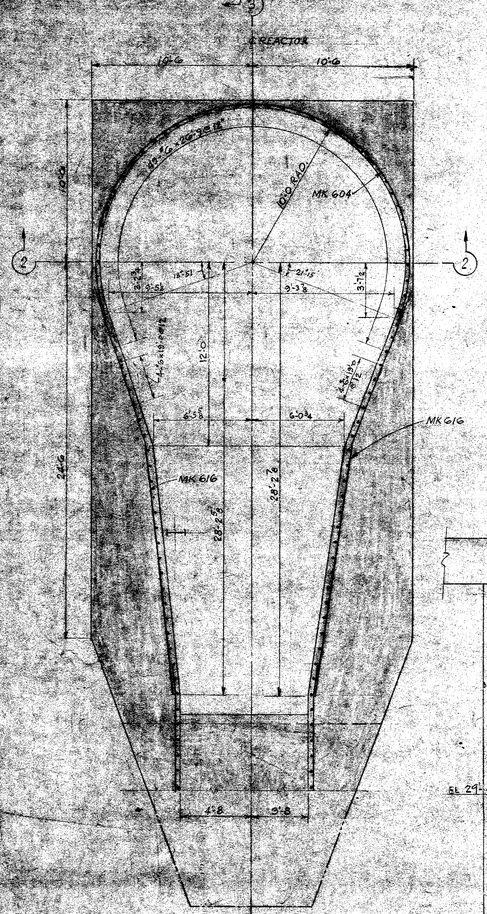

SECTION 1-1
SCALE 1/4"=1'-0

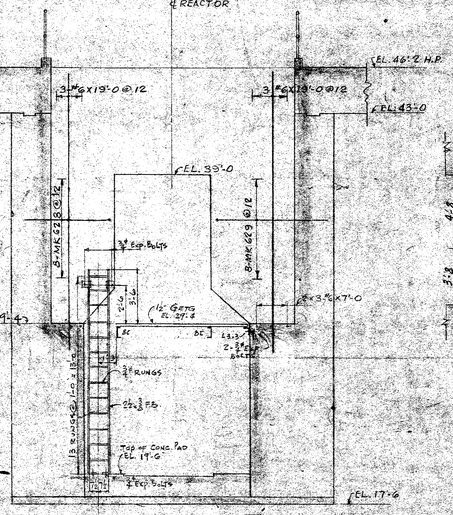

SECTION 8-8
SCALE 1/4"=1'-0

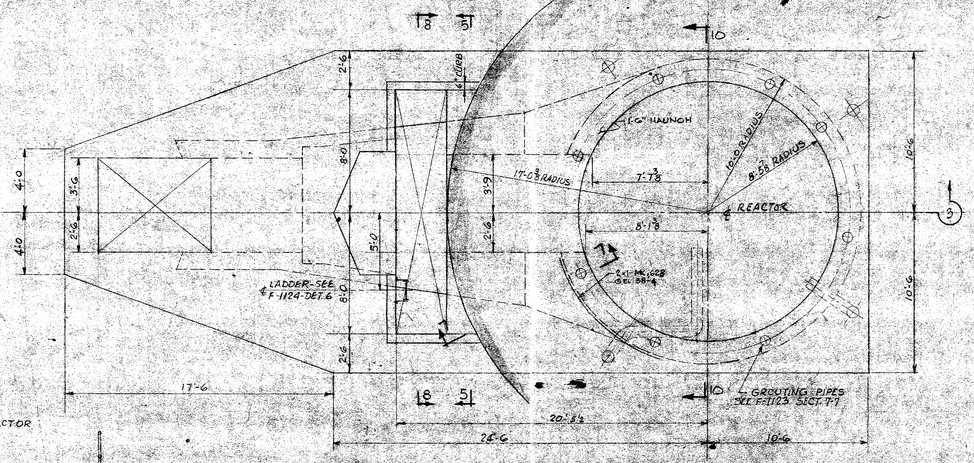

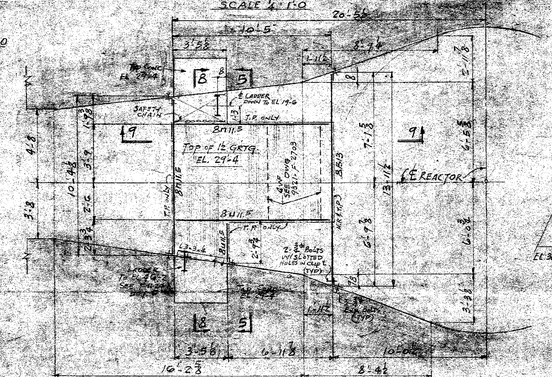

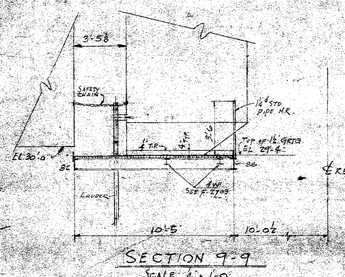

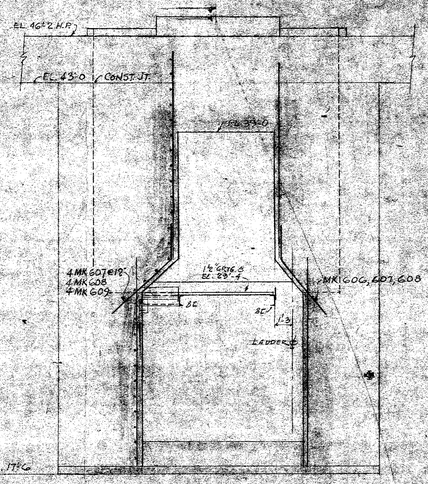

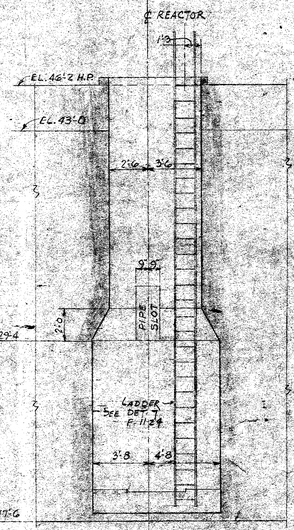

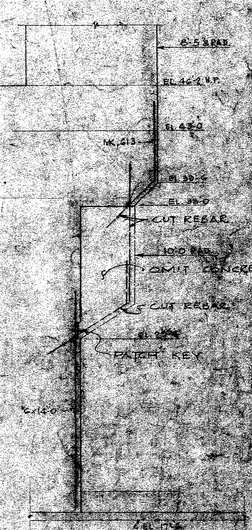

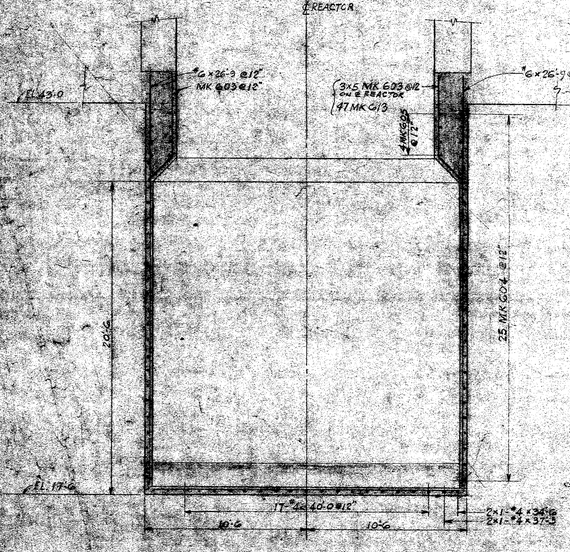

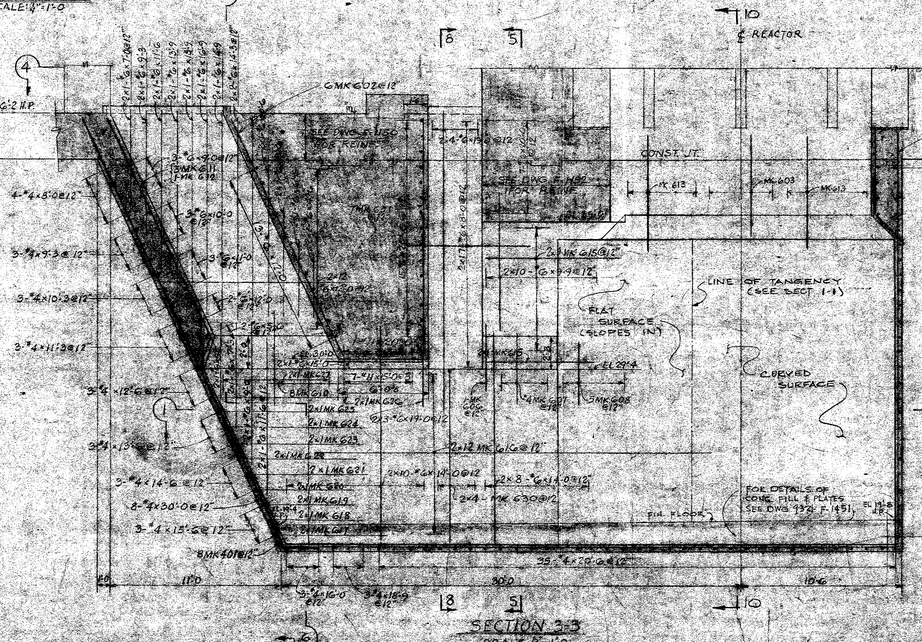

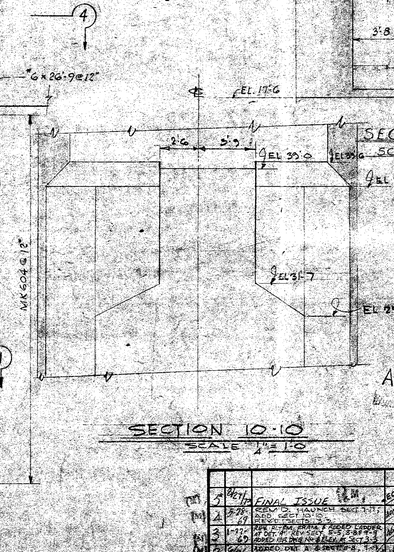

NOTES:
1. CONCRETE FOR REACTOR PIT UP TO EL. 43'-0 SHALL ENVISION A COMPRESSIVE STRENGTH OF NOT LESS THAN 4000 P.S.I. IN 28 DAYS.
2. FOR REFERENCE DRAWINGS SEE F-1126.

P.R.C. APERTURE CARD
POOR ORIGINAL
TERA APERTURE CARD

NO.	DATE	DESCRIPTION	ENGR.	SUP. ENGR.	QA
5	8/27/71	FINAL ISSUE			
4	5/24/71	ADD. REINFORCEMENT SECT. 1-1, SEC. SECT. 1-1			
3	1/22/71	REV. TO PIT WALL & SLAB, ADD. REINF. SECT. 1-1			
2	11/6/70	ISSUED FOR CONSTRUCTION			
1	9/24/70	ADD'L SECT. 1-1, 3-3 & 4-4 AND LOAD SEQ. 2-7			
0	7/24/70	FIRST ISSUED FOR CONSTRUCTION			

ENGINEER R.D. Parkhill
STATE REG. NO. 42413
UNITED ENGINEERS & CONSTRUCTORS INC.

WESTINGHOUSE ELECTRIC CORPORATION

CONTAINMENT
REACTOR PIT
CONCRETE & REINFORCING DETAILS
FOR
CONSOLIDATED EDISON COMPANY
INDIAN POINT GENERATING STATION
UNIT NO. 2

U.E.&C. DRG. NO. 9321-F-1115

8110220630