


Received w/Ltr Dated 6-28-73

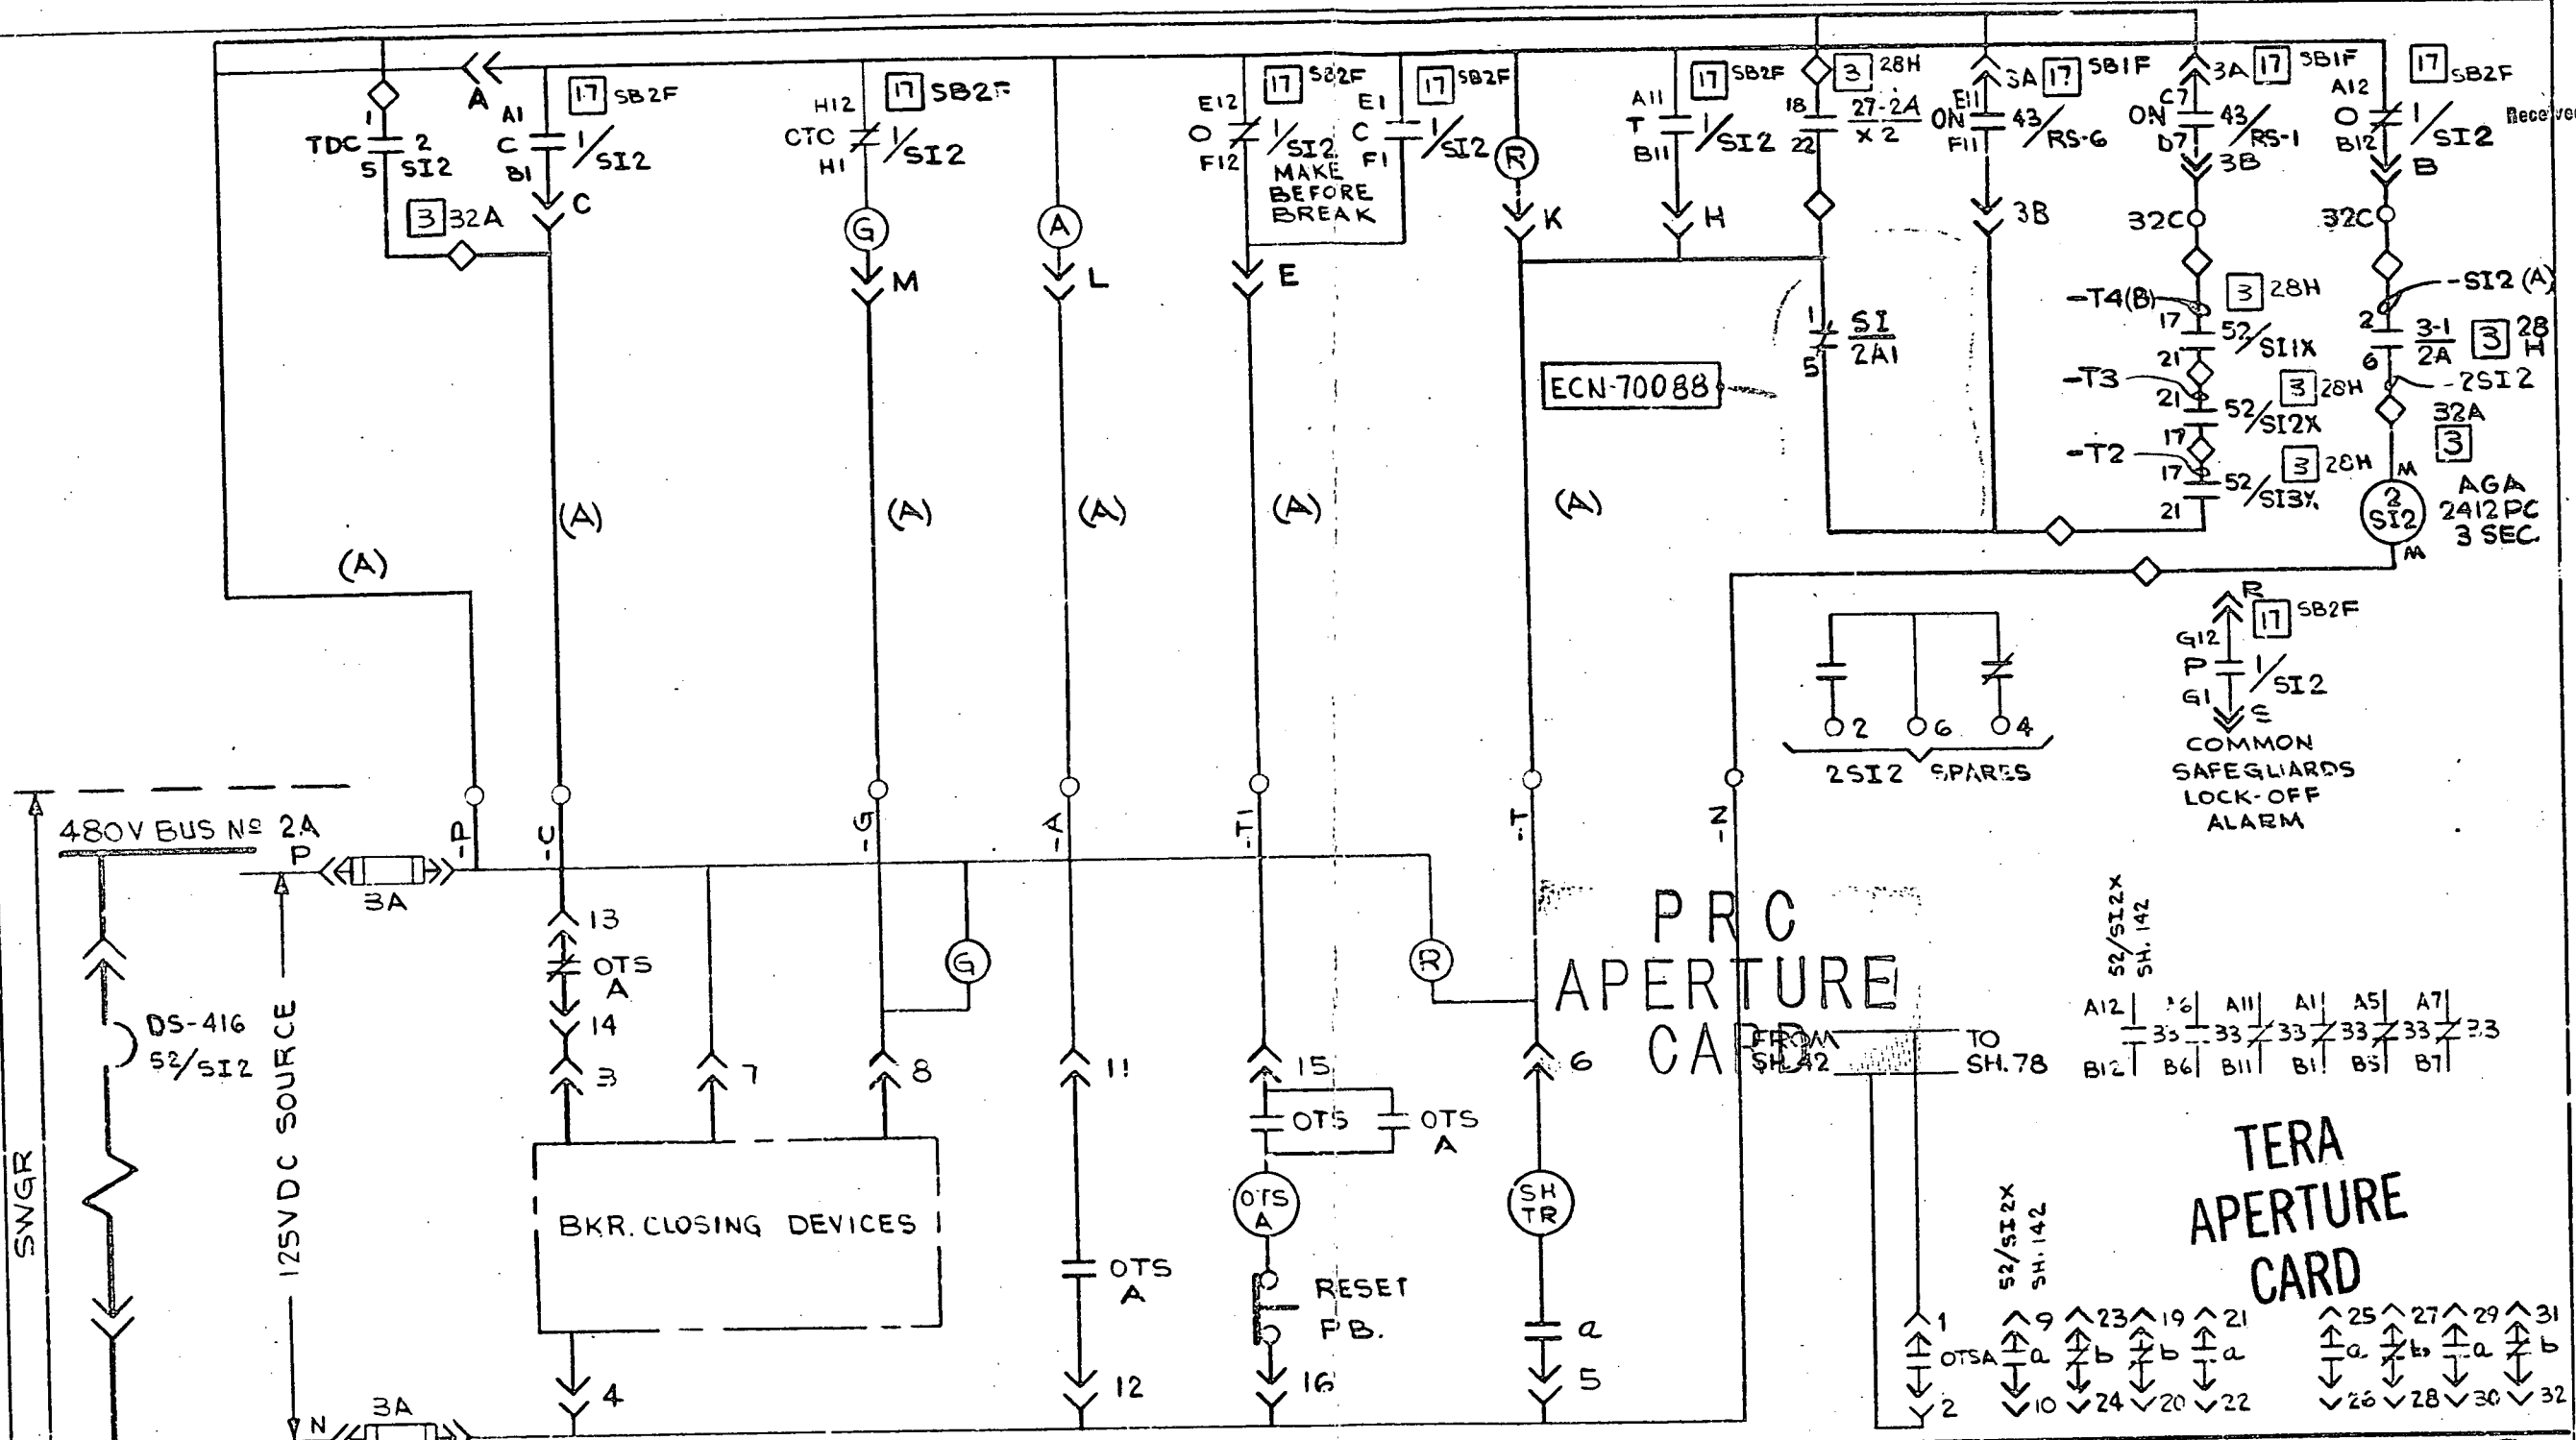

- 400 SI2-UNIT 32C
- NOTES:
1. WIRE DESIG. PREFIXED WITH 32C
 2. 1/SI2 - SW. DEV. SH. 9
 3. 43/RS-1, 43RS-6 SW. DEV. SH. 14
 4. \diamond SHOP WIRED
 5. LETTER (A) ETC. REFERS TO CABLE SCHEMATIC 9321-LL-31173, SH. 27A.

7	6	5	4	3	2
ECN-9750 W.C.D. 5-3-73 W.C.D. 5-3-73 W.C.D. 5-3-73	ECN-9678 W.C.D. 3-6-73 W.C.D. 3-6-73 W.C.D. 3-6-73	ECN-8050 J.G. 9-19-71 J.G. 9-19-71 J.G. 9-19-71	ECN-7151 L.G. 3-31-71 L.G. 3-31-71 L.G. 3-31-71	ECN-6867 W. MEARS 12/18/70 W. MEARS 12/18/70 W. MEARS 12/18/70	ECN-6851 W. MEARS 12-9-70 W. MEARS 12-9-70 W. MEARS 12-9-70

Westinghouse Electric Corporation			
TITLE: CONSOLIDATED EDISON CO.			
INDIAN POINT STATION-UNIT NO. 3			
ELEMENTARY WIRING DIAG.		SAFETY INJECTION PUMP 32	
WM. SOLES	9/28/70	16-27-70	500B971
			SHEET- 29
NUCLEAR ENERGY SYSTEMS		PITTSBURGH, PA., U.S.A.	

8110230059