


Received w/ Noted 6.28.73

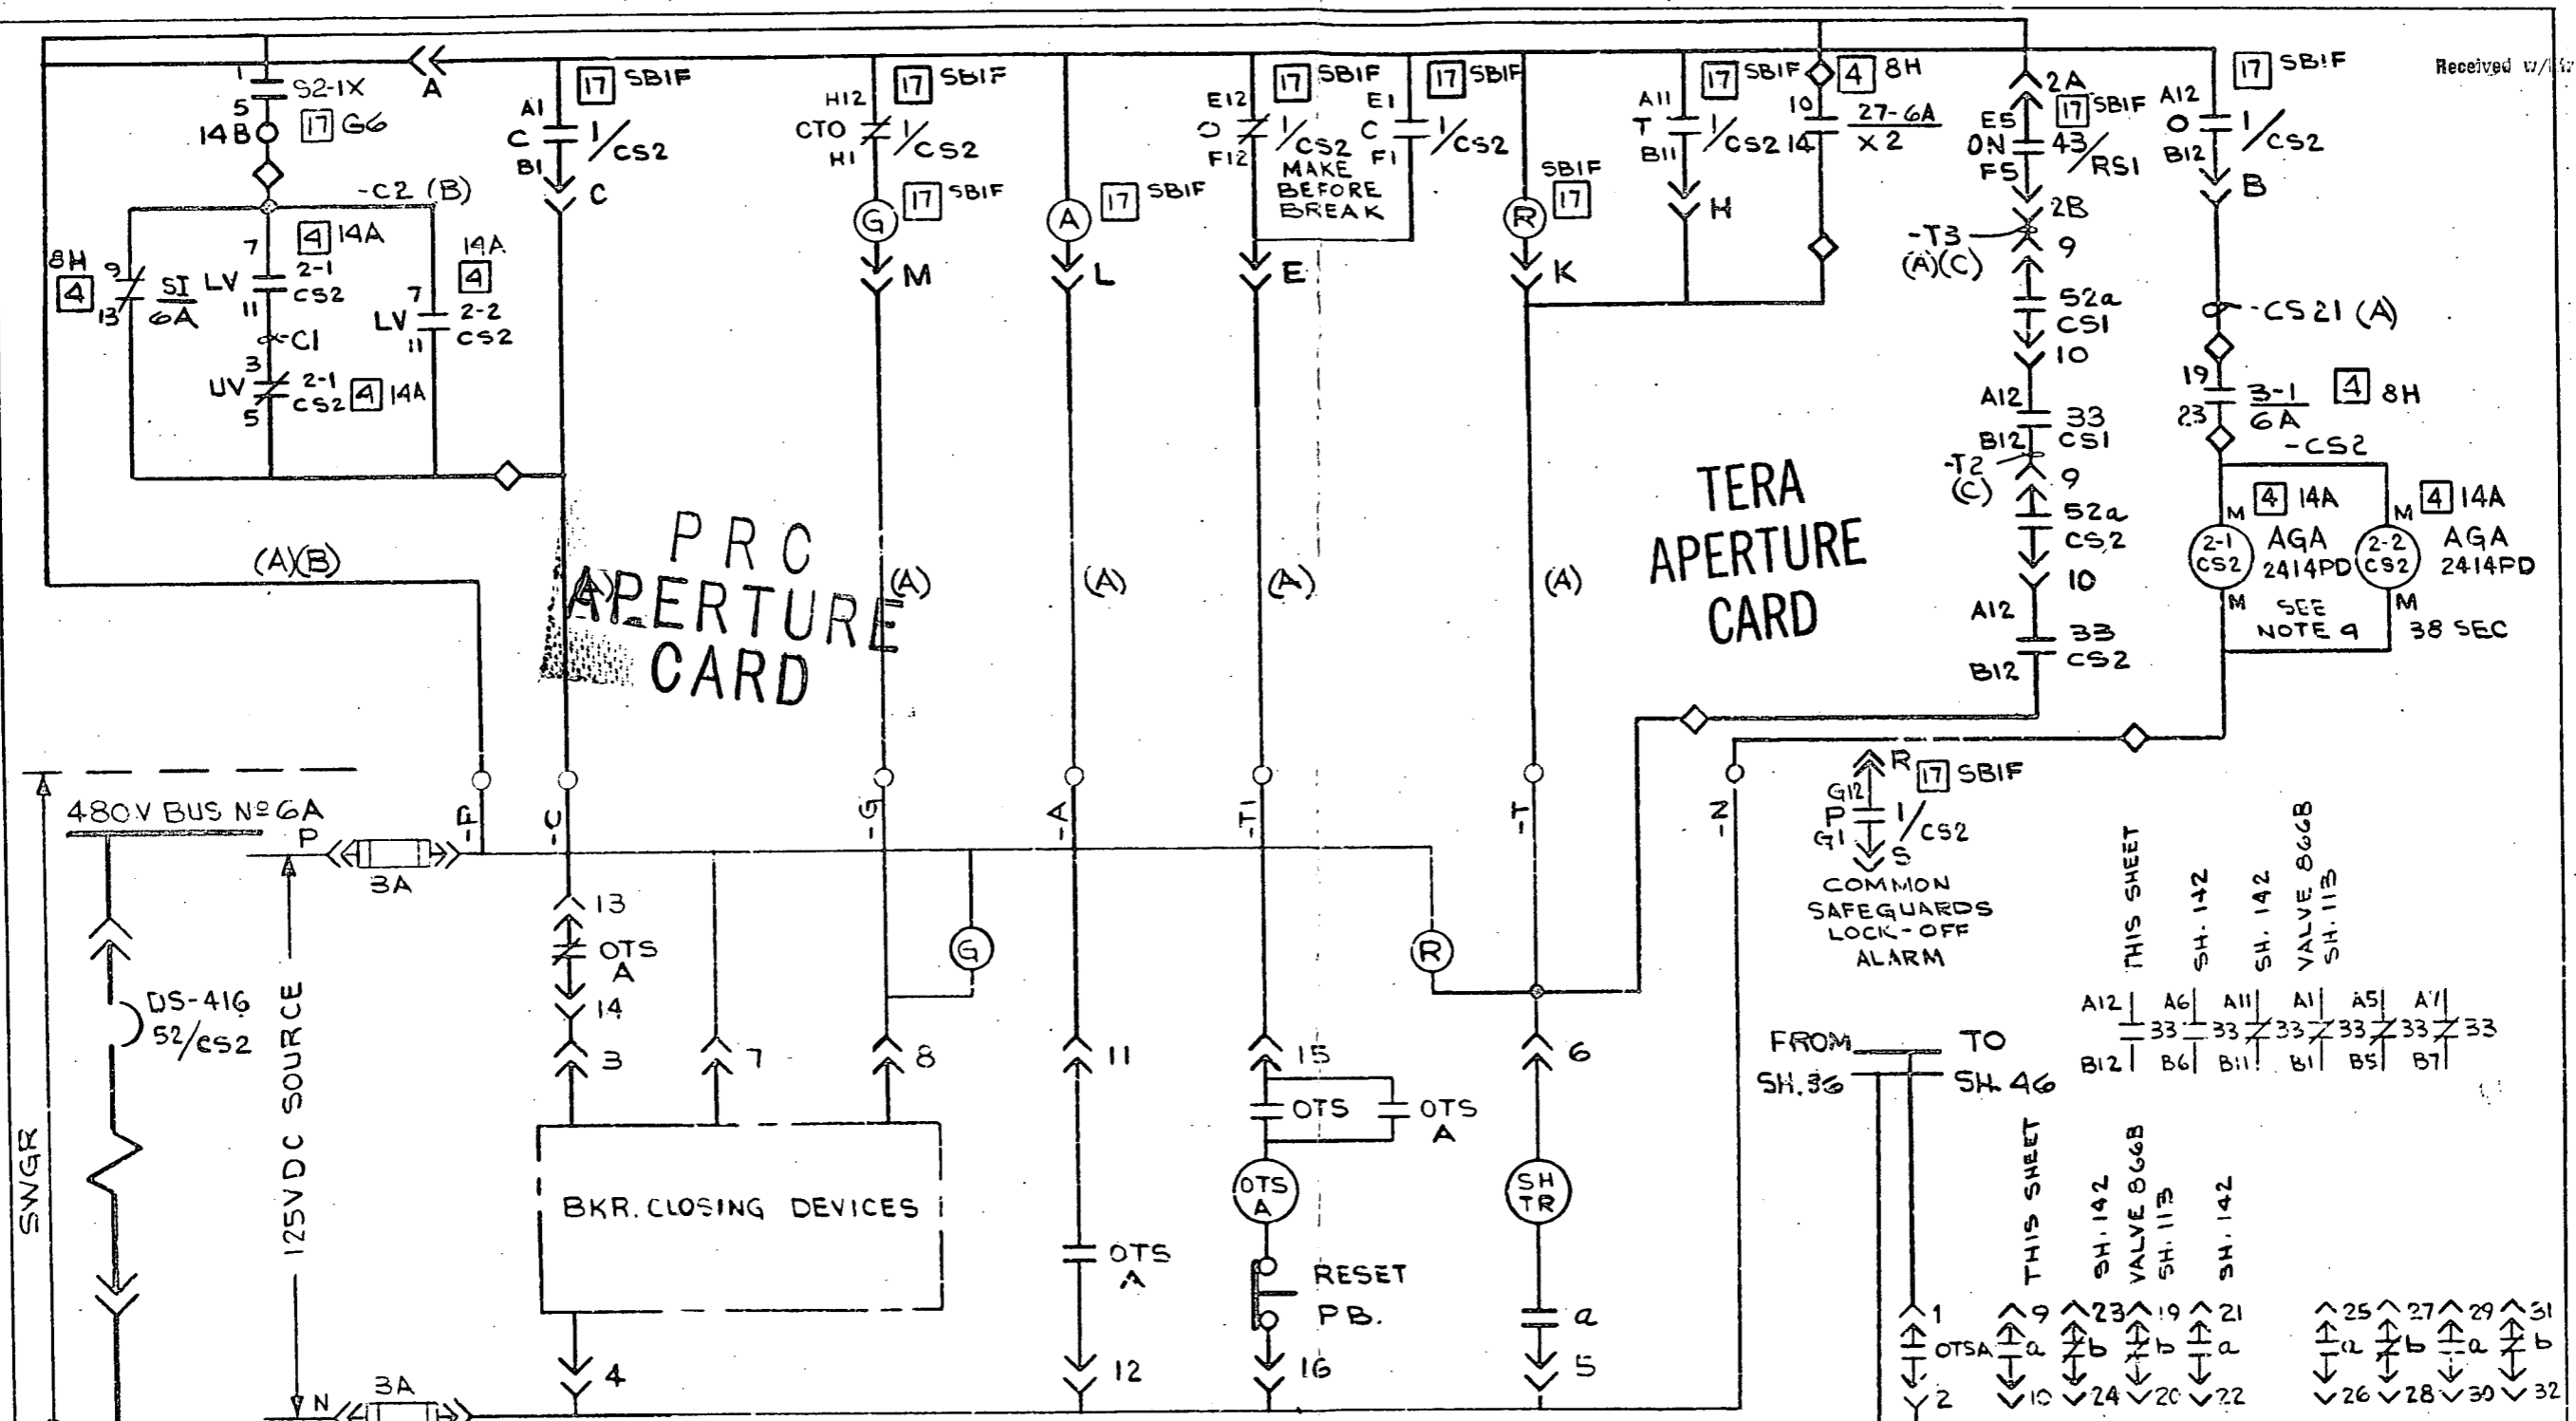

400 CS2-UNIT 14B

NOTES:

1. WIRE DESIG. PREFIXED WITH 14B
2. 42/RS-1 SW. DEV. SH. 14
3. 1/CS2 SW. DEV. SH. 9
4. 2-1/CS2 IS A TWO STEP TIMING DEVICE PRE-SET AT FACTORY. LOWER VALUE (LV=13 SEC) IS SET AT 84% OF UPPER VALVE (UV=16 SEC.)
5. S2-1X SEE W 113E503, SH. 6

6. \diamond SHOP WIRED
 7. LETTER (A) ETC. REFERS TO CABLE SCHEMATIC DWG. 9321-LL-31183 SH. 38.

ECN-9678	W.C.D. 3-6-73	W.C.D. 3-14-73	W.C.D. 3-16-73
ECN-8051	J.G. 9-15-71	J.G. 9-21-71	J.G. 9-23-71
6	5	1	SUB

Westinghouse Electric Corporation		
TITLE: CONSOLIDATED EDISON CO. INDIAN POINT STATION-UNIT NO. 3		
ELEMENTARY WIRING DIAG.	CONTAINMENT SPRAY PUMP 32	
WM SOLES 9/30/70	10-22-70	500B971
		SHEET-40
NUCLEAR ENERGY SYSTEMS		PITTSBURGH, PA., U.S.A.

8110230073