


Received w/Ltr Dated 6-28-73

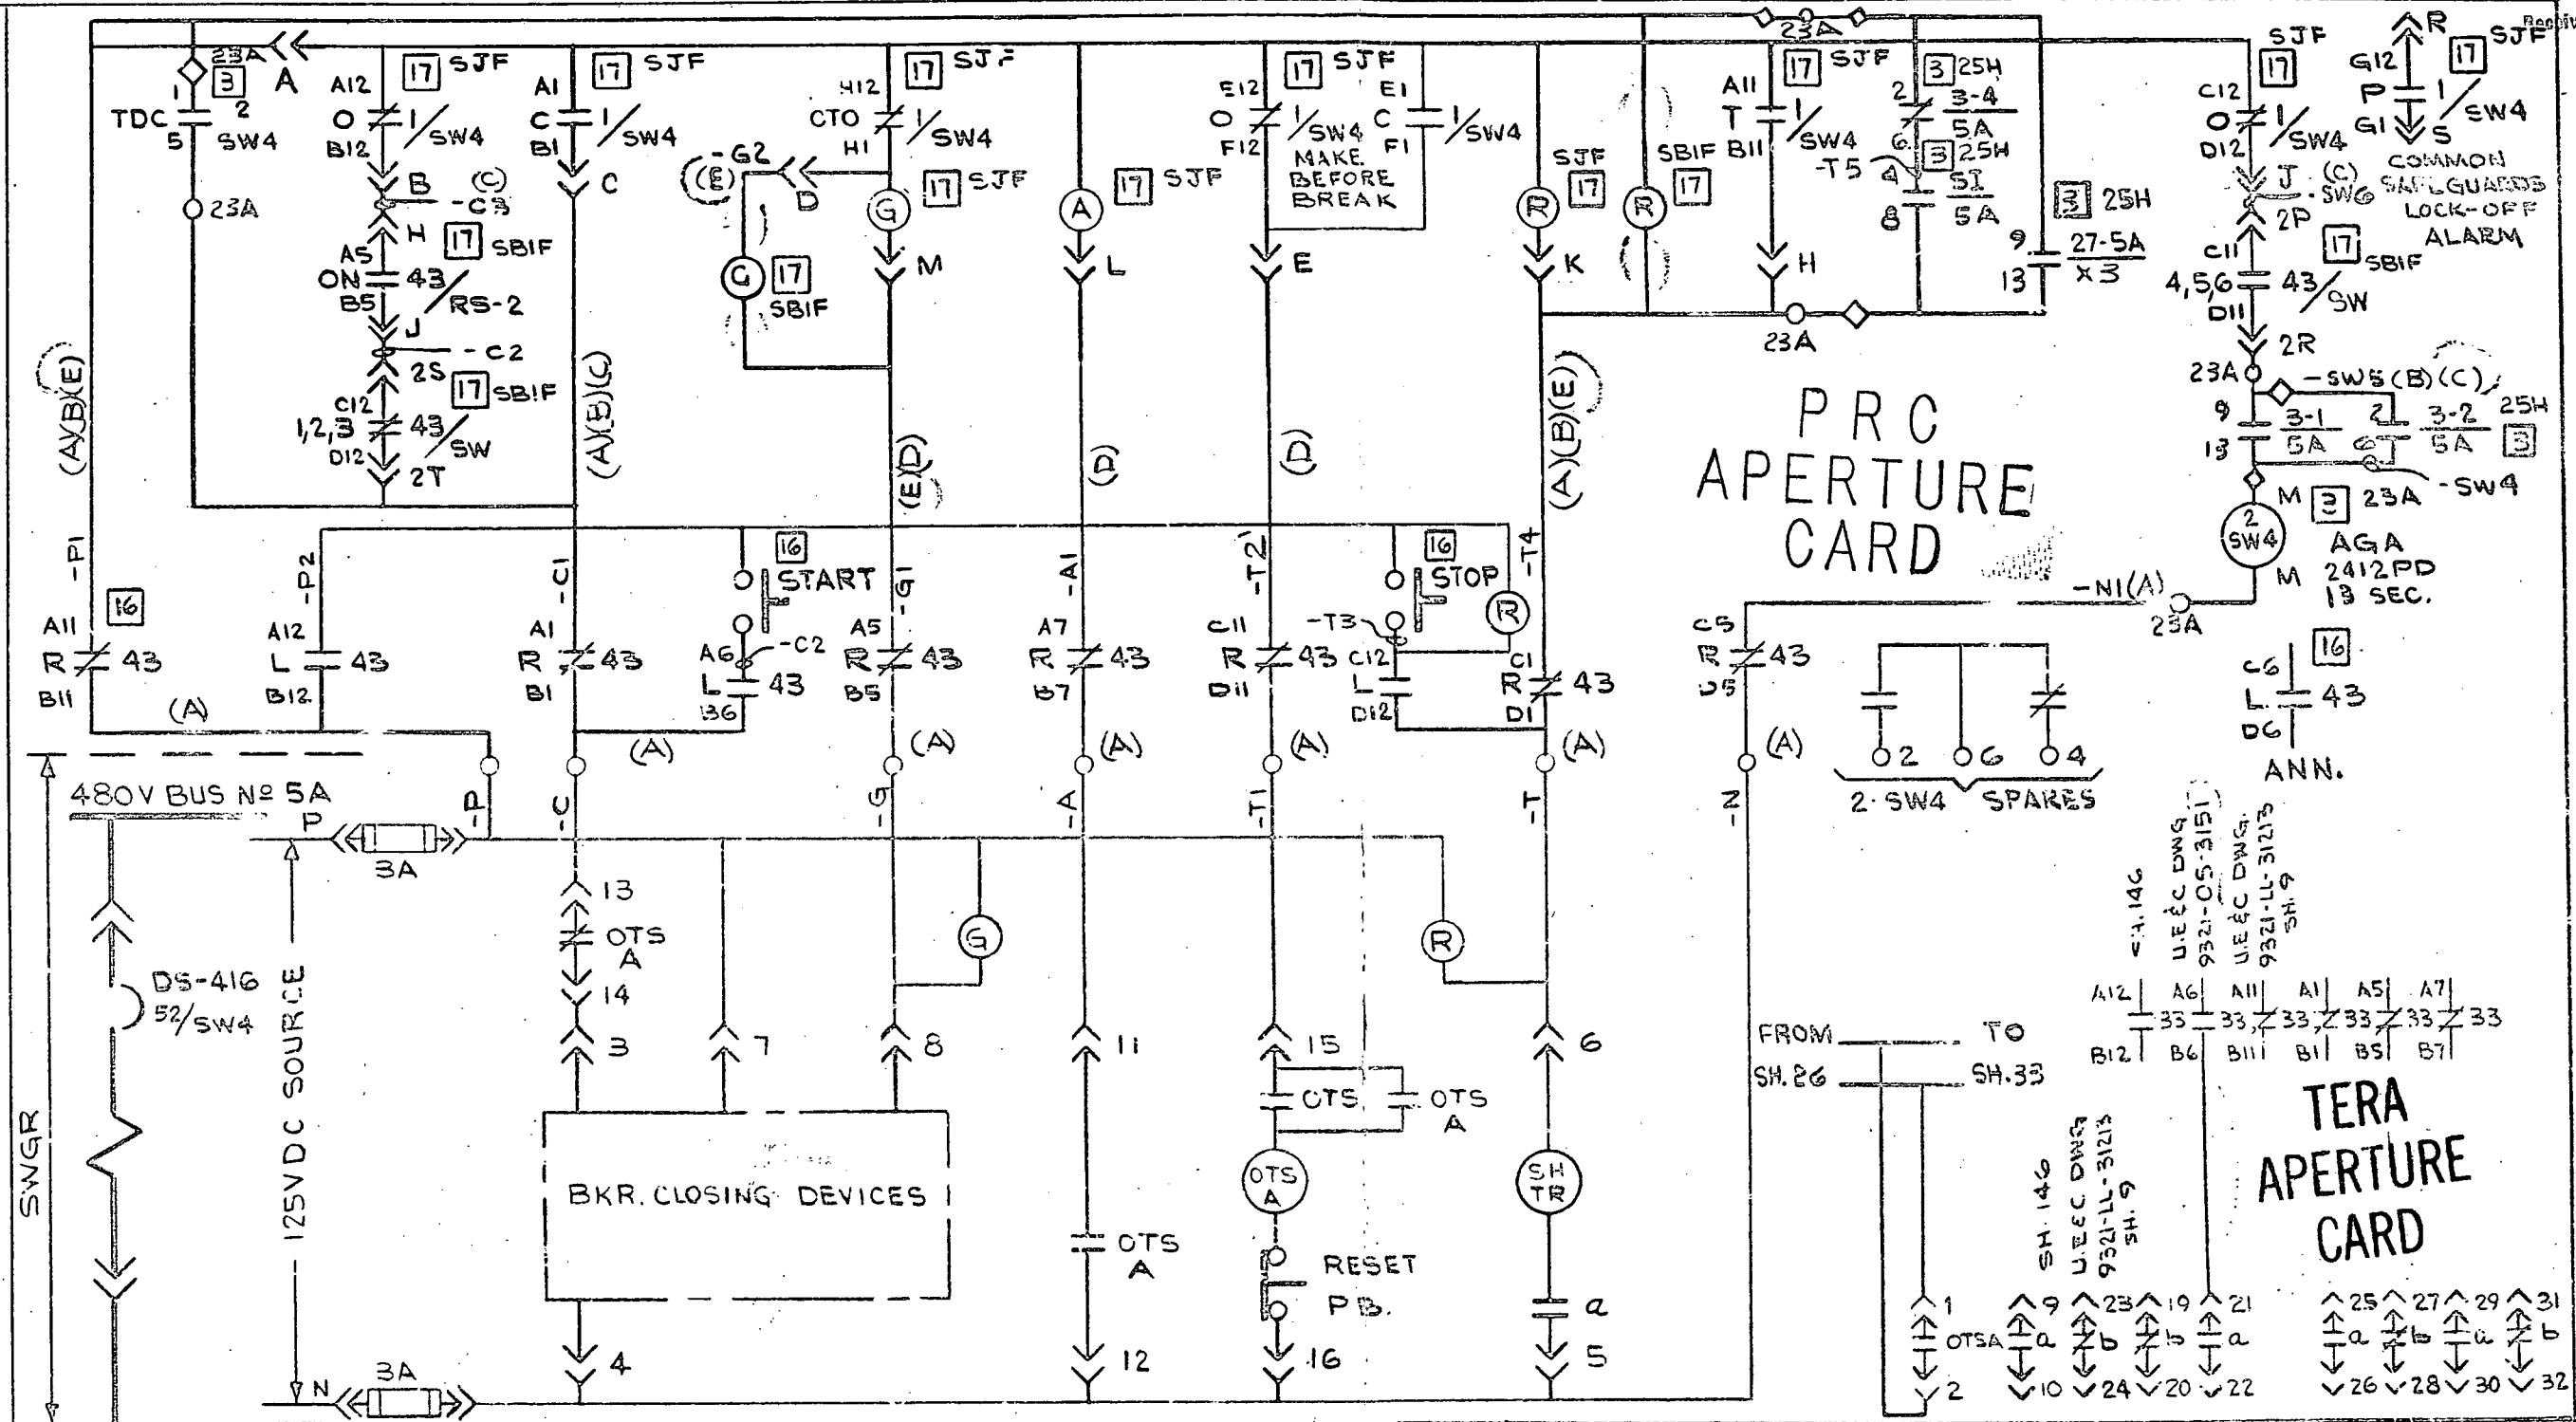

PRC APERTURE CARD

TERA APERTURE CARD

350 SW4 - UNIT 23C

- NOTES:
1. WIRE DESIG. PREFIXED WITH 23C
  2. 1/SW4 SW. DEV. SH. 9
  3. 43/SW 43/RS-2 SW. DEV. SH. 14
  4. 43 SW. DEV. SH. 13
  5. ◊ SHOP WIRED
- 6 LETTER (A) ETC. REFERS TO CABLE SCHEMATIC DWG 9321-LL-31173, SH 49A

6	5	4	3	2	SUB
ECN-9678 W.C.D. 3-7-73 W. MEARS 3-14-73 W. MEARS 3-14-73	ECN-8051 W.C.D. 9-5-71 W. MEARS 9-23-71 W. MEARS 9-23-71	ECN-7161 W.C.D. 5-8-71 W. MEARS 3-31-71 W. MEARS 4-2-71	ECN-6887 W. MEARS 12/21/70 W. MEARS 1/4/71 W. MEARS 1/5/71	ECN-6810 W.C.D. 12-8-70 W. MEARS 12-8-70 W. MEARS 12-5-70	S.O. INT.-385

Westinghouse Electric Corporation		(W)	
TITLE: CONSOLIDATED EDISON CO.			
INDIAN POINT STATION - UNIT NO. 3			
ELEMENTARY WIRING DIAG.		SERVICE WATER PUMP 34	
WM. SOLES	10/3/70	10-27-70	500B971
SHEET-76			10-30-70
NUCLEAR ENERGY SYSTEMS		PITTSBURGH, PA., U.S.A.	

8110230095