



VALVES 876A & 876B


MAN. CONTROL AUTO OR CANCEL OVERRIDE  
DE-ENERGIZE SOLENOID  
FIG. # 26

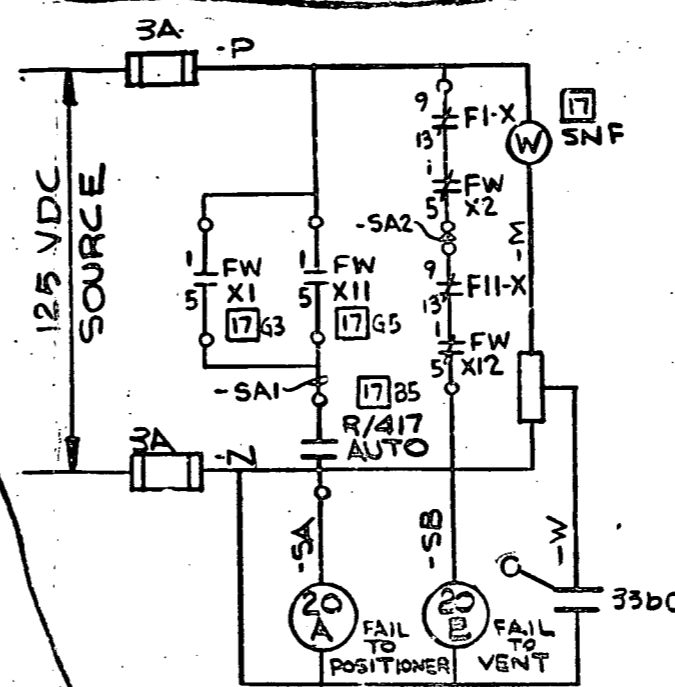


ENERGIZE TO CLOSE MAIN VALVE  
DE-ENERGIZE TO CLOSE MAIN VALVE  
FIG. # 27  
FCV-417

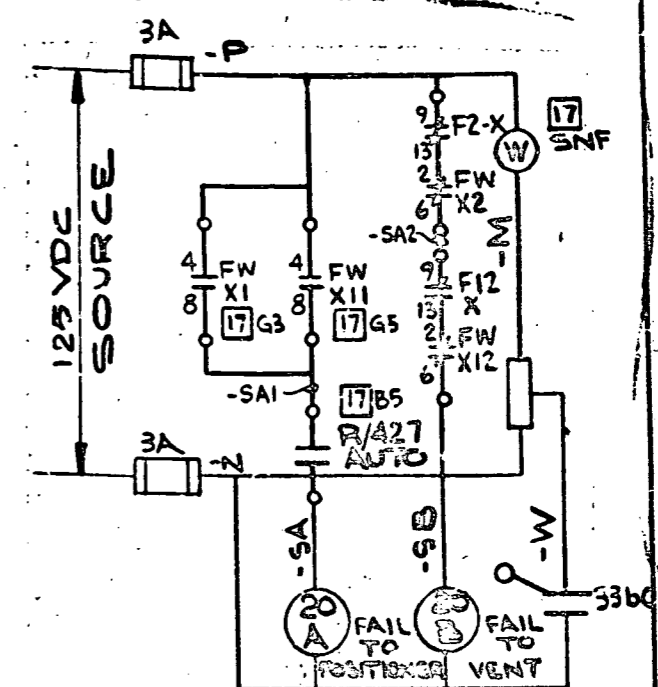

ENERGIZE TO CLOSE MAIN VALVE  
DE-ENERGIZE TO CLOSE MAIN VALVE  
FIG. # 28  
FCV-427

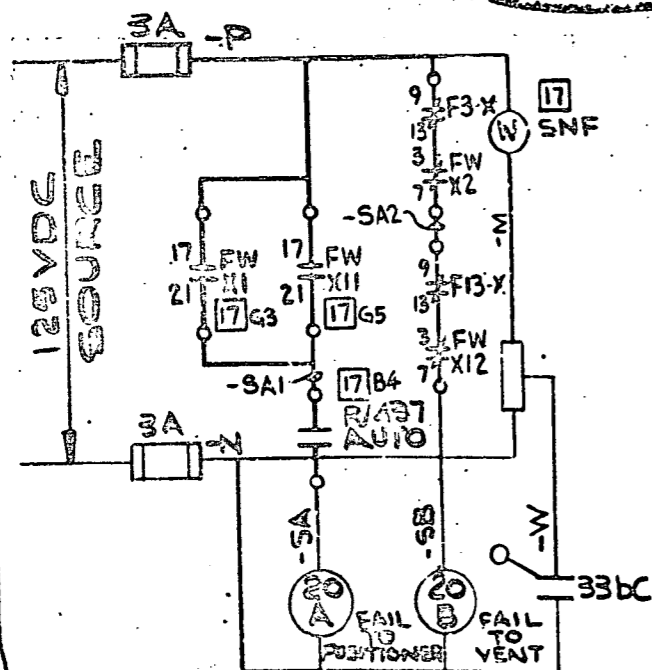

ENERGIZE TO CLOSE MAIN VALVE  
DE-ENERGIZE TO CLOSE MAIN VALVE  
FIG. # 29  
FCV-437

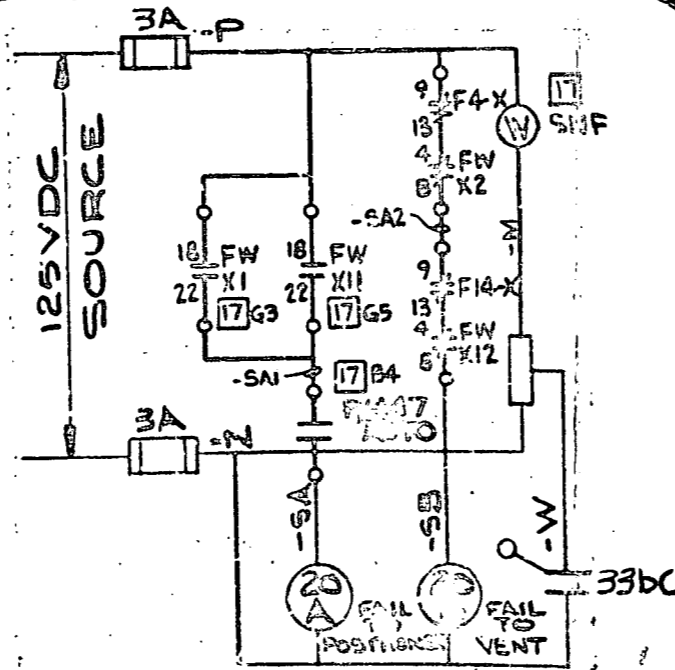

ENERGIZE TO CLOSE MAIN VALVE  
DE-ENERGIZE TO CLOSE MAIN VALVE  
FIG. # 30  
FCV-447

ECN-70065

TERA APERTURE CARD  
PRC APERTURE CARD

ECN-9616 W.C.D. 12-21-72 12/29/72		ECN-6811 10-23-78 10-30-78		S.O. INT 385		Westinghouse Electric Corporation CONSOLIDATED EDISON CO	
5		4		1		INDIAN POINT STATION - UNIT NO. 3	
R.W. KEMERER		12/11/69		7/1/69		ELEMENTARY WIRING DIAG. REMOTE OPERATED VALVES	
						500B971	
						SHEET-119	
ATOMIC POWER DIV.,				PITTSBURGH, PA., U.S.A.			

Received W/Ltr Filed 6-28-73  
File Cy. Registry

8110230118