


Ltr Dated 6-28-73

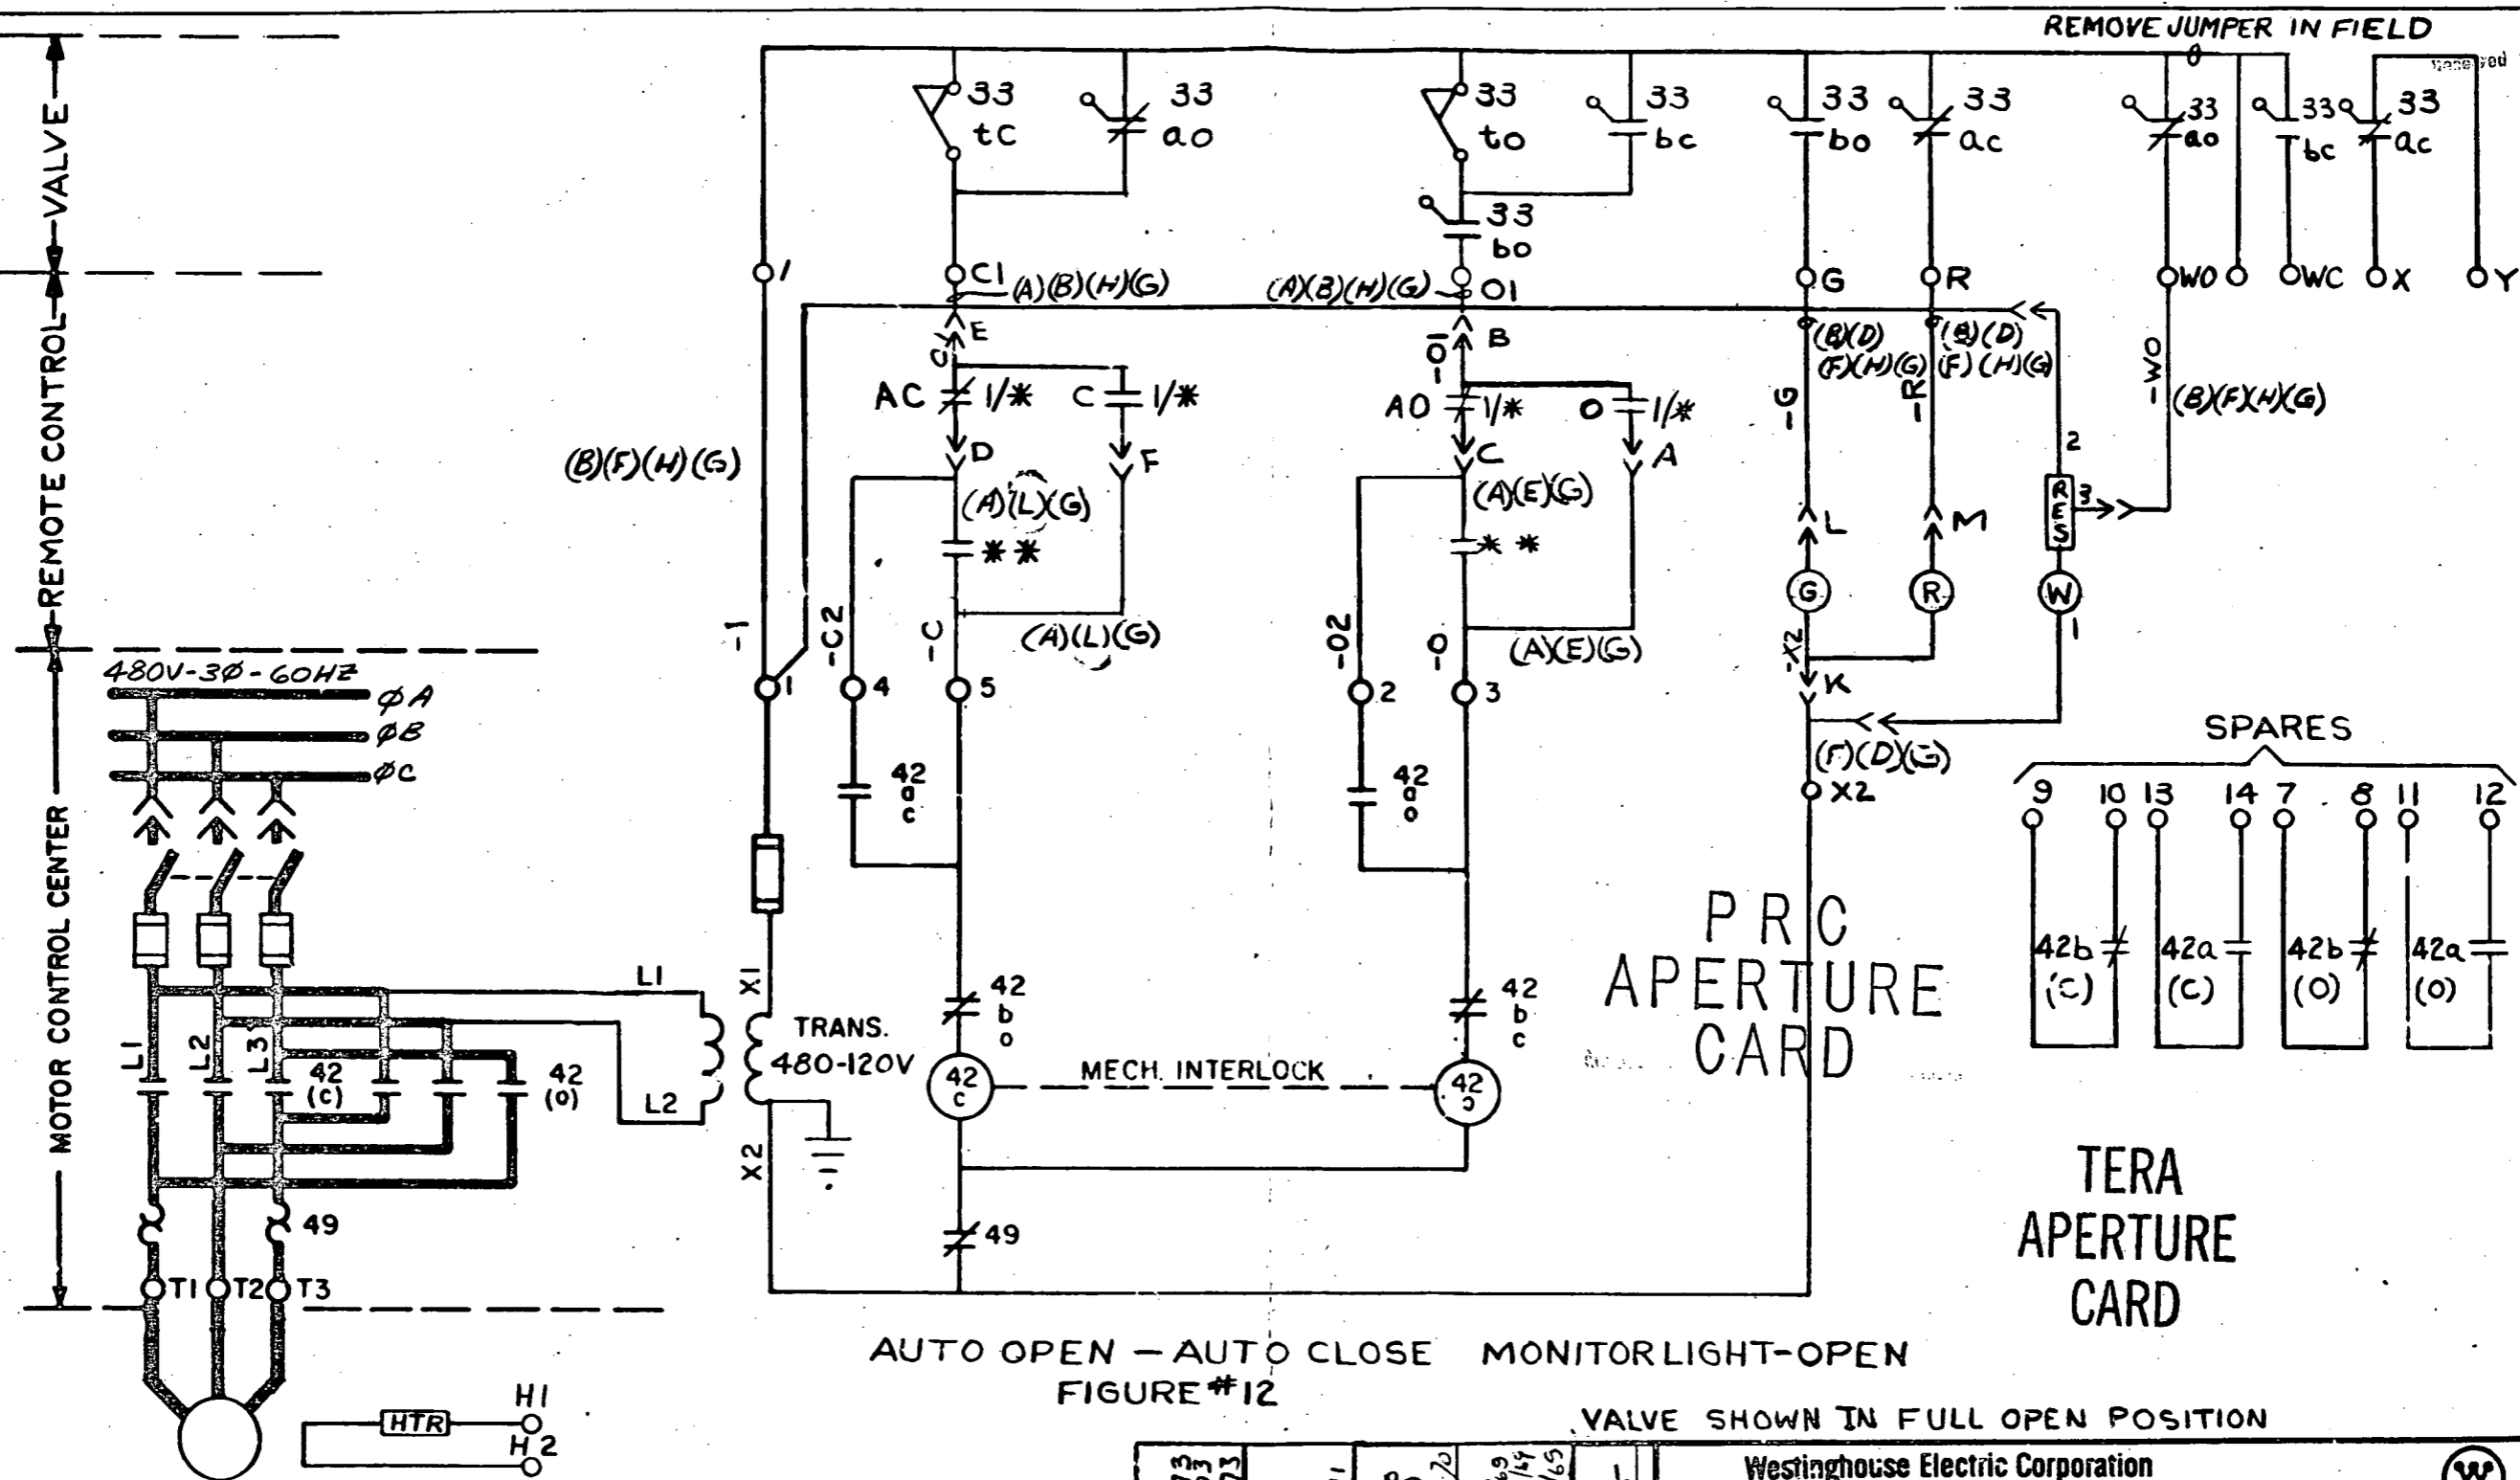

AUTO OPEN - AUTO CLOSE MONITOR LIGHT-OPEN
FIGURE #12

VALVE SHOWN IN FULL OPEN POSITION

NOTE:
1. WIRE DESIGNATIONS ARE TO BE PREFIXED WITH VALVE NO.
2. LETTER (A) ETC. REFERS TO CABLE SCHEMATIC.

| | | | | | | | | | | | |
|--|---|---|---|--|-----|--|---------------------|--------------|---------|--|--|
| ECN-9678 WCD 2-7-73 3-14-73 3-16-73 | | ECN-7161 3-9-71 3-31-71 4-2-71 | | ECN-6811 4-9-70 10-13-70 10-27-70 | | ECN 5522 RWKEMER 12/19/69 12/19/69 12/15/69 | | S.O. INT-385 | | Westinghouse Electric Corporation TITLE: CONSOLIDATED EDISON CO. INDIAN POINT STATION - UNIT N#3 ELEMENTARY WIRING DIAG. MOTOR OPERATED VALVE | |
| 5 | 4 | 3 | 2 | 1 | SUB | | M. HABERCHAR 8-8-69 | | 500B971 | | |
| | | | | | | | | 8/11/69 | | SHEET- 136 | |
| ATOMIC POWER DIV., | | | | | | | | | | PITTSBURGH, PA., U.S.A. | |

8110230165