


TYP. FOR VALVE LIMIT SW.

CONTACT	FULLY OPEN	FULLY CLOSED	
71			bo
71			bc
71			ac
71			no
71			bo
71			bc
71			ic
71			bc
71			ac
71			ao
71			bo

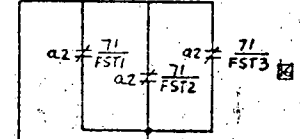


(ALP) (ALH) DIESEL GENERATOR OIL STORAGE TANK LOW LEVEL (SEE 9321-LL-31343 SH. 7)

NOTES:

- #1 - CONTACT CI USED IN DAY TANK LOW LEVEL ALARM. SEE U.E. AC. FP. 9321-05-3445 (DIESEL GEN. CTL. PNL.)
- #2 - FOR LIGHTING PANEL-323 SEE 9321-F-30263
- #3 - FOR DEVICE 52b, 52H/EG1 (9321-LL-31173 SH. 14), 52b, 52H/EG2 (9321-LL-31183 SH. 17) - 52b, 52H/EG3 (9321-LL-31173 SH. 8)
- #4 - DAY TANK INDICATION & GEN. HEATER PANEL SEE T-9321-05-LL-137
- #5 - EQUIP. ON CTL. PANEL UNLESS OTHERWISE NOTED.
- #6 - LETTER (A) REFERS TO CABLE SCHEMATIC ON SH. 7A.

DEVICE	INSTR. N°	CONTACT	FUNCTIONS
71/DT1	LC-12075	a1 (SPDT)	TRANSFERS ON DAY TANK HIGH LEVEL (90% VOL) SH. 15
71/DT2	LC-12085	b1, b2 (DPDT)	" " " " LOW LEVEL (65% VOL) SH. 15
71/DT3	LC-12095	c1 (SPDT)	" " " " LO-LO LEVEL (30% VOL) SH. 15
71/FST1	LC-12045	a1, a2 (DPDT)	" " STGE " LOW LEVEL SH. 15
71/FST2	LC-12055	b1, b2 (DPDT)	" " " " " LOW LEVEL SH. 15
71/FST3	LC-12065	c1 (SPST)	" " " " " LO-LO LEVEL SH. 15

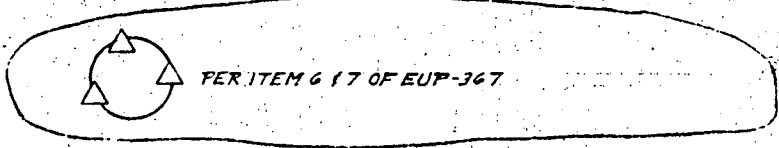

GENERATOR HEATER & FUEL OIL DAY TANK SUPPLY VALVES & INDICATING LIGHTS

4	2/26	REVISED PER ITEM 617 OF EUP-367				
3	6/13/71	REV. CABLE DESIGNATIONS				
2	1/13/71	ADDED CABLE LETTER REFERENCE & A.A. AND PEEBLY WIRE N°				
1	1/13/71	REVISED GEN. HTR CONTACTS & NOTES				
0	1/13/71	FIRST ISSUE FOR CONSTRUCTION				
DATE		DESCRIPTION	ENGR	SUP ENGR	W	
ENGINEER		<i>William P. ...</i>				
STATE REG. NEW YORK		NO. 42453				
UNITED ENGINEERS & CONSTRUCTORS INC.						
WESTINGHOUSE ELECTRIC CORPORATION			FOR CONSOLIDATED EDISON COMPANY			
			INDIAN POINT GENERATING STATION - UNIT NO. 3			
SCHEMATIC DIAGRAM						
DIESEL GENERATOR AUXILIARIES						
						SHEET NO. 6
U.E. AC. DWG. NO.			CON. ED. CO. DWG. NO.			
9321-LL-31333			D202471			

6246

8111030050

