



VALVES 876A & 876B


MAN CONTROL AUTO OR CANCEL OVERRIDE
DE-ENERGIZE SOLENOID
FIG. # 26

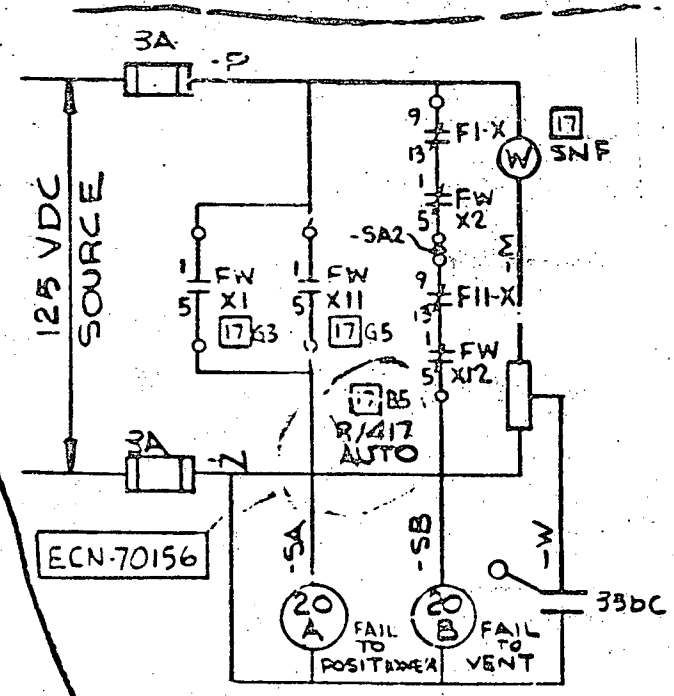


ENERGIZE DE-ENERGIZE
TO CLOSE TO CLOSE
MAIN VALVE MAIN VALVE
FIG. # 27
FCV-417

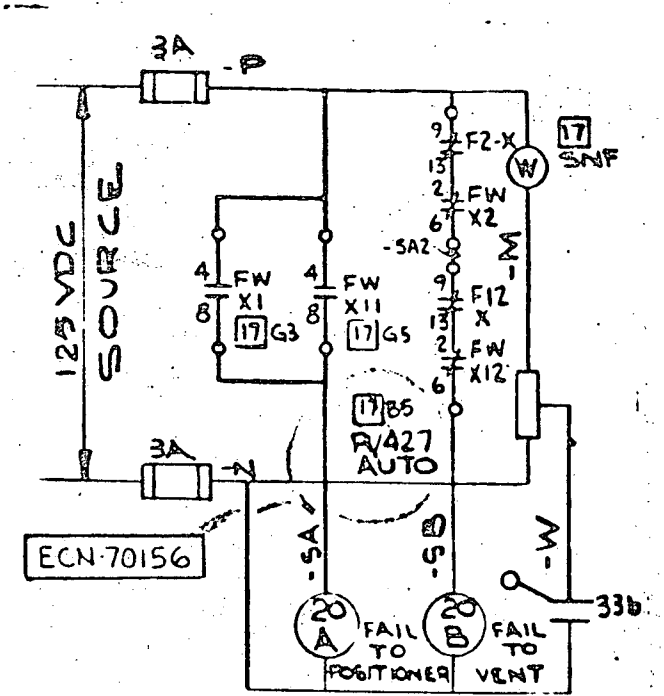

ENERGIZE DE-ENERGIZE
TO CLOSE TO CLOSE
MAIN VALVE MAIN VALVE
FIG. # 28
FCV-427

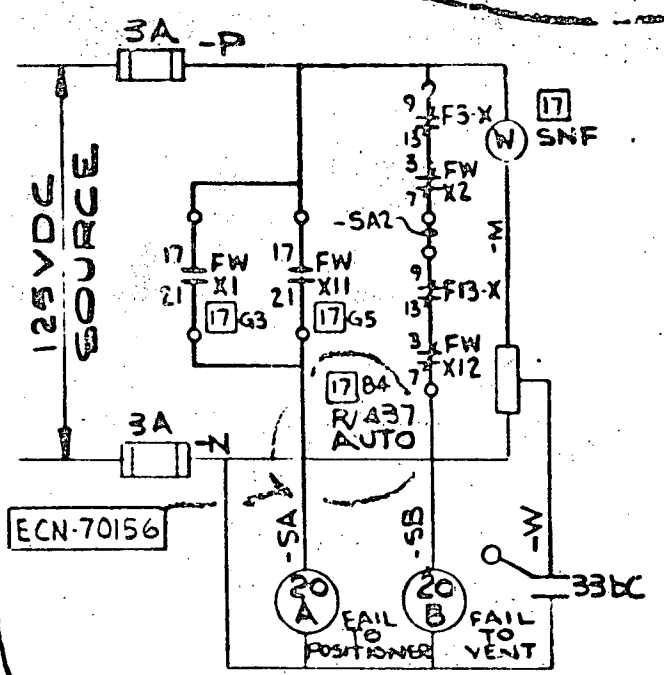

ENERGIZE DE-ENERGIZE
TO CLOSE TO CLOSE
MAIN VALVE MAIN VALVE
FIG. # 29
FCV-437

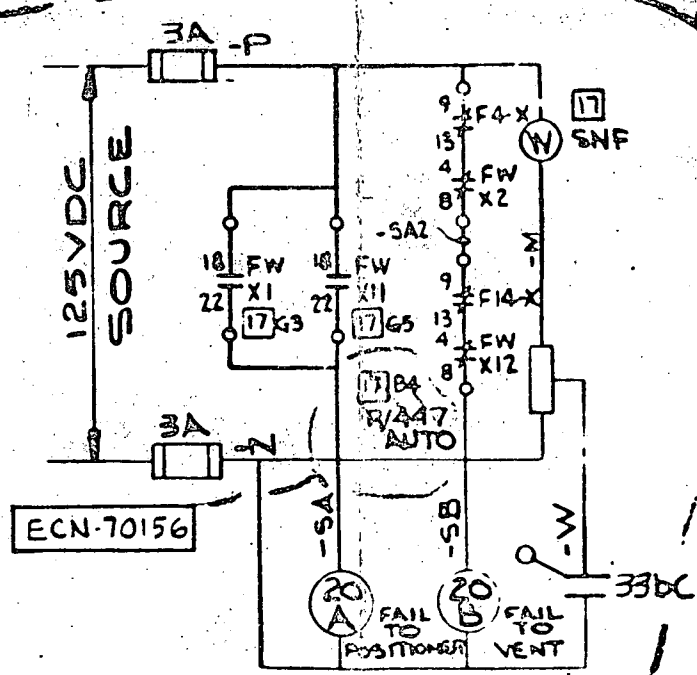

ENERGIZE DE-ENERGIZE
TO CLOSE TO CLOSE
MAIN VALVE MAIN VALVE
FIG. # 30
FCV-447

ECN-70065

6	SUB	S.C. INT 385	Westinghouse Electric Corporation		500B971	
			TITLE: CONSOLIDATED EDISON CO			
			INDIAN POINT STATION - UNIT NO. 3			
			ELEMENTARY WIRING DIAG.	REMOTE OPERATED VALVES		
			R.W. KEMERER	12/11/69	7/1/69	2/15/69
			PITTSBURGH, PA., U.S.A.			

8111070500

8111070500