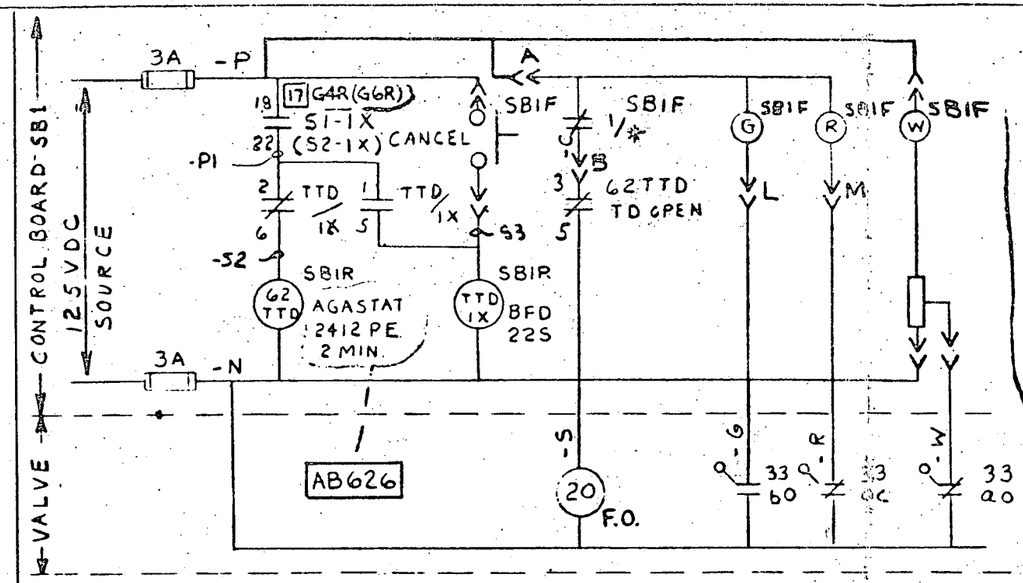

VALVES 876A & 876B

MAN CONTROL AUTO OR CANCEL OVERRIDE

DE-ENERGIZE SOLENOID

FIG. # 26

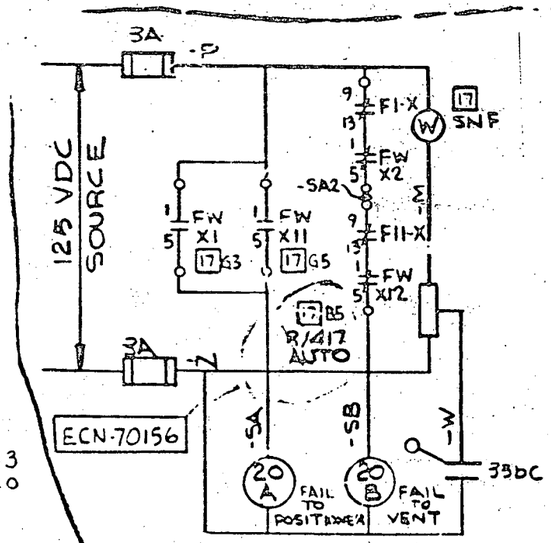

ENERGIZE TO CLOSE MAIN VALVE — DE-ENERGIZE TO CLOSE MAIN VALVE

FIG. # 27

FCV-417

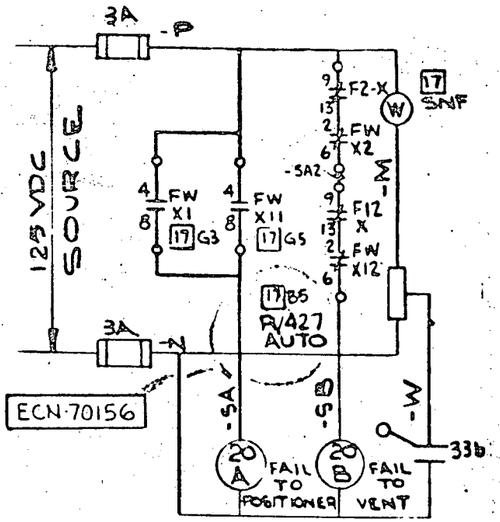

ENERGIZE TO CLOSE MAIN VALVE — DE-ENERGIZE TO CLOSE MAIN VALVE

FIG # 28

FCV-427

ECN-70065

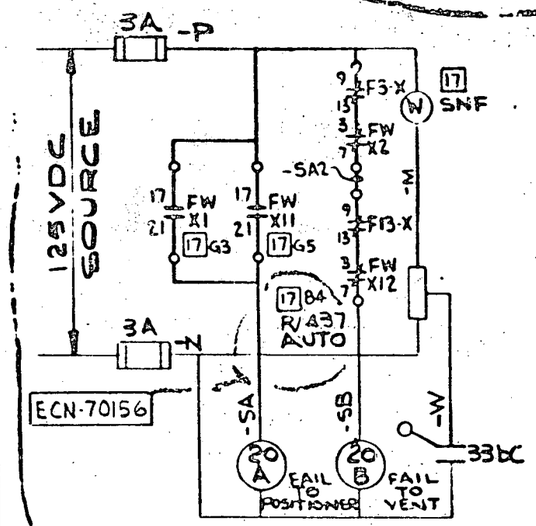

ENERGIZE TO CLOSE MAIN VALVE — DE-ENERGIZE TO CLOSE MAIN VALVE

FIG. # 29

FCV-437

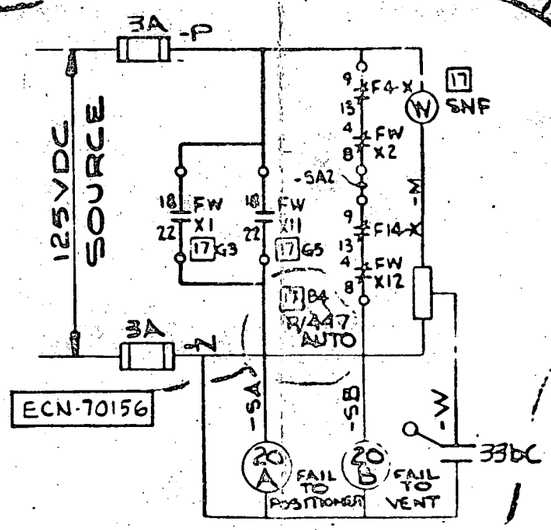

ENERGIZE TO CLOSE MAIN VALVE — DE-ENERGIZE TO CLOSE MAIN VALVE

FIG. # 30

FCV-447

ECN-30467	S.C. INT 385	Westinghouse Electric Corporation — CONSOLIDATED EDISON CO	
		TITLE: INDIAN POINT STATION - UNIT NO. 3	
		ELEMENTARY WIRING DIAG.	REMOTE OPERATED VALVES
		R.W. KEMERER 12/11/68	500B971
6	1 SUB		SHEET-119
		ATOMIC POWER DIV.,	PITTSBURGH, PA., U.S.A.

8111070500

8111070500