


- NOTES**
- *1- WIRE DESIGNATIONS ARE TO BE PREFIXED WITH 29B.
 - *2- NUMBERS IN SQUARES REFER TO EQUIPMENT LOCATION. FOR LEGENDS SEE SH. 1.
 - *3- FOR DEVICE I-1/EGI DEVELOPMENT SEE DEVICE T/* SH. 3.
 - *4- FOR DEVICES 52b/2AT5A & 52H/2A SEE SH. 1.
 - *5- FOR DEVICES 52b/2A & 52H/2A SEE SH. 1B.
 - *6- FOR DEVICES 55/EGI I-2/EGI (BCS-EGI), 86/EGI 27X1/EGI (CVX2), RSTR/EGI & KI/EGI SEE U.E. & C. F.P. 9321-05-3445.
 - *7- FOR DEVICES 27-2A/X2 & 86/2A SEE SH. 6.
 - *8- LETTER (A) ETC. REFERS TO CABLE SCHEMATIC SH. 14A.
 - Δ- INDICATES W. DWG. 500B971, (U.E. & C. F.P. 9321-05-3307) SHEET NUMBER.
- *9 CONTACT (RSTR/EGI RELAY NOT USED)

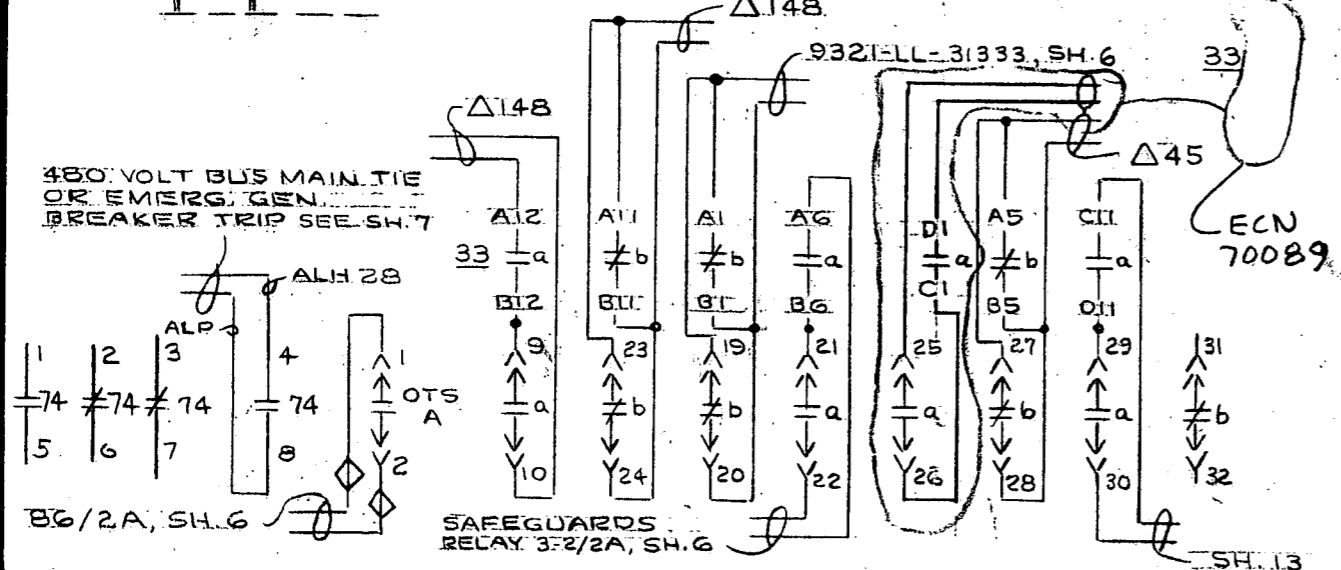

| REV. NO. | DATE | DESCRIPTION | ENGR | SUP ENGR |
|----------|----------|---|--------|----------|
| 7 | 10/24/74 | CHGP KI/EGI CONTACT TO KIX/EGI PER. AB 613 | J.H.S. | J.W.R. |
| 6 | 2/25/73 | REVERSED CONTACT NOS. DEVICE I-2/EGI & 55/EGI ALSO REVISED AS PER ECN 70089 | J.H.S. | J.W.R. |
| 5 | 2/24/72 | REVISED FUSE RATINGS & DWG. NO. REF. ADDED CABLE LETTERS. | J.H.S. | J.W.R. |
| 4 | 9/3/71 | 33H/2AT5A & 33H/2A WERE 52H/2AT5A & 52H/2A; I-2/EGI WAS I-1/EGI; ADD. NOTES ALH 28 WAS ALH 40 | J.H.S. | J.W.R. |
| 3 | 2/19/71 | DEV. I-2/EGI WAS I-1/EGI AT CONTACT G12-G1 | J.H.S. | J.W.R. |
| 2 | 2/3/71 | ADDED CABLE LETTERS & NOTE #8 | J.H.S. | J.W.R. |
| 1 | 12/16/70 | REVISED NOTE 3; ADDED WIRE SYMBOLS & CELL NO'S | J.H.S. | J.W.R. |
| 1 | 6/70 | FIRST ISSUE FOR CONSTRUCTION | J.H.S. | J.W.R. |

WESTINGHOUSE ELECTRIC CORPORATION
FOR
CONSOLIDATED EDISON COMPANY
INDIAN POINT GENERATING STATION - UNIT NO. 3

SCHEMATIC DIAGRAM
480V. SWITCHGEAR 31

SHEET NO. 14

U.E. & C. DWG. NO. **9321-LL-31173**
CON. ED. CO. DWG. NO. **D202469**