





F

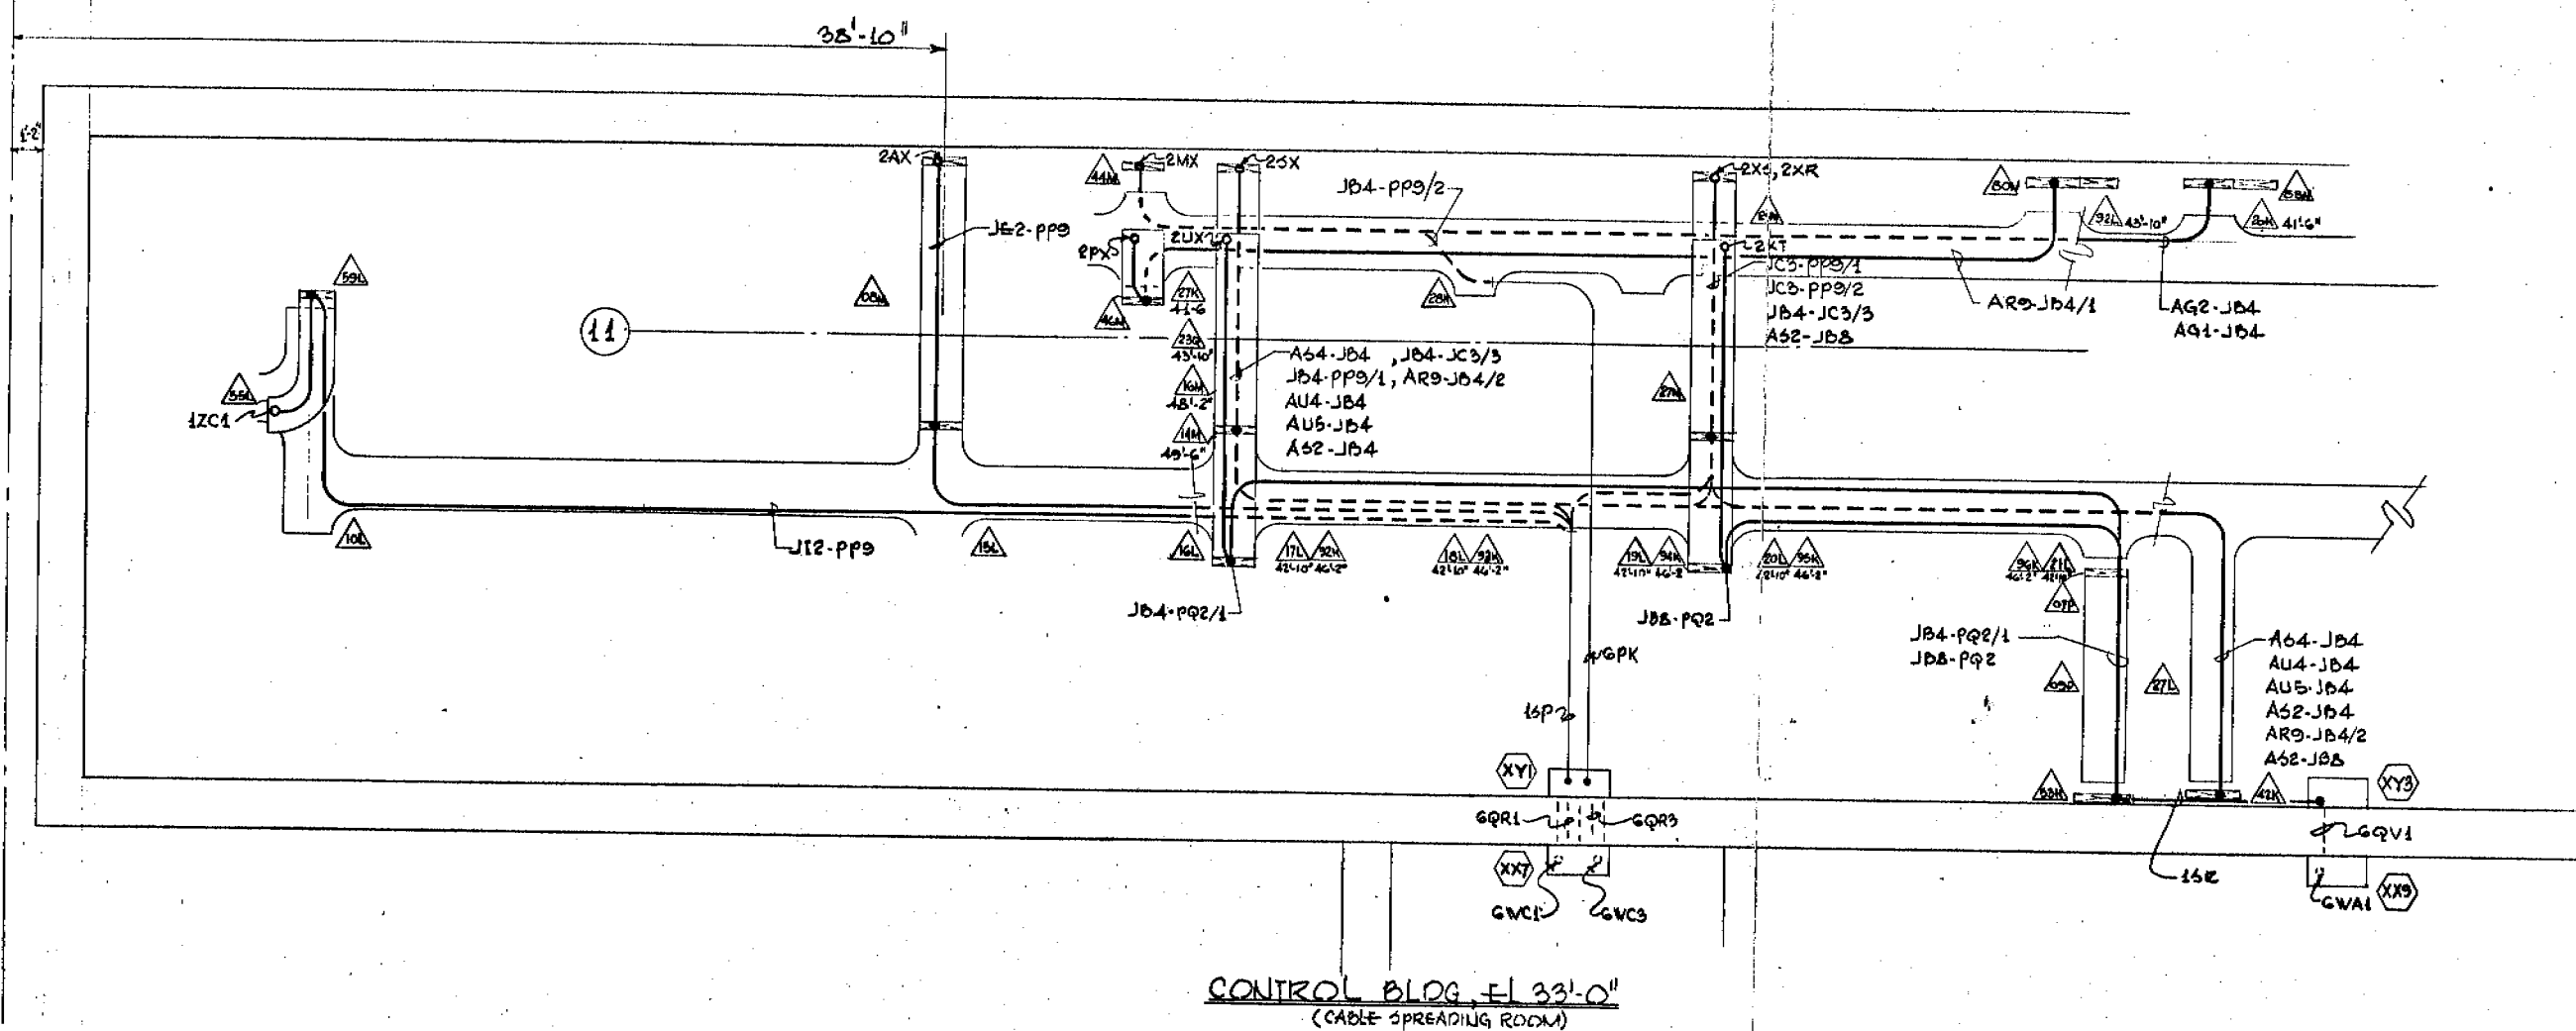

CONTROL BLDG FL 33'-0" (CABLE SPREADING ROOM)

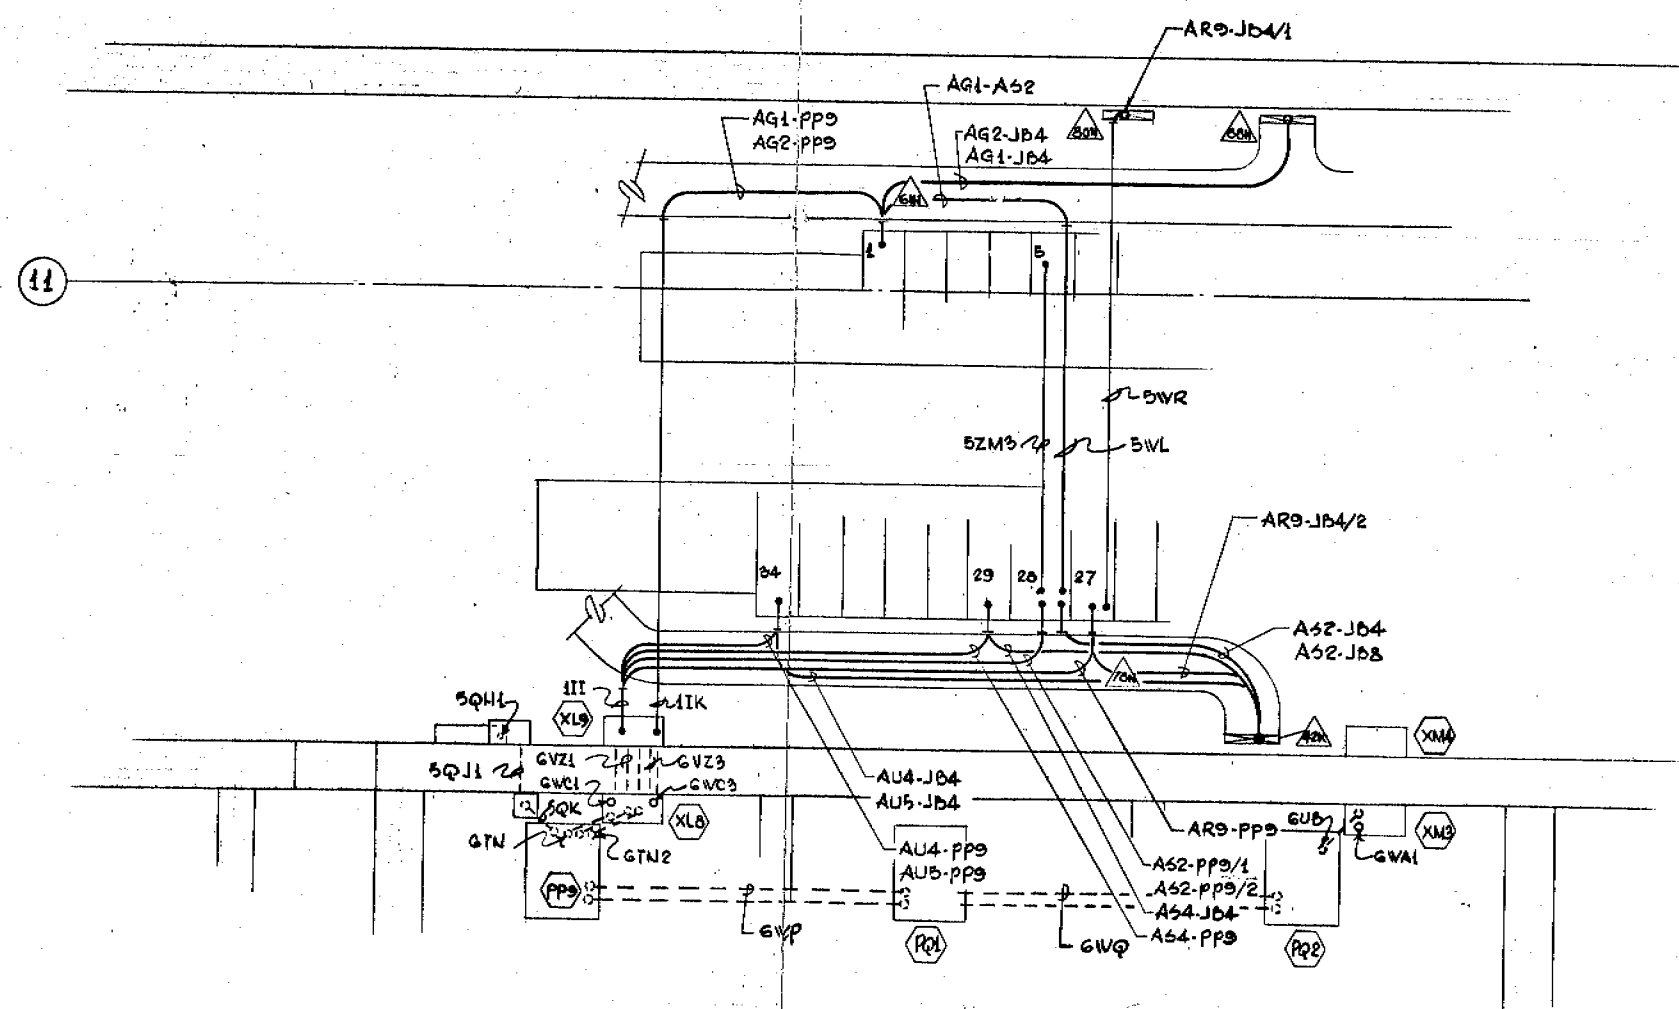

CONTROL BLDG FL 15'-0" (SWITCHGEAR ROOM)

| CONDUIT | CABLE NO. |
|---------------------|-------------------------------|
| 5ZM5 | A47-A52/B |
| 5Q41, 5Q41, 5QK-PP3 | PP3 |
| GQR1, GWC1 | JC3-PP3/1, JC3-PP3/2, JE2-PP3 |
| JT2-PP3 | JB4-PP3/1 |
| GQR3, GWC3 | JB4-PP3/2 |
| 5PVL, 5UB, 5WAL | JB4-PQ2/1, JB4-PQ2 |
| GTJ | AR3-PP3, A52-PP3/1, A52-PP3/2 |
| | A54-PP3, A55-PP3, JC3-PP3/1 |
| | JC3-PP3/2, JE2-PP3, JT2-PP3 |
| GTJ1 | AU4-PP3, JB4-PP3/1 |
| GTJ2 | AG2-PP3, JB4-PP3/2, AG1-PP3 |
| GVZ1 | AR3-PP3, A52-PP3/1, A52-PP3/2 |
| | A54-PP3, A55-PP3, A55-PP3 |
| GVZ3 | AG1-PP3, AG2-PP3 |
| 5VP1 | PP3-PQ2/2, PP3-PQ2/6 |
| 5WP | PQ1-PQ2/2, PQ1-PQ2/6 |

LEGEND
 ○ ELECTRICAL NODE NO
 △ TRAY SECTION NO

TERA
 APERTURE
 CARD
 PRC
 APERTURE
 CARD

POWER AUTHORITY OF THE
 STATE OF NEW YORK
 INDIAN POINT NUCLEAR
 GENERATING STATION UNIT NO 3
 IVAH 67

| DATE | FIRST ISSUE | DESCRIPTION | TROR. | REP. ITR. |
|------|-------------|-------------|-------|-----------|
| | | | | |
| | | | | |
| | | | | |

ENGINEER
 STATE REG. NO. _____ NO. _____

CABLE ROUTING
 DIESEL GENERATOR &
 BREAKER CONTROL

united engineers • consultants

SCALE: 1/4" = 1'-0" 6604-164-F-3K2