


A201416
 ENGINEERING
 UNIT NO. 2

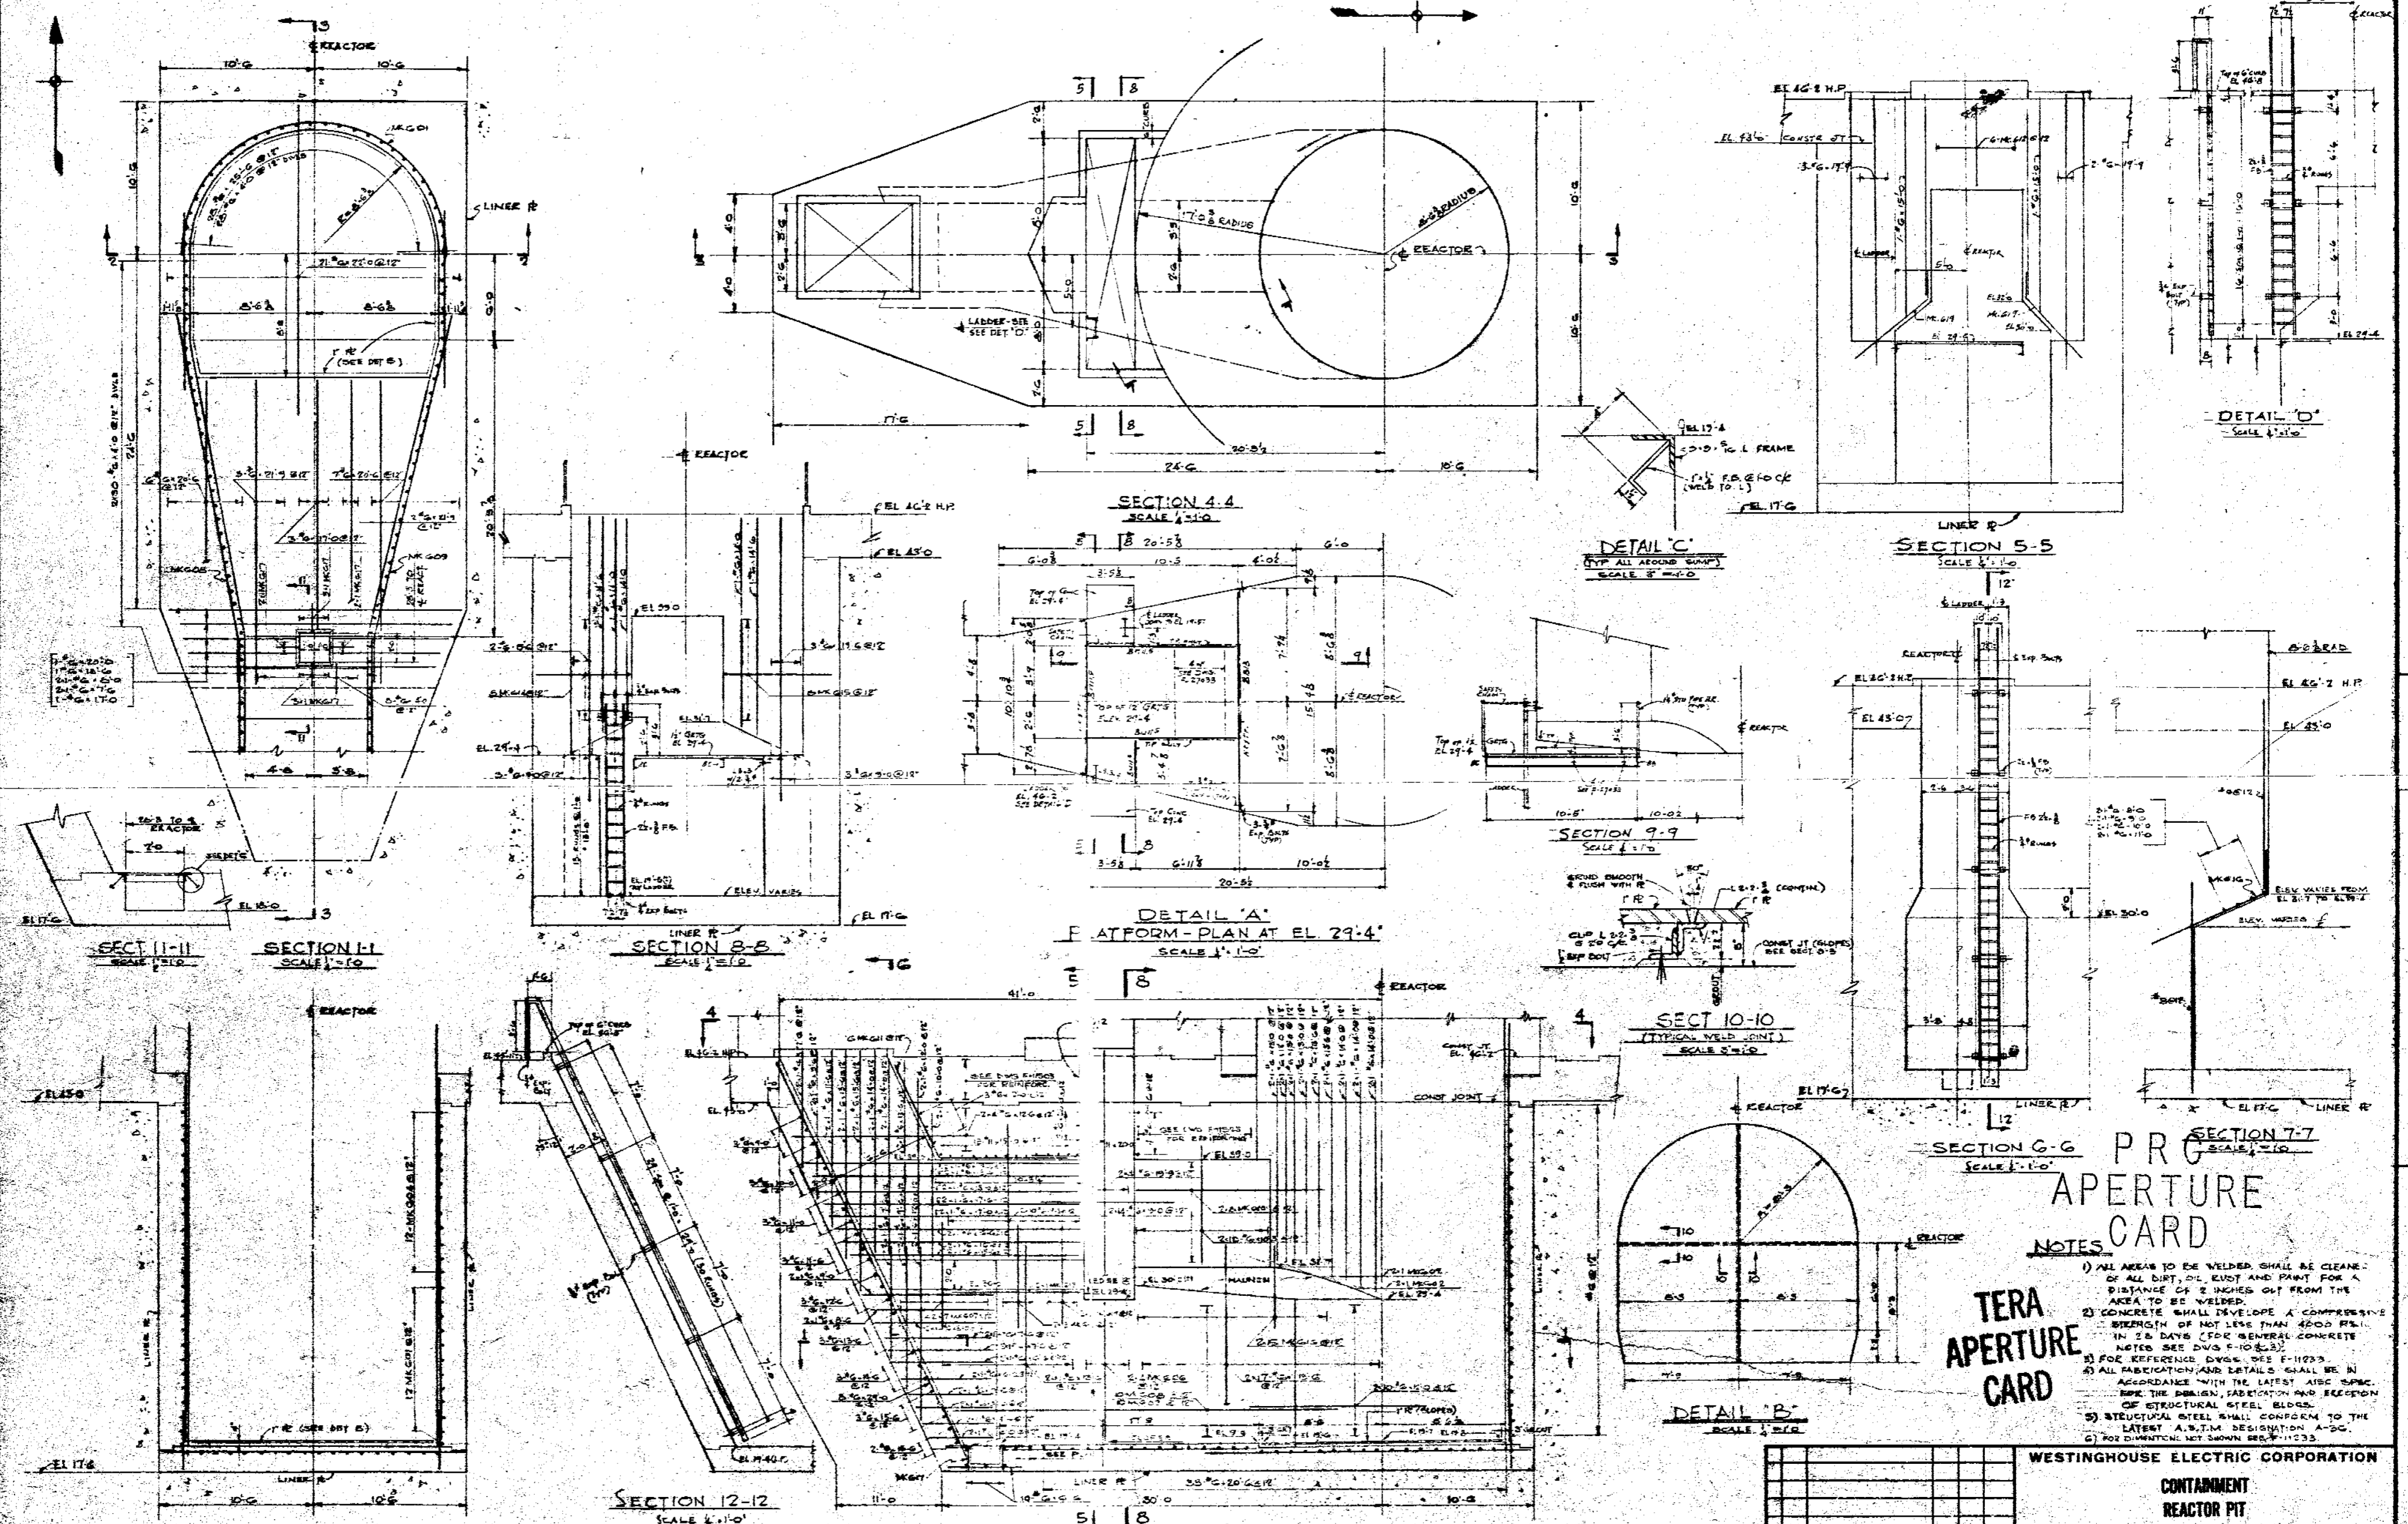

PRG
APERTURE CARD
 NOTES
 1) ALL AREAS TO BE WELDED SHALL BE CLEANED OF ALL DIRT, OIL, RUST AND PAINT FOR A DISTANCE OF 2 INCHES OUT FROM THE AREA TO BE WELDED.
 2) CONCRETE SHALL DEVELOPE A COMPRESSIVE STRENGTH OF NOT LESS THAN 5000 P.S.I. IN 28 DAYS (FOR GENERAL CONCRETE NOTED SEE DWG F-10-23).
 3) FOR REFERENCE DRAWING SEE F-11-23.
 4) ALL FABRICATION AND DETAILS SHALL BE IN ACCORDANCE WITH THE LATEST AISC SPEC. BE THE DESIGN, FABRICATION AND SECTION OF STRUCTURAL STEEL ELEMENTS.
 5) STRUCTURAL STEEL SHALL CONFORM TO THE LATEST A.S.T.M. DESIGNATION A-36.
 6) FOR DIMENSIONS NOT SHOWN SEE F-11-23.

TERA APERTURE CARD

POOR ORIGINAL

WESTINGHOUSE ELECTRIC CORPORATION	
CONTAINMENT REACTOR PIT	
CONCRETE & REINFORCING DETAILS	
FOR CONSOLIDATED EDISON COMPANY	
INDIAN POINT GENERATING STATION	
UNIT NO. 2	
U.S. A.C. DWG. NO. 9321-F-11253-0	COR. ED. CO. DWG. NO. A201416
UNITED ENGINEERS & CONTRACTORS INC.	

8111070578