

John D. O'Toole
Vice President

Consolidated Edison Company of New York, Inc.
4 Irving Place, New York, NY 10003
Telephone (212) 460-2533

Letter No. 81-73
April 14, 1981

Re: Indian Point Unit No. 2
Docket No. 50-247

Director of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

ATTN: Mr. Steven A. Varga, Chief
Operating Reactors Branch No. 1
Division of Licensing



Dear Mr. Varga:

This letter supplements my December 31, 1980 letter to you regarding the Adequacy of Station Electric Distribution System Voltages and Degraded Grid Voltage. Prior letters on these subjects were an August 1, 1980 letter to you from Peter Zarakas and an April 28, 1980 letter from William J. Cahill, Jr. to A. Schwencer.

The December 31, 1980 letter stated that based on discussions with your staff, we agreed to rack out the appropriate 6.9 kv circuit breaker rather than to install an electric interlock as described in our response to question 5 in the attachment to our August 1, 1980 letter.

Based on more recent discussions, initiated by your staff and their consultants, we have instead agreed to accomplish this task by placing the 6.9 kv bus tie breaker control switches in the "pull out" position and tagging them, whenever the 138 kv source of off-site power is lost.


The under voltage relays discussed in our December 31, 1980 letter and the 6.9 kv bus tie breaker control switches discussed in this letter, both require changes to the technical specifications. Such technical specification changes are part of a combined package and will be submitted under separate cover.

8104170 349
P

A015
S10

Should you or your staff have any questions, please contact us.

Very truly yours,

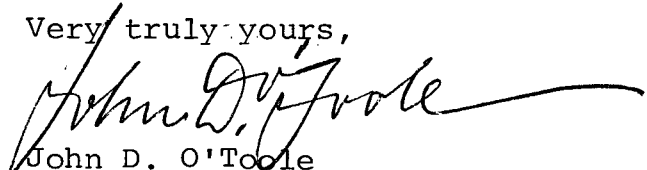

John D. O'Toole
Vice President