

2.0 SAFETY LIMITS (SLs)

2.1 SLs

2.1.1 Reactor Core SLs

In MODES 1 and 2, the combination of THERMAL POWER, Reactor Coolant System (RCS) highest loop average temperature, and pressurizer pressure shall not exceed the SLs specified in Figure 2.1.1-1.

2.1.2 RCS Pressure SL

In MODES 1, 2, 3, 4, and 5, the RCS pressure shall be maintained ≤ 2735 psig.

2.2 SL Violations

2.2.1 If SL 2.1.1 is violated, restore compliance and be in MODE 3 within 1 hour.

2.2.2 If SL 2.1.2 is violated:

2.2.2.1 In MODE 1 or 2, restore compliance and be in MODE 3 within 1 hour.

2.2.2.2 In MODE 3, 4, or 5, restore compliance within 5 minutes.

2.2.3 Within 1 hour, notify the NRC Operations Center, in accordance with 10 CFR 50.72.

2.2.4 Within 24 hours, notify the Plant Manager and Site Vice President.

2.2.5 Within 30 days a Licensee Event Report (LER) shall be prepared pursuant to 10 CFR 50.73. The LER shall be submitted to the NRC, the NSRB, the Plant Manager, and Site Vice President.

2.2.6 Operation of the unit shall not be resumed until authorized by the NRC.

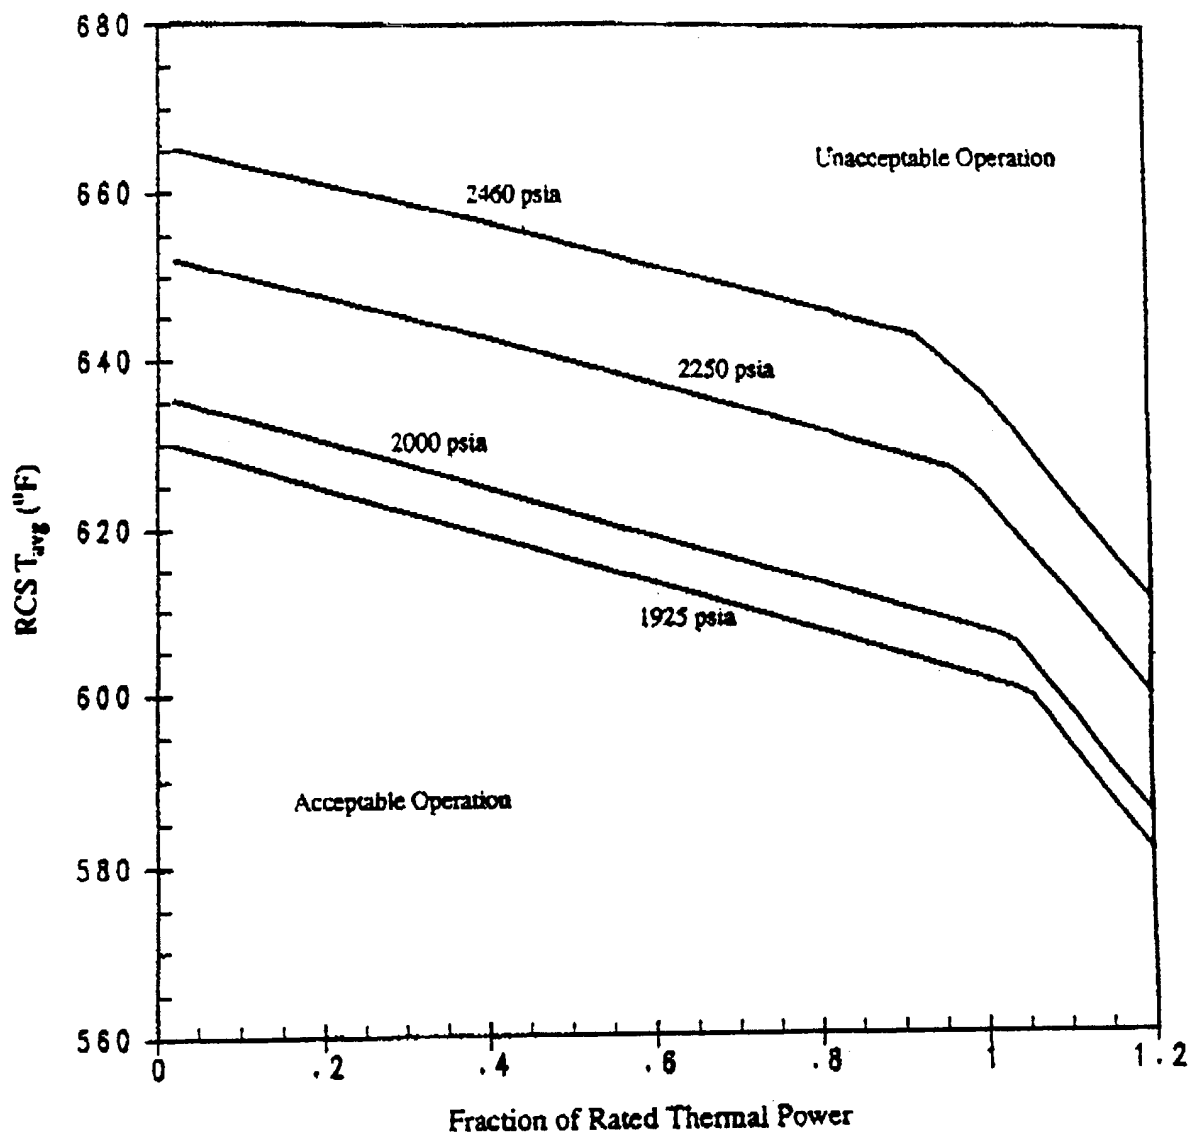


Figure 2.1.1-1 (page 1 of 1)
Reactor Core Safety Limits