



February 24, 2010
GDP 10-0004

Mr. Michael F. Weber
Director, Office of Nuclear Material Safety and Safeguards
Attention: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555-0001

**Portsmouth Gaseous Diffusion Plant (PORTS)
Docket No. 70-7002, Certificate No. GDP-2
Certificate Amendment Request-Deletion of Specific Technical Safety Requirements
(TSRs) for the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities and Their
Related Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16**

Dear Mr. Weber:

In accordance with 10 CFR 76.45, the United States Enrichment Corporation (USEC) hereby submits a request for an amendment to the Certificate of Compliance for the Portsmouth Gaseous Diffusion Plant (PORTS). This Certificate Amendment Request (CAR) proposes to delete in their entirety specific Technical Safety Requirements (TSRs) for the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities; specific TSRs for X-333 Freezer Sublimers, X-330/X-333 Cold Recovery, X-326 ERP, X-330 TAILS and X-333 LAW Operations and Certificate of Compliance Condition 16. TSR Sections 1.0, Use And Application, and 3.0, Administrative Controls, are being revised to reflect remaining Certified operations.

This change is being made due to the required de-lease of the following PORTS site facilities by 10/01/2010 to accommodate DOE's stated plans to Decontaminate and Decommission (D&D) these facilities:

X-342A	Feed, Vaporization Fluorine Generation Building
X-232C1	Tie Line No. 1 X-342 to X-330
X-342B	Fluorine Storage Building
X-343	Feed, Vaporization and Sampling Facility
X-232C5	Tie Line No. 5 X-343 to X-333
X-344A	UF ₆ Sampling Facility
X-344B	Maintenance Storage Building
X-326	Process Building
X-626-1	Recirculating Water Pump House

N145501

Mr. Michael F. Weber
February 24, 2010
GDP 10-0004, Page 2


X-626-2	Cooling Tower
X-111A	SNM Monitoring Portal (X-326)
X-111B	SNM Monitoring Portal (NW X-326)
X-232C4	Tie Line No. 4 X-326 to X-770
X-330	Process Building
X-630-1	Recirculating Water Pump House
X-630-2A	Cooling Tower
X-630-2B	Cooling Tower
X-630-3	Acid Station Pad
X-232C2	Tie Line No. 2 X-330 to X-326
X-232C3	Tie Line No. 3 X-330 to X-333
X-333	Process Building
X-230G	RCW System (except for blowdown line)

Enrichment operations at the PORTS site were ceased in 2001. Since that time a large portion of the site has been placed in Cold Shutdown with Surveillance and Maintenance (S&M) activities needed to maintain the required safety basis being performed until the start of D&D. In addition, activities such as UF₆ feed cleanup, uranium deposit removal, UF₆ cylinder repackaging, and cascade lube oil removal have been performed. The current plant shutdown conditions have resulted in a greatly reduced risk of a significant UF₆ release, criticality accident or large cascade fire.

USEC is requesting that the proposed changes to the TSR document be shown as effective on the date in which DOE has officially accepted turnover of all the stated facilities.

There are no new commitments contained in this submittal. Any questions related to this submittal should be directed to me at (301) 564-3250.

Sincerely,



Steven A. Toelle
Director, Regulatory Affairs

Mr. Michael F. Weber
February 24, 2010
GDP 10-0004, Page 3

- Enclosures:
1. Oath and Affirmation
 2. United States Enrichment Corporation (USEC), Certificate Amendment Request, Deletion of Specific Technical Safety Requirements (TSRs) for the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities and Their Related Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0, Administrative Controls, and Deletion of Certificate of Compliance Condition 16 Detailed Description and Justification
 3. Certificate Amendment Request, Portsmouth Gaseous Diffusion Plant, Letter GDP 10-0004, Removal/Insertion Instructions
 4. United States Enrichment Corporation (USEC), Certificate Amendment Request Significance Determination.


cc: R. DeVault, DOE-OR
D. Harland, Sr. Fuel Facility Inspector, NRC Region II
J. Henson, Chief, Fuel Facility Branch 2, NRC Region II
T. Liu, NRC Project Manger, NRC HQ

Enclosure 1
GDP 10-0004

Oath and Affirmation

OATH AND AFFIRMATION


I, Steven A. Toelle, swear and affirm that I am the Director, Regulatory Affairs of the United States Enrichment Corporation (USEC), that I am authorized by USEC to sign and file with the Nuclear Regulatory Commission this Certificate Amendment Request for the Portsmouth Gaseous Diffusion Plant addressing deletion of specific Technical Safety Requirements (TSRs) for the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities and Their Related Operations; Revision to TSR Sections 1.0, Use And Application, and 3.0, Administrative Controls; and Deletion of Certificate of Compliance Condition 16 as described in USEC letter GDP 10-0004, that I am familiar with the contents thereof, and that the statements made and matters set forth therein are true and correct to the best of my knowledge, information and belief.




Steven A. Toelle

On this 24th day of February 2010, the individual signing above personally appeared before me, is known by me to be the person whose name is subscribed to within the instrument, and acknowledge that he executed the same for the purposes therein contained.

In witness hereof I hereunto set my hand and official seal.

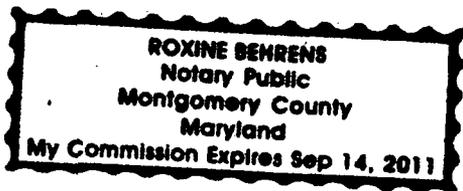

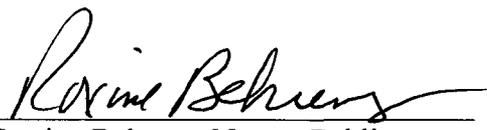

Roxine Behrens, Notary Public
State of Maryland, Montgomery County
My commission expires September 14, 2011

**Enclosure 2
GDP 10-0004**

**United States Enrichment Corporation (USEC), Certificate Amendment Request,
Deletion of Specific Technical Safety Requirements (TSRs) for the X-342, X-343, X-
344, X-326, X-330 and X-333 Facilities and Their Related Operations, Revision to TSR
Sections 1.0, Use And Application, and 3.0, Administrative Controls, and Deletion of
Certificate of Compliance Condition 16 Detailed Description and Justification**

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

Description of Change

The following Technical Safety Requirements (TSRs) are to be deleted from the “*Application For United States Nuclear Regulatory Commission Certification, Volume 4, Portsmouth Gaseous Diffusion Plant, Technical Safety Requirements*” document, Section 2.0, Facility Specific Technical Safety Requirements:

- 2.1 Specific TSRs For X-342, X-343, And X-344 Facilities;
TSRs 2.1.1 through 2.1.3.21 and 2.1.4 General Design Features
2.1.4.1 through 2.1.4.7
- 2.2 Specific TSRs For X-330 And X-333 Cascade Facilities;
TSRs 2.2.1 through 2.2.3.17 and 2.2.4 General Design Features
2.2.4.1 through 2.2.4.2
- 2.3 Specific TSRs For X-333 Freezer Sublimers;
TSRs 2.3.1 through 2.3.3.3 and 2.3.4 General Design Features
- 2.4 Specific TSRs For X-330 And X-333 Cold Recovery;
TSRs 2.4.1 through 2.4.3.5 and 2.4.4 General Design Features
- 2.5 Specific TSRs For X-326 ERP, X-333 LAW, And X-330 TAILS;
TSRs 2.5.1 through 2.5.3.15 and 2.5.4 General Design Features
2.5.4.1 through 2.5.4.6
- 2.6 Specific TSRs For X-326 Cascade Facility;
TSRs 2.7.1 through 2.7.3.15 and 2.7.4 General Design Features
2.7.4.1

The individual TSR pages being deleted and revised can be viewed in Enclosure 3 of this submittal.

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

The Technical Safety Requirements (TSRs) contained in the “*Application For United States Nuclear Regulatory Commission Certification, Volume 4, Portsmouth Gaseous Diffusion Plant, Technical Safety Requirements*” document, Sections 1.0, Use And Application, and 3.0, Administrative Controls, are being revised as follows:

Definition of Terms:

- Deletion of 1.2.4, Cascade Minimum Suction Pressure

Table 3.2.2-1, On-site Functional Staffing Requirements changes:

- Table 3.2.2-1 superscript #6 changed to #4 and removal of references to ACRs 1, 2, 3, 4, and 6
- Deletion of X-342, X-343, X-344, Mode/Operation and Staffing Requirements
- Deletion of ERP, LAW, TAILS Mode/Operation and Staffing Requirements
- X-300/APSS Staffing Requirements superscript changes from #9 to #6
- Deletion of X-326, X-330, X-333, Mode/Operation and ACR Staffing Requirements
- Deletion of X-326, X-330, X-333, Mode/Operation and Operator Staffing Requirements
- Deletion of Freezer/Sublimers X-333, Mode/Operation I, II and Operator Staffing Requirements
- Deletion of Freezer/Sublimers X-333, Mode/Operation III, and Operator Staffing Requirements
- Deletion of Cold Recovery X-330/X-333, Mode/Operation and Operator Staffing Requirements
- Power Operations Staffing Requirements changed from 2 to 1 and deletion of superscript #8
- Process Services/Mass Spectrometry Analytical Functions Staffing Requirements changed from 2 to 1, changed superscript #7 to renumber #5 and deleted superscript #8

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

- The following superscripts descriptions were deleted #'s 4, 5, 8 & 10. Superscripts #'s 6, 7, & 9 were renumbered correspondingly as 4, 5 & 6

Section 3.19, Operations

- Deleted second bullet, Cascade Operations Organization and Administration

Section 3.23, Worker Protection From UF₆ Process Hazards, item (g)

- Deleted reference to buildings X-326, X-330, X-333, X-342, X-343, & X-344

The individual TSR pages being revised can be viewed in Enclosure 3 of this submittal.

Deletion of Condition 16, which currently states the following, from GDP-2 Certificate of Compliance is being requested:

“The United States Enrichment Corporation (USEC) shall inform the Nuclear Regulatory Commission (NRC) in writing no less than 30 days before any planned reduction in the surveillance requirements of the Caretaker Project being conducted for the Department of Energy (DOE) for the installed shut-down and buffered cascade equipment in the X-326 Building. In addition, USEC shall inform the NRC in writing within 15 days of obtaining a result of a measurement, as part of the Caretaker Project, of a holdup quantity of uranium enriched in ²³⁵U equal to or above 10 weight percent in installed equipment leased by USEC from DOE that is outside the measuring instruments accuracy range.”

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

Justification of the Change:

Deletion of X-342, X-343, X-344, X-326, X-330 and X-333 Facility TSRs

DOE and USEC are both committed that on 10/01/2010 the de-lease process for returning the facilities listed in the cover letter will have been completed and DOE will be in full possession of the facilities and responsible for their regulatory oversight. Until that time USEC will remain in full compliance with all the applicable TSRs. At turnover, the operations within the facilities will no longer be under regulatory jurisdiction of the Nuclear Regulatory Commission (NRC) and USEC will no longer be in a position to implement the associated TSRs for these facilities. Therefore as presented in the "Description of Change" numerous TSRs need to be deleted, the TSR Administrative Controls need to be revised and Condition 16 to the Certificate of Compliance should be removed at the time of de-lease.

DOE regulations require that DOE establish a safety basis to ensure that there is no undue risk to the public health and safety, common defense and security and the environment for the de-leased facilities. DOE has contracted with USEC (PORTS) to prepare the safety basis documentation that would be used to allow for the facility turnovers and potential future activities within them. In accordance with 10 CFR 830 Part B the safety basis document must either be a Documented Safety Analysis (DSA) or a Basis for Interim Operation (BIO). The two cases in which a BIO is allowed involve short lived activities and during transition phases, including transition surveillance and maintenance, deactivation and decontamination and decommissioning. The anticipated scope of the required DOE authorization and safety basis documentation as documented in the BIO is within the operations already analyzed in the current SAR. None of the accidents described in the SAR for the facilities to be de-leased would have a significant impact to the facilities or operations that will remain under the NRC Certificate of Compliance. No accident in the de-leased facilities to be regulated by the DOE would have the potential of causing an accident in NRC regulated space. While there are accident scenarios that could result in evacuation of facilities remaining under the Certificate of Compliance, they are the same as the accidents that could now potentially occur prior to the de-lease. The DOE BIO will utilize as a basis the same analyses and TSR controls for the authorized activities as are

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

currently provided under the NRC Certificate of Compliance. USEC will be in position to identify and evaluate any changes that might occur during the BIO review and approval cycle which might impact USEC's remaining Certified operations. It is unlikely that any of the previously existing operations in these DOE owned facilities now addressed in the BIO and controlled by TSRs would result in an increase in the probability of a previously evaluated accident in the remaining NRC regulated facilities. Any changes in these potential DOE activities and operations that could possibly occur after the de-lease but prior to any actual D&D would be evaluated under DOE's required change process. If such changes have potential to impact NRC Certified operations or other site tenants the changes must be submitted to the affected tenant(s) for evaluation and expression of concern(s) in accordance with the Shared Site review process. The turnover from NRC to DOE regulatory authority will coincide with the USEC de-lease of the noted facilities.

With the ceasing of enrichment operations in 2001 and the placing of these uranium processing facilities into Cold Shutdown, the risk to the public and plant workers has been significantly reduced from that which was initially Certified and required the current TSRs. The main contributors to the reduced risk center around large UF₆ releases and criticality type accidents are as follows: a 99% reduction in the cascade UF₆ maximum inventory; cascade operating stage reduction from a maximum of 4080 to approximately 30 purge cascade stages and 80 cascade stages; reduction of UF₆ cylinder heating, feeding and transfer operations in the X-340 complex; reduction of liquid UF₆ operations at the ERP, LAW, TAILS withdrawal stations; reduction of all known greater than safe mass deposits (at system conditions) to levels below greater than safe mass; continuance of cascade shutdown cell buffering; isolation and/or removal of potential moderators and exothermic contributors such as recirculating water, lube oil and Freon from the cascade facilities. These actions listed above significantly reduce the potential consequences of corresponding accidents evaluated in the SAR. The shutdown of the high inventory cascade cells eliminates the potential for those large UF₆ release scenarios related to breaches in cascade containment and those related to large cascade fires. The potential for a criticality in these facilities remains low due to the reduction of greater than safe mass deposits and along with the shutdown of these processes the potential for the creation of new

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

deposits is very unlikely. Especially in the cascade, the continuance of cell buffering and the reduction in available moderators such as lube oil and recirculating cooling water also reduces the risk of a criticality.

Anticipated Facility Conditions at Time of De-Lease:

X-342, X-343 And X-344 Facilities

These facilities continued to be operated post 2001 cessation of enrichment operations to perform various uranium handling operations such as Tc feed cleanup, cylinder repackaging, cylinder sampling, etc. On the effective date of facility de-lease no USEC, NRC Certified operations will be performed within the facilities. While there are no significant uranium deposits in the facilities there will be some residual UF₆ and other uranium products contained in the process piping. USEC will no longer perform feed, sampling and transfer operations under the NRC Certification. The following utilities will remain available for DOE use in the facilities: sanitary water (including fire water), electrical power, steam, dry air and nitrogen. The de-lease demarcation for isolating of the utilities from the DOE facilities will be at a defined point outside the facility. In addition, PA and CAAS services will remain available to DOE for their use. The de-lease isolation point for these systems will be within DOE's area. The systems will be modified as necessary to ensure any DOE action that can disable the PA and CAAS would not impact these systems in Certified space.

X-326, X-330, and X-333 Facilities

Enrichment operations in these facilities were ceased in 2001. Since that time a few cells have been operated in order to transfer material to the ERP for material repackaging purposes and for down blending of UF₆ material. Cell treatments were performed to remove cascade deposits. On the effective date of facility de-lease the X-330 and X-333 enrichment equipment will be in a shutdown condition. The X-330 Conditioning Gas Storage Area will remain in service to support potential X-326 chemical

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

treatments. The X-326 cell operations will be significantly curtailed, with only the Top Purge and possibly a few cascade cells operating below atmospheric pressure. Cascade shutdown cells will be evacuated of UF₆ to a UF₆ negative and a dry gas buffer applied at 14.0 psia or greater. The cells will be isolated from the RCW system. The R-114 coolant will either be stored in the cell coolant system, in the coolant storage tanks or in railcars. Cell lube oil will be drained and isolated. The lube oil and hydraulic systems (except for possibly X-326 Top Purge Cascade and X-330 EBS) will be shutdown and in some cases the system oil will have been removed from the facility. The following utilities will remain available for DOE use in the facilities: sanitary water, HPFW, electrical power, steam, dry air and nitrogen. The de-lease demarcation for isolating of the utilities from the DOE facilities will be at a defined point outside the facility. In addition, PA and CAAS services will remain available to DOE for their use. The de-lease isolation point for these systems will be within DOE's area. The systems will be modified if necessary to ensure any DOE action that can disable the PA and CAAS would not impact these systems in Certified space.

X-333 Freezer Sublimers

The Freezer Sublimer (F/S) systems are located within the X-333 facility and are currently inoperable. The F/S vessel has been physically removed from each of the F/S systems. The F/S vessels are intended to be used in the future as part of the centrifuge plant design. Therefore, there are no plans to make these systems operable.

X-330 and X-333 Cold Recovery Areas

Both of these cold recovery operations are in a shutdown mode. Some residual UF₆ and/or other uranium materials may exist in the system piping and associated equipment.

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification**

X-326 ERP, X-333 LAW and X-330 TAILS

These withdrawal Facilities are in a shutdown condition. Some residual UF₆ and/or other uranium products may remain in the associated piping and equipment.

Revision to TSR 3.0, Administrative Controls

The changes to this section of the TSRs are only intended to reflect what will be the scope of their applicability after the de-lease of the Cascade, X-340 Complex, etc. facilities. The requirements as they are to be applied under the Certificate remain unchanged. While most of the changes are self explanatory, the changes to the On-site Functional Staffing Requirements Table for Power Operations and the Process Services functions have been reduced from 2 to 1 based on superscript #8 which states "Staff may be reduced to 1 individual if Cascade "Product" and "Tails" withdrawal streams are not established." The phrase "Cascade "Product" and "Tails" withdrawal streams are not established" was provided as a measurable means for determining if the Cascade had been returned to an "enrichment" operation and if so the staffing level was higher. Even though at that time, the returning to an enrichment status required NRC approval the plant was capable of performing enrichment operations, however after the de-lease occurs this will no longer be possible. The staffing requirements in these areas remaining under NRC regulation are therefore unchanged.

Deletion of Certificate of Compliance Condition 16

As stated in the Certificate of Compliance Condition, the Caretaker Project was being conducted for the DOE and addressed those HEU/MEU X-326 cascade cells that were shutdown prior to NRC Certification. As part of the Certification process NRC and DOE agreed that DOE owned the holdup material in these cells and as such this material would not be held against USEC's possession limits. However, since USEC under the Certification leased/owned the equipment containing the holdup material there existed a definite level of accountability to ensure that the holdup material remained accounted for. After the de-lease both the equipment and its contained HEU/MEU holdup material will be within DOE's

United States Enrichment Corporation (USEC)
Certificate Amendment Request
Deletion of Specific Technical Safety Requirements (TSRs)
For the X-342, X-343, X-344, X-326, X-330 and X-333 Facilities And Their Related
Operations, Revision to TSR Sections 1.0, Use And Application, and 3.0,
Administrative Controls, and Deletion of Certificate of Compliance Condition 16
Detailed Description and Justification

control. Condition 16 will no longer have any relevance to USEC under the post de-lease Certified space.

Enclosure 3
GDP 10-0004

Certificate Amendment Request, Portsmouth Gaseous Diffusion Plant, Letter
GDP 10-0004, Removal/Insertion Instructions

Certificate Amendment Request Portsmouth Gaseous Diffusion Plant Letter GDP 10-0004 Removal/Insertion Instructions	
Remove Pages	Insert Pages
APPLICATION FOR UNITED STATES NUCLEAR REGULATORY COMMISSION CERTIFICATION TECHNICAL SAFETY REQUIREMENTS VOLUME 4	
TSR 1.0 Page 1.0-2	TSR 1.0 Page 1.0-2
TSRs 2.1 Pages 2.1-1 thru 2.1-40	
TSRs 2.2 Pages 2.2-1 thru 2.2-37	
TSRs 2.3 Pages 2.3-1 thru 2.3-8	
TSRs 2.4 Pages 2.4-1 thru 2.4-12	
TSRs 2.5 Pages 2.5-1 thru 2.5-33	
TSRs 2.7 Pages 2.7-1 thru 2.7-28	
TSRs 3.0 Pages 3.0-4, 3.0-13, and 3.0-15	TSRs 3.0 Pages 3.0-4, 3.0-13, and 3.0-15

SECTION 1.0 USE AND APPLICATION

1.1 INTRODUCTION

10 CFR 76.87(a) states "The Corporation shall establish technical safety requirements. In establishing the requirements, the Corporation shall consider the analyses and results of the safety analysis report submitted pursuant to 10 CFR 76.35." These Technical Safety Requirements (TSRs) are intended to fulfill the requirements of 76.87 and set forth approved limitations for operation of the Portsmouth Gaseous Diffusion Plant (PORTS). The TSRs define the conditions, safe boundaries, and the management or administrative controls necessary to ensure safe operation of the facility and are based on the accidents analyzed in the Safety Analysis Report (SAR).

1.2 DEFINITION OF TERMS

1.2.1 Actions - That part of a TSR that prescribes required actions to be taken under designated conditions within specified completion times.

1.2.2 Administrative Controls - The provisions relating to organization and management, procedures, recordkeeping, reviews and audit, and reporting necessary to ensure operation of the plant in a safe manner.

1.2.3 Allowable Value - The limiting value that the trip setpoint can have when tested periodically, beyond which the instrument channel is declared inoperable and corrective action must be taken.

1.2.4 Text Deleted

1.2.5 Channel Check - The qualitative assessment of channel behavior during operation. This determination shall be based on observation and shall include, where possible, a comparison of the channel indication and status with other indications and the status derived from independent instrument channels measuring the same parameter.

1.2.6 Channel Functional Test - The injection of a simulated or actual signal into the channel as close to the sensor as practicable to verify operability, including required alarms, interlocks, trip functions, and channel failure trips. The Channel Functional Test may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is tested.

DELETE

**SECTION 2.1 SPECIFIC TSRs
FOR
X-342, X-343, AND X-344 FACILITIES**

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.1 X-342, X-343, X-344 AUTOCLAVE OPERATIONAL MODES:

- | | | |
|-------------|---------------------------------------|--|
| I | Cylinder Handling/ Preparation | UF ₆ cylinder movement, cylinder installation and connection, and other activities required prior to initiating cylinder heating and cylinder removal after disconnection from autoclave. |
| II | Heating | Cylinder containing UF ₆ being heated inside an autoclave (excluding Mode VI); autoclave closed, UF ₆ flow valve closed and steam valves open. |
| III | Cylinder/Pigtail Operations | Includes, but is not limited to pigtail connection/disconnections, roll/tilt, and valve clarity checks; steam valves closed, cylinder valve or safety valve may or may not be closed. |
| IV | Feeding, Transfer or Sampling | Transfer of UF ₆ from a heated cylinder containing UF ₆ to the Cascade or to another approved container; autoclave closed, steam valves open or closed, UF ₆ flow valve open. |
| V | Cold Feeding | Sublimation of UF ₆ from a cylinder without adding heat to the cylinder. |
| VI | Controlled Feeding | Sublimation of UF ₆ from a cylinder contained within an autoclave under special heating limitations (Max. cylinder skin temperature 145 °F and Max. cylinder pressure 20 psia). |
| VII | Shutdown | Steam valves closed, autoclave may contain a cylinder, parent cylinder valve/safety valve and/or UF ₆ flow valve closed. |
| VIII | Containment | Autoclave closed and at least one isolation valve in each autoclave penetration line is closed. |

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.2 SAFETY LIMITS

APPLICABILITY: All Autoclave Operational Modes

2.1.2.1 SL: Autoclave shell pressure shall not exceed the values contained in the safety limit column of the table below.

Autoclave Shell Pressure Safety Limit Versus Autoclave Size	
Autoclave Size	Safety Limit
96 Inch	165 psig
84 Inch	181 psig
72 Inch	179 psig

BASIS:

Should the autoclave pressure rise above its maximum allowable working pressure (MAWP) the autoclave shell high pressure relief system is provided to relieve the pressure buildup to prevent catastrophic failure of the containment autoclave. The safety limit is 110% of the Maximum Allowable Working Pressure (MAWP) based on the 1995 ASME Pressure Vessel Code, Division I, Section VIII paragraph UG-125. This paragraph while not directly applicable to this application, does indicate that there is a high degree of confidence that the vessel pressure boundary will not fail at 110% of the stated MAWP. [SAR Sections 3.8.2.3, 3.8.5.3, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.6, 4.3.2.2.7, 4.3.2.2.9, 4.3.2.2.13, and 4.3.2.2.14]

APPLICABILITY: All Autoclave Operational Modes

2.1.2.2 SL: Cylinder heating temperature shall not exceed the values contained in the safety limit column table below.

Cylinder Category	Safety Limit
A	250 °F
B	235 °F

BASIS:

The only time that the potential exists for a UF₆ cylinder to rupture is during the initial heating of the cylinder. During the heat up cycle the UF₆ expands in volume. Ullage or void volume is lost due to heating a cylinder to an excessive temperature based on the standard fill weight of UF₆ in the cylinder. A cylinder is assumed to fail at some point above its safety limit. The safety limit has been established for Category A cylinders at a value in which the remaining ullage is at least 3% for cylinders with depleted material and 5% for cylinders with product or feed material for that specified temperature. The Category B safety limit has been established at the temperature where there still remains an approximate 5% ullage for cylinders with depleted material and 7% ullage for cylinders with product or feed material due to the fact that these cylinders have uncertified volumes. These safety limits are conservative and do not reflect the zero ullage temperature of 280 °F for the 2.5, 10 and 14 inch diameter wall cylinders [SAR Sections 3.8.6.1, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.10, 4.3.2.2.13, 4.3.2.2.14, and 4.3.2.2.15].

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.1 Criticality Accident (Radiation) Alarm Systems

LCO 2.1.3.1a: Criticality accident detection coverage shall be operable.

APPLICABILITY: In areas, equipment, or processes which contain greater than 700 grams of ^{235}U at an enrichment greater than or equal to 1.0 wt% ^{235}U .

ACTIONS:

Condition	Required Actions	Completion Time
<p>A. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>A.1 Implement the following for areas, equipment, or processes applicable to this LCO and that are not otherwise covered by criticality accident detection.</p> <p>A.1.1 Discontinue movement of cylinders containing UF_6 enriched to ≥ 1 wt% ^{235}U. <u>AND</u></p> <p>A.1.2 Complete the current transfer and/or sampling operation and place transfer or sampling autoclaves processing cylinders containing UF_6 enriched to ≥ 1 wt% ^{235}U in Mode III. <u>AND</u></p> <p>A.1.3 Roll cylinders containing UF_6 enriched to ≥ 1 wt% ^{235}U with valves not in the 12 o'clock position to place the cylinder valve in the 12 o'clock position. <u>AND</u></p> <p>A.1.4 Place feed autoclaves processing cylinders containing UF_6 enriched to ≥ 1 wt% ^{235}U in Mode VII. <u>AND</u></p> <p>A.1.5 Discontinue movement of uranium enriched to ≥ 1 wt% ^{235}U. <u>AND</u></p> <p>A.2.1 Evacuate area within the area applicable to this LCO not covered by criticality accident detection. <u>AND</u></p> <p>A.2.2 Restrict access to area evacuated in A.2.1. <u>AND</u></p> <p>A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification, such as a device that will alarm on sensing a 10mr/hr dose rate.</p>	<p>Immediately</p> <p>Immediately after completing all steps in A.1</p> <p>Immediately</p>
<p>B. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>B.1.1 Restore criticality accident detection by installing portable CAAS unit providing required criticality accident detection and same alarms as fixed unit. <u>OR</u></p> <p>B.1.2 Restore criticality accident detection to operable status. TSR 1.6.2.2d is not applicable.</p>	<p>Prior to reinitiating activities</p>

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.1 Criticality Accident (Radiation) Alarm Systems (continued)

LCO 2.1.3.1b: Criticality accident alarm shall be operable (audible)

APPLICABILITY: In areas where the maximum foreseeable absorbed dose in free air exceeds 12 rad.

ACTIONS:

Condition	Required Action	Completion Time	
A. Area does not have an audible criticality accident alarm.	A.1 Implement the following for areas, equipment, or processes where a criticality accident could result in a maximum foreseeable dose exceeding 12 rad in the area of inaudibility and LCO 2.1.3.1a applies.	Immediately	
	A.1.1 Discontinue movement of cylinders containing UF ₆ enriched to ≥ 1 wt % ²³⁵ U. <u>AND</u>		
	A.1.2 Complete the current transfer and/or sampling operation and place transfer or sampling autoclaves processing cylinders containing UF ₆ enriched to ≥ 1 wt % ²³⁵ U in Mode III. <u>AND</u>		
	A.1.3 Roll cylinders containing UF ₆ enriched to ≥ 1 wt % ²³⁵ U with valves not in the 12 o'clock position to place the cylinder valve in the 12 o'clock position. <u>AND</u>		
	A.1.4 Place feed autoclaves processing cylinders containing UF ₆ enriched to ≥ 1 wt % ²³⁵ U in Mode VII. <u>AND</u>		
	A.1.5 Discontinue movement of uranium enriched to ≥ 1 wt % ²³⁵ U. <u>AND</u>		
	A.2.1 Evacuate area of inaudibility applicable to this LCO. <u>AND</u>		
	A.2.2 Restrict access to area evacuated in A.2.1. <u>AND</u>		
	A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification, such as a device that will alarm on sensing a 10m/hr dose rate, or a radio in constant communication with the Plant Control Facility.		Immediately after completing all steps in A.1
	A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification, such as a device that will alarm on sensing a 10m/hr dose rate, or a radio in constant communication with the Plant Control Facility.		Immediately
B. Area does not have an audible criticality accident alarm.	B.1.1 Restore criticality accident alarm to operable status. TSR 1.6.2.2d is not applicable.	Prior to reinitiating activities	

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.1 Criticality Accident (Radiation) Alarm Systems (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.1.3.1.1 Calibrate radiation clusters to a set point of 5 mRad/hr. in air.
	SR 2.1.3.1.2 Verify that the cluster nitrogen horn and X-300 alarm sounds when two out of three channels in a cluster are tripped.
Quarterly	SR 2.1.3.1.3 Verify nitrogen supply pressure is at least 900 psig for each CAAS horn.

BASIS:

Each cluster consists of three neutron-sensitive detection units. Clusters are designed and calibrated to detect and alarm on a minimum credible criticality accident of concern, defined as producing an integrated total dose of 20 Rads. in one minute at two meters from the reacting material. This system will provide an audible signal in the event of a criticality that will alert personnel to evacuate the immediate work areas. The minimum acceptable length of time for the CAAS horn to sound is 2 minutes. [SAR Sections 3.8.7.1 and 4.3.2.6].

DELETE

DELETE

SECTION 2.1 ~~SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES~~

2.1.4 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

2.1.3.2 ~~UF₆ Cylinder High Pressure Autoclave Steam Shutoff~~

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCO: UF₆ cylinder high pressure autoclave steam shutoff system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. Cylinder high pressure autoclave steam shutoff system inoperable in Mode II	A.1 Place the autoclave in Mode VII	1 Hour
B. Cylinder high pressure autoclave steam shutoff system inoperable in Modes IV, VI	B.1 Restore operability and removal of UF ₆ from the cylinder (any of Modes IV, VI) may be completed	Prior to initiating a new cylinder heating cycle

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.2.1 Perform channel functional test to verify the autoclave steam supply valve will close when pressure exceeds set point. Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 5 psia
Semiannually	SR 2.1.3.2.2 Calibrate high pressure shutoff instrumentation set point to ≤ 115 psia. Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 5 psia
Prior to entering Mode VI	SR 2.1.3.2.3 Calibrate high pressure shutoff instrumentation set point to ≤ 16.9 psia Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 3.1 psia

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.5 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.2 UF₆ Cylinder High Pressure Autoclave Steam Shutoff (continued)

BASIS:

The UF₆ Cylinder High Pressure Autoclave Steam Shutoff System is a single channel system. The heating of a UF₆ cylinder containing an excessive amount of "light" gases at normal heating temperatures could result in the internal cylinder pressure exceeding the hydrostatic test pressure and possibly create a UF₆ release in the autoclave. In addition, in the event an over filled cylinder is heated in the autoclave the higher cylinder pressure caused by the reduced void volume maybe sufficient to exceed the set point value and thereby stop the cylinder heating and prevent a possible hydraulic rupture of the cylinder. The 115 psia actuation pressure for heating all cylinders other than Category C (controlled feeding) is based on the lowest MAWP of these cylinders. The set point value corresponds to the trip point established under DOE 5481.1B in 1985 and amended by DOE approval in 1995 to allow a 5 psia tolerance to comply with the definition of "Allowable Value" in ANSI/ISA-S67.04-1988. For Controlled Feeding (Mode VI, Category C Cylinder) purposes, the shutoff system must be calibrated to a lower set point (16.9 psia with a tolerance of 3.1 psia) to assure that the UF₆ does not liquify. Closure time testing for the steam supply valve is accomplished under TSR surveillance requirement 2.1.3.5.1. [SAR Sections 3.8.2.6, 3.8.5.6, 4.3.2.2.6, 4.3.2.2.7, and 4.3.2.2.9].

DELETE

DELETE

SECTION 2.1 - SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.6 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.3 UF₆ Cylinder High Temperature Autoclave Steam Shutoff

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCS: Cylinder temperature set points shall be in accordance with the following table:

UF ₆ Cylinder High Temperature Set Points Versus Cylinder Category	
Cylinder Category	Limiting Control Setting
A	235 °F
B	220 °F
C	145 °F

LCO: Both channels of the UF₆ cylinder high temperature system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. One channel inoperable in Modes IV and VI	A.1 Restore operability and may continue operating in Modes IV or VI	Prior to initiating a new cylinder heating cycle
B. One channel inoperable in Mode II	B.1 Place autoclave in Mode VII	1 Hour
C. Both channels inoperable	C.1 Place autoclave in Mode VII	1 Hour

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.7 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.3 UF₆ Cylinder High Temperature Autoclave Steam Shutoff (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.3.1 Perform each channel functional test to verify the autoclave steam supply valve will close when temperature exceeds set point. Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 5 °F
Semiannually	SR 2.1.3.3.2 Calibrate cylinder high temperature shutoff instrumentation to a setpoint which coincides with the LCS for the applicable cylinder category. Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 5 °F
Prior to entering Mode VI	SR 2.1.3.3.3 Calibrate high temperature shutoff instrumentation set point to ≤ 145 °F Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 2.3 °F

BASIS:

Fill limits for UF₆ cylinders are established to allow adequate room for UF₆ expansion upon heating. Uranium hexafluoride exhibits a significant expansion when undergoing the phase change from solid to liquid. The expansion factor from a solid at 70°F to a liquid at 235°F is approximately a 53% increase in volume. The desired void volume is dependent upon whether the internal volume is certified to exceed a specified minimum as shown by its water weight stamped on the nameplate or uncertified in which a minimum design volume is used for the determination. Various cylinder models are placed in designated heating categories A, B to maintain at least a 5% void volume for certified volume cylinders containing feed and product and 3% void volume with depleted material. Uncertified volume cylinders are categorized to maintain at least a 7% void volume with product and 5% void volume with depleted material. This system maintains the initial condition of an acceptable temperature inside the cylinder within the parameters assumed in the accident analysis. The maintaining of temperature control will ensure that the cylinder hydrostatic or zero ullage limitation will not be exceeded or in the case of Controlled Feeding will ensure that the UF₆ is not liquefied. The LCS value corresponds to the trip set point established under DOE 5481.1B in 1985 and amended by DOE approval in 1995 to allow a 5 °F tolerance to comply with the definition of "Allowable Value" in ANSI/ISA-S67.04-1988. For Controlled Feeding (Mode VI) purposes, the shutoff system must be calibrated to a lower set point (145 °F with a tolerance of 2.3 °F) to assure that the UF₆ does not liquify. [SAR Sections 3.8.2.7, 3.8.5.7, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.10, 4.3.2.2.13, 4.3.2.2.14, and 4.3.2.2.15].

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.8 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.4 Autoclave Shell High Steam Pressure Shutdown

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCS: Steam pressure set points shall be in accordance with table below:

Autoclave Shell High Steam Pressure Set Points Versus Cylinder Category	
Cylinder Category	Limiting Control Setting
A	8.0 psig
B	2.5 psig

LCO: The autoclave shell high pressure steam shutdown system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. One pressure instrument channel inoperable	A.1 Restore operability and may continue operating in Modes IV or VI	Prior to initiating new cylinder heating cycle
B. One steam supply shutoff valve inoperable	B.1 Restore operability and may continue operating in Modes IV or VI.	Prior to initiating new cylinder heating cycle
C. Both steam supply shutoff valves or both pressure instrument channels inoperable	C.1 Place autoclave in Mode VII	1 Hour

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.9 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.4 Autoclave Shell High Steam Pressure Shutdown (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.4.1 Perform channel functional test to verify the autoclave steam supply valves will close when the pressure exceeds the LCS set point.
Semiannually	SR 2.1.3.4.2 Calibrate shell high pressure steam shutdown instrumentation at the installed LCS set point.
Each time set point is changed	SR 2.1.3.4.3 Calibrate shell high pressure steam shutdown instrumentation at new LCS set point.

BASIS:

The autoclave shell high pressure steam shutdown is a "defense-in-depth" system that supports the UF₆ Cylinder High Temperature Autoclave Steam Shutoff System. The High Steam Pressure Shutdown system consists of pressure sensing channels and two channels of isolation valves. If one of the channels is found to be inoperable and the affected autoclave is in a "feeding" mode (Modes IV or VI), it is permissible to continue to feed since the cylinder is open to the cascade or another container and is at little or no risk of over pressurizing. In Mode II (Heating), however, the cylinder has the potential to be over pressurized. Therefore the loss of a protective channel presents enough of a risk to require that further heating be halted (place autoclave in Mode VII).

The accident of concern involves the prevention of a "0" ullage condition in a UF₆ cylinder and therefore the prevention of the resultant hydraulic rupture of the cylinder. The LCS set points of 8 psig and 2.5 psig as they correspond to cylinder categories were established such that when the instrument drift and other calibration uncertainties associated with the installed instrumentation is added to the LCS set point there is an adequate safety margin below the lowest cylinder temperature of 275 °F at which there can be "0" ullage.

The allowable value is calculated accounting for drift, calibration uncertainties, and instrument uncertainties per ISA-S67.04-1988.

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.10 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.5 Autoclave Shell High Pressure Containment Shutdown

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCO: The autoclave shell high pressure containment system shall be operable:

ACTIONS:

Condition	Required Actions	Completion Time
A. One instrument channel inoperable	A.1 Restore instrument channel to operable status. NOTE The current Operating Cycle may be completed.	Prior to initiating a new Operating Cycle
B. Both instrument channels inoperable	B.1 Place autoclave in Mode VII	1 Hour
C. One containment isolation valve on one or more autoclave penetration inoperable	C.1 Restore containment isolation valve to operable status. NOTE The current Operating Cycle may be completed.	Prior to initiating a new Operating Cycle
D. All containment isolation valves on any one autoclave penetration inoperable	D.1 Place autoclave in Mode VII	1 Hour
E. Steam leakage around autoclave locking ring	E.1 Place autoclave in Mode VII	1 Hour

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.11 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.5 Autoclave Shell High Pressure Containment Shutdown (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.5.1 Perform channel functional test to verify the High Pressure Containment system will actuate at or below 13 psig. Containment valves must close within 15 seconds of pressure switch actuation. For autoclaves that have an interlock feature incorporated into this system, the autoclaves must remain interlocked shut while the high pressure isolation signal is present.
Semiannually	SR 2.1.3.5.2 Calibrate shell high pressure shutdown instrumentation at ≤ 13 psig
Quarterly	SR 2.1.3.5.3 Leak rate the autoclave by pressurizing the autoclave to at least 90 psig and verify that the system pressure loss is less than or equal to 10 psig/hr for each of the following autoclave loop containment valve conditions: <ol style="list-style-type: none"> 1. Inner loop valves closed and Outer loop valves open 2. Inner loop valves open and Outer loop valves closed <p style="text-align: center;">OR</p> Perform a leak rate test where the maximum acceptable leakage shall not exceed 12 scfm at a minimum test pressure of 90 psig for each of the same conditions as stated above.

BASIS:

The steam used to heat a cylinder within an autoclave is controlled at approximately 5 psig. Therefore, when the autoclave internal pressure reaches the ≤ 15 psig (13 psig setpoint plus the 2 psi tolerance), the operating logic assumes that a UF₆ release has occurred within the autoclave and causes the containment valves to close, preventing an external release of UF₆. The 15 psig represents the lowest pressure at which it can be assumed that it is not due to a steam control failure and yet gives the early indication that a UF₆ release is in progress. Testing the containment system at 90 psig is representative of the peak credible accident pressure that could be attained assuming functioning of safety systems, design features and administrative controls to prevent rupture of a cylinder or pigtail [SAR Sections 3.8.2.1, 3.8.5.1, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.13, and 4.3.2.2.14].

DELETE

DELETE

SECTION 2.1 - SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.12 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.6 Autoclave Shell High Pressure Relief System

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCS: Autoclave shell pressure relief set points shall be in accordance with table below:

Autoclave Shell High Pressure Relief Versus Autoclave Size		
Autoclave Size	Limiting Control Setting	Allowable Value (105% at MAWP)
96"	≤ 150 psig	158 psig
84"	≤ 165 psig	173 psig
72"	≤ 163 psig	171 psig

LCO: Autoclave Shell High Pressure Relief system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. Rupture disk inoperable	A.1 Place autoclave in Mode VII	Immediately
B. Relief valve inoperable	B.1 Place autoclave in Mode VII	Immediately
C. Block valve closed and/or seal broken	C.1 Open or verify valve open AND	Immediately
	C.2 Reseal valve	8 Hours
D. Rupture disk/relief valve cavity pressure > 2 psig	D.1 Replace rupture disk	Prior to initiating a new cylinder heating cycle

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.13 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.6 Autoclave Shell High Pressure Relief System (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each autoclave startup	SR 2.1.3.6.1 Verify isolation block valve sealed open and pressure indicator in the cavity between the rupture disk and relief valve reads ≤ 2 psig once steam has been introduced into the autoclave
Annually	SR 2.1.3.6.2 Calibrate the relief valve

BASIS:

The ASME code (1995 ASME Pressure Vessel Code, Section VIII, Division I, Part UG, General Requirements) requires that over pressure relief be provided by a device stamped at or below the MAWP and sized such that the subsequent transient pressure will be limited to a maximum of 110% of MAWP when a single relief path is used. ASME code allows rupture disks to have a 5% burst tolerance. Rupture disks stamped at MAWP and rated at 72 °F will therefore burst at or below 105% of MAWP thus, the LCS is set at 100% MAWP. To comply with these standards, pressure relief devices are purchased and installed on the autoclaves with stamped ratings at or below the LCS [SAR Sections 3.8.2.10 and 3.8.5.10].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.14 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.7 High Condensate Level Shutoff

APPLICABILITY: Autoclave Operational Modes II, IV, VI

LCO: Both channels of the high condensate level shutoff system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. One channel inoperable	A.1 Restore operability. May continue operating in Modes IV or VI	Prior to initiating a new cylinder heating cycle
B. Both channels inoperable	B.1 Place autoclave in Mode VII	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.1.3.7.1 Perform each channel functional test to verify the autoclave steam supply valve will close when probes are contacted with water.

BASIS:

The Condensate level shutoff system is provided to prevent over pressurization or a nuclear criticality in an autoclave following a postulated UF₆ release. Excess water is undesirable in the event of a UF₆ release from the cylinder that could cause either high HF pressure as the result of the reaction between UF₆ and water or the excessive moderation of an unsafe mass of uranium thereby causing a criticality within the autoclave.

When the autoclaves were initially installed and the probes were in a fixed location, a design based acceptance water inventory test was conducted. This quantified the total amount of water retained (surfaces, pools, drain lines, etc.) in the autoclave. The successful completion of the water inventory tests verified that an undesirable accumulation of water in the autoclave would not occur.

The system function is to detect either a drain line plug or restriction and to shut off the steam flow to the autoclave. The undetected plugging of the drain line while the autoclave is in service, regardless of the probe location, would result in the rapid buildup of water inventory and thereby potentially providing the conditions necessary for a release of radioactive materials to the atmosphere or a criticality within the autoclave [SAR Sections 3.8.2.5, 3.8.5.5, 4.3.2.2.13, and 4.3.2.2.14].

DELETE

SECTION 2.1 - SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.15 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.8 Cylinder Heating

APPLICABILITY: Autoclave Operational Mode II

LCO: Cylinder accountability weight shall be \leq the standard fill weight prior to heating a UF₆ cylinder to normal operating temperature.

ACTIONS:

Condition	Required Actions	Completion Time
<p>A. Accountability weight exceeds the standard fill weight</p>	<p>A.1 Calculate the temperature at which the cylinder will meet the following void volume criteria: Certified volume - stamped water weight - use water weight to determine actual cylinder volume.</p> <p>Min. void volume: 3% - cylinders with depleted material 5% - cylinders with product or feed material</p> <p>Uncertified volume - No stamped water weight - use min. design volume of the cylinder.</p> <p>Min. void volume: 5% cylinders with depleted material 7% - cylinders with product material</p> <p style="text-align: center;">AND</p>	<p>Prior to initiating Mode II</p>
	<p>A.2 Set the autoclave shell high pressure and autoclave high temperature system trips at the Category A or B setting to ensure that the calculated temperature will not be exceeded</p>	<p>Prior to initiating Mode II</p>
<p>B. Calculations determine that the cylinder cannot be heated in a manner that ensures void volume criteria can be met</p>	<p>B.1 Evacuate out the necessary material to meet void volume criteria and heating limitations OR handle cylinder emptying according to Mode VI</p>	<p>Prior to initiating Mode II</p>

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.16 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.8 Cylinder Heating (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each cylinder heating	SR 2.1.3.8.1 Verify cylinder accountability weight is \leq standard cylinder fill weight
Prior to initial heating under LCO 2.1.3.8 Required Actions	SR 2.1.3.8.2 Verify the autoclave has been calibrated for the proper cylinder category
Annually	SR 2.1.3.8.3 Calibrate scales used for accountability weights
Prior to use at the beginning of each shift	SR 2.1.3.8.4 Perform functional test of accountability scale

BASIS:

Minimum void volume requirements are established to prevent cylinder hydraulic rupture if temperature limits are exceeded. The standard fill weight of UR, if heated to 250°F will meet the identified void volume criteria. The heating of cylinders to a maximum of 235°F would provide approximately a 6.75% void volume which is an additional 35% safety factor. The proper heating of a cylinder regardless of its weight can be achieved if the net weight of the cylinder and the minimum volume of the cylinder are known such that the maximum heating temperature to meet the void volume criteria can be calculated. The TSR controlled temperature control systems provided the added assurance that the hydrostatic or hydraulic limitation will not be exceeded [SAR Sections 3.8.6.1, 4.3.2.2.2, 4.3.2.2.6, 4.3.2.2.14, and 4.3.2.2.15].

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.17 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.9 Low Cylinder Pressure Shutoff

APPLICABILITY: Autoclave Operational Mode II

LCO: Low Cylinder Pressure Shutoff system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. Low cylinder pressure shutoff system inoperable	A.1 Place autoclave in Mode VII	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.9.1 Perform a channel functional test to verify steam isolation to the autoclave when after the initial allowable time of cylinder heating the cylinder pressure does not exceed the allowable value.
Semiannually	SR 2.1.3.9.2 Perform calibration with allowable values of ≥ 15.0 psia and ≤ 65 minutes.

BASIS:

The heating of a UF₆ cylinder having a closed or plugged cylinder valve and/or pigtail would negate the protection afforded by the cylinder high pressure shutoff system due to the isolation of the cylinder from the high pressure instrumentation. A UF₆ cylinder should not be heated if its pressure cannot be measured because excessive internal cylinder pressures could potentially rupture the cylinder. The low cylinder pressure shutoff system will isolate the steam supply to an autoclave when after the initial nominal hour (≤ 65 minutes allowable value) of cylinder heating the cylinder pressure does not equal or exceed the allowable value of 15.0 psia. UF₆ cylinders are not heated unless their cold pressure is ≤ 10 psia which provides a 5.0 psia margin to the allowable value for the purpose of ensuring valve and line clarity to the cylinder pressure instrumentation. Setpoints established shall be consistent with ANSI/ISA-S67.04-Part I-1994 "Setpoints for Nuclear Safety Related Instrumentation" and ISA-RP67.04-Part II-1994 "Methodologies for the Determination of Setpoints for Nuclear Safety Related Instrumentation." The exception is that 2S sample cylinders heated to 235 °F would have a void volume of over 9% with the cylinder valve closed. This system only provides protection during initial heating and not at another time [SAR Sections 3.8.2.9 and 3.8.5.9].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.18 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.10 Cylinder Assay Limitation

APPLICABILITY: Autoclave Operational Mode II, IV, VI

LCO: No cylinder with a calculated or known assay value above 5% shall be placed in an autoclave for heating.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Mode II	SR 2.1.3.10.1 Verify cylinder assay (calculated) contained on the materials transfer log or other transfer authorizing documents is $\leq 5\%$

BASIS:

The Autoclave Criticality Analysis dated February 21, 1991 (POEF-T-3544), limits the assay in a cylinder to 5% U^{235} or less before the cylinder can be heated in a autoclave. The autoclave analysis also demonstrates that double contingency exists against a criticality occurring for cylinders with assays up to 5% [SAR Section 5.2, Appendix A, section 2.2].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.19 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.11 Autoclave Smoke Detection System

APPLICABILITY: All Autoclave Operational Modes

LCO: Autoclave UF₆ smoke detection systems shall be operable.

ACTIONS: **Note:** TSR 1.6.2.2(d) does not apply

Condition	Required Actions	Completion Time
<p>A. For the X-342 and X-344 buildings:</p> <p>< 1 operable smoke detector alarm circuit covering the area above the autoclaves</p>	<p>A.1 Provide continuous smoke watch at affected area OR</p>	<p>Immediately</p>
	<p>A.2 Place all autoclaves in the affected building in Mode VII</p>	<p>1 Hour</p>
<p>B. For the X-343 building:</p> <p>< 1 operable smoke detector alarm circuit covering the area above each autoclave pair (i.e., No. 1 and 2; 3 and 4; 5 and 6) and autoclave No. 7 OR</p> <p>< 4 operable smoke detector heads (total)</p>	<p>B.1 Provide continuous smoke watch at affected area OR</p>	<p>Immediately</p>
	<p>B.2 Place affected autoclaves(s) in Mode VII</p>	<p>1 Hour</p>

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.20 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.11 Autoclave Smoke Detection System (Continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.1.3.11.1 Test active smoke heads to ensure alarm indication will occur when smoke head is exposed to a simulated smoke condition.

BASIS:

In the event of a UF₆ release in the autoclave area a local indicator will sound notifying operating personnel that immediate investigation and action must occur. The smoke detection system and subsequent personnel actions will mitigate the consequences of any UF₆ release. The detection components used are ionization type fire detectors designed to detect not only smoke but invisible combustion products. Due to their operating principle these detectors will also actuate in the presence of steam and vehicle exhaust, etc. Therefore prompt investigation of the actuation source is required. This LCO ensures that at least one smoke detector alarm circuit, covering the area above each autoclave that is not shut down, is operable. For autoclaves in the X-343 building, an autoclave smoke detector alarm circuit is required to have at least one operable smoke detector head above each respective autoclave pair (i.e., autoclave No. 1 and 2; 3 and 4; 5 and 6) and above autoclave No. 7, in order to be considered operable.

Additionally, a minimum of four (4) smoke detector heads (total) mounted on the ceiling are required to be operable in X-343 to alleviate any potential adverse effects on the smoke detector heads from wind inside the building when one or both crane doors are open. If this condition is not satisfied, the "affected autoclaves" referenced in Action B.2 encompasses all autoclaves in X-343.

Furthermore, a single smoke watch is adequate to implement Action B.1, regardless of how many autoclaves may be affected. Because of the physical layout of the autoclaves and the smoke detector heads in the X-342 and X-344 buildings, an autoclave smoke detector alarm circuit in either of these two buildings is required to have both smoke detector heads operable in order to be considered operable. Other smoke detectors (and their associated alarm circuits) located in these facilities but not physically above the autoclaves are not covered by this TSR and shall not be used to satisfy the LCO requirements [SAR Section 3.8.7.3].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.21 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.12 Liquid UF₆ Handling Cranes

APPLICABILITY: Autoclave Operational Mode I

LCO: Cranes shall be operable prior to lifting a cylinder containing liquid UF₆.

ACTIONS:

Condition	Required Actions	Completion Time
A. Crane inoperable (hoist brakes, upper/lower limit switches, hook, cable)	A.1 Tag crane out of service	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to first time use during shift	SR 2.1.3.12.1 Perform Operator functional crane inspection of: hoist, trolley, bridge, stop button and upper limit switch
Annually	SR 2.1.3.12.2 Perform load test (100% of rated capacity) and verify that the crane does not allow a load to move (except for compensatory movements) upon operator release of the controls.
Monthly	SR 2.1.3.12.3 Perform OSHA required monthly hands on inspection
Annually	SR 2.1.3.12.4 Perform OSHA required annual hands on inspection

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.22 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.12 Liquid UF₆ Handling Cranes (continued)

BASIS:

Failure of the crane lifting components or load braking system while lifting a liquid UF₆ cylinder could result in the uncontrolled dropping of the cylinder resulting in the rupture of the cylinder and the release of up to 28,000 pounds of UF₆. The assurance of operability is provided by the ongoing inspection and tests and enhanced by the configuration management program that addresses component quality and change control [SAR Section 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15]. The OSHA test requirements are contained in 29 CFR 1910. Compensatory movements are small additional movements due to momentum after the crane drive mechanism stops and brakes are applied. These compensatory movements have no safety significance.

DELETE

DELETE

SECTION 2.1 - SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.23 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.13 Pigtail Line Isolation

APPLICABILITY: Autoclave Operational Modes II, III, IV, V, VI

LCO: Pigtail line isolation system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
A. Parent cylinder safety valve, manifold/feed containment valve and/or daughter cylinder safety valve inoperable	A.1 Shut daughter cylinder valve AND	Immediately
	A.2 Place autoclave in Mode VII	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.1.3.13.1 Perform channel functional test to verify that the pigtail isolation valves will close when the manual pushbutton is actuated.

BASIS:

Failure of the sample/transfer manifold or pigtail during the sample/transfer operation would result in a UF₆ release. Operation of the pigtail isolation system to close the isolation valves would minimize the quantity of UF₆ released. In the event of a UF₆ release the manual actuation of a remote push-button is required to initiate the closure of the isolation valves which eliminate the source of liquid UF₆. Closure time testing for the pigtail isolation valves is accomplished under TSR surveillance requirement 2.1.3.5.1. The SAR accident analysis assumes that for pigtail line failures the pigtail isolation valves close within 30 seconds after actuation of the system. [SAR Sections 3.8.2.2, 3.8.5.2, 4.3.2.2.4, and 4.3.2.2.10].

DELETE

DELETE

SECTION 2.1 ~~SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES~~

2.1.24 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

2.1.3.14 ~~Liquid UF₆ Movement~~

APPLICABILITY: Autoclave Operational Mode I

LCO: Cylinders containing liquid UF₆ shall be moved by overhead cranes or scale carts.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to cylinder movement by forklift or straddle carrier	SR 2.1.3.14.1 Verify the cylinder cooling time for solidification has been met

BASIS:

A liquid UF₆ release is significantly more severe than a release from a solid UF₆ source. Equipment reliability of straddle carriers and forklifts and road traffic conditions increase the risk of having a liquid UF₆ release. The handling of liquid UF₆ cylinders with cranes or scale carts is more reliable and therefore represents a lower risk. In the event a cylinder containing solid UF₆ is dropped, while the cylinder integrity may be compromised the rate of escaping UF₆ is sufficiently low enough to limit the release to several pounds upon taking emergency actions. SAR Section 3.2.4.5 provides the general guidelines used in determining UF₆ solidification [SAR Sections 3.8.6.2, 3.8.6.3, 4.3.2.2.4, and 4.3.2.2.15].

Solidification Criteria

- 48-inch cylinders containing less than 4000 pounds of liquid UF₆ must cool for at least 24 hours.
- 48-inch cylinders containing 4000-8000 pounds of liquid UF₆ must cool for at least 48 hours.
- 48-inch cylinders containing more than 8000 pounds of liquid UF₆ must cool for at least 5 days.
- 30-inch cylinders (all assumed to be filled to limit) must cool for at least 3 days.
- 5-inch, 8-inch, and 12-inch cylinders must cool for at least 24 hours.

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.25 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.15 Receiving Cylinder Fill Weights

APPLICABILITY: Autoclave Operational Mode IV

LCO: Receiving UF₆ cylinder fill weight shall be ≤ standard fill weight given in the table below.

Size Code	Description	Standard Fill Limit
1S	1S sample bomb	454 g
2S	2S sample bomb (unstamped)	2175 g
2S	2S sample bomb (stamped)	2200 g
5L	5 inch Aluminum	55 lbs (24,947 g)
5S	5 inch Steel	55 lbs (24,947 g)
5A	5 inch Monel	54.9 lbs (24,902 g)
5B	5 inch Nickel	54.9 lbs (24,902 g)
8H	8 inch Helium	245.00 lbs
8S	8 inch Steel	245 lbs (111.130 kg)
8A	8 inch Monel	255 lbs (115.665 kg)
10	10 inch	350 lbs (158.756 kg)
12A	12 inch, 1 valve (¾ inch)	460 lbs (208.651 kg)
12MD	12 inch, 2 valve (1 inch)	460 lbs (208.651 kg)
12FN	12 inch, 2 valve (1 inch)	430 lbs (195.0 kg)
12B	12 inch, 2 valve (¾ inch)	460 lbs (208.651 kg)
30A	2.5 TON	4950 lbs
30B	2.5 TON	5020 lbs
48A 1-5000	10 TON HW	21,030 lbs
48X	10 TON HW DELETE	21,030 lbs

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.26 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.15 Receiving Cylinder Fill Weights (continued)

LCO (continued):

Size Code	Description	Standard Fill Limit
48B(T) 5001-9230	10 TON TW	20,700 lbs
48F 9231-9660	14 TON HW	27,030 lbs
48Y 9661-9999	14 TON HW	27,560 lbs
48G(OM) 111820-below	14 TON TW	26,070 lbs
48G(OM) 111821-above	14 TON TW	28,000 lbs
48G(HX) 150001-151000	14 TON TW	27,030 lbs
48G(H) 151001-15XXXX	14 TON TW	27,030 lbs

ACTIONS:

Condition	Required Actions	Completion Time
A. Fill weight > Standard fill weight	A.1 Remove excess UF ₆ according to LCO 2.1.3.8 Required Actions	NA
B. Fill weight > Standard fill weight and cylinder shipped	B.1 Notify receiver of overfilled condition	12 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each receiving cylinder disconnection	SR 2.1.3.15.1 Verify final cylinder fill weight as specified by the standard fill limit.

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

**2.1.27 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.1.3.15 Receiving Cylinder Fill Weights (continued)

BASIS:

A safe fill limit must accommodate the internal volume of the cylinder, the density of the UF₆ at a specific temperature and an allowance for ullage or the gas volume above the liquid in the cylinder. The standard fill weight is based on providing a 5% ullage or void volume at a heating temperature of 250 °F [SAR Sections 3.8.6.1, 4.3.2.2.2, 4.3.2.2.6, 4.3.2.2.14, and 4.3.2.2.15].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.28 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.16 UF₆ Cylinder Crane Movement

APPLICABILITY: Autoclave Operational Mode I

LCO: No UF₆ cylinder shall be moved over another cylinder if one of the cylinders contains liquid UF₆.

ACTIONS:

Condition	Required Action	Completion Time
A. UF ₆ cylinders lifted one over the other when at least one of the cylinders contains liquid UF ₆ .	A.1 Move the lifted cylinder such that the LCO statement is satisfied.	Immediately

BASIS:

The cylinder drop and puncture scenarios in the accident analysis involving liquid UF₆ cylinders assume a release source term of 28,000 pounds of UF₆. The prohibition of lifting one cylinder over another if one of the cylinders contains liquid UF₆ preserves the accident analysis assumption of only one cylinder contributing to the release source term. [SAR Section 4.3.2.2.15].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.29 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.17 UF₆ Cylinder Weight Discrepancy

APPLICABILITY: Autoclave Operational Mode IV

LCO: UF₆ cylinders shall not be filled with UF₆ when there is > 40 pound discrepancy between shipper UF₆ cylinder weight and received cylinder weight until the weight discrepancy is explained.

ACTIONS:

Condition	Required Actions	Completion Time
A. UF ₆ cylinder weight discrepancy > 40 pounds between shipper UF ₆ cylinder weight and received cylinder weight	A.1 Reject the cylinder AND	Immediately
	A.2 Verify the reason for the weight discrepancy	Prior to removal of the rejection tag

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entry of UF ₆ into the cylinder	SR 2.1.3.17.1 Verify difference between shipped UF ₆ cylinder weight and received UF ₆ cylinder weight is ≤ 40 pounds

BASIS:

Liquid UF₆ will react explosively with hydrocarbon oil. The filling of a UF₆ cylinder that contains hydrocarbon oil with liquid UF₆ could result in the over pressuring of the cylinder to the point of its rupturing. The amount of UF₆ release could be as high as 28,000 lbs. of UF₆. Verification (by weight difference) that no unknown materials have been added to a UF₆ cylinder while in transit between plant or building cylinder handling operations conducted just prior to filling the cylinder with UF₆ increases the assurance that the cylinder does not contain any materials violently reactive with UF₆ [SAR Sections 4.3.2.2.10 and 4.3.2.2.11].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.30 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.18 UF₆ Plugs

APPLICABILITY: Operational Modes: All

LCO: Direct heat sources shall not be applied to solid UF₆ plugs until line clarity in the system has been assured.

ACTIONS:

Condition	Required Actions	Completion Time
A. Direct heat source being applied to a solid UF ₆ plug	A.1 Discontinue direct heat application to the UF ₆ plug AND	Immediately
	A.2 Ensure line clarity	Prior to reapplying direct heat

BASIS:

The application of an external heat source directly to a UF₆ plug can liquify the UF₆ within the center of the plug and thereby cause sufficient hydraulic forces to rupture the pipe containing the plug. The primary concern over the direct application of heat (i.e., steam tracing, heat tape, etc.) to the plug versus indirect heating (i.e., heated housings) is due to the fact that the energy is added to the plug at such a high rate that it is not evenly distributed over the entire plug and therefore does not allow for the sublimation of the plug before a portion of it liquefies. The secondary concern is that even though the UF₆ plug stays as a solid it must have room to expand. The consequences of a release of UF₆ from this type of failure mechanism would be minimal due to the fact that the UF₆ plug would remain as a solid and therefore, the release rate would be slow as the UF₆ sublimates into the atmosphere.

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343 AND X-344 FACILITIES

2.1.31 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.19 X-343 Cold Trapping Material Containing Intermediate Weight Gases

APPLICABILITY: X-343 Cold Trapping Operation

LCO: When cold trapping gas mixtures containing ClF_3 and greater than 2 mole % R-114 the following requirements apply to the cold traps:

1. R-114 concentration shall not exceed 5.85 mole %
2. Cold trap pressure shall not exceed 9.5 psia
3. Cold trap temperature shall not be lower than -73°F

ACTIONS:

Conditions	Required Actions	Completion Time
A. R-114 concentration greater than 5.85 mole % in cold trap(s)	A.1 Close cold trap inlet valve	Immediately
B. Cold Trap pressure greater than 9.5 psia	B.1 Decrease cold trap pressure to ≤ 9.5 psia OR Close cold trap inlet valve	Immediately
C. Cold Trap temperature lower than -73°F	C.1 Increase cold trap temperature to -73°F OR Close cold trap inlet valve	Immediately

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343 AND X-344 FACILITIES

2.1.32 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.19 X-343 Cold Trapping Material Containing Intermediate Weight Gases (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to cold trapping gas mixtures	SR 2.1.3.19.1 Analyze gas mixtures for R-114 concentration OR Ensure gas mixtures have been properly diluted.
Prior to first time use during shift and shiftly thereafter while in operation.	SR 2.1.3.19.2 Monitor cold trap pressure and temperature (Max. cycle pressure in batch mode).

BASIS:

A mixture of ClF₃ and R-114 in the proper proportions can react and create a pressure excursion, if exposed to an ignition source. Pressure excursions in the X-343 cold traps are avoided because there is no credible ignition source associated with the cold trap operation and the R-114 concentration in the gas entering the cold traps is limited to less than that required to liquefy and accumulate in the traps. Limiting cold trap pressure and temperature parameters prevents liquefaction of the R-114, which could accumulate the R-114 in the cold trap, and pose the potential for a pressure excursion. The shiftly surveillance is adequate since temperature and pressure parameters must significantly exceed the LCO values before R-114 will liquify. The parameters will be initially established prior to cold trapping and maintained there after by control systems. In addition, an ignition source would still be required to initiate the reaction between any liquified components.

The limiting condition for operation requirements are not applicable to the X-344 cold trap operation because incoming cylinders that could contain increased levels of R-114 and ClF₃ are first processed in X-343 to reduce these intermediate weight gases to below a safe level.

When the gas mixtures are not analyzed prior to cold trapping, diluting the gas mixtures with plant dry air will reduce the R-114 concentration to a safe value. Based on statistical analysis of actual product data and applying worse case conditions, there is a 99.96% confidence level that diluting the gas mixture by pressuring the surge volume to at least 50 psia with plant dry air will ensure that the R-114 concentration remains below 5.85 mole%.

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.33 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.20 High Pressure Fire Water System (X-343 facility only)

APPLICABILITY: Autoclave Operational Modes I through VIII, when a filled or partially filled UF₆ Cylinder is located within the building.

LCO: The high pressure fire water system shall be operable.

ACTIONS: Note: TSR 1.6.22 (d) does not apply

Condition	Required Actions	Completion Time
A. < 3,700 gpm flow capability at individual sprinkler system or individual sprinkler system inoperable	A.1 Halt hot work activities in the affected area AND	Immediately
	A.2 Restore water flow capability AND	4 Hours
	A.3 Obtain special Fire Services approval, provide portable fire suppression equipment and a continuous fire watch	Prior to resuming any hot work activities in the affected area
B. Condition A.2 required actions and/or completion time not accomplished	B.1 Initiate fire patrols every 4 hours for the affected area AND	4 Hours
	B.2 Initiate expediated repairs to restore water supply capability	Immediately

DELETE

DELETE

~~SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES~~

~~2.1.34 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.1.3.20 High Pressure Fire Water System (continued)~~

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Annually	SR 2.1.3.20.1 Functionally test sprinkler system at the Inspection Test Valve (ITV) for sustained water flow.
Annually	SR 2.1.3.20.2 Verify sprinkler system control valves are in the desired position by viewing the "post indicator" on the valve. AND Operate the valves (except those that are planned to be closed) and verify the actuation of the supervisory alarm. AND Verify valve is left in open position by "drain" test.

~~BASIS:~~

~~The fire protection system is provided to mitigate a fire that could cause structural damage to roof purlins, trusses and columns followed by localized collapse of the roof with potential onsite and off-site consequences due to the breach of the UF₆ containment boundary and the resulting UF₆ release. Surveillances for the fire water pump testing are addressed in TSR 2.2.3.4 (for the Cascade) and apply to those pumps relied upon to meet required flow rate of 3,700 gpm. These systems are designed to meet the intent of the insurance industry "improved risk" criteria as interpreted by the Authority Having Jurisdiction (AHJ) as described in SAR Section 5.4 [SAR Sections 3.8.7.2 and 4.3.2.2.16].~~

DELETE

DELETE

~~SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES~~

~~2.1.35 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.1.3.21 Autoclave Locking Ring Interlock System~~

~~**APPLICABILITY:** Autoclave Operational Modes II, IV, and VI (for autoclaves that do not have an interlock feature incorporated into the autoclave shell high pressure containment shutdown system)~~

~~**LCO:** The autoclave locking ring interlock system shall be operable~~

~~**ACTIONS:**~~

Condition	Required Action	Completion Time
A. Detection-initiating channel is inoperable	A.1 Verify that autoclave internal pressure is < 15 psig. AND	Prior to equalizing and opening the autoclave shell.
	A.2 Restore operability Note: The current operating cycle may be completed	Prior to initiating a new operating cycle.

~~**SURVEILLANCE REQUIREMENTS:**~~

Frequency	Surveillance
Quarterly	SR 2.1.3.21.1 Perform a channel functional test of the autoclave locking ring interlock system to provide assurance that the system prevents the hydraulics from opening the autoclave when internal pressure is \geq 15 psig.
Annually	SR 2.1.3.21.2 Perform a channel calibration of the detection-initiation channel.

~~**BASIS:**~~

~~The autoclave locking ring interlock system prevents opening of the autoclave shell when pressure exceeds a specified value. SAR accident analysis assumes that an autoclave containment isolation signal is not inadvertently overridden following an accident. For autoclaves that do not have an interlock feature incorporated into the autoclave shell high pressure containment shutdown system,~~

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.36 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.3.21 Autoclave Locking Ring Interlock System

BASIS (continued)

the autoclave locking ring interlock system is assumed to accomplish this function. The 15 psig value specified in this TSR is based on the autoclave shell high pressure containment system actuation limit. The autoclave locking ring interlock system also provides an equipment and personnel safety function, and typically utilizes a more conservative setpoint of approximately 0.5 psig to accomplish this function. Following modifications to the autoclaves, this interlock feature will be incorporated into all autoclave high pressure containment shutdown systems. [SAR Sections 3.8.2.8, 3.8.5.8, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.13, and 4.3.2.2.14].

DELETE

DELETE

~~SECTION 2.1 **SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES**~~

~~2.1.37 **GENERAL DESIGN FEATURES**~~

~~2.1.4.1 **UF₆ Cylinder Lifting Fixtures**~~

~~DF: UF₆ cylinder lifting fixtures are designed with a safety factor of 5 to 1.~~

~~**SURVEILLANCE:**~~

Frequency	Surveillance
Annually	SR 2.1.4.1.1 Perform load test at a minimum of 100% rated capacity
Prior to first time use during shift	SR 2.1.4.1.2 Perform inspection of cylinder lifting fixture

~~**BASIS:**~~

~~Lifting fixtures used to handle liquid filled UF₆ cylinders are credited for prevention of the liquid cylinder drop and rupture accident scenario [SAR Sections 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15].~~

~~2.1.4.2 **UF₆ Cylinders**~~

~~DF: Large UF₆ (2.5 Ton and greater) cylinders are as a minimum designed to a MAWP of 100 psig~~

~~**SURVEILLANCE:**~~

Frequency	Surveillance
5 Year	SR 2.1.4.2.1 Perform hydrostatic test on large UF ₆ cylinders with the following exception; cylinders that are full of UF ₆ but have an expired hydrostatic test date may be heated for removal of the UF ₆ but shall be hydrostatic tested prior to refilling.
Prior to cylinder filling or heating	SR 2.1.4.2.2 Inspect cylinder for defects

~~**BASIS:**~~

~~UF₆ cylinder MAWP \geq 100 psig is a basic assumption in the accident analysis and relates to the overall structural integrity of the UF₆ containment barrier [SAR Sections 3.8.6.1, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.6, 4.3.2.2.7, 4.3.2.2.9, 4.3.2.2.10, and 4.3.2.2.14].~~

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRS FOR X-342, X-343, AND X-344 FACILITIES

2.1.4 GENERAL DESIGN FEATURES

2.1.4.3 UF₂ Cylinder Pigtails

DF: Newly fabricated pigtails are designed to withstand at least 400 psig

SURVEILLANCE:

Frequency	Surveillance
Prior to initial use	SR 2.1.4.3.1 Inspect and perform hydrostatic test at least to 400 psig and ensure inspection tag is attached to the pigtail.

BASIS:

Structural integrity of the pigtail significantly reduces the likely hood of a catastrophic rupture [SAR Sections 3.8.2.4, 3.8.5.4, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.6, 4.3.2.2.7, 4.3.2.2.9, 4.3.2.2.10, and 4.3.2.2.13].

2.1.4.4 X-342 Condensate Sump and Oil Interceptor

DF: Condensate sump and oil interceptor shall contain Borosilicate glass Raschig Rings

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.1.4.4.1 Verify that the surveillance requirements contained in ANSI Standard 8.5 are satisfied.

BASIS:

X-342A sump and oil interceptor are of an unfavorable geometry and Raschig rings are used to enhance criticality prevention [SAR Section 5.2, Appendix A, sections 2.3 and 2.4].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.5 GENERAL DESIGN FEATURES

2.1.4.5 Autoclave Shell

DF: The autoclave shell Maximum Allowable Working Pressure (MAWP) shall be at least 150 psig.

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.1.4.5.1 Perform visual inspection of autoclave shell and head according to the National Board Inspection Code U-110.1 Inspection of Shells and Heads.

BASIS:

The autoclave shell, valves and external piping out to the second isolation valve were credited in the cylinder rupture inside an operating autoclave scenario for containing the reaction products resulting from the release and its reaction with autoclave steam and water [SAR Sections 3.8.2.3, 3.8.5.3, 4.3.2.2.2, 4.3.2.2.4, 4.3.2.2.6, 4.3.2.2.7, 4.3.2.2.9, 4.3.2.2.10, 4.3.2.2.13, and 4.3.2.2.14].

2.1.4.6 Overhead Crane Capacity

DF: Cranes that transport cylinders containing liquid UF₆ are designed with a minimum lifting capacity of 18 tons.

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.1.4.6.1 Perform surveillance in accordance with SR 2.1.3.12.2.

BASIS:

Cranes used to handle liquid UF₆ cylinders are credited for prevention of a liquid cylinder drop and rupture [SAR Sections 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15].

DELETE

DELETE

SECTION 2.1 SPECIFIC TSRs FOR X-342, X-343, AND X-344 FACILITIES

2.1.6 GENERAL DESIGN FEATURES

2.1.4.7 Liquid UF₆ Cylinder Handling Scale Carts

DF: The scale carts that carry liquid UF₆ cylinders are designed and maintained not to fail in a manner to cause primary system integrity failure.


SURVEILLANCE:

Frequency	Surveillance
Biennially	SR 2.1.4.7.1 Perform a visual inspection of the scale cart for structural damage.

BASIS:

The scale carts are designed and maintained to handle weight loads appropriate for their usage to minimize the potential of cylinder failure during handling of cylinders containing greater than 500 lbs of liquid UF₆. [SAR Sections 3.8.6.3, 4.3.2.2.4, and 4.3.2.2.15]

DELETE

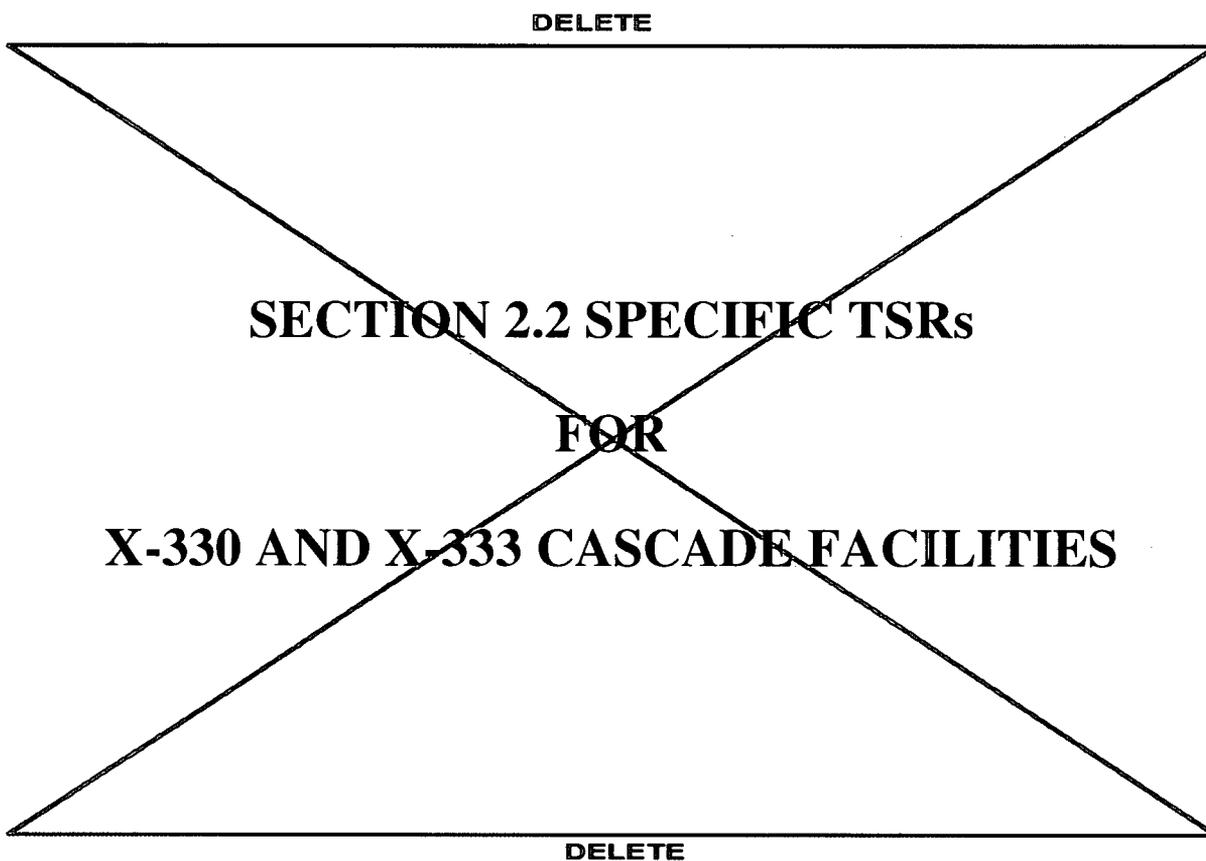

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

1.2.7 X-330/X-333 CASCADE OPERATIONAL MODES

I	Startup/Checkout	Cell/equipment motors ready to be energized, cell/equipment being made ready for startup
II	Operating	Motors energized and cell/equipment pressurized with UF ₆ to > Cascade minimum suction pressure
III	Standby	Motors energized, UF ₆ at ≤ Cascade minimum suction pressure
IV	Treatment	Cell/equipment isolated from Cascade, initial charge of CLF ₃ /F ₂ placed into cell/equipment
V	Floating	Motors de-energized and isolation block valve(s) open and UF ₆ pressure ≥ Cascade Minimum Suction Pressure
VI	Shutdown	Cell/equipment motors de-energized, block/boundary valve(s) closed.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

1.2.8 SAFETY LIMITS

APPLICABILITY: All Cascade Operational Modes

2.2.2.1 SL: Coolant pressures shall not exceed values in Table 1

BASIS:

Overpressurization and rupture (multiple tubes) of the coolant system into the UF₆ system could result in the subsequent release of UF₆ due to overpressurization of the UF₆ enrichment system. The Safety Limit has been established at 110% of the MAWP based on the ASME Pressure Vessel Code, Division I, Section VIII. While not directly applicable to this application, the 110% overpressurization value does indicate that there is a high degree of confidence that the vessel pressure boundary will not fail at 110% of the stated MAWP.

APPLICABILITY: All Cascade Operational Modes (except during maintenance)

2.2.2.2 SL: Cascade pressures shall be \leq 40 psia for X-31 (except 31-1-odd) and X-33 sized equipment.

Cascade pressures shall be \leq 16 psia for X-31-1-odd and X-29 sized equipment.

BASIS:

Overpressurization and rupture of the cascade system could result in a release of UF₆ to the cell housing and potentially to the atmosphere. For uprated equipment the safety limit is based on a postulated cascade system rupture pressure of 40 psia. This value is less than 110% of the design pressure of the limiting uprated cascade system components, the rupture of which could release significant quantities of UF₆. The only exception is the compressor seals which have been tested to a pressure greater than 40 psia. Given the highest system operating pressure of 25 psia, there is reasonable assurance that the cascade system will remain below this safety limit during anticipated transients.

DELETE

DELETE

SECTION 2.2 ~~SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

2.1.7 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

2.2.3.1 ~~Coolant High Pressure Relief System~~

APPLICABILITY: Cascade Operational Modes II and III

LCS: ≤ Coolant pressure listed in Table 1:

TABLE 1

Coolant System Overpressure Protection		
Equipment	Limiting Control Setting	Safety Limit
X-33	330 psig	363 psig
X-31	330 psig	363 psig
X-29	400 psig	440 psig
X-330 A Booster	400 psig	440 psig
X-333 A & B Boosters	400 psig	440 psig
X-326 A Booster	400 psig	440 psig
X-330 & X-333 EBSs	400 psig	440 psig

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.1 Coolant High Pressure Relief System (continued)

LCO: Coolant high pressure relief system shall be operable.

ACTIONS:

Conditions	Required Actions	Completion Time
B. Rupture disk inoperable	A.1 Place cell/equipment in Mode VI	30 Minutes
B. Cavity between double rupture disks blocked	B.1 Restore vent to atmosphere	8 Hours
C. Isolation block valve closed and/or seal broken	C.1 Open or verify open valve AND	Immediately
	C.2 Reseal valve	8 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Annually and prior to entering Modes II or III from either Modes I, IV, or VI	SR 2.2.3.1.1 Verify isolation block valve sealed open and cavity between rupture disks, if present, is vented to atmosphere.

BASIS:

The 1995 ASME Pressure Vessel Code, Division I, Section VIII requires that overpressure relief be provided by a device stamped at or below the MAWP and sized such that the subsequent transient pressure will be limited to a maximum of 110% of MAWP. ASME Code allows rupture disks to have a 5% burst tolerance. Rupture disks stamped at MAWP will therefore burst at or below 105% of MAWP. The LCS is set at 100% of MAWP. To comply with these standards, pressure relief devices are purchased and installed on the Cascade cell coolant condensers with stamped ratings at or below the MAWP [SAR Section 3.8.3.4].

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.2 Criticality Accident (Radiation) Alarm Systems

LCO 2.2.3.2a: Criticality accident detection shall be operable

APPLICABILITY: In areas, equipment, or processes which contain greater than 700 grams of ²³⁵U at an enrichment ≥ 1.0 wt % ²³⁵U.

ACTIONS:

Condition	Required Action	Completion Time
<p>B. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>A.1 Implement the following for areas, equipment, or processes applicable to this LCO and that are not otherwise covered by criticality accident detection.</p> <p>A.1.1 Discontinue cell maintenance activities that require breach of the containment boundary of cells containing UF₆ enriched to ≥ 1 wt % ²³⁵U. <u>AND</u></p> <p>A.1.2 Monitor temperatures/pressures in the cascade cells containing UF₆ enriched to ≥ 1 wt % ²³⁵U hourly to maintain UF₆ in the gaseous state. <u>AND</u></p> <p>A.1.3 Waste containing uranium enriched to ≥ 1 wt % ²³⁵U shall not be handled. <u>AND</u></p> <p>A.1.4 Wet air pumps shall not be used for evacuation of cells containing UF₆ enriched to ≥ 1 wt % ²³⁵U. <u>AND</u></p> <p>A.1.5 Monitor temperature and pressure of surge drums containing UF₆ enriched to ≥ 1 wt % ²³⁵U hourly to maintain inventory in gaseous state. <u>AND</u></p> <p>A.1.6 Place freezer/sublimers containing UF₆ enriched to ≥ 1 wt % ²³⁵U in mode F/S III, F/S IV, or F/S V. <u>AND</u></p> <p>A.2.1 Evacuate the area not covered by detection capability. <u>AND</u></p> <p>A.2.2 Restrict access to area evacuated in A.2.1. <u>AND</u></p> <p>A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification such as a device that will alarm on sensing a 10mr/hr dose rate.</p>	<p>Immediately</p> <p>Immediately</p> <p>Immediately</p>
<p>B. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>B.1.1 Restore criticality accident detection by installing portable CAAS unit providing required criticality accident detection and same alarms as fixed unit. <u>OR</u></p> <p>B.1.2 Restore criticality accident detection to operable status.</p> <p>TSR 1.6.2.2(d) is not applicable</p>	<p>48 Hours</p> <p>48 Hours</p>

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.2 Criticality Accident (Radiation) Alarm System (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.2.3.2.1 Calibrate radiation clusters to a set point of 5 mRad/hr. in air.
	SR 2.2.3.2.2 Verify that the cluster nitrogen horn and X-300 alarm sounds when two out of three channels in a cluster are tripped.
Quarterly	SR 2.2.3.2.3 Verify nitrogen supply pressure is at least 900 psig for each CAAS horn.

BASIS:

Each cluster consists of three neutron-sensitive detection units. Clusters are designed and calibrated to detect and alarm on a minimum credible criticality accident of concern, defined as producing an integrated total dose of 20 Rads. in one minute at two meters from the reacting material. This system will provide an audible signal in the event of a criticality that will alert personnel to evacuate the immediate work areas. The minimum acceptable length of time for the CAAS horn to sound is 2 minutes. [SAR Sections 3.8.7.1 and 4.3.2.6].

DELETE

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.3 CADP UF₆ Smoke Detection System~~

~~APPLICABILITY: Cascade Operational Mode II, above atmospheric pressure~~

~~LCO: 50% of the installed CADP UF₆ smoke detection heads shall be operable within each cell, bypass housing, tie line and booster station operating above atmospheric pressure.~~

~~ACTIONS: Note: TSR 1.6.2.2(d) does not apply~~

Condition	Required Actions	Completion Time
B. Less than two smoke detectors operable in: Cell or Bypass Housing or Tie Line or Booster Station	A.1 Provide continuous smoke watch at affected area. OR	1 Hour
	A.2 Reduce cell/equipment pressure below atmospheric pressure or exit Mode II	2 Hours
B. CADP computer inoperable	B.1 Place affected smoke detectors in manual operation	Immediately

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Monthly	SR 2.2.3.3.1 Perform test of operable smoke detectors to verify that the smoke detectors have provided an alarm condition in the ACR.
Shiftly	SR 2.2.3.3.2 Channel check the smoke detector heads.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

**2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION,
SURVEILLANCES**

2.2.3.3 CADP UF₆ Smoke Detection System (continued)

BASIS:

In the event of a UF₆ release in a cell, bypass housing, tie-line or booster station, an alarm will sound in the ACR notifying operating personnel that immediate investigation and action must occur. The CADP system is sensitive enough to detect very minor out gassings of UF₆ and therefore will provide operators sufficient time to take any actions necessary to minimize the amount of UF₆ released [SAR Sections 3.8.7.3, 4.3.2.1.1, 4.3.2.1.2, 4.3.2.1.3, and 4.3.2.1.7].

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.4 High Pressure Fire Water System

APPLICABILITY: Cascade Operational Modes I through VI, Mode VI is not applicable when the lube oil is valved off or removed from the cells covered by a specific sprinkler system.

LCO: The high pressure fire water system shall be operable.

ACTIONS: Note: TSR 1.6.2.2 (d) does not apply

Condition	Required Actions	Completion Time
B. No water flow capability at individual sprinkler system	A.1 Halt hot work activities in the affected area AND	Immediately
	A.2 Restore water flow capability	4 Hours
	A.3 Obtain special Fire Services approval, provide portable fire suppression equipment and a continuous fire watch	Prior to resuming any hot work activities in the affected area
B. Condition A.2 required actions and/or completion time not accomplished	B.1 Initiate fire patrols every 4 hours for the affected area	4 Hours
C. $\leq 16,000$ gpm but $\geq 4,000$ gpm available for 4 hours	C.1 Restore water supply capability	8 Hours
D. Condition C required actions and/or completion time not accomplished	D.1 Initiate expedited repairs to restore water supply capability	Immediately
E. $< 4,000$ gpm available for 4 hours	E.1 Initiate expedited repairs to restore water supply capability AND	Immediately
	E.2 Halt hot work activities in the affected area AND	Immediately
	E.3 Initiate fire patrols every 4 hours for the affected areas	4 Hours

DELETE

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.4 High Pressure Fire Water System (continued)~~

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Monthly	SR 2.2.3.4.1 Manually start electric and diesel fire water pumps
Monthly	SR 2.2.3.4.2 Verify X-640-2 Fire Water Storage Tank contains at least 270,000 gallons of water (filled to at least 90% of capacity).
Monthly	SR 2.2.3.4.3 Verify adequate diesel supply for diesel fire water pumps in X-640-1 and X-6644 pumphouses.
Annually	SR 2.2.3.4.4 Functionally test sprinkler system at the Inspection Test Valve (ITV) for sustained water flow
Annually	SR 2.2.3.4.5 Simulate automatic start of electric fire water pumps
Annually	SR 2.2.3.4.6 Verify electric and diesel fire water pump flow is $\geq 90\%$ of their rated capacity
Annually	SR 2.2.3.4.7 Verify sprinkler system control valves are in the desired position by viewing the "post indicator" on the valve. AND Operate the valves (except those that are planned to be closed) and verify the actuation of the supervisory alarm. AND Verify valve is left in open position by "drain" test.
Annually	SR 2.2.3.4.8 Visually inspect the exterior of X-640-2 Fire Water Storage Tank.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.4 High Pressure Fire Water System (continued)

BASIS:

The fire protection system is provided to mitigate a fire that could cause structural damage to roof purlins, trusses and columns followed by localized collapse of the roof with potential onsite and off-site consequences due to the breach of the UF₆ containment boundary and the resulting UF₆ release. Surveillances for fire water pump testing apply to those pumps relied upon to meet required flow rates. These systems are designed to meet the intent of the insurance industry "improved risk" criteria as interpreted by the Authority Having Jurisdiction (AHJ) as described in SAR Section 5.4. The sprinkler system will minimize the potential for, and mitigate the effects of a large fire. The fire water system flow requirement is conservative with respect to the system evaluation presented in the SAR. [SAR Sections 3.8.7.2 and 4.3.2.1.9].

DELETE

DELETE

SECTION 2.2 - SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.5 Coolant Removal

APPLICABILITY: Cascade Operational Mode IV

LCO: Cell and applicable Freezer Sublimator (F/S) coolant systems shall be drained of coolant before addition of oxidants for cell treatment.

ACTIONS:

Condition	Required Actions	Completion Time
3. Failure to drain coolant prior to adding oxidants and there are no indications of a reaction	A.1 Evacuate cell contents	1 Hour
B. Failure to drain coolant prior to adding oxidants and there are indications of a reaction	B.1 Stop cell/equipment motors AND	Immediately
	B.2 Drain coolant	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each cell treatment	SR 2.2.3.5.1 Verify and document the removal of cell coolant prior to the initial charge of oxidants.

BASIS:

In the event of a leak from the coolant system to process, the failure to control the concentrations of coolant and ClF_3/F_2 within the cell can form explosive mixtures that in the presence of an ignition source could over pressure the cell and release toxic materials. The draining of coolant includes the evacuating of the coolant system to between 18 and 30 inches of Hg for the X-27 and X-29 size equipment. The other equipment sizes have no specific coolant evacuation requirement other than for the system pressure to be below atmospheric pressure. The indications of an exothermic reaction are usually rapid pressure spikes and/or a rapid increase in temperature. A leaking block valve between a F/S that has a leaking cooler and the host cell could allow coolant and treatment gases to mix and therefore potentially form a highly exothermic reaction mixture.

DELETE

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.6 Cell Treatment Monitoring~~

~~APPLICABILITY: Cascade Operational Mode IV~~

~~LCO: Cell treatments shall be monitored with an Infrared Analyzer.~~

~~ACTIONS: Note: TSR 1.6.2.2(d) does not apply~~

Condition	Required Actions	Completion Time
B. Infrared Analyzer inoperable	A.1 Initiate sampling for free ClF_3 and the presence of hydrocarbons	30 Minutes
B. Above condition required actions and/or completion time are not accomplished	B.1 Evacuate cell contents	30 Minutes

~~SURVEILLANCE:~~

Frequency	Surveillance
Each cell treatment	SR 2.2.3.6.1 Verify and document the installation of an Infrared Analyzer prior to the initial charge of treatment gas

~~BASIS:~~

~~Failure to maintain an adequate amount of ClF_3 within the cell can lead to the formation of reaction products that will result in highly exothermic reactions upon the re-introduction of ClF_3/F_2 . In addition, the Infrared Analyzer is used to detect the presence of hydrocarbon materials that could also react violently with ClF_3/F_2 under the right conditions. Replacing an inoperable analyzer can take up to three hours. For this reason sampling is initiated within thirty minutes and continued until an operable analyzer is hooked up and operating properly.~~

DELETE

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION,
SURVEILLANCES~~

~~2.2.3.7 Cell Inverse Recycle Treatment~~

~~APPLICABILITY: Cascade Operational Mode IV~~

~~LCO: Individual cells shall be isolated from each other when the cell inverse recycle treatment method is used.~~

~~SURVEILLANCE:~~

Frequency	Surveillance
Each cell inverse recycle treatment	SR 2.2.3.7.1 Verify and document that an inverse recycle treatment cell is not tied together with any other cell prior to the initial charge of treatment gas

~~BASIS:~~

~~Due to the inverse recycle treatment method there is no assurance that an adequate supply of ClF₃ would be present in the second cell tied to the parent cell. The lack of a sufficient amount of ClF₃ allows the formation of ClO₂ on the interior cell surfaces that upon contact with a new supply of ClF₃ will react violently and could cause a breach in the cell containment; thereby releasing toxic materials and spreading contamination.~~

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.8 Seal Exhaust Station Enrichment

APPLICABILITY: Cascade Operational Mode II

LCO: U²³⁵ enrichment at the Seal Exhaust Station system shall not exceed:

ASSAY LIMITATIONS	
AREA I	3% U ²³⁵
AREA II	5% U ²³⁵
AREA III	10% U ²³⁵

ACTIONS:

Condition	Required Actions	Completion Time
B. Enrichment limitation is being exceeded	A.1 Locate source of higher enrichment material entering Seal Exhaust Station and isolate source from the station	8 Hours
B. Required action and completion time not met	B.1 Provide an alternate means of seal exhausting	2 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Shiftly	SR 2.2.3.8.1 Monitor the cascade assay gradient to verify that the LCO limitations have not been exceeded.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.8 Seal Exhaust Station Enrichment (continued)

BASIS:

To process UF₆ with an enrichment greater than the given limitations through the Seal Exhaust Station could result in a criticality involving the Alumina Traps. The Area III seal exhaust station has been analyzed to be safe at an enrichment of 15% U²³⁵. For this event to occur numerous compressor seals are required to be leaking and the alumina traps must trap the minimum mass required at a particular assay for a criticality [SAR Section 5.2, Appendix A, section 1.3].

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.9 Evacuation Booster Station (EBS) Enrichment

APPLICABILITY: Cascade Operational Mode II

LCO: U²³⁵ enrichment within the Evacuation Booster Station shall not exceed:

ASSAY LIMITATIONS		
LOCATION	Seal Exhaust Valved-In	Seal Exhaust Valved-Off
X-330 EBS	10% U ²³⁵	10% U ²³⁵
X-333 EBS	3.0% U ²³⁵	10% U ²³⁵

ACTIONS:

Condition	Required Actions	Completion Time
B. X-330 enrichment limitation is being exceeded	A.1 Isolate the EBS from the higher enrichment source	1 Hour
B. X-333 enrichment limitation exceeded when seal exhaust is valved in	B.1 Valve off seal exhaust AND	Immediately
	B.2 Verify seal exhaust station inlet did not exceed the maximum assay	4 Hours
C. X-333 enrichment limitation exceeded when seal exhaust is valved off	C.1 Isolate the EBS from the higher enrichment source	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to startup	SR 2.2.3.9.1 Determine enrichment of material to be pumped based on cascade location or sampling to ensure LCO limit is not exceeded

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~ ~~DELETE~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.9 Evacuation Booster Station (EBS) Enrichment (continued)~~

~~BASIS:~~

~~The X-330 EBS has been analyzed to be safe at an enrichment of 15% U²³⁵ when the seal exhaust is valved in. Both EBSs are safe up to an enrichment of 54% U²³⁵, assuming the seal exhaust is valved off. Due to the possible interaction of the X-333 EBS via the seal exhaust, the enrichment is limited unless the seal exhaust is valved off, reference DM-620 [SAR Section 5.2, Appendix A, section 1.6].~~

~~DELETE~~

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.10 Crane Movement of Cascade Equipment~~

~~APPLICABILITY: Cascade Operational Modes II & V~~

~~LCO: Area Control Room operator shall know time and travel path of cascade equipment moved overhead of cells.~~

~~ACTIONS:~~

Condition	Required Actions	Completion Time
B. Equipment being moved without prior notification of the ACR operator	A.1 Place equipment on the floor at the first closest location AND	Immediately
	A.2 Inform ACR operator of equipment movement time and travel path	Prior to resuming equipment movement

~~SURVEILLANCE REQUIREMENTS: None~~

~~BASIS:~~

~~In the event a piece of equipment is dropped on a cell/equipment operating above atmosphere the amount of UF₆ released could be reduced significantly by the prompt action to de-energize the motors which reduces the internal pressure of the cell/equipment to below atmosphere, thereby stopping the release of UF₆. An ACR operator that knows the travel path of the equipment could respond more quickly to the affected location upon receiving less than specific indications of a major problem [SAR Section 4.3.2.1.8].~~

DELETE

DELETE

SECTION 2.2 ~~SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES~~

2.1.3 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

2.2.3.11 ~~Evacuation Booster Station Oxidant Limit~~

APPLICABILITY: Cascade Operational Mode II

LCO: EBS shall not pump material with a ClF_3 and/or F_2 concentration ≥ 8 mole %.

ACTIONS:

Condition	Required Actions	Completion Time
B. ClF_3/F_2 concentration exceeded	A.1 Close EBS suction valve and evacuate	30 Minutes

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to transfer of material containing ClF_3/F_2	SR 2.2.3.11.1. Review sample or infrared analyzer results of material to be pumped to ensure LCO is not exceeded

BASIS:

Failure to control the concentrations of ClF_3/F_2 within the EBS could result in highly reactive mixtures if there was a simultaneous coolant leak in the EBS cooler. The resultant mixture in the presence of an ignition source could over pressure the EBS and cause the spread of contamination.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.12 UF₆ Plugs

APPLICABILITY: Operational Modes: All

LCO: Direct heat sources shall not be applied to solid UF₆ plugs until line clarity in the system has been assured.

ACTIONS:

Condition	Required Actions	Completion Time
B. Direct heat source being applied to a solid UF ₆ plug	A.1 Discontinue direct heat application to the UF ₆ plug	Immediately
	AND A.2 Ensure line clarity	Prior to reapplying direct heat

BASIS:

The application of an external heat source directly to a UF₆ plug can liquify the UF₆ within the center of the plug and thereby cause sufficient hydraulic forces to rupture the pipe containing the plug. The primary concern over the direct application of heat (i.e., steam tracing, heat tape, etc.) to the plug versus indirect heating (i.e., heated housings) is due to the fact that the energy is added to the plug at such a high rate that it is not evenly distributed over the entire plug and therefore does not allow for the sublimation of the plug before a portion of it liquefies. The secondary concern is that even though the UF₆ plug stays as a solid it must have room to expand. The consequences of a release of UF₆ from this type of failure mechanism would be minimal due to the fact that the UF₆ plug would remain as a solid and therefore, the release rate would be slow as the UF₆ sublimates into the atmosphere.

DELETE

DELETE

SECTION 2.2 - SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.13 Cascade Pressure Limitation

APPLICABILITY: Cascade Operational Modes II and V

LCO: Cascade cell high side pressures shall be ≤ 25 psia for X-31 (except 31-1-odd) & X-33 size cells, and cascade cell high side pressures shall be ≤ 14.45 psia for 31-1-odd and for X-29 size cells.

ACTIONS:

Condition	Required Actions	Completion Time
B. Cascade cell pressure discovered $>$ LCO value for specified cell size	A.1 Reduce cell pressure to \leq the LCO value for the specified cell size	Immediately

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.2.3.13.1 Verify that each cell is operating at \leq the LCO value for the specified cell size
Prior to cascade physical inventory	SR 2.2.3.13.2 Calibrate the cell datum when utilized in place of the unit datum
Annually	SR 2.2.3.13.3 Calibrate the unit datum

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.13 Cascade Pressure Limitation (continued)

BASIS:

The accident analysis provided in SAR Section 4.3.2 assumes that cascade high pressure accidents proceed to their conclusion which, in many cases, results in some form of breach in the cascade system. It is at this point that the consequences are evaluated and the identification of any mitigating actions takes place. The cascade was not designed to directly measure cell pressures in the ACR or to measure pressures that approach 40 psia. Motor load and other process indicators in the ACR alert the operator to significant cascade transients which require appropriate actions to be taken, including cell shutdown, to preclude cascade pressures from exceeding 40 psia which is the postulated rupture pressure of cascade piping. The monitoring of cell pressures from the local cell panels is sufficient to ensure that the steady state pressures do not exceed 25 psia. Due to the ability to perform a channel check across the 8 to 10 stage pressure indicating controllers (PICs) per cell and the fact that within an operating cell any stage high side pressure increase will quickly cascade through the cell (i.e., raise the other stage high side pressure), it is not necessary that all the PICs are functional to determine the cell pressure. The calibration of the unit and cell datums will ensure an adequate level of accuracy (cell averaging) and therefore the calibration of individual PICs is not necessary. As part of the cascade inventories there are several data comparisons made that provide the information needed to identify any out of tolerance PIC without doing a calibration. The cascade inventory data comparison includes analyzing stage compression ratios and the comparison of motor amperage versus stage high pressure against known process relationships.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.14 Compressor Motor Manual Trip System

APPLICABILITY: Cascade Operational Modes II and III

LCO: Compressor motor manual trip system for UF₆ stage motors shall be operable.

ACTIONS:

Conditions	Required Actions	Completion Time
B. DC voltage potential < 200 at cascade unit battery room/X-533 main DC bus OR No DC power at the cell breaker	A.1 Notify Cascade Control of potential need to utilize alternate means for cell shutdown AND	Immediately
	A.2 Restore DC voltage potential	48 Hours
B. Condition A.2 required actions and/or completion time not accomplished	B.1 Shutdown affected cascade compressors	8 Hours
C. X-533 Air Circuit Breaker air pressure ≤ 195 psig	C.1 Notify Cascade Control of potential need to utilize alternate means for cell shutdown AND	Immediately
	C.2 Restore air pressure to > 195 psig	48 Hours
D. Condition C.2 required actions and/or completion time not accomplished	D.1 Shutdown affected cascade compressors	8 Hours

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.14 Compressor Motor Manual Trip System (continued)

ACTIONS: (continued)

<p>E. Individual battery (connected cell)/ charger system conditions (other than voltage) found outside surveillance parameters</p>	<p>E.1 Restore individual battery parameters to within limits AND E.2 If battery charger is inoperable, verify applicable battery bank is operable TSR 1.6.2.2.d does not apply</p>	<p>90 Days 8 Hours</p>
<p>F. PCF DC bus voltage potential is < 100 volts DC.</p>	<p>F.1 Verify that Condition A is not in effect. AND F.2 Verify that applicable ACR compressor motor stop button is operable. AND F.3 Restore PCF DC bus voltage potential \geq 100 volts DC.</p>	<p>Immediately Immediately 7 Days</p>
<p>G. ACR compressor motor stop button for "00" and "000" compressors inoperable (other than loss of battery voltage). OR ACR is evacuated.</p>	<p>G.1 Verify that the applicable PCF cell trip capability is operable. AND G.2 Restore ACR cell trip to operable status. TSR 1.6.2.2.d does not apply</p>	<p>Immediately 7 Days</p>
<p>H. PCF compressor motor stop button for "00" and "000" compressors inoperable (other than loss of battery voltage).</p>	<p>H.1 Verify that the applicable ACR cell trip capability is operable AND H.2 Restore PCF cell trip to operable status. TSR 1.6.2.2.d does not apply</p>	<p>Immediately 7 Days</p>

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.14 Compressor Motor Manual Trip System (continued)

ACTIONS: (continued)

B. Both conditions G and H apply.	I.1	Notify Cascade Control of potential need to utilize alternate means for cell shutdown AND	Immediately
	I.2	Station an operator at an established alternate shutdown location with communications to the ACR or PCF. OR	8 Hours
	I.3	Shutdown affected UF ₆ compressor motor(s).	8 Hours
J. Required Action E.1, E.2, F.1, F.2, F.3, G.2, or H.2 not accomplished	J.1	Station an operator at an established alternate shutdown location with communications to the ACR or PCF. OR	8 Hours
	J.2	Shutdown affected UF ₆ compressor motor(s).	8 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.2.3.14.1 Verify cascade unit/X-533 main DC bus DC voltage ≥ 200
Daily	SR 2.2.3.14.2 Verify X-533 ACB bus air pressure > 195 psig
Prior to cell restart after a planned cell shutdown	SR 2.2.3.14.3 a) Perform a functional test: of the ACR and PCF cell motor stop buttons for the "00" and "000" cells; and of the ACR cell motor stop button for "0" cells; b) Monitor expected cell block valve closures and any other required recycle valve actuation.
Each planned cell shutdown	Note: Performance of this surveillance to demonstrate system operability is not required for any cell in operation until the next planned shutdown.

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.14 Compressor Motor Manual Trip System (continued)

SURVEILLANCE REQUIREMENTS (continued)

Quarterly	SR 2.2.3.14.4 Inspect battery terminals and racks for evidence of corrosion and for cell leakage of electrolyte.
Quarterly	SR 2.2.3.14.5 Check that the specific gravity of the pilot cell is ≥ 1.180 .
Daily	SR 2.2.3.14.6 Verify that the battery charger output is > 0 DC amps.
Quarterly	SR 2.2.3.14.7 Visually check the cell electrolyte levels to verify that the level is above the low level indication line and no more than 0.25 inches above the high level indication line.
Annually	SR 2.2.3.14.8 Check that the specific gravity of the cells is ≥ 1.180 .
Daily	SR 2.2.3.14.9 Verify PCF DC bus voltage ≥ 100 .
Daily	SR 2.2.3.14.10 Verify DC power is available at UF ₆ compressor motor breakers.

BASIS:

The accident analysis discusses the fact that large UF₆ release scenarios from the cascade can be mitigated or terminated by stopping the cell motors which allow the cascade systems to go to subatmospheric pressure. If during a release situation, this rapid reduction in cell pressure causes an "underloading" in this part of the cascade. It is at this time coupled with the internal resistance of the cascade equipment (control valves, barrier, piping, etc.) that there will be inleakage in to the cascade which will mitigate the release until the necessary valve evolutions can take place to isolate the system from any additional supply of UF₆ and to prepare the system for compensatory actions and repair. The operator in response to process alarms and indications such as, two simultaneous smoke alarms in the same cell or a cell deblade will take action to shutdown the affected cell. In order to initiate a cell shutdown the DC control and trip power circuit must be functional. However, the failure of the local cell trip circuit to function on demand does not constitute a significant impact on any of the scenarios where cell shutdown is assumed to occur at sometime during the scenario. This is due to the numerous alternate and independent means available for disrupting cell power, i.e., breaker manual trip or X-300/switchyard de-energization of electrical feeders, buses, transformer bays, main switchyard lines.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.14 Compressor Motor Manual Trip System (continued)

The functional test of the ACR and PCF cell manual trip buttons for the "00" and "000" cells (SR 2.2.3.14.3.a) may be accomplished by (1) crediting a successful function of the ACR or PCF trip system at the time the cell was shutdown, and (2) testing the function of the trip button(s) not utilized during the planned cell shutdown. It is permissible to verify functionality via tripping the breaker on a deenergized bus, performing combinations of wiring and relay checks, and/or tripping the breaker from the "test" position. In determining the appropriate test method, credit may be taken for portions of the circuitry previously tested during or since the previous cell shutdown (e.g., the breaker mechanism does not necessarily need to be cycled twice to test both the ACR and PCF trip buttons). Functional testing the ACR trip button for the "0" cells to satisfy this surveillance requirement may be accomplished by crediting a successful function of the ACR trip at the time the cell was shutdown. Other available shutdown locations, such as the Local Control Center (LCC) or the switchyard are considered alternate shutdown locations. Because of the number of available trip locations, these alternate locations are not required to be tested periodically. Note that a planned cell shutdown is defined as the process of manually deenergizing the process motors in accordance with approved procedures when the cell trip is not required to mitigate a transient condition.

Cell tripping is classified as a momentary load per IEEE Standard 485-1983, Recommended Practice for Sizing Large Lead Storage Batteries for Generating Stations and Substations, Section 4.2.3, and as such represents a small instantaneous ampere-hour load on the total battery banks. The additional battery surveillances provide additional assurances that the battery system will be able to deliver the power necessary to trip the cell breakers as long as the system voltage is maintained above 200 volts. Any failure of the cell trip action to stop the compressor motor(s) should be investigated. The 200 VDC and the 195 psig air pressure values have been long standing action points for establishing operability of these systems. For example, the 200 VDC value has been in the Operational Safety Requirements document since 1985 and the 195 psig air pressure value is also the interlock set point in the X-533 switchyard for the prevention of the initial energization of the air circuit breakers when the system air pressure is below 195 psig. The use of available vendor information coupled with engineering evaluations provided the basis for the determination that the systems in question would perform at > than these specified parameters. [SAR Sections 3.8.3.1, 3.8.3.2, 4.3.2.1.1, 4.3.2.1.2, 4.3.2.1.3, 4.3.2.1.5, 4.3.2.1.7, and 4.3.2.1.8].

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.15 Moderation Control

Applicability: Cascade Operational Modes I, II, III, IV, V, VI

LCO: Moderation Control shall be maintained when the UO_2F_2 mass is $>$ safe mass.

ACTIONS: **Note:** TSR 1.6.2.2(d) does not apply

Condition	Required Actions	Completion Time
<p>B. UO_2F_2 deposit $>$ safe mass in a fluorinating (including chemical treatment) environment.</p>	<p>A.1 Continue to maintain a fluorinating environment for the deposit AND A.2 Initiate actions to determine the cause of deposit and its significance. AND A.3 Establish and document a plan of action AND A.4 Initiate SR 2.2.3.15.3</p>	<p>Immediately Immediately 30 Days 90 Days</p>
<p>B. UO_2F_2 deposit $>$ safe mass with the deposit not in a fluorinating environment.</p>	<p>B.1.1 Establish a dry cover gas blanket at ≥ 14 psia except when performing maintenance or operational activities associated with remediation of the deposit, equipment removal or leak repair. AND B.1.2 Initiate SR 2.2.3.15.2 AND B.2 Remove equipment containing the UO_2F_2 deposit from the cascade OR Note: Upon completion of B.3, Condition A is re-entered. B.3 Initiate re-fluorinating activities</p>	<p>Within 72 Hours after entering Mode VI 12 Hours 180 days Within 72 hours of removal of dry cover gas blanket</p>

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

DELETE

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.15 Moderation Control (continued)

Condition	Required Actions	Completion Time
<p>C. Installed equipment containing known or previously unknown deposit of UO_2F_2 deposit > safe mass opened to atmosphere.</p>	<p>C.1 Apply TSR 2.2.3.16 as appropriate to equipment removed AND C.2 A person shall be stationed to valve off local sprinkler system, if inadvertently actuated, anytime the system opening(s) remain uncovered. AND A fire watch, equipped with portable CO_2 and/or dry chemical fire suppression equipment, shall be established during cutting/welding AND Cover opening(s) with prestaged waterproof covers, if conditions develop where a moderating material can begin to enter opened equipment. AND C.3 Cover opening(s) that expose UO_2F_2 deposit to atmosphere when maintenance evolutions are <u>not</u> impacting equipment. AND C.4 Maintain dry cover gas blanket \geq 14 psia when cascade system maintenance evolutions are <u>not</u> impacting equipment. AND Note: Upon completion of C.5, Condition B is re-entered. C.5 Maintain dry cover gas blanket \geq 14 psia following completion of cascade system maintenance on affected equipment and UO_2F_2 deposit is not in a fluorinating environment.</p>	<p>Immediately Immediately Immediately after determining acceptable UF_6/HF conditions Within 72 hours after completing REQUIRED ACTION C.3 Within 72 hours after completing system maintenance</p>
<p>D. UO_2F_2 deposit > safe mass, not in a fluorinating environment and coolant system pressure \leq RCW condenser pressure.</p>	<p>D.1.1 Increase coolant system pressure to > RCW condenser pressure. AND D.1.2 Initiate SR 2.2.3.15.1 OR D.2 Drain RCW from coolant condenser</p>	<p>4 Hours 12 Hours 20 Hours</p>
<p>E. UO_2F_2 deposit > safe mass with the deposit not in a fluorinating environment and required dry cover gas blanket < 14 psia.</p>	<p>E.1 Re-establish a dry cover gas blanket \geq 14 psia.</p>	<p>12 Hours</p>

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.15 Moderation Control (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each shift when not in a fluorinating environment, deposit > safe mass and RCW not drained	SR 2.2.3.15.1 Verify coolant system pressure > RCW condenser pressure.
Each shift when dry cover gas blanket is required by Condition B or C	SR 2.2.3.15.2 Monitor the system pressure and adjust pressure to \geq 14 psia.
Quarterly when in Condition A	SR 2.2.3.15.3 Monitor size of the deposit.
Quarterly	SR 2.2.3.15.4 Perform routine qualitative radiation surveys of bypass housings to check for deposits and initiate "NDA" quantitative measurements based on "radiation reading trending".

BASIS:

As used in this TSR, the term "safe mass" is defined as being 43.5% of the minimum fissionable mass for system conditions (enrichment, geometry, H/U, reflection, etc.). Cascade deposits of UO₂F₂ (and deposits of other compounds resulting from wet air leakage) and freeze-out of UF₆ are an expected result of normal operation. It is considered non-credible for a dry criticality to occur in the Cascade. Therefore, for a freeze-out condition, criticality would not result and the UF₆ freeze-out may be remediated at the discretion of the operating organization. Any deposit that has a uranium mass less than the "always" safe mass (i.e., optimally moderated material) may be remediated at the discretion of the operating organization. In regards to those situations in which a loss of moderation control could result in criticality, it has been determined that NCSA specified controls provide double contingency against the leakage of liquid water into the cascade. Based on additional technical evaluations it is not possible to hydrate a deposit of uranyl fluoride above a H/U ratio of 4 by exposure to ambient air within the process buildings. Therefore, there is no potential for criticality when a cascade deposit is less than the safe mass at a H/U ratio of 4 due to exposure to atmospheric water vapor in the ambient process building air.

The amount of water required for a criticality reaction varies with the enrichment and the mass. However, at any given enrichment, there is a minimum amount of water that is required for a criticality to occur. As the H/U ratio changes from this optimum level, the amount of water required overall increases. For enrichments between 3% and 7% ²³⁵U the minimum amount of water occurs at an H/X ratio of about 200. The optimum H/U ratio is always greater than an H/U of 4. The TSR control time limits are established for a deposit in a buffered condition. The TSR time limits are based on the following assumptions: (1) that the equipment breathes with changes in atmospheric pressure, (2) that any atmospheric moisture entering the system remains in the system, (3) that an H/U of 4 is the maximum that can be achieved, and (4) that a minimum critical mass at an H/U of 4 is present. If the mass of the uranium deposit is greater than the minimum critical mass at an H/U of 4, it will always require more water to achieve criticality than would be required for the minimum critical mass at an H/U of 4. Therefore, the time required to reach the H/U ratio for a criticality to be possible would be greater than the time limit specified in the TSR. The only situation where the TSR controls would be in question would be for a deposit above a minimum critical mass at an H/U of 4 that had been exposed to wet air for an unknown period of time. In this event, sampling of the gas inside the equipment for moisture content and/or sampling of the deposit to determine the H/U ratio would potentially be required to establish a baseline. The deposit signature determination would provide the analysis of the adequacy of the TSR controls.

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

DELETE

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.15 Moderation Control (continued)

UF₆, F₂, and ClF₃ react with available water more readily than UO₂F₂ absorbs water. For instance, water entering onstream cascade equipment will preferentially react with UF₆ to form more UO₂F₂ rather than react with UO₂F₂ to form hydrates (moderated forms) of UO₂F₂. HF gas formed as a byproduct of the water-UF₆ reaction cannot liquefy to moderate a deposit at the pressures encountered in the cascade. A UO₂F₂ deposit cannot become moderated if it is being continuously fluorinated and moderation is not a concern until the equipment is taken off-stream and evacuated of UF₆. Continued fluorination of the deposit provides nuclear criticality safety by preventing moderation of the deposit.

Chemical treatment processes which involve the addition of ClF₃ and/or F₂ (i.e. fluorinating agents) provide the same level of moderation control as when the deposit is exposed to UF₆. Fluorinating gas treatments have been used as a means of drying out equipment after exposure to atmospheric air and for removing/reducing uranium deposits since the enrichment plants were placed into service. It has been demonstrated that these fluorinating agents will react vigorously and preferentially with any available moisture. The presence of excess fluorinating agents will not only prevent further hydration of a deposit but will over time effectively remove any free moisture and dehydrate the exposed deposit to an H/U ratio as low as when the deposit was exposed to the UF₆ process. In addition, use of fluorinating agents will convert UO₂F₂ deposits to UF₆, thereby reducing the deposit mass. Repeated use of the fluorinating agents (i.e., chemical treatment) will proceed to reduce/eliminate the deposit which is the safest condition. Therefore, a deposit that has been hydrated to some extent due to "breathing" or during the times necessary to expose the deposit to atmosphere when maintenance functions are performed can be dehydrated by the presence of a fluorinating agent. The sustained liberation of UF₆ from the deposit during a chemical treatment is the proven indicator that the deposit has been dehydrated. Once a deposit has been dehydrated, re-entry into Condition B establishes a new initiating time for required actions. After having been exposed to a fluorinating environment in which there has been the sustained liberation of UF₆, the re-entry to the buffered condition for 180 days will not decrease the assumed safety margin for this condition. Chemical treatment activities as discussed in this LCO may include preparation activities such as evacuation, leakrate, seal checks and cell startup.

UO₂F₂ deposits in onstream operating equipment are not a nuclear criticality safety concern due to continuous fluorination of the deposit. Over time, sustained or large wet air leakage in operating equipment (active process area) will readily announce itself in the form of changing motor loads, compressor surging, line recorder readings, stage control valve positions, A-suction pressures, etc. Additionally, deposit formation in operating equipment will be dispersed by the gas flow. This dispersion of UO₂F₂ can occur on the inside of process piping, across barrier tubing, on cooler fins and inside compressors on the rotor and stator. Due to this dispersion, the formation of deposits in unsafe geometries in active process areas where there is UF₆ gas flow is not likely, given the above indicators. However, the above mentioned indicators and continuous gas flow are not always available for wet air leakage in bypass/auxiliary piping, expansion joints and valves (inactive process areas). Operational experience indicates that quarterly surveillances by NDA methods for UO₂F₂ deposits in inactive process area is appropriate for early detection and prudent remediation of the deposit. Follow up surveys are conducted to assure that the deposit does not become sufficiently large to become an operational problem or a cascade structural concern.

Upon discovery of a deposit exceeding the safe mass of uranium, the significance of the deposit is determined. The significance determination includes an assessment of the following criteria. If the mass and enrichment of the deposit, including uncertainty, is less than a minimum critical mass at an H/U of 4, the following items may have limited significance. Also, the determination of a deposit configuration and/or distribution may render further evaluation unnecessary.

- a. mass and enrichment of the deposit;
- b. formation mechanism and assessment of likely chemical composition of deposit;
- c. distribution/configuration of the deposit relative to geometry or interaction parameters;
- d. presence of a fluorinating environment during deposit formation;

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

DELETE

2.2.3.15 ~~Moderation Control (continued)~~

- e. if fluorinating environment not always present, determine presence of dry gas buffer;
- f. estimate length of time exposure to atmospheric moisture may have occurred;
- g. evaluate mass of U at enrichment versus minimum critical mass at H/U of 4;
- h. if mass of U is greater than a minimum critical mass at H/U of 4, calculate amount of water/time required to reach the H/U ratio where deposit mass equals minimum critical mass and compare to TSR controls.

Routine NDA surveillance methods are of limited value (e.g., with respect to quantification of deposit size) for active process areas which include compressors, converters, process gas coolers and freezer/sublimers. However, sustained or large wet air leakage in active process areas will readily announce itself which will prompt corrective actions by operating personnel. Also, the formation of UO_2F_2 deposits in unsafe geometries in active process areas is not likely given the above corrective actions. The limited ability to hydrate a deposit in-place process equipment assures that these deposits will remain critically safe after shutdown. Thus the primary concern for the formation of UO_2F_2 deposits in unsafe geometries in operating equipment is if this equipment trips or is shutdown while containing UF_6 and massive wet air leakage occurs. In this event, the wet air leakage will be obvious from the equipment leak rate which will prompt corrective actions to limit the size of the deposit.

For shutdown equipment, moderation control can be provided by a fluorinating environment or by a dry gas (plant air or nitrogen) blanket over the deposit even if significant wet air leakage has occurred. Once a system has been isolated from the cascade and filled to ≥ 14 psia with dry gas blanket, normal atmosphere pressure fluctuations may cause minor in and out flow through any existing system leaks. Analyses have demonstrated that this "breathing" of the cell or even the exposure to atmospheric air (diffusion) when the system is opened to allow for necessary maintenance will not significantly affect deposit moderation. Even for periods much longer than the 180 day limitation, moderation above an H/U ratio of 4 would not be expected. The daily surveillance demonstrates that the gas blanket is maintained as assumed in the analyses. The LCO requirements of this TSR assure nuclear criticality safety for equipment with UO_2F_2 deposits greater than a safe mass.

Maintenance evolutions or cascade system maintenance terminology, used in the Required Action statements, include other related tasks such as decontamination and sampling. Condition C is considered to be met when the UF_6 primary system is first breached. During the time frame it takes to cover the cell opening(s) created by equipment removal which would expose a greater than safe mass deposit to the atmosphere or while maintenance is being performed on the same opening(s), actions are taken to further reduce the probability of a criticality. These actions involve covering of equipment openings as soon as possible, stationing a person to valve off sprinkler water in case of an inadvertent actuation, establishing a fire watch and having waterproof covers available that can be quickly placed over the opening(s) should the sprinklers actuate under a real fire situation. The fire watch provides the capability for potentially mitigating a fire, utilizing CO_2 and/or dry chemical type of extinguishing agents, while in its early stages of development, thereby preventing any sprinkler actuation. If the normal equipment vertical opening orientation is assumed to exist, versus the SAR accident analysis assumed horizontal opening orientation, it would require a significantly long period of time to accumulate the necessary water mass to cause a criticality. The stated actions will preclude sufficient water from entering the equipment to moderate the deposit to a critical state. Also the potential for moderation from RCW system water is controlled by NCSA requirements and demonstrated to meet the probable contingency principle. [SAR Section 5.2, Appendix A, sections 1.1 and 1.2]

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.16 Removed Equipment With Deposits

APPLICABILITY: Cascade Operational Mode VI, equipment removed from the Cascade with UO_2F_2 mass > safe mass

LCO: Equipment removed from the Cascade shall be handled as follows:

- B. Equipment that has contained UF_6 and could contain > a safe mass of UO_2F_2 shall be surveyed prior to and after removal to determine PEH (Planned Expedious Handling) or UH (Uncomplicated Handling) classification.
- C. Equipment classified as PEH shall have openings to atmosphere covered or closed.
- D. Equipment classified as PEH shall be decontaminated to \leq safe mass within 72 hours of removal and post PEH classification.

ACTIONS:

Conditions	Required Actions	Completion Time
A. Applicable equipment removed prior to classification survey	A.1 Declare the equipment PEH AND	Immediately
	A.2 Perform "NDA" survey	Prior to declassifying to UH
B. PEH equipment openings not covered or closed	B.1 Cover or close openings AND	Immediately after determination of acceptable UF_6 /HF conditions
	B.2 A person shall be stationed to valve off local sprinkler system, if inadvertently actuated, during the time equipment opening(s) remain open or uncovered. AND Cover openings with prestaged waterproof covers, if conditions develop where a moderating material can begin to enter opened equipment	Immediately
C. PEH equipment not decontaminated to \leq safe mass within 72 hours	C.1 Ensure equipment openings remain covered or closed AND	Immediately
	C.2 Reinitiate a dry air or nitrogen atmosphere	Immediately

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.16 Removed Equipment With Deposits (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.2.3.16.1 Inspect equipment for closed or covered openings
Prior to equipment exiting building	SR 2.2.3.16.2 Inspect equipment for closed or covered openings

BASIS:

For a criticality to occur in a piece of equipment with a uranium deposit that has been removed from the cascade would require that the deposit be moderated. Cascade deposits in operating equipment regardless of their size, at the enrichment level of $\leq 7\%$ will remain safe as long as the deposit is unmoderated. For unmoderated deposits ($H/U=0$) $> 7\%$ assay but $\leq 20\%$ assay the mass required for a criticality would exceed the amount of UF_6 available in the cascade at this enrichment range. As used in this TSR the term "safe mass" is defined as being 43.5% of the minimum fissionable mass for the assay of concern in a fully moderated and fully reflected system whether these specific conditions actually exist or not. In addition, determining the mass of any uranium deposit in the equipment allows segregation and controlled handling of equipment containing amounts of U^{235} that require additional controls to prevent the formation of an unsafe mass/geometry. It is not likely based on the chemistry of UO_2F_2 deposits for this potential mass to be moderated by diffusion of ambient air to greater than a H/U ratio of 4. The loss of moderation control as described in the SAR requires that the equipment be dropped such that an opening is tilted upwards to receive fire water (i.e. water in liquid state) and that a fire must occur simultaneously in order to actuate the sprinkler system (i.e. probability of a false actuation is 1×10^{-6} per year, Factory Mutual) and this accident scenario meets Double Contingency. The actions that shall occur to further reduce the probability of a criticality, involve the covering of the equipment openings as soon as possible and during the time frame it takes to get covers in place, stationing a person to valve off sprinkler water in case of an inadvertent actuation and having waterproof covers available that can be quickly placed over the opening(s) should the sprinklers actuate under a real fire situation. If the normal equipment vertical opening orientation is assumed to exist, versus the SAR accident analysis assumed horizontal opening orientation, it would require a significantly long period of time to accumulate the necessary water mass to cause a criticality. Typically, the time to cover a removed piece of equipment is determined by the time necessary to lift it from the cell and the time to allow for flange cooling. However, this time frame can be extended due to UF_6/HF out gassing which is an immediate hazard to local personnel. In either case these actions will preclude sufficient water from entering the equipment to moderate the deposit to a critical state. [SAR Section 5.2, Appendix A, section 1.11].

DELETE

~~SECTION 2.2 SPECIFIC TSRS FOR X-330 NAD X-333 FACILITIES~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.2.3.17 Motor Load Indicators~~

~~**APPLICABILITY:** Modes II and III when "00" or "000" UF₆ stage compressors motors are operating~~

~~**LCO:** Cascade UF₆ stage compressor motor load indicators for "00" and "000" compressor motors shall be operable.~~

~~**ACTIONS:**~~

Conditions	Required Actions	Completion Time
<p>A. ACR stage compressor motor load indicator inoperable.</p>	<p>A.1 Verify that the stage compressor motor load indicators for the adjacent stages are operable.</p> <p>Note: If more than one ACR indicator is inoperable, perform this action for each inoperable indicator.</p> <p>TSR 1.6.2.2.d does not apply</p>	<p>4 Hours</p>
<p>B. ACR stage compressor motor load indicators inoperable for ≥ 2 adjacent stage motors. OR An ACR is evacuated.</p>	<p>B.1 Verify that the applicable cell compressor motor load indicator in the PCF is operable by performing a Channel Check. AND B.2 Restore at least one of the adjacent ACR stage compressor motor load indicators to operable status.</p>	<p>4 Hours 7 Days</p>
<p>C. PCF cell compressor motor load indicator inoperable.</p>	<p>C.1 Verify that the applicable ACR stage compressor motor load indicator(s) are operable. OR C.2 Verify that Required Action A.1 is complete.</p> <p>TSR 1.6.2.2.d does not apply.</p>	<p>4 Hours 4 Hours</p>

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 NAD X-333 FACILITIES

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.17 Motor Load Indicators (continued)

ACTIONS: (continued)

Conditions	Required Actions	Completion Time
D. Required Action B.1 or B.2 or C.1 and C.2 not accomplished	D.1 Station an operator at the local cell panel to monitor cell parameters with communications to the ACR or PCF.	8 Hours
	OR	
	D.2 Shutdown affected UF ₆ compressor motor(s).	8 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Following compressor motor start	SR 2.2.3.17.1 Perform a Channel Check of the ACR stage compressor motor load indicators.

BASIS:

The motor load indicators provide an indication of various types of failures of the compressor(s). Using ammeter indications in the CAR for the individual compressor motors, operators can quickly identify various abnormalities caused by malfunctions of the process equipment. Operator training is relied upon to distinguish between load changes associated with normal fluctuations, such as cascade power increases, and equipment malfunctions. Compressor load changes can be caused by such events as compressor failures, inadvertent closures of B-stream block valves or stage control valves, or failures of primary system pressure boundary that cause inleakage or a release of UF₆. Compressor surging will produce large swings in the loads. If an ammeter should malfunction, the load changes can be seen on the ammeters for the compressor motors in stages that are adjacent to the stage that is experiencing the compressor malfunction. Motor indicators in the ACRs are used to detect large load changes for cell compressor motors in the enrichment cascade. Load indications in the PCF are used to detect large load changes for cell compressor motors (i.e., PCF indicator provides total load for all of the stages in a particular cell). These PCF indicators are not required to satisfy the LCO unless the ACR indicator is inoperable. In the event of evacuation of an ACR, the ammeter indications in the PCF can be used to monitor for large load changes that could be representative of a pressure increase.

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 NAD X-333 FACILITIES

2.2.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.2.3.17 Motor Load Indicators (continued)

BASIS (continued):

Although the monitors in the PCF are less sensitive than those in the ACR, they are able to indicate the significant compressor load changes. This indication of an event and mitigative action by the operator (1) controls the primary system pressure and temperature increases to minimize the potential for primary system integrity failures and (2) reduces the primary system pressure to minimize UF₆ releases for onsite personnel. This system is not essential for off-site public protection. The Surveillance Requirement is provided to ensure that, after motor start, the ammeter provide qualitative (or relative) indication of motor load. It is appropriate to perform this surveillance after sufficient UF₆ is introduced into the cell so that a nominal reading on the ammeter can be obtained. [SAR Sections 3.8.3.6, 4.3.2.1.1, 4.3.2.1.2, 4.3.2.1.3, and 4.3.2.1.5]

DELETE

DELETE

SECTION 2.2 SPECIFIC TSRS FOR X-330 AND X-333 FACILITIES

2.2.4 GENERAL DESIGN FEATURES

2.2.4.1 Seal Exhaust Pump Overflows

DF: Seal exhaust pumps shall contain an overflow that limits the oil inventory in the pump.

SURVEILLANCE:

Frequency	Surveillance
Prior to pump startup	SR 2.2.4.1.1 Verify that the oil overflow is in place and that the effluent valve if present is open

BASIS:

The seal exhaust pump cavities are of an unfavorable geometry in the presence of an oil moderator. The pump overflow lines ensure that the oil volume does not exceed the safe quantity when mixed with uranium of a limited enrichment that is documented in Nuclear Criticality Safety Evaluation and Approvals [SAR Section 5.2, Appendix A, section 1.3].

DELETE

SECTION 2.2 SPECIFIC TSRs FOR X-330 AND X-333 FACILITIES

2.2.4 GENERAL DESIGN FEATURES

2.2.4.2 Process Building Cranes

DF: The process building cranes in X-330 and X-333 that are used to move heavy equipment above/around the UF₆ primary system, that is intended to be operated above atmospheric pressure, are designed and shall be maintained not to fail in a manner to cause primary system integrity failure.


SURVEILLANCE:

Frequency	Surveillance
Prior to first time use during shift	SR 2.2.4.2.1 Perform operator functional crane inspection of hoist, trolley, bridge, and upper limit switch.
Biennially	SR 2.2.4.2.2 Verify crane hoist does not allow load to move (except for compensatory movements) upon operator release of the controls while at a minimum of 100% of rated capacity.

BASIS:

The process building cranes on the cell floor consist of the overhead bridge cranes and associated equipment in the enrichment facilities and the withdrawal facilities. The process building cranes shall not fail in a manner to cause primary system integrity failure during: (1) normal operations; (2) natural phenomena events with the crane parked in the parked position; and (3) an evacuation event due to a release of crane controls. These safety functions are passive in nature (i.e., no action components are required of the system). The movement of a heavy load with a crane is infrequent. Thus, the movement of a heavy load with a crane concurrent with a natural phenomena event is not considered a credible event. The assurance of crane operability is provided by the surveillance requirements. In addition to the surveillance requirements specified above, cranes handling heavy equipment as described in this DF are inspected and tested in accordance with sections of applicable industry standards as described in the SAR Chapter 1, Appendix A. Compensatory movements are small additional movements due to momentum after the crane drive mechanism stops and brakes are applied. These compensatory movements have no safety significance. [SAR Sections 3.8.9.2, 4.3.2.1.5, and 4.3.2.1.8].

DELETE

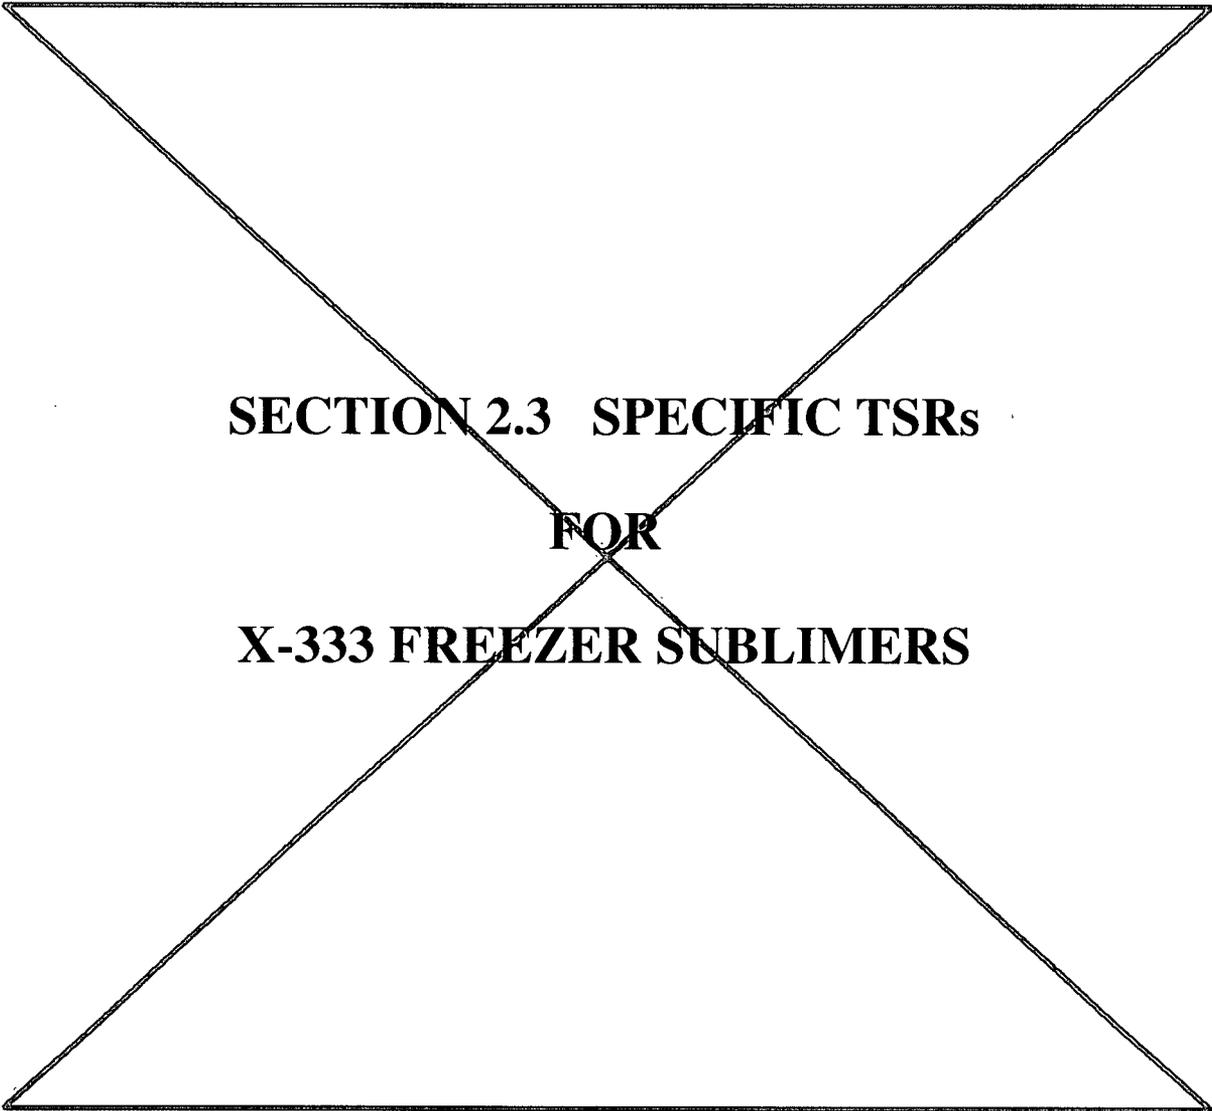

**SECTION 2.3 SPECIFIC TSRs
FOR
X-333 FREEZER SUBLIMERS**

DELETE

~~SECTION 2.3 SPECIFIC TSRS FOR X-333 FREEZER-SUBLIMERS~~

DELETE

2.1.4 FREEZER-SUBLIMERS OPERATIONAL MODES

- I Freeze** Solidification of UF₆ from the Cascade "B" stream on the F/S vessel finned tubes by cold liquid coolant flowing through inside of the F/S vessel tubes.
- II Sublime** Removal of solid UF₆ from the F/S vessel tubes by flowing heated coolant through the inside of the F/S vessel tubes. The UF₆ converts directly from a solid to a gas and is returned to the Cascade "A" stream.
- III Cold Standby** UF₆ is maintained as a solid in the F/S vessel by recirculating cold coolant through the F/S tubes while the F/S process lines are isolated from the Cascade.
- IV Hot Standby** UF₆ is maintained in an equilibrium state as the coolant and UF₆ temperatures equalize. The F/S process lines are isolated from the Cascade and there is no flow of coolant through the F/S vessel.
- V Shutdown** F/S UF₆ process lines are isolated from the Cascade, the F/S is in Mode IV and the unit has been tagged out of service. In the case where the containment of the F/S unit is to be breached the F/S vessel would be emptied of UF₆ inventory.

DELETE

DELETE**SECTION 2.3 SPECIFIC TSRs FOR X-333 FREEZER SUBLIMERS****2.1.5 SAFETY LIMITS****APPLICABILITY:** All F/S Operational Modes**2.3.2.1 SL:** Shall not exceed 11,900 pounds of UF₆ in F/S vessel.**BASIS:**

The original design of the Freezer/Sublimator system considered the potential for UF₆ bridging between fins or adjoining coolant tubes that could cause mechanical stress rupture of the coolant tubes inside the F/S vessel when heated. The release of the coolant to the interior of the F/S could result in over-pressuring an expansion joint in the piping to the Cascade and a subsequent crack would release the mixture of coolant and UF₆. A safety limit of 11,900 lbs. UF₆ was established in the original design for the amount of UF₆ at which the onset of bridging could occur [SAR Section 3.8.3.5].

DELETE

DELETE

SECTION 2.3 SPECIFIC TSRS FOR X-333 FREEZER-SUBLIMERS

2.1.6 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.3.3.1 Freezer/Sublimer UF₆ High-High Weight Trip System

APPLICABILITY: F/S Operational Mode I, III

LCS: ≤ 9,000 pounds of UF₆ in F/S vessel

LCO: A. Both channels of the High-High Weight Trip system shall be operable.

B. Weight of coolant in F/S vessel shall be ≥ 1800 pounds or ≥ 96 inches.

ACTIONS:

Condition	Required Actions	Completion Time
4. One weight channel inoperable	A.1 Restore operability and current freeze cycle with subsequent cold standby may be completed	Prior to re-entry into Mode I
B. Both weight channels inoperable	B.1 Exit Mode I or III	Immediately
C. < 96 inches of coolant in F/S vessel or <1800 pounds	C.1 Add coolant to vessel OR exit Mode I or III	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.3.3.1.1 Perform channel functional test to verify isolation of the F/S when the set point is exceeded Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 456 total lbs.
Semiannually	SR 2.3.3.1.2 Calibrate the F/S High High Weight system set point at ≤ 9000 pounds UF ₆ Note: Allowable test tolerance to cover instrument drift and uncertainties during normal operation = + 456 total lbs.
Prior to Mode I	SR 2.3.3.1.3 Ensure coolant level is ≥ 96 inches

DELETE

R

DELETE**SECTION 2.3 SPECIFIC TSRS FOR X-333 FREEZER SUBLIMERS****2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES****2.3.3.1 Freezer/Sublimer UF₆ High-High Weight Trip System (continued)****BASIS:**

The UF₆ High-High Weight Trip System prevents the rupture of the F/S vessel due to excess UF₆. The vessel weight is monitored by two independent measuring systems and is activated by weight trip switches. The F/S weighing system measures the combined weight of the UF₆ and R-114 in the vessel. The amount of R-114 in the system is maintained at 2,000 lbs. ± 200 lbs. The trip occurs when the UF₆ weight in the F/S vessel reaches 9,000 lbs. In this case, the F/S vessel is not fully isolated, but is placed in the sublime mode trip configuration for the system, with the weight control valve (FV3600) and FV3602 open to the cascade "A" stream, thus reducing the UF₆ inventory in the F/S vessel. After the inventory is reduced, the F/S is placed in the Hot Standby Mode.

The original design of the Freezer/Sublimer system considered the potential for UF₆ bridging between fins or adjoining coolant tubes that could cause mechanical stress rupture when heated. Applying heat to an overfilled vessel could result in a rupture in the form of a crack and subsequent UF₆ release. The Limiting Control Setting (LCS) is set at 9,000 lbs. of UF₆ which with a potential weighing system tolerance of an additional 200 lbs. of UF₆ provides an adequate safety margin of 2,700 lbs. of UF₆ to prevent vessel damage due to tube bridging. The set point value corresponds to the trip point established under DOE 5481.1B in 1985 and provide a test tolerance to comply with the definition of "Allowable Value" in ANSI/ISA-S67.04-1988 [SAR Section 3.8.3.5].

DELETE

T
R

DELETE

SECTION 2.3 SPECIFIC TSRS FOR X-333 FREEZER SUBLIMERS

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.3.3.2 Assay Limitations

APPLICABILITY: F/S Operational Modes I, II, III, IV, V

LCO: No F/S unit shall freeze out or contain UF₆ of an enrichment greater than 3.0% U²³⁵.

ACTIONS:

Condition	Required Actions	Completion Time
E. Freezing out UF ₆ of enrichment > 3.0% U ²³⁵	A.1 Place F/S in Mode IV	Immediately

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to Mode I	SR 2.3.3.2.1 Determine enrichment of material to be frozen out is ≤ 3.0% U ²³⁵ .

BASIS:

"ORNL/CSD/TM-288 (Calculational Criticality Analyses of 10- and 20-MW UF₆ Freezer/Sublimers Vessels, W. C. Jordan of ORNL Computing and Telecommunications Division, February 1993) document states that if the F/S vessel is filled with solid UF₆ at an H/U of 0.33 and the R-114 tubes are filled with water, the F/S system will be subcritical when the UF₆ is at an enrichment of 3.0% U²³⁵ or less [SAR Section 5.2, Appendix A, section 1.2].

DELETE

DELETE

SECTION 2.3 SPECIFIC TSRs FOR X-333 FREEZER-SUBLIMERS

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.3.3.3 Freezer/Sublimer Venting

APPLICABILITY: F/S Operational Modes I, II, III, IV

LCO: F/S vent block valve shall be sealed open

ACTIONS:

Condition	Required Actions	Completion Time
C. Units 2,3,5,7 AFS(unit)C(cell) V1 valve closed and/or seal broken	A.1 Open or verify valve open AND	Immediately
	A.2 Seal valve open	8 Hours
B. Units 4 and 6 AFS(unit)C(cell)V1 and AFS(unit)C6V2 valve closed and/or seal broken	B.1 Open or verify open one of the vent valves AND	Immediately
	B.2 Seal valve open	8 Hours


SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Modes I,II,III,IV from Mode V	SR 2.3.3.3.1 Verify that the vent valve is sealed open

BASIS:

Provide a relief path for any F/S system high pressure to the cascade in order to not over pressure the vessel. The source of high pressure would be from a ruptured coolant tube(s) [SAR Section 3.8.3.4]

DELETE

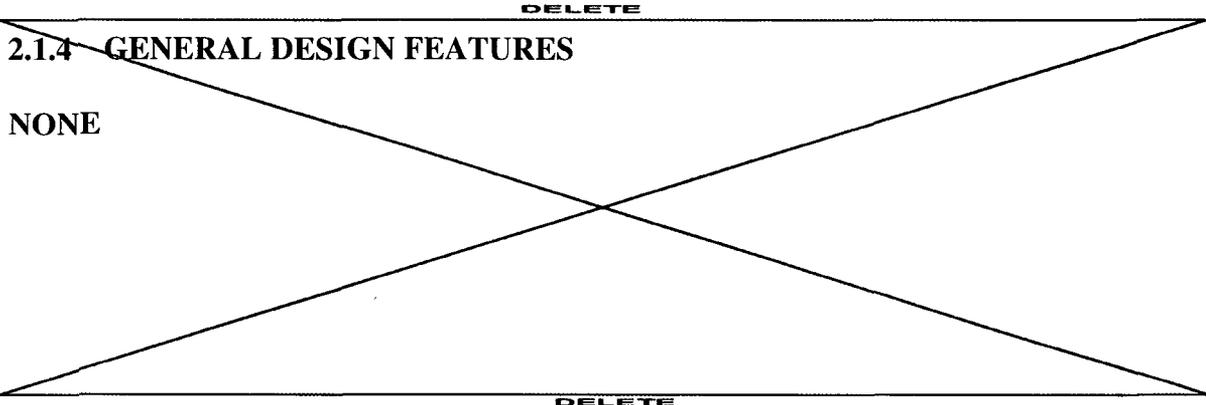

DELETE

**SECTION 2.4 SPECIFIC TSRs
FOR
X-330 AND X-333 COLD RECOVERY**

DELETE

DELETE

SECTION 2.4 ~~SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY~~

2.1.5 ~~COLD RECOVERY OPERATIONAL MODES:~~

- I Preparation** Sampling of UF₆ and low molecular weight gases stored in surge drum banks prior to processing.
- II Freeze** Separation of UF₆ from other gases in cold traps by solidifying the UF₆ at extreme low temperatures, refrigerant flow, inlet valve open, vent valve open.
- III Flash** Vaporization of solid UF₆ from cold traps to holding drums, refrigerant flow off, heaters energized, inlet valve closed, vent valve closed, holding drum inlet valve open.
- IV Refeed** Returning UF₆ from holding drums to the cascade at the appropriate matching enrichment location.
- V Vent** Removal of low molecular weight gases through chemical traps to atmosphere without prior cold trapping.
- VI Standby** The cold trap is operational, no process gases flowing through trap, inlet valve closed.
- VII Shutdown** The cold trap and/or its auxiliary components are not operational; no gas flow, heaters de-energized, refrigeration maybe shutdown.

DELETE

~~DELETE~~

~~SECTION 2.4 SPECIFIC TSRs FOR X-330 AND X-333 COLD RECOVERY
2.1.6 SAFETY LIMITS~~

~~NONE~~

~~DELETE~~

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.1.7 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.1 Criticality Accident (Radiation) Alarm System

LCO 2.4.3.1a Criticality accident detection shall be operable.

APPLICABILITY: In areas, equipment, or processes which contain greater than 700 grams of ^{235}U at an enrichment $\geq 1.0 \text{ wt } \% ^{235}\text{U}$.

ACTIONS:

Condition	Required Action	Completion Time
D. Areas, equipment, or processes not covered by criticality accident detection.	A.1 Implement the following for areas, equipment, or processes applicable to this LCO and that are not otherwise covered by criticality accident detection.	Immediately
	A.1.1 Discontinue cell maintenance activities that require breach of the containment boundary of cells containing UF_6 enriched to $\geq 1 \text{ wt } \% ^{235}\text{U}$.	
	<u>AND</u> A.1.2 Waste containing uranium enriched to $\geq 1 \text{ wt } \% ^{235}\text{U}$ shall not be handled.	
	<u>AND</u> A.1.3 NaF traps containing uranium enriched to $\geq 1 \text{ wt } \% ^{235}\text{U}$ shall not be handled.	
	<u>AND</u> A.1.4 Wet air pumps shall not be used for evacuation of cells containing UF_6 enriched to $\geq 1 \text{ wt } \% ^{235}\text{U}$.	
	<u>AND</u> A.1.5 Monitor temperature and pressure of surge drums containing UF_6 enriched to $\geq 1 \text{ wt } \% ^{235}\text{U}$ hourly to maintain inventory in gaseous state.	
	<u>AND</u> A.2.1 Evacuate the area not covered by detection capability.	
B. Areas, equipment, or processes not covered by criticality accident detection.	A.2.2 Restrict access to area evacuated in A.2.1.	Immediately
	<u>AND</u> A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification such as a device that will alarm on sensing a 10mr/hr dose rate.	
	B.1.1 Restore criticality accident detection by installing portable CAAS unit providing required criticality accident detection and same alarms as fixed unit.	
	<u>OR</u> B.1.2 Restore criticality accident detection to operable status.	48 hours
	TSR 1.6.2.2(d) is not applicable.	

DELETE

DELETE

SECTION 2.4 ~~SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY~~

2.1.3 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE~~

2.4.3.1 ~~Criticality Accident (Radiation) Alarm System (continued)~~

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.4.3.1.1 Calibrate radiation clusters to a set point of 5 mRad/hr. in air.
	SR 2.4.3.1.2 Verify that the cluster nitrogen horn and X-300 alarm sounds when two out of three channels in a cluster are tripped.
Quarterly	SR 2.4.3.1.3 Verify nitrogen supply pressure is at least 900 psig for each CAAS horn.

BASIS:

Each cluster consists of three neutron-sensitive detection units. Clusters are designed and calibrated to detect and alarm on a minimum credible criticality accident of concern, defined as producing an integrated total dose of 20 Rads. in one minute at two meters from the reacting material. This system will provide an audible signal in the event of a criticality that will alert personnel to evacuate the immediate work areas. The minimum acceptable length of time for the CAAS horn to sound is 2 minutes. [SAR Sections 3.8.7.1 and 4.3.2.6].

DELETE

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.4.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.2 Cold Trap Pressure Relief System

APPLICABILITY: Cold Recovery Operational Mode III

- LCO:**
- A. The cold trap pressure relief system shall be operable.
 - B. Relief drum pressure shall be \leq 0.3 psia.

ACTIONS:

Condition	Required Actions	Completion Time
C. Pressure relief control valve inoperable	A.1 De-energize cold trap heaters	Immediately
B. Rupture Disk inoperable or stamped burst pressure > 61.1 psig at 72° F	B.1 De-energize cold trap heaters	Immediately
C. Block valves between cold trap inlet and relief drum closed and/or seal broken	C.1 Open or verify open block valve(s) AND	Immediately
	C.2 Seal valve open	8 Hours
D. Relief drum pressure > 0.3 psia	D.1 Evacuate relief drum to \leq 0.3 psia	30 Minutes
E. Unable to evacuate relief drum or within required completion time	E.1 De-energize cold trap heaters	Immediately

DELETE

~~SECTION 2.4~~ ~~SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY~~ ~~DELETE~~

~~2.4.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCE~~

~~2.4.3.2 Cold Trap Pressure Relief System (continued)~~

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Semiannually	SR 2.4.3.2.1 Calibrate the relief system instrumentation
Semiannually	SR 2.4.3.2.2 Verify the relief control valve will open between 30.0 & 30.6 psig AND will reclose \geq 27.44 psig but less than the actual trip pressure.
Prior to Mode III	SR 2.4.3.2.3 Verify flow path to relief drum is open, block valves sealed open AND relief drum pressure is \leq 0.3 psia
Annually	SR 2.4.3.2.4 Calibrate the holding drum pressure alarm

~~DELETE~~

DELETE

SECTION 2.4 ~~SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY~~

2.1.3 **LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE**

2.4.3.2 **Cold Trap Pressure Relief System (continued)**

BASIS:

In order to prevent a cold trap rupture due to excessive internal trap pressure, a pressure relief valve set to open at approximately 30 psig and a rupture disk are installed. The rupture disk is to be nominally rated at ≤ 61.1 psig at a coincident temperature of 72° F (equivalent to 54.4 psig at 190° F) which is \leq the cold trap MAWP and in accordance with the manufacturer's range as specified by Section VIII of the ASME Pressure Vessel Code. To ensure the design differential across the rupture disk is not exceeded, the relief drum pressure is evacuated to ≤ 0.3 psia prior to the cold trap flashing operation. Rupture of the cold trap could result in the release of UF₆ and other toxic gases such as ClF₃ [SAR Section 3.8.3.4].

DELETE

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.3 Cold Recovery Enrichment

APPLICABILITY: Cold Recovery Operational Mode II

LCO: The U^{235} enrichment of a gas mixture to be cold trapped shall not exceed:

- 5. 5.0% in X-333 Cold Recovery
- 6. 10% in X-330 Cold Recovery

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Mode II	SR 2.4.3.3.1 Verify by Cascade location of material source or sample result the U_{235} enrichment to be : ≤ 5.0% in X-333 OR ≤ 10.0% in X-330

BASIS:

The cold trapping gas mixtures of a U^{235} enrichment greater than the stated limitations under optimum reflection could result in a critical reaction within the Cold Recovery system [SAR Section 5.2, Appendix A, section 1.8]. The X-330 Cold Recovery operation has been analyzed to be safe at an enrichment of 27% U^{235} .

DELETE

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.4 X-333 Wet Air Evacuation Enrichment

APPLICABILITY: Cold Recovery Operational Mode V

LCO: U²³⁵ enrichment of gas mixture to be vented through Wet Air Alumina traps shall not exceed 3.0%.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Mode V	SR 2.4.3.4.1 Verify U ²³⁵ enrichment by sampling or source location

BASIS:

The venting of wet air mixtures of a U²³⁵ enrichment greater than the stated limitations under optimum reflection could result in a critical reaction within the X-333 Alumina traps. There is not a limiting enrichment for the X-330 wet air operation due to the use of 5 inch traps. Although there is a "T" section in the vent line that has a enrichment limitation of 27% U²³⁵ the plant limitation of 10% enrichment addresses this situation [SAR Section 5.2, Appendix A, section 1.3].

DELETE

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.5 Reaction Products

APPLICABILITY: Cold Recovery Operational Mode II

LCO: The cold trapping of gas mixtures containing reaction products and/or ClF_3 shall meet the following requirements:

- F. Mixtures containing Freon and ClF_3 shall not be cold trapped unless the Freon concentration is ≤ 16.9 mole %.
- G. Mixtures shall contain quantities of ClF_3/F_2 not less than 0.14 mole % or not more than 5.25 mole % ClF_3 .
- H. Cold trap inlet pressure shall not exceed 3.3 psia.
- I. Cold trap upper shell temperature shall not be lower than -65°F .

ACTIONS:

Condition	Required Actions	Completion Time
C. Cold Trapping material concentration does not comply with limitations, i.e., > 16.9 mole% Freon or < 0.14 mole % ClF_3 or > 5.25 mole % ClF_3	A.1 Close cold trap inlet valve	Immediately
B. Col trap upper shell temperature between -65°F and -70°F	B.1 Increase cold trap temperature to -65°F or warmer	Immediately
C. Cold trap upper shell temperature lower than -70°F	C.1 Close cold trap inlet valve	Immediately
D. Cold trap inlet pressure > 3.3 psia	D.1 Decrease cold trap inlet pressure to ≤ 3.3 psia	Immediately

DELETE

DELETE

SECTION 2.4 SPECIFIC TSRS FOR X-330 AND X-333 COLD RECOVERY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCE

2.4.3.5 Reaction Products (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Mode II	SR 2.4.3.5.1 Verify sample or Infrared Analyzer results of drum bank material be trapped are with in LCO limitations
Twice a shift, after entering Mode II	SR 2.4.3.5.2 Monitor cold trap inlet pressure and upper shell temperature

BASIS:

Failure to control the concentrations of various mixtures of coolant and ClF_3 can result in liquification of these materials in the cold trap and formation of violently reactive mixtures that could ignite when the trap is flashed creating an over-pressure situation. Rupture of the trap and the release of toxic gases into the cold trap room can only occur if the pressure relief system fails to operate [SAR Section 3.8.3.4].

DELETE

~~DELETE~~

~~SECTION 2.4 SPECIFIC TSRs FOR X-330 AND X-333 COLD RECOVERY~~

~~2.1.4 GENERAL DESIGN FEATURES~~

~~NONE~~

~~DELETE~~

DELETE

**SECTION 2.5 SPECIFIC TSRs
FOR
X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

DELETE

DELETE

2.1.5 WITHDRAWAL STATION OPERATIONAL MODES

- | | | |
|------------|--------------------------------------|---|
| I | Preparation | Withdrawal station checkout performed, UF ₆ cylinder weighing, inspection and hookup completed. |
| II | Compression/
Liquifaction | Withdrawal loop compressors running, loop UF ₆ supply suction valve open, inlet valve to UF ₆ condenser open and liquifaction of UF ₆ is based on temperature/pressure conditions. |
| III | Withdrawal | Liquid UF ₆ is draining into a cylinder; filled cylinders are being disconnected, weighed or placed by crane into local storage for cool down. |
| IV | Standby | Withdrawal loop compressors shutdown or operating on recycle, withdrawal loop UF ₆ supply suction valve open or closed, vent valve(s) establishing a vent path from the compression loop to the cascade are open or closed. The withdrawal loop may still contain stored UF ₆ but station pressure remains below atmospheric. |
| V | Transport | Cylinders being moved from local storage lot for further handling and storage. |
| VI | Shutdown | Withdrawal loop compressors not running, withdrawal loop UF ₆ supply suction valve closed and UF ₆ evacuated from the loop. Accumulators may still contain some UF ₆ . |

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

2.1.6 SAFETY LIMITS

APPLICABILITY: All Withdrawal Operational Modes

2.5.2.1 SL: Coolant pressures shall not exceed the values contained in the Safety Limit column of the table below:

LOCATION VERSUS SAFETY LIMIT	
LAW STATION	330 PSIG
ERP STATION	440 PSIG

BASIS:

Overpressurization and rupture (multiple tubes) of the coolant system into the UF₆ system could result in the subsequent release of UF₆ due to overpressurization of the UF₆ enrichment system. The Safety Limit has been established at 110% of the MAWP based on the ASME Pressure Vessel Code, Division I, Section VIII. While not directly applicable to this application, the 110% overpressurization value does indicate that there is a high degree of confidence that the vessel pressure boundary will not fail at 110% of the stated MAWP. [SAR Section 3.8.3.4]

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.1 Criticality Accident (Radiation) Alarm Systems

LCO 2.5.3.1a: Criticality accident detection shall be operable

APPLICABILITY: In areas, equipment, or processes which contain greater than 700 grams of ²³⁵U at an enrichment greater than or equal to 1.0 wt % ²³⁵U.

ACTIONS:

Condition	Required Action	Completion Time
<p>7. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>A.1 Implement the following for areas, equipment, or processes applicable to this LCO and that are not otherwise covered by criticality accident detection.</p> <p>A.1.1 Discontinue movement of cylinders containing UF₆ enriched to ≥ 1.0 wt % ²³⁵U. <u>AND</u></p> <p>A.1.2 Waste containing uranium enriched to ≥ 1.0 wt % ²³⁵U shall not be moved <u>AND</u></p> <p>A.1.3 Discontinue maintenance activities that require breach of containment of equipment containing uranium enriched to ≥ 1.0 wt % ²³⁵U. <u>AND</u></p> <p>A.1.4 Complete current cycle and then discontinue withdrawal of UF₆ enriched to ≥ 1.0 wt % ²³⁵U <u>AND</u></p> <p>A.2.1 Evacuate area within the area not covered by criticality accident detection. <u>AND</u></p> <p>A.2.2 Restrict access to area evacuated in A.2.1. <u>AND</u></p> <p>A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification such as a device that will alarm on sensing a 10m/hr dose rate.</p>	<p>Immediately</p> <p>Immediately</p> <p>Immediately</p>
<p>B. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>B.1.1 Restore criticality accident detection by installing portable CAAS unit providing required criticality accident detection and same alarms as fixed unit. <u>OR</u></p> <p>B.1.2 Restore criticality accident detection to operable status.</p> <p>TSR 1.6.2.2d is not applicable.</p>	<p>48 hours</p> <p>48 hours</p>

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.1 Criticality Accident (Radiation) Alarm System (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Semiannually	SR 2.5.3.1.1 Calibrate radiation clusters to a set point of 5 mRad/hr. in air
	SR 2.5.3.1.2 Verify that the cluster nitrogen horn and the X-300 alarm sounds when two out of three channels in a cluster are tripped.
Quarterly	SR 2.5.3.1.3 Verify that the nitrogen supply pressure to the cluster horns is at least 900 psig.

BASIS:

Within the cluster, three neutron-sensitive detection units are provided to detect radiation from a criticality accident. Clusters are designed and calibrated to detect and alarm on a minimum credible criticality accident of concern, defined as producing an integrated total dose of 20 Rads. in one minute at two meters from the reacting material. This system will provide an audible signal in the event of a criticality that will alert personnel to evacuate the immediate work areas. The minimum acceptable length of time for the CAAS horn to sound is 2 minutes [SAR Sections 3.8.7.1 and 4.3.2.6].

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.2 Coolant High Pressure Relief System

APPLICABILITY: Withdrawal Operational Modes II, III, IV

LCS: Coolant pressure set points shall be in accordance with the following table:

LOCATION VERSUS LIMITING CONTROL SETTING	
LAW STATION	≤ 300 PSIG
ERP STATION	≤ 400 PSIG

LCO: The coolant high pressure relief system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
E. Rupture disk inoperable	A.1 Place the affected withdrawal loop in Mode VI	30 Minutes
B. Block valve closed and/or seal broken	B.1 Open or verify valve open AND	Immediately
	B.2 Reseal valve	8 Hours
C. Condition B Required Actions and/or Completion Time not accomplished	C.1 Place the affected withdrawal loop in Mode VI	30 Minutes

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.2 Coolant High Pressure Relief System (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each withdrawal loop post maintenance startup	SR 2.5.3.2.1 Verify isolation block valve sealed open

BASIS:

The 1995 ASME Pressure Vessel Code, Division I, Section VIII requires that overpressure relief be provided by a device stamped at or below the MAWP and sized such that the subsequent transient pressure will be limited to a maximum of 110% of MAWP. ASME Code allows rupture disks to have a 5% burst tolerance. Rupture disks stamped at MAWP will therefore burst at or below 105% of MAWP. The LCS is set at 100% of MAWP. To comply with these standards, pressure relief devices are purchased and installed on the Cascade cell coolant condensers with stamped ratings at or below the MAWP [SAR Section 3.8.3.4]. The Tails Withdrawal uses a heat transfer medium with a much lower vapor pressure that remains as a liquid. As a result, there cannot be a catastrophic failure of the equipment.

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

**2.5.3 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES~~**

2.5.3.3 ~~UF₆ Smoke Detection~~

APPLICABILITY: Withdrawal Operational Modes II, III

LCO: Compressor/Accumulator UF₆ Smoke Detectors shall be operable.

ACTIONS: ~~Note: TSR 1.6.2.2(d) does not apply~~

Condition				Required Actions	Completion Time
A. Smoke detectors operable				A.1 Provide a continuous smoke watch	1 Hour
Location	ERP	LAW	TAILS		
Inside Compressor Housing	< 2	< 2	< 2		
Outside Compressor Housing per Compressor	< 1	< 1	< 1		
Condenser/Accumulator Area	< 2	< 2	< 2		

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Monthly	SR 2.5.3.3.1 Perform test of active CADP smoke detectors to verify that the smoke detectors have provided an alarm condition in the ACR.
Quarterly	SR 2.5.3.3.2 Test active smoke heads to ensure alarm indication will occur when smoke head is exposed to a simulated smoke condition.

BASIS:

In the event of a UF₆ release in the compressor area or withdrawal room, an alarm will sound in the ACR notifying operating personnel that immediate investigation and action must occur. The smoke detection system is sensitive enough to detect very minor out gassings of UF₆ and therefore will prompt the operator actions necessary to minimize the amount of UF₆ released [SAR Sections 3.8.7.3, 4.3.2.2.1, and 4.3.2.2.12].

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.4 Pigtail Line Isolation System

APPLICABILITY: Withdrawal Operational Modes II,III

LCO: Pigtail line isolation system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
D. One smoke detector for a withdrawal position inoperable	A.1 Restore operability and may complete current cylinder filling	Prior to start of new cylinder filling
B. Both smoke detectors for a withdrawal position inoperable	B.1 Isolate cylinder and withdrawal manifold AND	15 Minutes
	B.2 Restore operability	Prior to initiation/resuming cylinder filling
C. Isolation valve(s) inoperable	C.1 Isolate cylinder and withdrawal manifold AND	15 Minutes
	C.2 Restore operability	Prior to initiation/resuming cylinder filling

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Quarterly	SR 2.5.3.4.1 Perform channel functional test to verify that with the simulation of smoke at the smoke detectors the two isolation valves will close within ≤ 30 seconds after detection.

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.4 Pigtail Line Isolation System (continued)

BASIS:

Failure of the cylinder pigtail during the filling of a cylinder would result in a UF₆ release. Operation of the pigtail isolation system to close the isolation valves would minimize the quantity of UF₆ released. Prior to initiation of withdrawal, both smoke detectors over the withdrawal position must be operable. This system is actuated by either of the 2 smoke detectors over each withdrawal position or can be initiated manually [SAR Sections 3.8.4.1, 4.3.2.2.4, and 4.3.2.2.11].

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.5 Assay Monitoring

APPLICABILITY: Withdrawal Operational Modes II, III

LCO: Assay monitoring shall be required when withdrawing > 1.0% U²³⁵ material.

ACTIONS:

Condition	Required Actions	Completion Time
D. Assay and Gamma spectrometer inoperable	A.1 Initiate 2 hour sampling with assay result in 4 hours.	2 Hours
	OR	
	A.2 Place the affected withdrawal loop in Mode IV	2 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.5.3.5.1 Perform a comparison of the assay spectrometer reading against a known assay controller sample and make any necessary assay spectrometer adjustments.

BASIS:

Enrichment monitoring of the UF₆ withdrawn into shipping containers is essential to ensuring that the maximum enrichment, as it relates to the other necessary parameters (geometry, moderation, mass, etc.), required for a critical reaction is not exceeded. This monitoring is essential for the Tails area to ensure the enriched assay of the accumulators is not exceeded. The monitoring at the ERP and LAW stations enhance the controls necessary to ensure that enrichment limitation for the autoclave are not exceeded [SAR Section 5.2, Appendix A, section 1.4].

DELETE

DELETE

SECTION 2.5 — SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.6 Withdrawal Accumulator Enrichment

APPLICABILITY: Withdrawal Operational Modes II, III

LCO: Withdrawal accumulator UF₆ enrichment limitation shall be in accordance with table below:

LOCATION	SIZE	ENRICHMENT
ERP-1	4 INCH	≤ 10%
ERP-2	8 INCH	≤ 10%
LAW A & B	8 INCH	≤ 10%
TAILS	10 INCH	≤ 5%
TAILS	30 INCH	≤ .95%

ACTIONS:

Condition	Required Actions	Completion Time
D. Enrichment limitation exceeded	A.1 Place withdrawal loop in Mode IV	15 Minutes

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Every 2 Hours	SR 2.5.3.6.1 Monitor assay spectrometer and/or samples to verify enrichment limitations are being met

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.6 Withdrawal Accumulator Enrichment (continued)

BASIS:

Storing UF₆ of a U²³⁵ enrichment greater than the stated limitations in the Withdrawal Area accumulators could result in a critical reaction. The ERP-1 accumulator has been analyzed to be safe at an enrichment of 100% U²³⁵. [SAR Section 5.2 Appendix A, section 1.4].

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326, ERP, X-333, LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.7 UF₆ Cylinder Enrichment

APPLICABILITY: Withdrawal Operational Mode III

LCO: A. UF₆ Cylinder weighted average enrichment limitation shall be in accordance with table below:

B. UF₆ condensing pressure ≤ 45 psig

	14-Ton	10-Ton	10-Ton*	2.5-Ton
Cylinder Diameter Inches	48	48	48	30
Weighted Average Product Assay % U ²³⁵ Full Cylinder	≤ 4.5	≤ 4.5	≤ 5.0	≤ 5.0
Maximum Assay % U ²³⁵	5.25	10.0	10.0	10.0
* Applies only to properly identified 48X intraplant cylinders.				

ACTIONS:

Condition	Required Actions	Completion Time
C. Enrichment limitation exceeded	A.1 Close the cylinder valve	15 Minutes
B. Condensing pressure limitation exceeded	B.1 Reduce condensing pressure to ≤ 45 psig AND	15 Minutes
	B.2 Place the withdrawal loop in Mode IV	30 Minutes

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.7 UF₆ Cylinder Enrichment (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Every 2 hours	SR 2.5.3.7.1 Monitor assay spectrometer and/or samples to verify enrichment limitations are being met
Once per shift	SR 2.5.3.7.2 Monitor the condenser pressure to ensure \leq 45 psig

BASIS:

Filling a UF₆ cylinder with a U²³⁵ enrichment greater than the stated limitations eliminates one of the two constraints assumed to be present to prevent a criticality. Three nuclear criticality safety reports (POEF-T-3597, POEF-T-3563, and GAT-DM-1333) provide the justification for the the acceptability of filling 14-ton cylinders with 5.25% material and 10-ton cylinders with 10% material. The maximum assay values are predicated on the liquid filling of the cylinders under moderation control. Moderation control is based on maintaining a H/U ratio \leq .088. High concentrations of HF cannot enter the condensation/liquification stations from the cascade since, as a light gas, HF preferentially proceeds toward the cascade top to be removed by either the Top or Side Purge Cascade. The controlling of the condenser pressure \leq 45 psig will provide added assurance that what HF is present will not condense [SAR Section 5.2, Appendix A, section 1.4].

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.8 UF₆ Cylinder Cart Movement

APPLICABILITY: Withdrawal Operational Mode III

LCO: Movement of the cylinder cart, shall be prohibited while the cylinder is connected to the withdrawal manifold.

ACTIONS:

Condition	Required Actions	Completion Time
4. Air interlock key not over pigtail or air hose not disconnected from cylinder cart	A.1 Tag out the air supply to cylinder cart OR	Immediately
	A.2 Stop UF ₆ withdrawal and disconnect pigtail	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each pigtail connection	SR 2.5.3.8.1 Verify air interlock key is over pigtail prior to starting UF ₆ withdrawal

BASIS:

Movement of the cylinder cart while a UF₆ cylinder is connected to the withdrawal manifold and boundary valves are open, may lead to a large UF₆ release [SAR Section 4.3.2.2.11].

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.9 Liquid UF₆ Cylinder Movement

APPLICABILITY: Withdrawal Operational Modes III, V

LCO: Cylinders containing liquid UF₆ shall be moved by overhead cranes or scale carts.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each cylinder disconnection	SR 2.5.3.9.1 Verify the cylinder valve protector has been installed prior to removing cylinder from withdrawal cart.
Prior to cylinder movement by forklift or straddle carrier	SR 2.5.3.9.2 Verify the cylinder cooling time for solidification has been met.

BASIS:

A liquid UF₆ release is significantly more severe than a release from a solid UF₆ source. Equipment reliability of straddle carriers and forklifts and road traffic conditions increase the risk of having a liquid UF₆ release. The handling of liquid UF₆ cylinders with cranes or scale carts is more reliable and therefore represents a lower risk. In the event a cylinder containing solid UF₆ is dropped, while the cylinder integrity may be compromised the rate of escaping UF₆ is sufficiently low enough to limit the release to several pounds upon taking emergency actions. SAR Section 3.2.4.5 provides the general guidelines used in determining UF₆ solidification [SAR Sections 3.8.6.2, 3.8.6.3, 4.3.2.2.4, and 4.3.2.2.15].

Solidification Criteria

- 48-inch cylinders containing less than 4000 pounds of liquid UF₆ must cool for at least 24 hours.
- 48-inch cylinders containing 4000-8000 pounds of liquid UF₆ must cool for at least 48 hours.
- 48-inch cylinders containing more than 8000 pounds of liquid UF₆ must cool for at least 5 days.
- 30-inch cylinders (all assumed to be filled to limit) must cool for at least 3 days.
- 5-inch, 8-inch, and 12-inch cylinders must cool for at least 24 hours.

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.10 Liquid UF₆ Handling Cranes

APPLICABILITY: Withdrawal Operational Mode III

LCO: Cranes shall be operable prior to lifting a cylinder containing liquid UF₆.

ACTIONS:

Condition	Required Actions	Completion Time
C. Crane inoperable (hoist brakes, upper/lower limit switches, hook, cable)	A.1 Tag crane out of service	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to first time use during shift	SR 2.5.3.10.1 Perform Operator functional crane inspection of: hoist,trolley,bridge,stop button and upper limit switch
Annually	SR 2.5.3.10.2 Perform load test (100% of rated capacity) and verify that the crane does not allow a load to move (except for compensatory movements) upn operator release of the controls.
Monthly	SR 2.5.3.10.3 Perform OSHA required monthly hands on inspection
Annually	SR 2.5.3.10.4 Perform OSHA required annual hands on inspection

BASIS:

Failure of the crane lifting components or load braking system while lifting a liquid UF₆ cylinder could result in the uncontrolled dropping of the cylinder resulting in a rupture of the cylinder and the release of up to 28,000 pounds UF₆. The OSHA test requirements are contained in 29 CFR 1910. The assurance of operability is provided by the ongoing inspections and tests and enhanced by the Configuration Management Program that addresses component quality and change control. Compensatory movements are small additional movements due to momentum after the crane drive mechanism stops and brakes are applied. These compensatory movements have no safety significance. [SAR Sections 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15].

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.11 Cylinder Fill Weights

APPLICABILITY: Withdrawal Operational Mode III

LCO: UF₆ cylinder fill weight prior to removal of cylinder from scale cart shall be ≤ Standard fill weight given in table below.

CYLINDER CODE	DESCRIPTION	STANDARD FILL WEIGHT lbs. UF₆
30A	2.5 TON	4950
30B	2.5 TON	5020
48A 1-5000	10 TON HW	21030
48X	10 TON HW	21030
48B(T) 5001-9230	10 TON TW	20700
48F 9231-9660	14 TON HW	27030
48Y 9661-9999	14 TON HW	27560
48G(OM) 111820-below	14 TON TW	26070
48G(OM) 111821-above	14 TON TW	28000
48G(HX) 150001-151000	14 TON TW	27030
48G(H) 151001-15xxxx	14 TON TW	27030

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.11 Cylinder Fill Weights (continued)

ACTIONS:

Condition	Required Actions	Completion Time
C. Fill weight > Standard fill weight and cylinder still on scale cart	A.1 Evacuate excess UF ₆ prior to cylinder removal from scale cart	NA
B. Fill weight > Standard fill weight and UF ₆ cylinder removed from scale cart	B.1 Tag cylinder as having been over filled AND	Immediately
	B.2 Transport cylinder with solidified UF ₆ for accountability weighing and handling under autoclave specific LCO 2.1.3.8 "Required Actions"	NA

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each cylinder disconnection	SR 2.5.3.11.1 Verify final cylinder fill weight.
Prior to placing cylinder in the withdrawal position	SR 2.5.3.11.2 Perform a functional test of the scale.

BASIS:

A safe fill limit must accommodate the internal volume of the cylinder, the density of the UF₆ at a specific temperature and an allowance for ullage or the gas volume above the liquid in the cylinder. The operational fill weight is based on providing a 5% ullage or void volume at a heating temperature of 250 °F. The functional test of the scale will consist of obtaining a cylinder tare weight and comparing it to the accountability tare weight to verify that the two weights are within 40 pounds. [SAR Sections 3.8.6.1, 4.3.2.2.2, 4.3.2.2.6, 4.3.2.2.14, and 4.3.2.2.15]

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

**2.5.3 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES~~**

2.5.3.12 ~~UF₆ Cylinder Crane Movement~~

APPLICABILITY: Withdrawal Operational Mode I, III

LCO: No UF₆ cylinder shall be moved over another cylinder if one of the cylinders contains liquid UF₆.

ACTIONS:

Condition	Required Action	Completion Time
C. UF ₆ cylinders lifted one over the other when at least one of the cylinders contains liquid UF ₆ .	A.1 Move the lifted cylinder such that the LCO statement is satisfied.	Immediately

BASIS:

The cylinder drop and puncture scenarios in the accident analysis involving UF₆ cylinders assume a release source term of 28,000 pounds of UF₆. The prohibition of lifting one cylinder over another if one of the cylinders contains liquid UF₆ preserves the accident analysis assumption of only one cylinder contributing to the release source term. [SAR Section 4.3.2.2.15]

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.13 UF₆ Plugs

APPLICABILITY: All Withdrawal Operational Modes

LCO: Direct heat sources shall not be applied to solid UF₆ plugs until line clarity in the system has been assured.

ACTIONS:

Condition	Required Actions	Completion Time
C. Direct heat source being applied to a solid UF ₆ plug	A.1 Discontinue direct heat application to the UF ₆ plug AND	Immediately
	A.2 Ensure line clarity	Prior to reapplying direct heat

BASIS:

The application of an external heat source directly to a UF₆ plug can liquify the UF₆ within the center of the plug and thereby cause sufficient hydraulic forces to rupture the pipe containing the plug. The primary concern over the direct application of heat (i.e., steam tracing, heat tape, etc.) to the plug versus indirect heating (i.e., heated housings) is due to the fact that the energy is added to the plug at such a high rate that it is not evenly distributed over the entire plug and therefore does not allow for the sublimation of the plug before a portion of it liquefies. The secondary concern is that even though the UF₆ plug stays as a solid it must have room to expand. The consequences of a release of UF₆ from this type of failure mechanism would be minimal due to the fact that the UF₆ plug would remain as a solid and therefore, the release rate would be slow as the UF₆ sublimates into the atmosphere.

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.14 Motor Load Indicators

APPLICABILITY: Mode II when second stage compressor motors are running.

LCO: Withdrawal station second stage UF₆ compressor motor load indicators in the ACRs (LCR at ERP) shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
C. ACR (LCR at ERP) compressor motor load indicator inoperable. OR ACR is evacuated.	A.1 Shutdown affected compressor motor. OR	4 Hours
	A.2 Station an operator at station panels to monitor station parameters with communications to the ACR/LCR. [Not applicable if ACR is evacuated.] OR	4 Hours
	A.3 Place affected equipment in Mode IV.	4 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Following compressor motor start.	SR 2.5.3.14.1 Perform a Channel Check of the ACR (LCR at ERP) compressor motor load indicator.

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

**2.5.3 ~~LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR~~
~~OPERATION, SURVEILLANCES~~**

2.5.3.14 ~~Motor Load Indicators~~

BASIS:

The motor load indicators provide an indication of various types of failures of the compressor motors. Using ammeter indications in the ACR (LCR for ERP) for the individual compressor motors, operators can quickly identify most abnormalities caused by various malfunctions of the process equipment. Operator training is relied upon to distinguish between load changes associated with normal fluctuations, such as inventory changes, and equipment malfunctions. Compressor load changes can be caused by such events as compressor failures or failures of the primary system pressure boundary that cause inleakage or a release of UF₆. The detection of an event and mitigative action by the operator will control primary pressure and temperature increases to minimize UF₆ releases for on-site personnel. At ERP, a motor load alarm is actuated in the ACR during an event to provide backup indication when the LCR is unmanned. This system is not essential for off-site public protection. The surveillance requirement is provided to ensure that, after motor start, the ammeter provides nominal indication of motor load. [SAR Sections 3.8.4.4, 4.3.2.2.1, and 4.3.2.2.12]

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.15 Withdrawal Station Compressor Motor Manual Trip System

APPLICABILITY: Mode II when second stage compressor motors are running.

LCO: Withdrawal station second stage UF₆ compressor motor manual trip system shall be operable.

ACTIONS:

Condition	Required Actions	Completion Time
C. ACR (LCR at ERP) compressor motor stop button inoperable (not due to loss of DC voltage)	A.1 Notify Cascade Control of potential need to utilize alternate means for applicable compressor motor shutdown.	Immediately
	AND	
	A.2 Station an operator at an established alternate motor shutdown location with communications to the ACR (LCR for ERP) or PCF.	8 Hours
	OR	
	A.3 Shutdown affected UF ₆ compressor motors	8 Hours
	OR	
	A.4 Place affected equipment in Mode IV.	8 hours

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326, ERP, X-333, LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.15 Withdrawal Station Compressor Motor Manual Trip System (continued)

ACTIONS: (continued)

Condition	Required Actions	Completion Time
<p>B. Battery/connected cell/charger conditions (other than voltage) found outside surveillance parameters.</p>	<p>B.1 If the AC battery charger is inoperable, verify that the applicable battery is operable. AND B.2 If battery/cell conditions are found outside surveillance parameters, restore battery/cell parameters to within limits. TSR 1.6.2.2.d does not apply.</p>	<p>8 Hours 90 Days</p>
<p>C. DC voltage potential < 200 volts at applicable battery room. OR No DC power at the compressor motor breaker.</p>	<p>C.1 Notify Cascade Control of potential need to utilize alternate means for applicable compressor motor shutdown. AND C.2 Station an operator at an established alternate motor shutdown location with communications to the ACR (LCR for ERP) or PCF. OR C.3 Shutdown affected UF₆ compressor motors. OR C.4 Place affected equipment in Mode IV.</p>	<p>Immediately 8 Hours 8 Hours 8 Hours</p>

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.15 Withdrawal Station Compressor Motor Manual Trip System (continued)

ACTIONS: (continued)

Condition	Required Actions	Completion Time
D. Required Action B.2 not accomplished.	D.1 Station an operator at an established alternate motor shutdown location with communications to the ACR (LCR for ERP) or PCF. OR	8 Hours
	D.2 Shutdown affected UF ₆ compressor motors. OR	8 Hours
	D.3 Place affected equipment in Mode IV.	8 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.5.3.15.1 Verify withdrawal station DC bus voltage \geq 200 volts DC.
Daily	SR 2.5.3.15.2 Verify DC power is available at UF ₆ compressor motor breakers.
Daily	SR 2.5.3.15.3 Verify that the battery charger output is $>$ 0 DC amps.
Quarterly	SR 2.5.3.15.4 Inspect battery terminals and racks for evidence of corrosion and for cell leakage of electrolyte.

DELETE

DELETE

SECTION 2.5 SPECIFIC TSRs FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS

2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.5.3.15 Withdrawal Station Compressor Motor Manual Trip System (continued)

SURVEILLANCE REQUIREMENTS: (continued)

Frequency	Surveillance
Quarterly	SR 2.5.3.15.5 Check that the specific gravity of the pilot cell is ≥ 1.180 .
Quarterly	SR 2.5.3.15.6 Visually check the cell electrolyte levels to verify that the level is above the low level indication line and no more than 0.25 inches above the high level indication line.
Annually	SR 2.5.3.15.7 Check that the specific gravity of the cells is ≥ 1.180 .
Each scheduled motor trip prior to restart after a planned motor trip	<p>SR 2.5.3.15.8 Utilize the ACR (or LCR for ERP) motor stop button for each planned motor trip or verify that the motor stop button opens the breaker prior to restart.</p> <p>Note: Performance of this surveillance to demonstrate system operability is not required for any compressor in operation until the next planned shutdown.</p>

BASIS:

The compressor motor manual trip system aids in the prevention and mitigation of UF₆ releases during withdrawal station operations by reducing the operating pressure and temperature to minimize the potential for process system integrity failure and to minimize the release of UF₆ after a failure of the system integrity. Station compressor motors can be tripped from their associated ACRs with the exception of ERP which is tripped from the Local Control Room (LCR). All three withdrawal stations have emergency trip capability in the PCF but this trip is a withdrawal station trip, not just a compressor trip. This PCF trip button is not required to satisfy this LCO but may be used as an alternate trip method when specified by a Required Action statement. Additional alternate trip capability exists at the motor control center for each compressor.

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

**2.5.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR
OPERATION, SURVEILLANCES**

2.5.3.15 Withdrawal Station Compressor Motor Manual Trip System (continued)

BASIS: (continued)

In order to demonstrate the reliability of the ACR compressor motor trip function (LCR at ERP), motor trips that are not required to mitigate a transient condition will be performed utilizing the "motor stop" capability, or an alternate test (i.e., tripping the motor breakers prior to compressor motor startup). Either method is satisfactory to demonstrate the operability of the motor trip function. Other available shutdown locations, such as the switchyard are considered alternate shutdown locations. Because of the number of available trip locations, these alternate locations are not tested periodically. Internal resistance of the cascade equipment slows repressurization of the shutdown equipment, allowing inleakage rather than outleakage which will mitigate the release until necessary valve evolutions can take place to isolate the system from any additional supply of UF₆ and to prepare the system for compensatory action and repair. In order to initiate a compressor motor shutdown for some withdrawal station compressor, the DC control and trip power circuit must be operable (Certain withdrawal station (second stage) compressor motor manual trip circuits are fail-safe and do not require the DC power system to perform their safety function. The TSR requirements associated with the DC power supply are not applicable to these compressors). However the failure of the local trip circuit to function on demand does not constitute a significant impact on any of the scenarios where shutdown is assumed to occur sometime during the scenario. This is due to the numerous alternate and independent means available for disrupting power, i.e., breaker manual trip, switchyard de-energization of electrical feeders, buses, transformer bays, or main switchyard lines. The battery surveillances provide additional assurance that the battery system will be able to deliver the power necessary to trip the compressor motor breakers as long as the system voltage is maintained above 200 volts. [SAR Sections 3.8.4.2, 4.3.2.2.1, 4.3.2.2.4, and 4.3.2.2.12]

DELETE

DELETE

SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS WITHDRAWAL STATIONS~~

2.5.4 GENERAL DESIGN FEATURES

2.5.4.1 UF₆ Cylinder Lifting Fixtures

DF: UF₆ cylinder lifting fixtures are designed with a safety factor of 5 to 1.

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.5.4.1.1 Perform load test (100% of rated capacity)
Prior to first time use during shift	SR 2.5.4.1.2 Perform inspection of cylinder lifting fixture

BASIS:

Lifting fixtures used to handle liquid filled UF₆ cylinders are credited for prevention of the liquid cylinder drop and rupture accident scenario [SAR Sections 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15]

2.5.4.2 UF₆ Cylinders

DF: Large UF₆ (2.5 Ton and greater) cylinders are as a minimum designed to a MAWP of 100 psig

SURVEILLANCE:

Frequency	Surveillance
5 Years	SR 2.5.4.2.1 Perform hydrostatic test on large UF ₆ cylinder with the following exception; cylinders that are full of UF ₆ but have an expired hydrostatic test date may be heated for removal of the UF ₆ but shall be hydrostatic tested prior to refilling.
Prior to cylinder filling	SR 2.5.4.2.2 Inspect cylinder for defects

BASIS:

UF₆ cylinder MAWP \geq 100 psig is a basic assumption in the accident analysis and relates to the overall structural integrity of the UF₆ containment barrier. [SAR Sections 3.8.6.1, 4.3.2.2.4, and 4.3.2.2.11]

DELETE

DELETE

**SECTION 2.5 SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS
WITHDRAWAL STATIONS**

2.1.4 GENERAL DESIGN FEATURES

2.5.4.3 UF₆ Cylinder Pigtails

DF: Newly fabricated pigtails are designed to withstand at least 400 psig

SURVEILLANCE:

Frequency	Surveillance
Prior to initial use	SR 2.5.4.3.1 Inspect and perform hydrostatic test at least to 400 psig and ensure inspection tag is attached to the pigtail

BASIS:

Structural integrity of the pigtail significantly reduces the likelihood of a catastrophic rupture [SAR Sections 3.8.4.5, 4.3.2.2.4, and 4.3.2.2.11]

2.5.4.4 Scale Pit Raschig Rings

DF: ERP, LAW and Tails scale pits shall contain Borosilicate glass Raschig rings to a minimum depth of 6 inches.

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.5.4.4.1 Verify that the surveillance requirements contained in ANSI Standard 8.5 are satisfied.

BASIS:

The scale pits contain Raschig Rings to enhance nuclear criticality safety [SAR Section 5.2, Appendix A, section 1.4]

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

2.5.4.5 Overhead Crane Capacity

DF: Cranes that transport cylinders containing liquid UF₆ are designed with a minimum lifting capacity of 18 tons.

SURVEILLANCE:

Frequency	Surveillance
Annually	SR 2.5.4.5.1 Perform surveillance in accordance with SR 2.5.3.10.2.

BASIS:

Cranes used to handle liquid UF₆ cylinders are credited for prevention of a liquid cylinder drop and rupture [SAR Sections 3.8.6.2, 4.3.2.2.4, and 4.3.2.2.15]

DELETE

DELETE

**SECTION 2.5 ~~SPECIFIC TSRS FOR X-326 ERP, X-333 LAW, AND X-330 TAILS~~
WITHDRAWAL STATIONS**

2.5.4.6 Liquid UF₆ Cylinder Handling Scale Carts

DF: The scale carts that carry liquid UF₆ cylinders are designed and maintained not to fail in a manner to cause primary system integrity failure.


SURVEILLANCE:

Frequency	Surveillance
Biennially	SR 2.5.4.6.1 Perform a visual inspection of the scale cart for structural damage.

BASIS:

The scale carts are designed and maintained to handle weight loads appropriate for their usage to minimize the potential of cylinder failure during handling of cylinders containing greater than 500 lbs. of liquid UF₆. [SAR Sections 3.8.6.3, 4.3.2.2.4, and 4.3.2.2.15]

DELETE

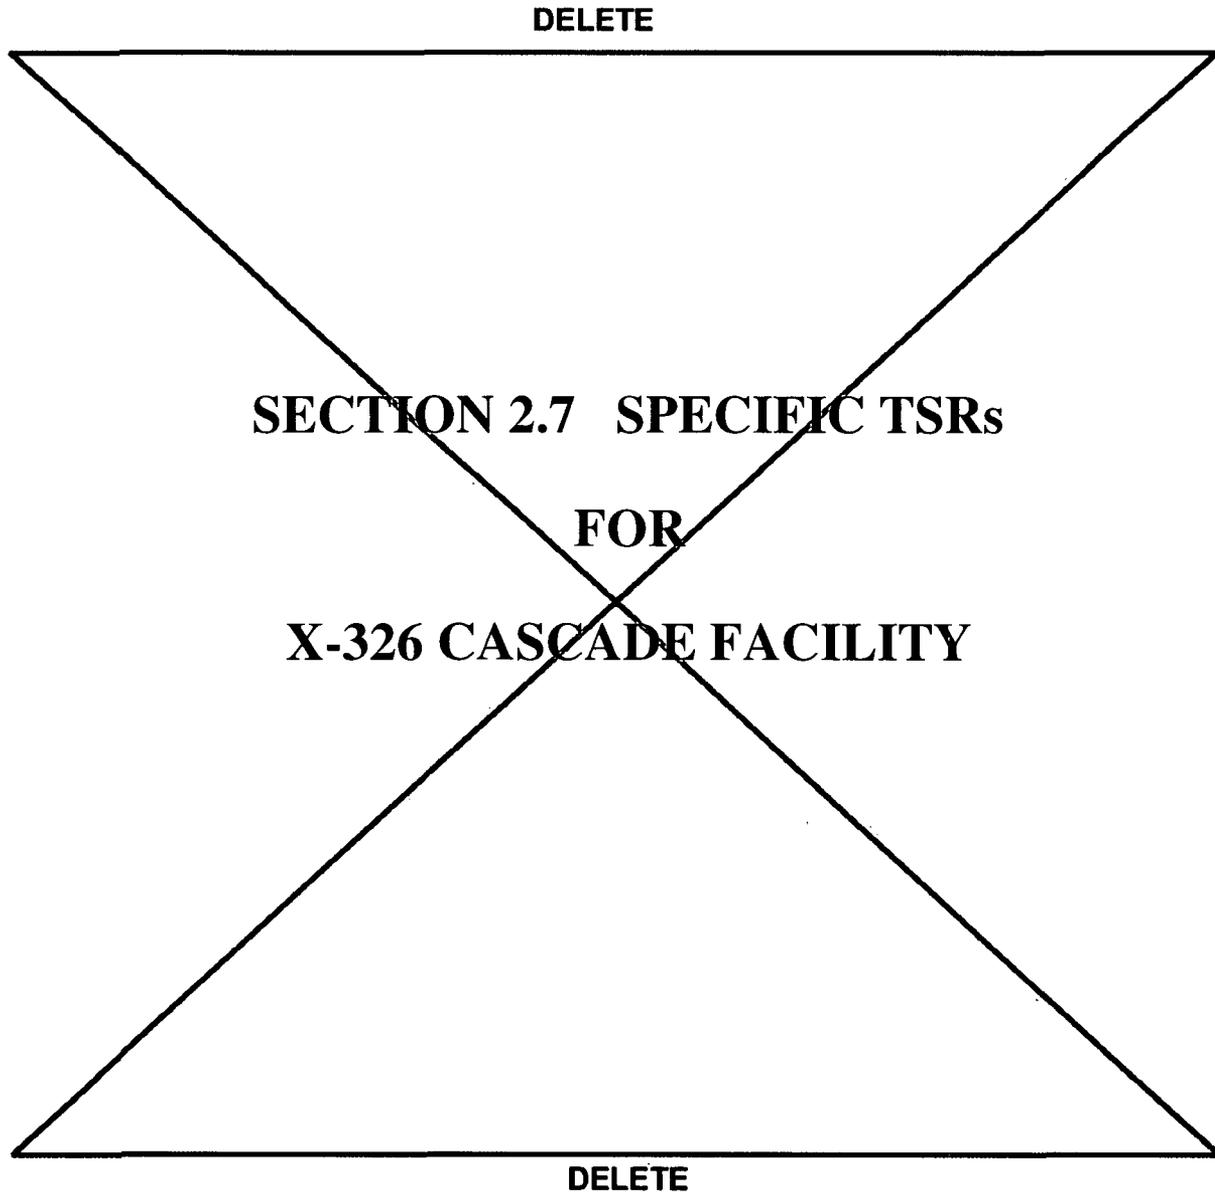

DELETE

SECTION 2.7 ~~SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

2.1.5 X-326 CASCADE OPERATIONAL MODES:

I	Startup/Checkout	Cell/equipment motors ready to be energized and cell/equipment made ready for startup.
II	Operating	Motors energized and Cell/Equipment pressurized with UF ₆ to > Cascade Minimum Suction Pressure.
III	Standby	Motors energized, UF ₆ at ≤ Cascade Minimum Suction Pressure.
IV	Treatment	Cell/Equipment isolated from Cascade, initial charge of ClF ₃ /F ₂ fed into cell/equipment.
V	Floating	Motors de-energized and isolation block valve(s) open and UF ₆ pressure ≥ Cascade Minimum Suction Pressure.
VI	Shutdown	Cell/Equipment motors de-energized, block/boundary valves closed.
VII	Venting	Purge Cascade is venting non-UF ₆ gases to atmosphere.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.6 SAFETY LIMITS

APPLICABILITY: All Cascade Operational Modes

2.7.2.1 SL: Cell coolant pressure shall be \leq 440 psig

BASIS:

Overpressurization and rupture (multiple tubes) of the coolant system into the UF₆ system could result in the subsequent release of UF₆ due to overpressurization of the UF₆ enrichment system. The Safety Limit has been established at 110% of the MAWP based on the ASME Pressure Vessel Code, Division I, Section VIII. While not directly applicable to this application, the 110% overpressurization value does indicate that there is a high degree of confidence that the vessel pressure boundary will not fail at 110% of the stated MAWP.

APPLICABILITY: All Cascade Operational Modes (except during maintenance)

2.7.2.2 SL: Cascade pressures shall be \leq 16 psia

BASIS:

Overpressurization and rupture of the cascade system could result in a release of UF₆ to the cell housing and potentially to the atmosphere.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.7 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.1 Coolant High Pressure Relief System

APPLICABILITY: Cascade Operational Modes II, III

LCS: ≤ 400 PSIG.

LCO: Coolant high pressure relief system shall be operable.

ACTIONS:

Conditions		Required Actions	Completion Time
F.	Rupture disk inoperable	A.1 Place cell/equipment in Mode VI	30 Minutes
B.	Isolation block valve closed or seal broken	B.1 Open or verify open valve AND	Immediately
		B.2 Reseal valve	8 Hours

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to entering Mode II or III from any of Modes I, IV, or VI	SR 2.7.3.1.1 Verify isolation block valve sealed open

BASIS:

The 1995 ASME Pressure Vessel Code, Division I, Section VIII requires that overpressure relief be provided by a device stamped at or below the MAWP and sized such that the subsequent transient pressure will be limited to a maximum of 110% of MAWP. ASME Code allows rupture disks to have a 5% burst tolerance. Rupture disks stamped at MAWP will therefore burst at or below 105% of MAWP. The LCS is set at 100% of MAWP. To comply with these standards, pressure relief devices are purchased and installed on the Cascade cell coolant condensers with stamped ratings at or below the MAWP [SAR Section 3.8.3.4].

DELETE

DELETE

SECTION 2.7 ~~SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.2 Criticality Accident (Radiation) Alarm Systems

LCO 2.7.3.2a: Criticality accident detection shall be operable.

APPLICABILITY: In areas, equipment, or processes which contain greater than 700 grams of ²³⁵U at an enrichment ≥ 1.0 wt % ²³⁵U.

ACTIONS:

Condition	Required Action	Completion Time
<p>E. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>A.1 Implement the following for areas, equipment, or processes applicable to this LCO and that are not otherwise covered by criticality accident detection.</p> <p>A.1.1 Discontinue cell maintenance activities that require breach of the containment boundary of cells containing UF₆ enriched to ≥ 1 wt % ²³⁵U. <u>AND</u></p> <p>A.1.2 Monitor temperatures/pressures in the cascade cells containing UF₆ enriched to ≥ 1 wt % ²³⁵U hourly to maintain UF₆ in the gaseous state. <u>AND</u></p> <p>A.1.3 Waste containing uranium enriched to ≥ 1 wt % ²³⁵U shall not be handled. <u>AND</u></p> <p>A.1.4 Monitor temperature and pressure of surge drums containing UF₆ enriched to ≥ 1 wt % ²³⁵U hourly to maintain inventory in gaseous state. <u>AND</u></p> <p>A.2.1 Evacuate the area not covered by detection capability. <u>AND</u></p> <p>A.2.2 Restrict access to area evacuated in A.2.1. <u>AND</u></p> <p>A.3 Provide personnel allowed into the area that would be restricted under Action A.2.1 with an alternate means of criticality alarm notification such as a device that will alarm on sensing a 10mr/hr dose rate.</p>	<p>Immediately</p> <p>Immediately</p> <p>Immediately</p>
<p>B. Areas, equipment, or processes not covered by criticality accident detection.</p>	<p>B.1.1 Restore criticality accident detection by installing portable CAAS unit providing required criticality accident detection and same alarms as fixed unit. <u>OR</u></p> <p>B.1.2 Restore criticality accident detection to operable status.</p> <p>TSR 1.6.2.2(d) is not applicable.</p>	<p>48 Hours</p> <p>48 Hours</p>

DELETE

DELETE

~~SECTION 2.7 - SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.7.3.2 Criticality Accident (Radiation) Alarm Systems (continued)~~

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Semiannually	SR 2.7.3.2.1 Calibrate radiation clusters to a set point of 5 mRad/hr. in air
	SR 2.7.3.2.2 Verify that the cluster nitrogen horn and X-300 alarm sounds when two out of three channels in a cluster are tripped.
Quarterly	SR 2.7.3.2.3 Verify that the nitrogen supply pressure to the cluster horns is at least 900 psig.

~~BASIS:~~

~~Within the cluster, three neutron-sensitive detection units are provided to detect radiation from a criticality accident. Clusters will actuate an alarm within 0.5 seconds after activation by a minimum credible criticality accident of concern, defined as producing an integrated total dose of 20 Rads. in one minute at two meters from the reacting material. This system will provide an audible signal in the event of a criticality which will alert personnel to evacuate the immediate work areas. The minimum acceptable length of time for the CAAS horn to sound is 2 minutes [SAR Sections 3.8.7.1 and 4.3.2.6].~~

DELETE

DELETE

~~SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.7.3.3 High Pressure Fire Water System~~

~~**APPLICABILITY:** Cascade Operational Modes I through VII, Mode VI is not applicable when the lube oil is valved off or removed from the cells covered by a specific sprinkler system~~

~~**LCO:** The high pressure fire water system shall be operable.~~

~~**ACTIONS:** Note: TSR 16.2.2(d) does not apply~~

Condition	Required Actions	Completion Time
E. No water flow capability at individual sprinkler system	A.1 Halt hot work activities in the affected area AND	Immediately
	A.2 Restore water flow capability	4 Hours
	A.3 Obtain special Fire Services approval, provide appropriate portable fire suppression equipment, and a continuous fire watch	Prior to resuming any hot work activities in the affected area
B. Condition A.2 required actions and/or completion time not accomplished	B.1 Initiate fire patrols every 4 hours for the affected area	4 Hours
C. $\leq 16,000$ gpm but $\geq 4,000$ gpm available for 4 hours	C.1 Restore water supply capability	8 Hours
D. Condition C. required actions and/or completion time not accomplished	D.1 Initiate expedited repairs to restore water supply capability	Immediately
E. $< 4,000$ gpm available for 4 hours	E.1 Initiate expedited repairs to restore water supply capability AND	Immediately
	E.2 Halt hot work activities in the affected area AND	Immediately
	E.3 Initiate fire patrols every 4 hours for the affected areas	4 Hours

DELETE

DELETE

SECTION 2.7 - SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.3 High Pressure Fire Water System (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Monthly	SR 2.7.3.3.1 Manually start electric and diesel fire water pumps
Monthly	SR 2.7.3.3.2 Verify X-640-2 Fire Water Storage Tank contains at least 270,000 gallons of water (filled to at least 90% of capacity).
Monthly	SR 2.7.3.3.3 Verify adequate diesel supply for diesel fire water pumps in X-640-1 and X-6644 pumphouses.
Annually	SR 2.7.3.3.4 Functionally test sprinkler system at the Inspection Test Valve (ITV) for sustained water flow
Annually	SR 2.7.3.3.5 Simulate automatic start of electric fire water pumps
Annually	SR 2.7.3.3.6 Verify electric and diesel fire water pump flow is \geq 90% of their rated capacity
Annually	SR 2.7.3.3.7 Verify sprinkler system control valves are in the desired position by viewing the "post indicator" on the valve. AND Operate the valves (except those that are planned to be closed) and verify the actuation of the supervisory alarm. AND Verify valve is left in open position by "drain" test.
Annually	SR 2.7.3.3.8 Visually inspect the exterior of X-640-2 Fire Water Storage Tank.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.3 High Pressure Fire Water System (continued)

BASIS:

The fire protection system is provided to mitigate a fire that could cause structural damage to roof purlins, trusses and columns followed by localized collapse of the roof with potential onsite and off-site consequences due to the breach of the UF₆ containment boundary and the resulting UF₆ release. Surveillances for fire water pump testing apply to those pumps relied upon to meet required flow rates. These systems are designed to meet the intent of the insurance industry "improved risk" criteria as interpreted by the Authority Having Jurisdiction (AHJ) as described in SAR Section 5.4. The sprinkler system will minimize the potential for, and mitigate the effects of a large fire. The fire water system flow requirement is conservative with respect to the system evaluation presented in the SAR [SAR Sections 3.8.7.2 and 4.3.2.1.9].

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.4 Coolant Removal

APPLICABILITY: Cascade Operational Mode IV

LCO: Cell coolant systems shall be drained of coolant before addition of oxidants for cell treatment.

ACTIONS:

Condition	Required Actions	Completion Time
D. Failure to drain coolant prior to adding oxidants and there are no indications of a reaction	A.1 Evacuate cell contents	1 Hour
B. Failure to drain coolant prior to adding oxidants and there are indications of a reaction	B.1 Stop cell/equipment motors AND	Immediately
	B.2 Drain coolant	1 Hour

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Each cell treatment	SR 2.7.3.4.1 Verify and document the removal of cell coolant prior to the initial charge of oxidants.

BASIS:

In the event of a leak from the coolant system to the process gas, the failure to control the concentrations of coolant and ClF₃/F₂ within the cell can form explosive mixtures that in the presence of an ignition source could over pressure the cell and release toxic materials. The draining of coolant includes the evacuating of the coolant system to between 18 and 30 inches of Hg for the X-27 and X-29 size equipment. The other equipment sizes have no specific coolant evacuation requirement other than for the system pressure to be below atmospheric pressure. The indications of an exothermic reaction are usually rapid pressure spikes and/or a rapid increase in temperature.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-526 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.5 Cell Treatment Monitoring

APPLICABILITY: Cascade Operational Mode IV

LCO: Cell treatments shall be monitored with an Infrared Analyzer.

ACTIONS: Note: TSR 1.6.2.2(d) does not apply

Condition	Required Actions	Completion Time
5. Infrared Analyzer inoperable during running cell treatment or during first 24 hours of static (LTLT) cell treatment	A.1 Initiate sampling for free ClF ₃ and the presence of hydrocarbons	30 Minutes
B. Above condition required actions and/or completion time are not accomplished	B.1 Evacuate cell contents	30 Minutes

SURVEILLANCE:

Frequency	Surveillance
Each cell treatment	SR 2.7.3.5.1 Verify and document the installation of an Infrared Analyzer prior to the initial charge of treatment gas
Once per day during LTLT or Static Cell Treatment	SR 2.7.3.5.2 Collect sample from cell and analyze using Infrared Analyzer

BASIS:

Deposit removal can be conducted on cascade equipment that is operating or on equipment that is shutdown. The rate of oxidant gas consumption, especially ClF₃, is dependant on whether the treatment being performed is a running or static treatment. In either type of treatment, the treatment gas mixture is monitored to assure that no hydrocarbons or fluorocarbons are present and that free ClF₃ is always present to prevent the formation of ClO₂ and Cl₂ which can damage cascade equipment and can pose hazards during subsequent processing to recover UF₆ recovered by the chemical treatments. A specialized type of static chemical treatment, called Long-Term, Low-Temperature (LTLT), is used for shutdown equipment. During cell treatments with process equipment running, failure to maintain an adequate amount of ClF₃ within the cell can lead to the formation of reaction products that will result in highly exothermic reactions upon the re-introduction of ClF₃/F₂. In addition, the Infrared Analyzer is used to detect the presence of hydrocarbon materials that could also react violently with ClF₃/F₂

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY**2.7.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES****2.7.3.5 Cell Treatment Monitoring (continued)**

under the right conditions. Replacing an inoperable analyzer can take up to three hours. For this reason sampling is initiated within thirty minutes and continued until an operable analyzer is hooked up and operating properly.

Static cascade equipment treatments are those performed where the cell (or other cascade equipment) is not running. Higher concentrations of oxidant gases are used and the pressure of the cell (or equipment) is maintained below atmospheric pressure. Because of the lower temperatures, absence of running equipment and additional measures to prevent the presence of coolant, static (LTLT) cell treatments do not progress rapidly or have the potential for rapid changes of conditions that could result in an exothermic or explosive reaction. Operator presence and frequent monitoring of the cell temperatures, pressures and infrared monitor readings occur during the initial addition of treatment gas increments and for twenty four hours after the last increment is added. After the initial treatment monitoring period, an operator will monitor the cell (or equipment) temperatures, pressures at least once each shift and will collect a gas sample from the cell at least once every day to verify that free ClF_3 is present and that no unexpected reactions are occurring.

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.6 Cell Inverse Recycle Treatment

APPLICABILITY: Cascade Operational Mode IV

LCO: Individual cells shall be isolated from each other when the cell inverse recycle treatment method is used.

SURVEILLANCE:

Frequency	Surveillance
Each cell inverse recycle treatment	SR 2.7.3.6.1 Verify and document an inverse recycle treatment cell is not tied together with any other cell prior to the initial charge of treatment gas

BASIS:

Due to the inverse recycle treatment method there is no assurance that an adequate supply of ClF_3 would be present in the second cell tied to the parent cell. The lack of a sufficient amount of ClF_3 allows the formation of ClO_2 on the interior cell surfaces that upon contact with a new supply of ClF_3 will react violently and could cause a breach in the cell containment; thereby releasing toxic materials and spreading contamination.

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.7 Oxidant Control

APPLICABILITY: Cascade Operational Modes II, VII

LCO: Oxidant addition to the Cascade shall be administratively controlled to prevent explosive mixtures in the Purge Cascade.

ACTIONS:

Conditions	Required Actions	Completion Time
D. Oxidant addition administrative control assumptions (Side Purge venting, Freon Degradation reaction not occurring and Drum bleed back of oxidants controlled) violated	A.1 Re-establish control assumptions	1 Hour
B. Condition A Required Actions and/or Completion Time not accomplished	B.1 Stop oxidant additions AND restore oxidant addition control	Prior to re-instituting any oxidant additions

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Twice a shift	SR 2.7.3.7.1 Ensure drum bleed back rate of oxidants is \leq to the calculated rate determined by the control model

DELETE

DELETE

SECTION 2.7 - SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.7 Oxidant Control (continued)

BASIS:

Failure to control the concentrations of ClF_3/F_2 within the Cascade can result in the formation of highly exothermic mixtures with coolant, that in the presence of an ignition source may have the potential to cause a breach in the cell containment; thereby releasing toxic materials and spreading contamination.

The prevention of these highly exothermic reactions is based on controlling the amount of oxidants that are available to react with the coolant that is always present in the Cascade flow. The following study, K/ET-302, Safety Guidelines For Cascade Treatment Materials, established the safe concentrations for ClF_3/F_2 . An administrative control/model for ensuring oxidant concentrations stay below the reactive level is used and has been validated through plant operations. The basic premise of the model is to maintain the ClF_3/F_2 concentrations in the Top Purge Cascade to ≤ 16 mole %. This is achieved by controlling drum bleed back (LCO 2.7.3.7) and Freon Degradation operations (LCO 2.7.3.8 & 2.7.3.9) and by ensuring proper operation of the Side Purge (venting).

Previous and current studies have determined that a potentially reactive mixture is not achieved until the oxidant concentrations exceed 19 mole % at 2.9 psia.

DELETE

DELETE

SECTION 2.7

SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.8 Freon Degradar

APPLICABILITY: X-326 Cascade Operational Mode II (i.e., F₂ and coolant flow into reactor)

LCO: No more than 1 Freon Degradar in operation at a time.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Once per shift	SR 2.7.3.8.1 Verify and document that no more than one Freon Degradar is operating

BASIS:

The combined addition of unreacted F₂ from 2 Freon Degradars on the Cascade is not an assumption in the administrative modeling method for ensuring safe oxidant concentrations and therefore could cause the exceedance of the safe oxidant limit.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.9 Freon Degradar Fluorine Flow

APPLICABILITY: X-326 Cascade Operational Mode II (i.e., F₂ and coolant flow into reactor)

LCO: Fluorine addition to Freon Degradar shall be ≤ 400 scfd.

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Annually	SR 2.7.3.9.1 Calibrate four Cell Floor Freon Degradar F ₂ supply capillaries to 25, 50, 100, 200 scfd, respectively, at 5.0 psig fore pressure
Annually	SR 2.7.3.9.2 Calibrate one Operating Floor Freon Degradar F ₂ supply capillary to 265 scfd at 0 psig fore pressure
Annually	SR 2.7.3.9.3 Perform functional test of the Cell Floor Freon Degradar to verify that F ₂ high high pressure will shutoff F ₂ supply to the Freon Degradar
Semiannually	SR 2.7.3.9.4 Calibrate the Cell Floor Freon Degradar high high pressure F ₂ trip at ≤ 5.0 psig
Annually	SR 2.7.3.9.5 Perform functional test of the Operating Floor Freon Degradar to verify that F ₂ high pressure will shutoff F ₂ supply to the Freon Degradar
Semiannually	SR 2.7.3.9.6 Calibrate the Operating Floor Freon Degradar high pressure F ₂ trip at ≤ 0 psig

BASIS:

Oxidant concentration can build up in the Top Purge and therefore could form a highly exothermic reacting mixture that in the presence of an ignition source will react and has the potential to create an overpressure situation that may result in breaching the process system and the release of process gas to the environment. Previous studies have determined that an the highly exothermic reaction is not achieved until the oxidant concentration exceeds 19 mole %.

The addition of 400 scfd unreacted F₂ on the cascade would not exceed the assumptions made in the administrative model for ensuring safe oxidant concentrations in the Purge Cascade.

DELETE

DELETE

SECTION 2.7

SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.10 Side Feed Cylinders

APPLICABILITY: X-326 Cascade Operational Mode II, side feeding of 5,8 and 12 inch cylinders containing LEU material.

LCO: Heat applied to cylinder body shall not exceed 500 watts

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Prior to side feed cylinder being fed in which heat is being utilized	SR 2.7.3.10.1 Verify that the heater rating is \leq 500 watts

BASIS:

The limiting of the heating rate to 500 watts provides the assurance that the solid UF₆ will not liquify. Side feed operations may use a heat lamp, a heat ring, or no heat.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.11 UF₆ Plugs

APPLICABILITY: All Cascade Operational Modes

LCO: Direct heat sources shall not be applied to solid UF₆ plugs until line clarity in the system has been assured.

ACTIONS:

Condition	Required Actions	Completion Time
D. Direct heat source being applied to a solid UF ₆ plug	A.1 Discontinue direct heat application to the UF ₆ plug AND	Immediately
	A.2 Ensure line clarity	Prior to reapplying direct heat

BASIS:

The application of an external heat source directly to a UF₆ plug can liquify the UF₆ within the center of the plug and thereby cause sufficient hydraulic forces to rupture the pipe containing the plug. The primary concern over the direct application of heat (i.e., steam tracing, heat tape, etc.) to the plug versus indirect heating (i.e., heated housings) is due to the fact that the energy is added to the plug at such a high rate that it is not evenly distributed over the entire plug and therefore does not allow for the sublimation of the plug before a portion of it liquefies. The secondary concern is that even though the UF₆ plug stays as a solid it must have room to expand. The consequences of a release of UF₆ from this type of failure mechanism would be minimal due to the fact that the UF₆ plug would remain as a solid and therefore, the release rate would be slow as the UF₆ sublimates into the atmosphere.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.12 Cascade Pressure Limitation

APPLICABILITY: Cascade Operational Modes II and V

LCO: Cascade cell high side pressures shall be \leq 14.45 psia for X-25 and X-27 size cells.

ACTIONS:

Condition	Required Actions	Completion Time
D. Cascade cell pressure discovered > LCO value for specified cell size	A.1 Reduce cell pressure to \leq the LCO value for the specified cell size	Immediately

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.7.3.12.1 Verify that each cell is operating at \leq the LCO value for the specified cell size
Prior to cascade physical inventory	SR 2.7.3.12.2 Calibrate the cell datum when utilized in place of the unit datum
Annually	SR 2.7.3.12.3 Calibrate the unit datum

DELETE

DELETE

SECTION 2.7

SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.12

Cascade Pressure Limitation (continued)

BASIS:

The accident analysis provided in SAR Section 4.3.2 assumes that cascade high pressure accidents proceed to their conclusion which, in some cases, results in some form of breach in the cascade system (isotopic cells). It is at this point that the consequences are evaluated and the identification of any mitigating actions takes place. Maintaining cascade steady state pressure at or below 14.45 psia establishes an initial condition assumed in the evaluation of scenario consequences. The cascade was not designed to directly measure cell pressures in the ACR or to measure pressures that approach 40 psia. Motor load and other process indicators in the ACR alert the operator to significant cascade transients which require appropriate actions be taken, including cell shutdown, to preclude cascade pressures from exceeding 40 psia which is the postulated rupture pressure of cascade piping. The monitoring of cell pressures from the local cell panels is sufficient to ensure that the steady state pressures do not exceed 14.45 psia. Due to the ability to perform a channel check across the 4 or 6 stage pressure indicating controllers (PICs) per cell and the fact that within an operating cell any stage high side pressure increase will quickly cascade through the cell (i.e., raise the other stage high side pressure), it is not necessary that all the PICs are functional to determine the cell pressure. The calibration of the unit and cell datums will ensure an adequate level of accuracy (cell averaging) and therefore the calibration of individual PICs is not necessary. As part of the cascade inventories there are several data comparisons made that provide the information needed to identify any out of tolerance PIC without doing a calibration. The cascade inventory data comparison includes analyzing stage compression ratios and the comparison of motor amperage verses stage high side pressure against known process relationships. This TSR does not apply to the X-25-7 even cells (Top Purge cells) since these cells by design contain light gases with no significant inventory of UF₆.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.13 Cascade DC Control Power

APPLICABILITY: Cascade Operational Modes II and III

LCO: DC control (cell trip) power for UF₆ stage motors shall be operable.

ACTIONS:

Conditions	Required Actions	Completion Time
D. DC voltage potential < 200 at cascade unit battery room OR No DC power at the cell breaker	A.1 Notify Cascade Control of potential need to utilize alternate means for cell shutdown AND	Immediately
	A.2 Restore DC voltage potential	48 Hours
B. Condition A.2 required actions and/or completion time not accomplished	B.1 Shutdown affected cascade compressors	8 Hours
C. Battery system conditions (other than voltage) found outside surveillance parameters	C.1 Restore individual battery parameters to within limits	90 Days

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.13 Cascade DC Control Power (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.7.3.13.1 Verify cascade unit DC voltage ≥ 200
Each scheduled cell trip	SR 2.7.3.13.2 Utilize the ACR "motor stop" button for each scheduled cell trip. Monitor expected cell block valve closures and any required recycle valve actuation.
Quarterly	SR 2.7.3.13.3 Inspect battery terminals and racks for evidence of corrosion and for cell leakage of electrolyte.
	SR 2.7.3.13.4 Check that the specific gravity of the pilot cell is ≥ 1.180
	SR 2.7.3.13.5 Verify battery charger output is > 0 DC/amps.
	SR 2.7.3.13.6 Visually check the cell electrolyte levels to verify the level is above the low level indication line and no more than 0.25 inches above the high level indication line.
Annually	SR 2.7.3.13.7 Check that the specific gravity of the cells is ≥ 1.180 .

BASIS:

The accident analysis discusses the fact that large UF₆ release scenarios from the cascade can be mitigated or terminated by stopping the cell motors which allow the cascade systems to go to subatmospheric pressure [SAR Sections 3.8.3.2, 4.3.2.1.1, 4.3.2.1.2, 4.3.2.1.3, 4.3.2.1.7, and 4.3.2.1.8]. If during a release situation, this rapid reduction in cell pressure causes an "underloading" in this part of the cascade. It is at this time coupled with the internal resistance of the cascade equipment (control valves, barrier, piping, etc.) that there will be inleakage into the cascade which will mitigate the release until the necessary valve evolutions can take place to isolate the system from any additional supply of UF₆ and to prepare the system for compensatory actions and repair. The operator in response to process alarms and indications such as, two simultaneous smoke alarms in the same cell or a cell deblade will take action to shutdown the affected cell. In order to initiate a cell shutdown the

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.13 Cascade DC Control Power (continued)

BASIS (continued):

DC control and trip power circuit must be functional. However, the failure of the local cell trip circuit to function on demand does not constitute a significant impact on any of the scenarios where cell shutdown is assumed to occur at sometime during the scenario. This is due to the numerous alternate and independent means available for disrupting cell power, i.e., breaker manual trip or X-300/switchyard de-energization of electrical feeders, buses, transformer bays, main switchyard lines. In order to demonstrate the reliability of the ACR cell trip function, cell trips that are not required to mitigate a transient condition will be initiated from the ACR. Cell tripping is classified as a momentary load per IEEE Standard 485-1983, Recommended Practice for Sizing Large Lead Storage Batteries for Generating Stations and Substations, Section 4.2.3 and as such represents a small instantaneous ampere-hour load on the total battery banks. The additional battery surveillances provide additional assurances that the battery system will be able to deliver the power necessary to trip the cell breakers as long as the system voltage is maintained above 200 volts. Any failure of the cell trip action to stop the compressor motor(s) should be investigated. The 200 VDC value has been a long standing action point for establishing operability of these systems. For example, the 200 VDC value has been in the Operational Safety Requirements document since 1985. The use of available vendor information coupled with engineering evaluations provided the basis for the determination that the systems in question would perform at > than these specified parameters.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.14 Moderation Control

Applicability: Cascade Operational Modes I, II, III, IV, V, VI

LCO: Moderation Control shall be maintained when the UO_2F_2 mass is > safe mass.

ACTIONS: **Note:** TSR 1.6.2.2(d) does not apply

Condition	Required Actions	Completion Time
<p>D. UO_2F_2 deposit > safe mass in a fluorinating (including chemical treatment) environment.</p>	<p>A.1 Continue to maintain a fluorinating environment for the deposit AND A.2 Initiate actions to determine the cause of deposit and its significance. AND A.3 Establish and document a plan of action AND A.4 Initiate SR 2.7.3.14.3</p>	<p>Immediately Immediately 30 Days 90 Days</p>
<p>B. UO_2F_2 deposit > safe mass with the deposit not in a fluorinating environment.</p>	<p>B.1.1 Establish a dry cover gas blanket at \geq 14 psia except when performing maintenance or operational activities associated with remediation of the deposit, equipment removal or leak repair. AND B.1.2 Initiate SR 2.7.3.14.2 AND B.2 Remove equipment containing the UO_2F_2 deposit from the cascade OR Note: Upon completion of B.3, Condition A is re-entered. B.3 Initiate re-fluorinating activities</p>	<p>Within 72 Hours after entering Mode VI 12 Hours 180 days Within 72 hours of removal of dry cover gas blanket</p>

DELETE

DELETE

~~SECTION 2.7 - SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.7.3.14 Moderation Control (continued)~~

Condition	Required Actions	Completion Time
<p>C. Installed equipment containing known or previously unknown deposit of UO₂F₂ deposit > safe mass opened to atmosphere.</p>	<p>C.1 Apply TSR 2.7.3.15 as appropriate to equipment removed</p>	<p>Immediately</p>
	<p>AND C.2 A person shall be stationed to valve off local sprinkler system, if inadvertently actuated, anytime the system opening(s) remain uncovered. AND A fire watch, equipped with portable CO₂ and/or dry chemical fire suppression equipment, shall be established during cutting/welding AND Cover opening(s) with prestaged waterproof covers, if conditions develop where a moderating material can begin to enter opened equipment.</p>	<p>Immediately</p>
	<p>AND C.3 Cover opening(s) that expose UO₂F₂ deposit to atmosphere when maintenance evolutions are <u>not</u> impacting equipment.</p>	<p>Immediately after determining acceptable UF₆/HF conditions</p>
	<p>AND C.4 Maintain dry cover gas blanket ≥ 14 psia when cascade system maintenance evolutions are <u>not</u> impacting equipment.</p>	<p>Within 72 hours after completing REQUIRED ACTION C.3</p>
	<p>AND Note: Upon completion of C.5, Condition B is re-entered. C.5 Maintain dry cover gas blanket ≥ 14 psia following completion of cascade system maintenance on affected equipment and UO₂F₂ deposit is not in a fluorinating environment.</p>	<p>Within 72 hours after completing system maintenance</p>
<p>D. UO₂F₂ deposit > safe mass, not in a fluorinating environment and coolant system pressure ≤ RCW condenser pressure.</p>	<p>D.1.1 Increase coolant system pressure to > RCW condenser pressure. AND</p>	<p>4 Hours</p>
	<p>D.1.2 Initiate SR 2.7.3.14.1 OR</p>	<p>12 Hours</p>
	<p>D.2 Drain RCW from coolant condenser</p>	<p>20 Hours</p>
<p>E. UO₂F₂ deposit > safe mass with the deposit not in a fluorinating environment and required dry cover gas blanket < 14 psia.</p>	<p>E.1 Re-establish a dry cover gas blanket ≥ 14 psia.</p>	<p>12 Hours</p>

DELETE

DELETE

~~SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY~~

~~2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES~~

~~2.7.3.14 Moderation Control (continued)~~

~~SURVEILLANCE REQUIREMENTS:~~

Frequency	Surveillance
Each shift when not in a fluorinating environment, deposit > safe mass and RCW not drained	SR 2.7.3.14.1 Verify coolant system pressure > RCW condenser pressure.
Each shift when dry cover gas blanket is required by Condition B or C	SR 2.7.3.14.2 Monitor the system pressure and adjust pressure to \geq 14 psia.
Quarterly when in Condition A	SR 2.7.3.14.3 Monitor size of the deposit.
Quarterly	SR 2.7.3.14.4 Perform routine qualitative radiation surveys of bypass housings to check for deposits and initiate "NDA" quantitative measurements based on "radiation reading trending".

BASIS:

As used in this TSR, the term "safe mass" is defined as being 43.5% of the minimum fissionable mass for system conditions (enrichment, geometry, H/U, reflection, etc.). Cascade deposits of UO₂F₂ (and deposits of other compounds resulting from wet air leakage) and freeze-out of UF₆ are an expected result of normal operation. It is considered non-credible for a dry criticality to occur in the Cascade. Therefore, for a freeze-out condition, criticality would not result and the UF₆ freeze-out may be remediated at the discretion of the operating organization. Any deposit that has a uranium mass less than the "always" safe mass (i.e., optimally moderated material) may be remediated at the discretion of the operating organization. In regards to those situations in which a loss of moderation control could result in criticality, it has been determined that MCSA specified controls provide double contingency against the leakage of liquid water into the cascade. Based on additional technical evaluations it is not possible to hydrate a deposit of uranyl fluoride above a H/U ratio of 4 by exposure to ambient air within the process buildings. Therefore, there is no potential for criticality when a cascade deposit is less than the safe mass at a H/U ratio of 4 due to exposure to atmospheric water vapor in the ambient process building air.

The amount of water required for a criticality reaction varies with the enrichment and the mass. However, at any given enrichment, there is a minimum amount of water that is required for a criticality to occur. As the H/U ratio changes from this optimum level, the amount of water required overall increases. For enrichments between 3% and 7% ²³⁵U the minimum amount of water occurs at an H/X ratio of about 200. The optimum H/U ratio is always greater than an H/U of 4. The TSR control time limits are established for a deposit in a buffered condition. The TSR time limits are based on the following assumptions: (1) that the equipment breathes with changes in atmospheric pressure, (2) that any atmospheric moisture entering the system remains in the system, (3) that an H/U of 4 is the maximum that can be achieved, and (4) that a minimum critical mass at an H/U of 4 is present. If the mass of the uranium deposit is greater than the minimum critical mass at an H/U of 4, it will always require more water to achieve criticality than would be required for the minimum critical mass at an H/U of 4. Therefore, the time required to reach the H/U ratio for a criticality to be possible would be greater than the time limit specified in the TSR. The only situation where the TSR controls would be in question would be for a deposit above a minimum critical mass at an H/U of 4 that had been exposed to wet air for an unknown period of time. In this event, sampling of the gas inside the equipment for moisture content and/or sampling of the deposit to determine the H/U ratio would potentially be required to establish a baseline. The deposit significance determination would provide the analysis of the adequacy of the TSR controls.

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.14 Moderation Control (continued)

UF₆, F₂, and ClF₃ react with available water more readily than UO₂F₂ absorbs water. For instance, water entering onstream cascade equipment will preferentially react with UF₆ to form more UO₂F₂ rather than react with UO₂F₂ to form hydrates (moderated forms) of UO₂F₂. HF gas formed as a byproduct of the water-UF₆ reaction cannot liquefy to moderate a deposit at the pressures encountered in the cascade. A UO₂F₂ deposit cannot become moderated if it is being continuously fluorinated and moderation is not a concern until the equipment is taken off-stream and evacuated of UF₆. Continued fluorination of the deposit provides nuclear criticality safety by preventing moderation of the deposit.

Chemical treatment processes which involve the addition of ClF₃ and/or F₂ (i.e. fluorinating agents) provide the same level of moderation control as when the deposit is exposed to UF₆. Fluorinating gas treatments have been used as a means of drying out equipment after exposure to atmospheric air and for removing/reducing uranium deposits since the enrichment plants were placed into service. It has been demonstrated that these fluorinating agents will react vigorously and preferentially with any available moisture. The presence of excess fluorinating agents will not only prevent further hydration of a deposit but will over time effectively remove any free moisture and dehydrate the exposed deposit to an H/U ratio as low as when the deposit was exposed to the UF₆ process. In addition, use of fluorinating agents will convert UO₂F₂ deposits to UF₆, thereby reducing the deposit mass. Repeated use of the fluorinating agents (i.e., chemical treatment) will proceed to reduce/eliminate the deposit which is the safest condition. Therefore, a deposit that has been hydrated to some extent due to "breathing" or during the times necessary to expose the deposit to atmosphere when maintenance functions are performed can be dehydrated by the presence of a fluorinating agent. The sustained liberation of UF₆ from the deposit during a chemical treatment is the proven indicator that the deposit has been dehydrated. Once a deposit has been dehydrated, re-entry into Condition B establishes a new initiating time for required actions. After having been exposed to a fluorinating environment in which there has been the sustained liberation of UF₆, the re-entry to the buffered condition for 180 days will not decrease the assumed safety margin for this condition. Chemical treatment activities as discussed in this LCO may include preparation activities such as evacuation, leakrate, seal checks and cell startup.

UO₂F₂ deposits in onstream operating equipment are not a nuclear criticality safety concern due to continuous fluorination of the deposit. Over time, sustained or large wet air inleakage in operating equipment (active process area) will readily announce itself in the form of changing motor loads, compressor surging, line recorder readings, stage control valve positions, A-suction pressures, etc. Additionally, deposit formation in operating equipment will be dispersed by the gas flow. This dispersion of UO₂F₂ can occur on the inside of process piping, across barrier tubing, on cooler fins and inside compressors on the rotor and stator. Due to this dispersion, the formation of deposits in unsafe geometries in active process areas where there is UF₆ gas flow is not likely given the above indicators. However, the above mentioned indicators and continuous gas flow are not always available for wet air inleakage in bypass/auxiliary piping, expansion joints and valves (inactive process areas). Operational experience indicates that quarterly surveillances by NDA methods for UO₂F₂ deposits in inactive process area is appropriate for early detection and prudent remediation of the deposit. Follow up surveys are conducted to assure that the deposit does not become sufficiently large to become an operational problem or a cascade structural concern.

Upon discovery of a deposit exceeding the safe mass of uranium, the significance of the deposit is determined. The significance determination includes an assessment of the following criteria. If the mass and enrichment of the deposit, including uncertainty, is less than a minimum critical mass at an H/U of 4, the following items may have limited significance. Also, the determination of a deposit configuration and/or distribution may render further evaluation unnecessary.

- a. mass and enrichment of the deposit;
- b. formation mechanism and assessment of likely chemical composition of deposit;
- c. distribution/configuration of the deposit relative to geometry or interaction parameters;
- d. presence of a fluorinating environment during deposit formation;

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.14 Moderation Control (continued)

- e. if fluorinating environment not always present, determine presence of dry gas buffer;
- f. estimate length of time exposure to atmospheric moisture may have occurred;
- g. evaluate mass of U at enrichment versus minimum critical mass at H/U of 4;
- h. if mass of U is greater than a minimum critical mass at H/U of 4, calculate amount of water/time required to reach the H/U ratio where deposit mass equals minimum critical mass and compare to TSR controls.

Routine NDA surveillance methods are of limited value (e.g., with respect to quantification of deposit size) for active process areas which include compressors, converters, process gas coolers and freezer/sublimers. However, sustained or large wet air leakage in active process areas will readily announce itself which will prompt corrective actions by operating personnel. Also, the formation of UO_2F_2 deposits in unsafe geometries in active process areas is not likely given the above corrective actions. The limited ability to hydrate a deposit in-place process equipment assures that these deposits will remain critically safe after shutdown. Thus the primary concern for the formation of UO_2F_2 deposits in unsafe geometries in operating equipment is if this equipment trips or is shutdown while containing UF_6 and massive wet air leakage occurs. In this event, the wet air leakage will be obvious from the equipment leak rate which will prompt corrective actions to limit the size of the deposit.

For shutdown equipment, moderation control can be provided by a fluorinating environment or by a dry gas (plant air or nitrogen) blanket over the deposit even if significant wet air leakage has occurred. Once a system has been isolated from the cascade and filled to ≥ 14 psia with dry gas blanket, normal atmosphere pressure fluctuations may cause minor in and out flow through any existing system leaks. Analyses have demonstrated that this "breathing" of the cell or even the exposure to atmospheric air (diffusion) when the system is opened to allow for necessary maintenance will not significantly affect deposit moderation. Even for periods much longer than the 180 day limitation, moderation above an H/U ratio of 4 would not be expected. The daily surveillance demonstrates that the gas blanket is maintained as assumed in the analyses. The LCO requirements of this TSR assure nuclear criticality safety for equipment with UO_2F_2 deposits greater than a safe mass.

Maintenance evolutions or cascade system maintenance terminology used in the Required Action statements, include other related tasks such as decontamination and sampling. Condition C is considered to be met when the UF_6 primary system is first breached. During the time frame it takes to cover the cell opening(s) created by equipment removal which would expose a greater than safe mass deposit to the atmosphere or while maintenance is being performed on the same opening(s), actions are taken to further reduce the probability of a criticality. These actions involve covering of equipment openings as soon as possible, stationing a person to valve off sprinkler water in case of an inadvertent actuation, establishing a fire watch and having waterproof covers available that can be quickly placed over the opening(s) should the sprinklers actuate under a real fire situation. The fire watch provides the capability for potentially mitigating a fire, utilizing CO_2 and/or dry chemical type of extinguishing agents, while in its early stages of development, thereby preventing any sprinkler actuation. If the normal equipment vertical opening orientation is assumed to exist, versus the SAR accident analysis assumed horizontal opening orientation, it would require a significantly long period of time to accumulate the necessary water mass to cause a criticality. The stated actions will preclude sufficient water from entering the equipment to moderate the deposit to a critical state. Also the potential for moderation from RCW system water is controlled by NCSA requirements and demonstrated to meet the double contingency principle. [SAR Section 5.2, Appendix A, sections 1.1 and 1.2]

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.15 Removed Equipment With Deposits

APPLICABILITY: Cascade Operational Mode VI, equipment removed from the Cascade with UO_2F_2 mass > safe mass

LCO: Equipment removed from the Cascade shall be handled as follows:

- K. Equipment that has contained UF_6 and could contain \geq a safe mass of UO_2F_2 shall be surveyed prior to and after removal to determine PEH (Planned Expedious Handling) or UH (Uncomplicated Handling) classification.
- L. Equipment classified as PEH shall have openings to atmosphere covered or closed.
- M. Equipment classified as PEH shall be decontaminated to \leq safe mass within 72 hours of removal and post PEH classification.

ACTIONS:

Conditions	Required Actions	Completion Time
D. Applicable equipment removed prior to classification survey	A.1 Declare the equipment PEH AND	Immediately
B. PEH equipment openings not covered or closed	B.1 Cover or close openings AND	Immediately after determination of acceptable UF_6/HF conditions
	B.2 A person shall be stationed to valve off local sprinkler system, if inadvertently actuated, during the time equipment opening(s) remain open or uncovered. AND Cover openings with prestaged waterproof covers, if conditions develop where a moderating material can begin to enter opened equipment	Immediately
C. PEH equipment not decontaminated to \leq safe mass within 72 hours	C.1 Ensure equipment openings remain covered or closed AND	Immediately
	C.2 Reinitiate a dry air or nitrogen	Immediately

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRS FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.7.3.15 Removed Equipment With Deposits (continued)

SURVEILLANCE REQUIREMENTS:

Frequency	Surveillance
Daily	SR 2.7.3.15.1 Inspect equipment for closed or covered openings
Prior to equipment exiting building	SR 2.7.3.15.2 Inspect equipment for closed or covered openings

BASIS:

For a criticality to occur in a piece of equipment with a uranium deposit that has been removed from the cascade would require that the deposit be moderated. Cascade deposits in operating equipment regardless of their size, at the enrichment level of $\leq 7\%$ will remain safe as long as the deposit is unmoderated. For unmoderated deposits ($H/U=0$) $> 7\%$ assay but $\leq 20\%$ assay the mass required for a criticality would exceed the amount of UF_6 available in the cascade at this enrichment range. As used in this TSR the term "safe mass" is defined as being 43.5% of the minimum fissionable mass for the assay of concern in a fully moderated and fully reflected system whether these specific conditions actually exist or not. In addition, determining the mass of any uranium deposit in the equipment allows segregation and controlled handling of equipment containing amounts of U^{235} that require additional controls to prevent the formation of an unsafe mass/geometry. It is not likely based on the chemistry of UO_2F_2 deposits for this potential mass to be moderated by diffusion of ambient air to greater than a H/U ratio of 4. The loss of moderation control as described in the SAR requires that the equipment be dropped such that an opening is tilted upwards to receive fire water (i.e. water in liquid state) and that a fire must occur simultaneously in order to actuate the sprinkler system (i.e. probability of a false actuation is 1×10^{-6} per year, Factory Mutual) and this accident scenario meets Double Contingency. The actions that shall occur to further reduce the probability of a criticality, involve the covering of the equipment openings as soon as possible and during the time frame it takes to get covers in place, stationing a person to valve off sprinkler water in case of an inadvertent actuation and having waterproof covers available that can be quickly placed over the opening(s) should the sprinklers actuate under a real fire situation. If the normal equipment vertical opening orientation is assumed to exist, versus the SAR accident analysis assumed horizontal opening orientation, it would require a significantly long period of time to accumulate the necessary water mass to cause a criticality. Typically, the time to cover a removed piece of equipment is determined by the time necessary to lift it from the cell and the time to allow for flange cooling. However, this time frame can be extended due to UF_6 /HF out gassing which is an immediate hazard to local personnel. In either case these actions will preclude sufficient water from entering the equipment to moderate the deposit to a critical state. [SAR Section 5.2, Appendix A, section 1.11].

DELETE

DELETE

SECTION 2.7 SPECIFIC TSRs FOR X-326 CASCADE FACILITY

2.1.3 LIMITING CONTROL SETTINGS, LIMITING CONDITIONS FOR OPERATION, SURVEILLANCES

2.1.4 GENERAL DESIGN FEATURES

2.7.4.1 Seal Exhaust Pump Overflows

DF: Seal exhaust pumps shall contain an overflow that limits the oil inventory in the pump

SURVEILLANCE:

Frequency	Surveillance
Prior to pump startup	SR 2.7.4.1.1 Verify that the oil overflow is in place and that the effluent valve if present is open

BASIS:

The seal exhaust pump cavities are of an unfavorable geometry in the presence of an oil moderator. The pump overflow lines ensure that the oil volume does not exceed the safe quantity when mixed with uranium of a limited enrichment that is documented in Nuclear Criticality Safety Evaluations and Approvals. [SAR Section 5.2, Appendix A, section 1.3]

DELETE

SECTION 3.0 ADMINISTRATIVE CONTROLS

Table 3.2.2-1. On-site Functional Staffing Requirements⁴

Facility	Mode/Operation	Staffing Requirements
X-300	At all times	1 assigned Operator and 1 Power Operator
X-300/PSS	At all times	1 ³
X-300/APSS	At all times	1 ^{1, 6}
Radiation Protection	At all times	1 ¹
Utility Operations	At all times	4 ¹
Power Operations	At all times	1 ¹
X-705	Calciner Mode III	1 assigned Operator
Fire Brigade	At all times	4 ²
Process Services/ Mass Spectrometry Analytical Functions	At all times	1 ^{1, 5}
Protective Force	At all times	4 ¹

¹ These individuals are not tied to a particular duty station and are only required to be on site.

² Fire Brigade members making a run to deliver an individual to a local hospital are considered to be on duty and available.

³ If the PSS needs to leave the X-300, a designee can be assigned in accordance with TSR 3.1.3.

⁴ Staffing may be less than the minimum requirement listed for a period of a time not to exceed four hours in order to accommodate unexpected absence of on-duty shift members provided immediate action is taken to restore the shift manning requirements to within the minimum requirements. PSS position shall be manned in all applicable modes.

⁵ Staff will not be on-site unless analytical support is required.

⁶ APSS may provide temporary relief to X-300 assigned operator.

SECTION 3.0 ADMINISTRATIVE CONTROLS

- Biological Monitoring
- Soil and Sediment Monitoring
- Methods of Evaluation and Demonstration of Compliance

3.17 PACKAGING AND TRANSPORTATION PROGRAM

A packaging and transportation quality assurance program shall be established, implemented, and maintained as described in the NRC-approved version of UEO-1041, "Radioactive Material Packaging and Transportation Quality Assurance Program."

3.18 CHEMICAL SAFETY PROGRAM

A Chemical Safety Program shall be established, implemented, and maintained as described in SAR Section 5.6.

3.19 OPERATIONS

An Operations Program shall be established, implemented, and maintained as described in SAR Section 6.5 and shall address the following program elements:

- Shift Operations
- Text Deleted
- Chemical/Utilities/Power Organization and Administration
- Operator Responsibility, Authority and Shift Routines
- Operations Procedures and Operator Aids and System Labeling
- Permits and Logging
- Management Monitoring of Operations
- Control of Equipment

3.20 ACCIDENT ANALYSIS

The Accident Analysis is presented in SAR Chapter 4. Changes to the Accident Analysis shall be reviewed and approved in accordance with the plant design change control process in Section 6.3 of the SAR.

3.21 SHARING OF FACILITIES, STRUCTURES, SYSTEMS, AND COMPONENTS

Facilities, structures, systems, and components relied upon in Section 2 of the TSRs are controlled by USEC. The corporation is not dependent upon outside agencies to provide the level of safety described in this TSR. This is with the exception of electric power for the XT-847 CAAS and the X-6644 High Pressure Fire Water Pumps; the electric power for these SSCs is controlled by the ACP NRC License Holder.

SECTION 3.0 ADMINISTRATIVE CONTROLS

- f. Controlling work and entry into locations where UF₆ may be present as described in the chemical safety and radiation protection sections of the Safety Analysis Report.
- g. For buildings X-710, X-705, X-700:
 - C. Controlling work in process areas where choice and freedom of emergency egress routes may be limited, for example, cranes or tunnels, by eliminating the source of the hazard or by providing personnel protective equipment or taking other protective measures as described in work control documents, work permits, or procedures as appropriate.
 - D. Identifying and marking emergency egress routes in process areas and maintaining them free of obstruction.
 - E. Providing illumination in process areas with battery backup for emergency egress. Where illumination with battery backup is not functional, not available, or not feasible, personnel shall be provided with functional portable lights.

3.24 RECORDS RETENTION

The following records will be retained for the specified durations. The administration of the records retention program is addressed in SAR Section 6.10.

3.24.1 The following records shall be retained for at least 2 years:

- C. Changes in programs, plans, policies, procedures, and operations, including copies of the safety analysis on which the changes were based.

3.24.2 The following records shall be retained for at least 4 years:

- C. Records of surveillance activities, inspections, and calibrations required by the TSRs
- D. Records of maintenance activities associated with systems, structures, or components, related to nuclear safety.

Enclosure 4
GDP 10-0004

United States Enrichment Corporation (USEC), Certificate Amendment Request
Significance Determination

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Significance Determination**

The United States Enrichment Corporation (USEC) has reviewed the proposed changes associated with this certificate amendment request and provides the following Significance Determination for consideration.

1. No Significant Change to Any Conditions to the Certificate of Compliance

There are no conditions to the Certificate of Compliance that pertain directly to the proposed TSR deletions and revisions. However, due to the return of the X-326 cascade building to DOE, Condition 16 will no longer be applicable under NRC Certified operations after the effective date of the de-lease. Condition 16 content which addresses HEU/MEU holdup "Caretaker Project" will become the sole responsibility of DOE now that they will not only own the holdup material but will also own the equipment containing the material. The change to the Certificate of Compliance Conditions is not significant since the issue, its potential risk and the established protective actions are being transferred under DOE regulation.

2. No Significant Change to Any Condition of the Approved Compliance Plan

All Compliance Plan Issues have been closed. As a result, the conditions specified in the Compliance Plan are no longer in effect. Thus, these proposed changes do not represent a significant change to any condition of the approved Compliance Plan.

3. No Significant Increase in the Probability of Occurrence or Consequences of Previously Evaluated Accidents

The proposed change does not involve any change to the plant safety analysis or to the safety controls in the remaining NRC Certified operations. The probability of an uncontrolled release of radioactive material or of a criticality in the remaining facilities or operations governed by the NRC Certificate of Compliance is not affected. The SSCs relied upon to prevent occurrence of an accident previously evaluated in the SAR will continue to meet the current SAR envelope requirements for availability and reliability. The TSRs will continue to be met as required for plant operations. There are no new or different potential accident scenarios or accident initiating events. As a result of the change there will not be any increase in the amount of hazardous materials that are used/processed and therefore, there is no increase in the source term from a postulated accident in the SAR.

The anticipated scope of the DOE BIO is within the operations previously analyzed in the current SAR. None of the accidents described in the existing SAR for the facilities to be de-leased would have caused an accident in the facilities or operations that will remain under NRC regulation. No accident in the de-leased facilities to be regulated by DOE would have the potential for

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Significance Determination**

causing an accident in NRC regulated space. While there are accident scenarios that could result in evacuation of facilities remaining under the Certificate, they are the same potential accidents that could now occur under NRC regulated operations and activities. The DOE BIO being prepared will utilize as a basis the same analyses and controls for authorized activities that now currently exist in the SAR. Thus, there would be no increased risk to co-located facilities onsite than currently now exists. Any significant changes that occur during the BIO review and approval process will be identified by USEC and evaluated for potential impact to the remaining NRC Certified operations and facilities. It is unlikely that any of the existing operations in these de-leased facilities with an appropriate DOE safety basis (BIO), maintained SSCs and associated TSRs would result in an increase in either the probability or consequence of a previously evaluate accident in any facility under NRC regulation.

In summary, the proposed change does not significantly increase the probability or occurrence or the consequence of any previously evaluated accidents.

4. No New or Different Type of Accident

The change will not create any new failure modes or create initiating events that are different than previously evaluated for facilities still under NRC regulation. The enrichment cascade buildings, X-340 complex buildings and any associated operations while controlled and regulated by DOE would present no new accident or initiating events or potential failure conditions for the SSCs important to safety in the remaining NRC Certified operations. Thus, no new or different type of accident in the remaining NRC Certified facilities and operations has been identified.

5. No Significant Reduction in Margins of Safety

The proposed change that deletes the Cascade Buildings, X-340 Building Complex and their associated operations TSRs, in conjunction with the simultaneous transfer of these facilities and operations to DOE has no direct impact on the remaining TSRs in Section 2.0. In addition, the revision to Section 3.0, Administrative Controls of the TSRs to reflect the facility de-lease also does not have a direct impact on the remaining TSRs. The operation and maintenance of these de-leased facilities, including the CAAS, will be managed similarly to other DOE owned facilities, such as the X-345, that co-exist within the PORTS GDP. The approved CAAS design or as-found installation of these systems while in operation remains unchanged.

The requirements of the TSRs governing the remaining NRC Certified operations of the site will continue to be met at all times. No margins of safety

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Significance Determination**

are impacted as defined in the supporting bases for any TSR. The requirements of the TSRs in Section 2.0 governing the operation of the plant will continue to be met at all times as required for the applicable operational mode. No margins of safety are impacted as defined in the supporting TSR bases.

6. No Significant Decrease in the Effectiveness of the Plant's Safety and Safeguards Or Security Programs and Plans

The TSR change does not adversely affect the plant's safety and safeguards or security programs and plans as contained in the Certification Application. There is no change to established programmatic controls, requirements or surveillances associated with the plant's safety and safeguards or security programs and plans beyond any obvious reduction in scope due to the significant return of previously certified space to DOE. For example, the Fundamental Nuclear Materials Control Program elements are not affected but will not be applied to the Cascade and X-340 Complex. These areas will be transferred to the DOE NMC&A program with the appropriate transfer of the existing physical inventory.

7. The Proposed Change does not Result in Undue Risk to 1) Public Health and Safety, 2) Common Defense and Security, and 3) the Environment

For the remaining NRC Certified operations, the TSR change does not alter any approved plant operation or physical condition nor any of the accident analysis assumptions. There is no increase in the probability of occurrence or consequences of a previously evaluated accident or malfunction of equipment important to safety. There are no new accident initiators, increase in hazardous materials or waste streams. The de-leased facilities still remain within the GDP CAA and will be afforded the same level of protection as the other facilities still covered under the Certification. The overall security posture remains unchanged. Consequently, this change does not result in undue risk to public health and safety, the environment, or to the common defense and security from the remaining NRC Certified operations.

As discussed in item 3 of this Significance Determination, the DOE activities that will be authorized under the BIO at the time of de-lease should not have any significant impact on the remaining leased Certified facilities and operations. DOE operation and regulation of the de-leased facilities will not increase the probability of occurrence or consequence of a previously evaluated accident or malfunction of equipment important to safety, introduce any new accident initiators or malfunctions of equipment important to safety or reduce the margin of safety. There should be no adverse increase in hazardous materials or waste streams since all activities with the potential to impact the environment would meet DOE standards that are equivalent to NRC requirements.

In summary, this change does not result in undue risk to public health and safety, the environment, or to the common defense and security.

**United States Enrichment Corporation (USEC)
Certificate Amendment Request
Significance Determination**

8. No Change in the Types or Significant Increase in the Amounts of Any Effluents That May be Released Offsite

The proposed TSR change does not involve any physical change to the remaining Certified plant operations that could affect the types or the amounts of any effluents that may be released offsite. It is not anticipated that the DOE operations or activities as addressed in the BIO at the time of the de-lease would result in a significant increase in the types or amounts of any effluent that may be released offsite. Therefore, the change does not affect the type or significantly increase the amount of effluents that could be released offsite.

9. No Significant Increase in Individual or Cumulative Occupational Radiation Exposure

The change does not increase the probability or consequences of a UF₆ release from the remaining Certified operations; The UF₆ handling and operations related facilities that previously provided the most significant impact to the probability or consequence of a large UF₆ release are being de-leased. The change will not affect the radiological protection program or the actions in place to minimize occupational exposures in the remaining NRC Certified areas. The DOE occupational radiation exposure requirements are similar to those of the NRC and the activities to be authorized by DOE at the time of the de-lease will be bounded by the operations and activities currently authorized by the NRC Certificate for the facilities to be de-leased.

Thus, there is no significant increase in individual or cumulative occupational radiation exposure.

10. No Significant Construction Impact

The proposed TSR change does not involve any construction activities. However, the actual de-lease of the noted facilities to DOE will cause some impact on the day to day activities of the remaining facilities. The most significant impact will be from the need to construct stand alone air and nitrogen plants. The existing plants are located within the X-330 cascade building and as such will be controlled in the future by DOE for their use. Except for being designed at most likely a reduced capacity the new air and nitrogen plants will continue to meet current performance criteria such as a dry air dew point of at least -25 °F measured at atmospheric pressure. The final plant designs and installation will be evaluated utilizing the 10 CFR 76.68 change process and dispositioned accordingly.