


NOTES:
 1. ALL MOTOR OPERATED VALVES SHALL HAVE MANUAL OPERATION HANDWHEELS.

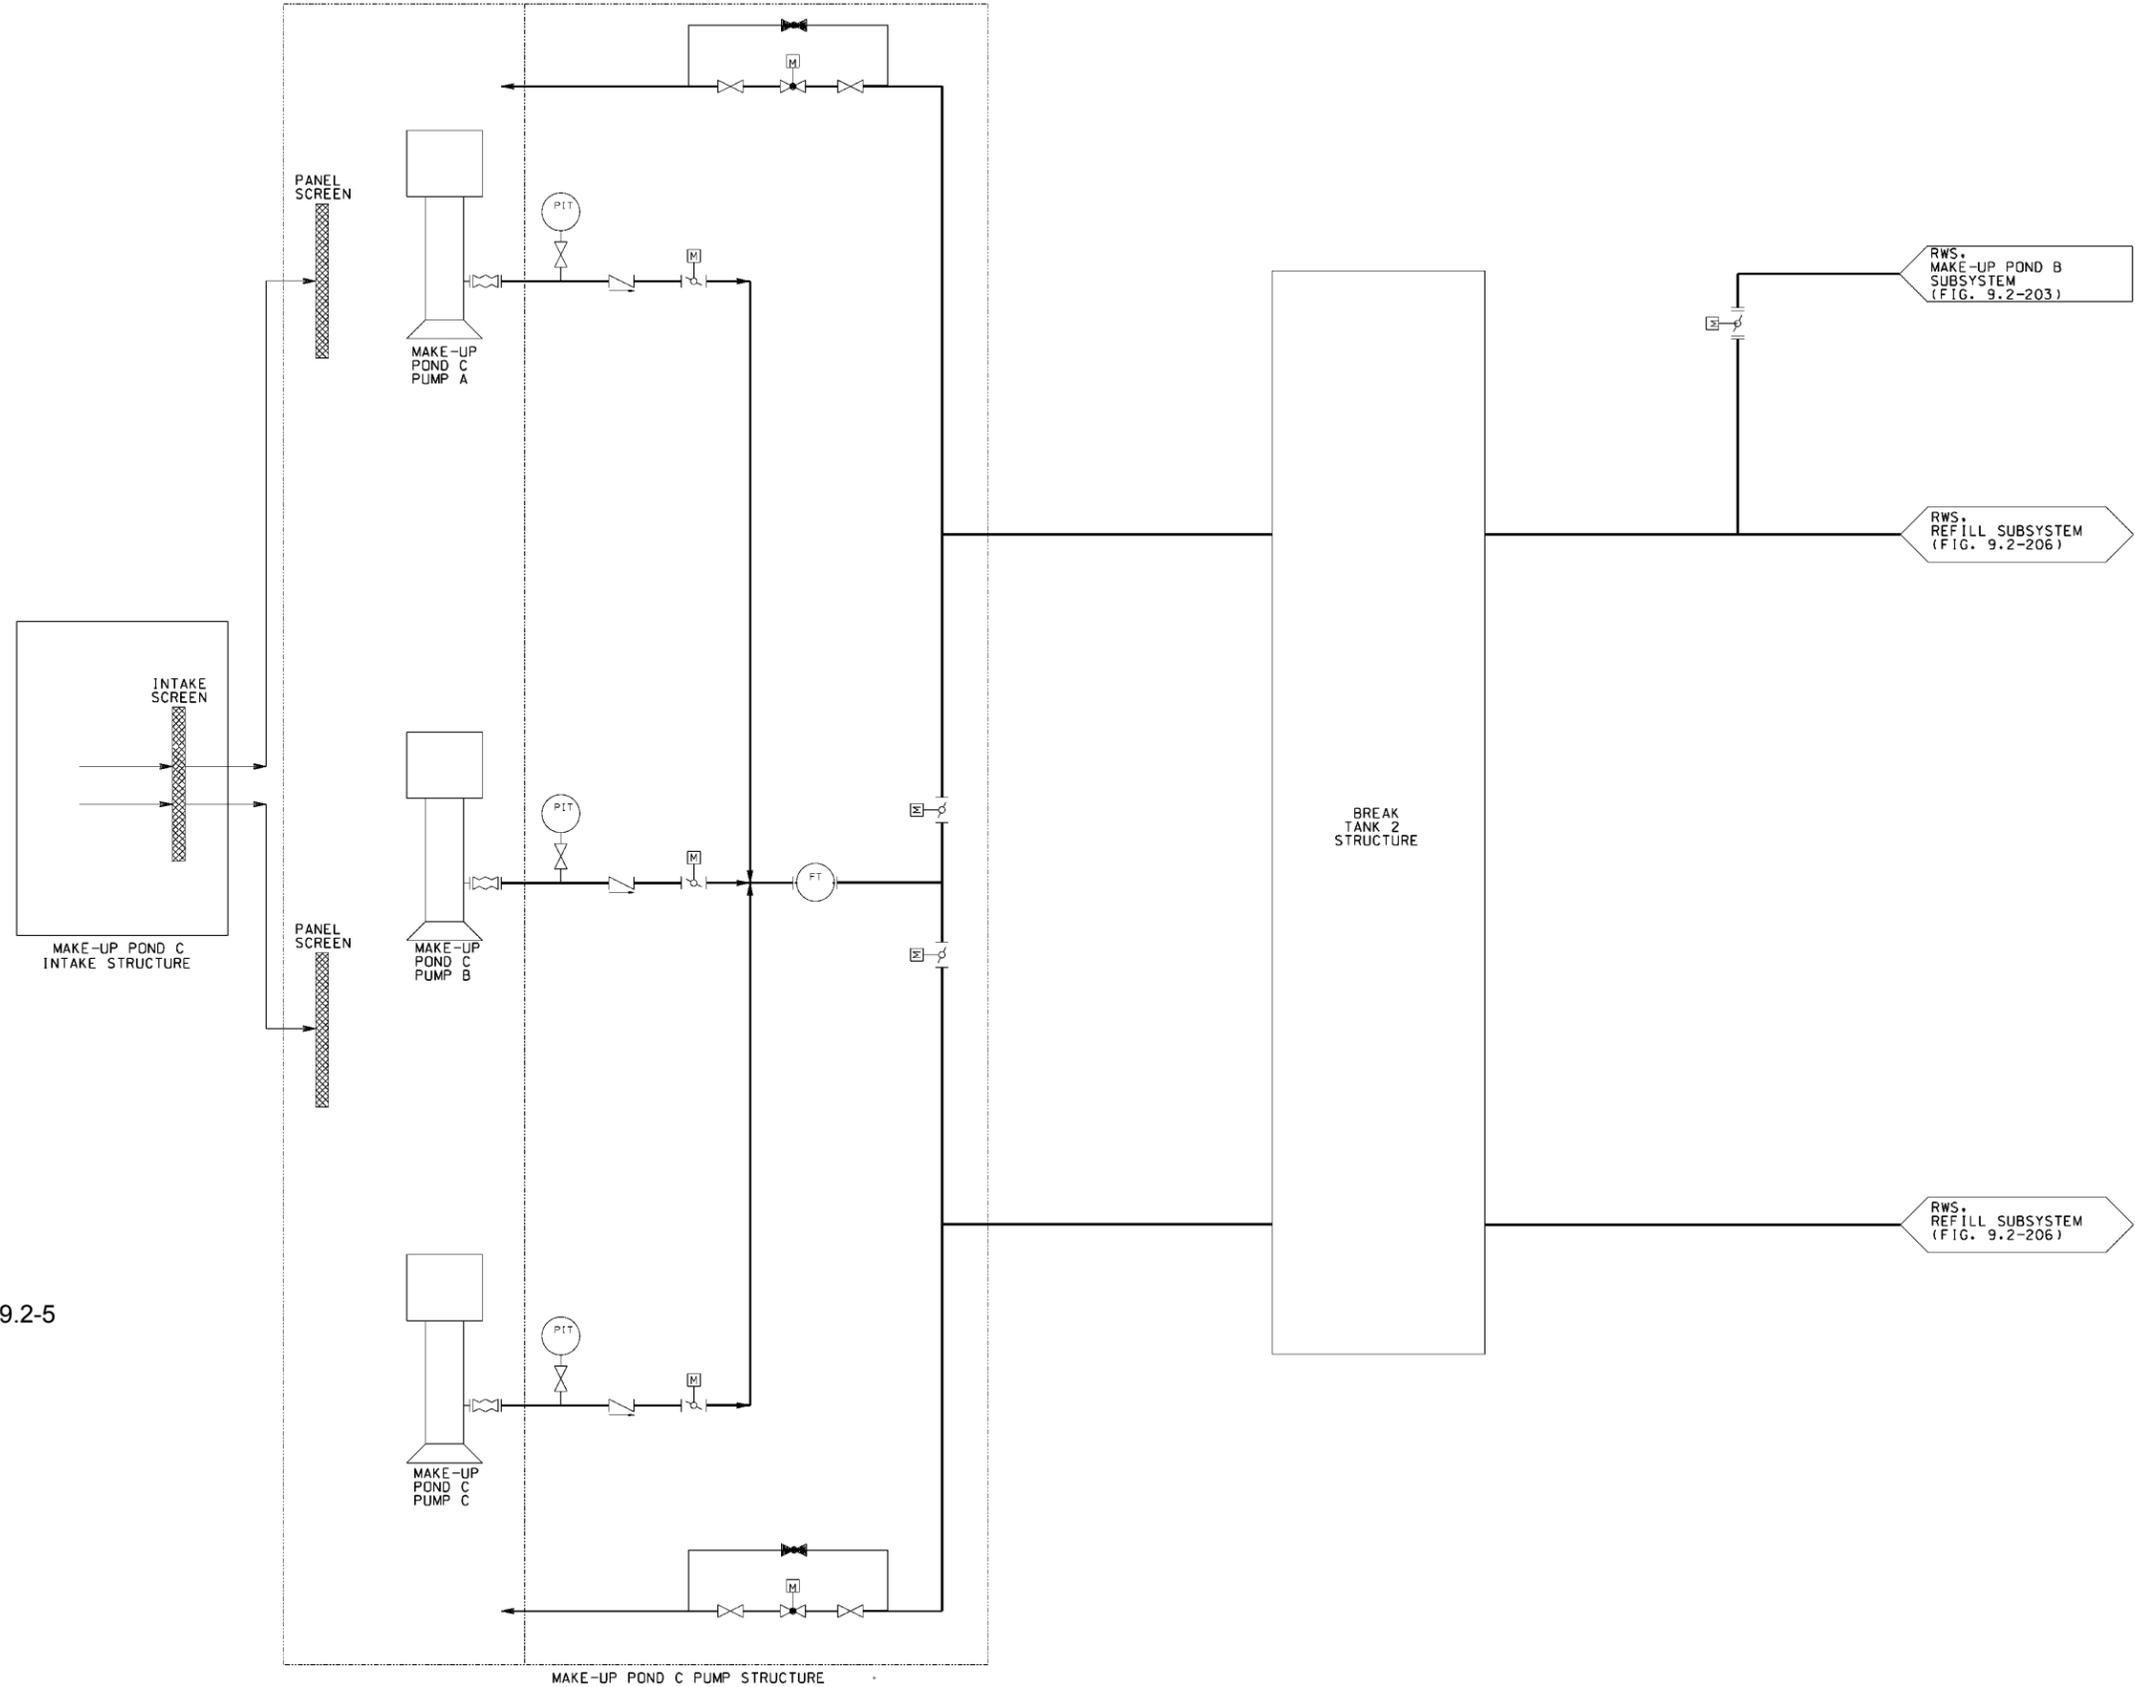

WLS SUP 9.2-5

**WILLIAM STATES LEE III
 NUCLEAR STATION UNITS 1 & 2**
 Raw Water System,
 Make-Up Pond C Subsystem
 FIGURE 9.2-207 Rev 2