



South Texas Project Electric Generating Station P.O. Box 289 Wadsworth, Texas 77483



April 8, 2010

U7-C-STP-NRC-100080

U. S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
One White Flint North  
11555 Rockville Pike  
Rockville, MD 20852-2738

South Texas Project

Units 3 and 4

Docket No. ~~52-001~~ 52-012 & 52-013

Response to Request for Additional Information

Reference: Letter, Scott Head to Document Control Desk, "Response to Request for Additional Information," dated February 8, 2010, U7-C-STP-NRC-100037 (ML100470589).

The Attachment to this letter is a supplement to the Response to Request for Additional Information (RAI) related to the application to amend the ABWR DCD Part 2, Tier 2, Section 1.0 provided in Attachment 1 to the referenced letter. This submittal adds proposed changes to ABWR DCD Part 2, Tier 2, Chapter 17 to include the South Texas Project Units 3 & 4 (STP 3 & 4) Quality Assurance Program Description (QAPD), Revision 3, which is the current STP 3 & 4 QAPD revision.

Work activities associated with the application to amend the ABWR DCD began before the adoption of QAPD, Revision 3, and were subject to previous QAPD revisions. The design controls in the QAPD, Revision 3, are not changed to any substantial degree from the previous revisions.

There are no commitments in this letter.

If you have any questions, please contact me at (361) 972-7136, or Bill Mookhoek at (361) 972-7274.

I declare under penalty of perjury that the foregoing is true and correct.

Executed on 4/8/10

Scott Head  
Manager, Regulatory Affairs  
South Texas Project Units 3 & 4

fjp  
Attachment: 01-2 Supplemental Response

D091  
D050  
MRO

STI 32653090

cc: w/o attachment except\*  
(paper copy)

Director, Office of New Reactors  
U. S. Nuclear Regulatory Commission  
One White Flint North  
11555 Rockville Pike  
Rockville, MD 20852-2738

Regional Administrator, Region IV  
U. S. Nuclear Regulatory Commission  
611 Ryan Plaza Drive, Suite 400  
Arlington, Texas 76011-8064

Kathy C. Perkins, RN, MBA  
Assistant Commissioner  
Division for Regulatory Services  
Texas Department of State Health Services  
P. O. Box 149347  
Austin, Texas 78714-9347

Alice Hamilton Rogers, P.E.  
Inspection Unit Manager  
Texas Department of State Health Services  
P. O. Box 149347  
Austin, Texas 78714-9347

C. M. Canady  
City of Austin  
Electric Utility Department  
721 Barton Springs Road  
Austin, TX 78704

\*Steven P. Frantz, Esquire  
A. H. Gutterman, Esquire  
Morgan, Lewis & Bockius LLP  
1111 Pennsylvania Ave. NW  
Washington D.C. 20004

\* Paul Kallan  
Two White Flint North  
11545 Rockville Pike  
Rockville, MD 20852

(electronic copy)

\*George F. Wunder  
\* Paul Kallan  
Loren R. Plisco  
U. S. Nuclear Regulatory Commission

Steve Winn  
Joseph Kiwak  
Eli Smith  
Nuclear Innovation North America

Jon C. Wood, Esquire  
Cox Smith Matthews

Richard Peña  
Kevin Pollo  
L. D. Blaylock  
CPS Energy

**RAI 01-2****QUESTION**

On June 30, 2009, South Texas Project Nuclear Operating Company (STPNOC) submitted an application to amend the ABWR design certification to comply with the aircraft impact rule. In a letter of intent dated February 11, 2009, STPNOC's parent company, NRG, advised the agency that a joint venture with Toshiba has been formed to create Nuclear Innovation North America LLC (NINA) to submit an application for renewal of the ABWR certification in accordance with 10CFR52.57. The renewal application will include the updates and revisions consistent with the STP Units 3 and 4 Combined License Application.

Based upon these representations to the NRC, the staff believes that STPNOC is intending, either by itself or in conjunction with other entities, to supply the design of the amended ABWR (including design and engineering services within the scope of the certified design as amended) to third parties. Under such circumstances, the NRC staff's position is that STPNOC must demonstrate that they meet the same technical qualification requirements as an original applicant for design certification in accordance with 10CFR52.47(a)(7). Please provide additional information demonstrating that STPNOC is technically qualified to supply the entire amended ABWR design.

Based on technical meetings and interactions with STPNOC and its EPC team, it is understood that Toshiba and Westinghouse have been involved in preparing this amendment application. Please explain the legal and contractual relationship between STPNOC and Toshiba, and STPNOC with Westinghouse in its current and future development of ABWR design certification activities.

**SUPPLEMENTAL RESPONSE**

STPNOC response to RAI 01-2 was provided to the NRC on February 8, 2010 in letter U7-C-STP-NRC-100037. In a telephone conversation on March 26, 2010, the NRC Staff requested that STPNOC provide a supplemental response to add a description of the STPNOC Quality Assurance Program to the DCD Amendment application. This supplemental response is an addition to the previous response.

As shown in the markup below to the DCD amendment application, reference to the STPNOC Quality Assurance Program Description is being added as a new paragraph to be inserted before the last paragraph of DCD Subsection 17.0, and a new DCD Subsection 17.1.19. All changes are shown with gray shading.

**17.0 Introduction**

The QA program which is implemented by STP Nuclear Operating Company (STPNOC) for Design Certification Document Aircraft Impact Amendment is contained in Subsection 17.1.19.

**17.1.19 Aircraft Impact Amendment**

The QA program which is implemented by STP Nuclear Operating Company (STPNOC) for Design Certification Document Amendment activities associated with the STPNOC Aircraft Impact Amendment is described in STP 3 & 4 Quality Assurance Program Description, Revision 3, April 8, 2010, provided below.

**17.1.19 20 References**

STP Nuclear Operating Company		
<b>Quality Assurance Program Description</b>		
Title: STP 3&4 Quality Assurance Program Description		
Process/Program Owner: M. A. McBurnett Vice President, Oversight & Regulatory Affairs		
	Version Number <b>Revision 3</b>	Effective Date <b>4-12-2010</b>
Revision Summary  Changes include various administrative corrections, responses to NRC Requests for Additional Information (RAIs), updates which will maintain QAPD consistency with the NEI 06-14 Template, and the scope and applicability section was updated to include Design Certification Amendment activities (associated with the Aircraft Impact Amendment).		
Prepared By/Date:  K. B. Glassin/T. F. Walker		
Reviewed By/Date:  M. A. McBurnett Vice President, Oversight & Regulatory Affairs	Approved By/Date:  E. D. Halpin President and Chief Executive Officer	

**STP 3&4**  
**Quality Assurance Program Description**

---

**STP Nuclear Operating Company**


**POLICY STATEMENT**

STP Nuclear Operating Company (STPNOC) shall design, procure, construct and operate the nuclear plants in a manner that will ensure the health and safety of the public and workers. These activities shall be performed in compliance with the requirements of the Code of Federal Regulations (CFR), the applicable Nuclear Regulatory Commission (NRC) Facility Operating Licenses, and applicable laws and regulations of the state and local governments.


The STPNOC Quality Assurance Program (QAP) is the Quality Assurance Program Description (QAPD) provided in this document and the associated implementing documents. Together they provide for control of STPNOC activities that affect the quality of safety-related nuclear plant structures, systems, and components (SSCs) and include all planned and systematic activities necessary to provide adequate confidence that such SSCs will perform satisfactorily in service. The QAPD may also be applied to certain equipment and activities that are not safety-related, but support safe plant operations, or where other NRC guidance establishes program requirements.

The QAPD is the top-level policy document that establishes the manner in which quality is to be achieved and presents STPNOC's overall philosophy regarding achievement and assurance of quality. Implementing documents assign more detailed responsibilities and requirements and define the organizational interfaces involved in conducting activities within the scope of the QAP. Compliance with the QAPD and implementing documents is mandatory for personnel directly or indirectly associated with implementation of the STPNOC QAP.

Signed

  
\_\_\_\_\_  
E. D. Halpin  
President and Chief Executive Officer  
STP Nuclear Operating Company

Date

  
\_\_\_\_\_  
4/8/10

**TABLE OF CONTENTS**

<b>PART I INTRODUCTION .....</b>	<b>4</b>
SECTION 1 GENERAL .....	4
<b>PART II QAPD DETAILS .....</b>	<b>6</b>
SECTION 1 ORGANIZATION .....	6
SECTION 2 QUALITY ASSURANCE PROGRAM .....	16
SECTION 3 DESIGN CONTROL .....	20
SECTION 4 PROCUREMENT DOCUMENT CONTROL .....	22
SECTION 5 INSTRUCTIONS, PROCEDURES, AND DRAWINGS .....	24
SECTION 6 DOCUMENT CONTROL .....	25
SECTION 7 CONTROL OF PURCHASED MATERIAL, EQUIPMENT, AND SERVICES .....	27
SECTION 8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS, AND COMPONENTS .....	30
SECTION 9 CONTROL OF SPECIAL PROCESSES .....	31
SECTION 10 INSPECTION .....	32
SECTION 11 TEST CONTROL .....	34
SECTION 12 CONTROL OF MEASURING AND TEST EQUIPMENT .....	35
SECTION 13 HANDLING, STORAGE, AND SHIPPING .....	36
SECTION 14 INSPECTION, TEST, AND OPERATING STATUS .....	39
SECTION 15 NONCONFORMING MATERIALS, PARTS, OR COMPONENTS .....	40
SECTION 16 CORRECTIVE ACTION .....	41
SECTION 17 QUALITY ASSURANCE RECORDS .....	42
SECTION 18 AUDITS .....	43
<b>PART III NONSAFETY-RELATED SSC QUALITY CONTROL .....</b>	<b>46</b>
SECTION 1 Nonsafety-Related SSCs - Significant Contributors to Plant Safety .....	46
SECTION 2 Nonsafety-Related SSCs Credited for Regulatory Events .....	49
<b>PART IV REGULATORY COMMITMENTS .....</b>	<b>50</b>
NRC Regulatory Guides and Quality Assurance Standards .....	50
<b>PART V ADDITIONAL QUALITY ASSURANCE AND ADMINISTRATIVE CONTROLS FOR THE PLANT</b>	
<b>OPERATIONAL PHASE .....</b>	<b>55</b>
SECTION 1 Definitions .....	55
SECTION 2 Review of Activities Affecting Safe Plant Operation .....	56
SECTION 3 Operational Phase Procedures .....	58
SECTION 4 Control of Systems and Equipment in the Operational Phase .....	64
SECTION 5 Plant Maintenance .....	64

## **PART I INTRODUCTION**

### **SECTION 1 GENERAL**

STP Nuclear Operating Company's (STPNOC) Units 3 & 4 (STP 3&4) Quality Assurance Program Description (QAPD) is the top-level policy document that establishes the quality assurance policy and assigns major functional responsibilities for COL/construction/pre-operation and/or operations activities and/or Design Certification Amendment activities (associated with the Aircraft Impact Amendment) conducted by or for STPNOC. The QAPD describes the methods and establishes Quality Assurance (QA) and administrative control requirements that meet 10 CFR 50, Appendix B and 10 CFR 52. The QAPD is based on the requirements and recommendations of ASME NQA-1-1994, "Quality Assurance Requirements for Nuclear Facility Applications," Parts I, II and III as specified in this document.

The QA Program (QAP) is defined by the NRC-approved regulatory document that describes the QA elements (i.e. the QAPD), along with the associated implementing documents. Procedures and instructions that control STP 3&4 activities will be developed prior to commencement of those activities. Policies establish high-level responsibilities and authority for carrying out important administrative functions which are outside the scope of the QAPD. Procedures establish practices for certain activities which are common to all STPNOC organizations performing those activities so that the activity is controlled and carried out in a manner that meets QAPD requirements. Procedures specific to a site, organization, or group establish detailed implementation requirements and methods, and may be used to implement policies or be unique to particular functions or work activities.

#### **1.1 Scope/Applicability**

The QAPD applies to COL, construction/pre-operation and operations activities affecting the quality and performance of safety-related structures, systems, and components, including, but not limited to:

Designing	Receiving	Pre-operational activities (including ITAAC)
Siting	Storing	Operating
Licensing	Constructing	Maintaining
Procuring	Erecting	Repairing
Fabricating	Installing	Modifying
Cleaning	Inspecting	Refueling
Handling	Testing	Training
Shipping	Startup	Decommissioning

ITAAC are those Inspections, Tests, Analyses and Acceptance Criteria the applicant must satisfy as determined by the commission in accordance with 10 CFR Part 52.

Safety-related SSCs, under the control of the QAPD, are identified by design documents. The technical aspects of these items are considered when determining program applicability, including, as appropriate, the item's design safety function. The QAPD may be applied to certain activities where regulations other than 10 CFR 50 and 10 CFR 52 establish QA requirements for activities within their scope.



**STP 3&4**  
**Quality Assurance Program Description**

---

Portions of the QAPD also apply to design quality assurance activities conducted in support of Design Certification Aircraft Impact Amendment (AIA). Assessments for AIA are beyond design basis and therefore the quality assurance requirements, of 10 CFR 50 Appendix B, do not apply. Controls in accordance with NEI 07-13 are in place to establish the validity of analyses and supporting calculations, and documentation files are maintained with a complete set of analyses. Changes to the facility design as a result of the assessments are subject to the full design controls described in this QAPD.

The policy of STPNOC is to assure a high degree of availability and reliability of the nuclear plants while ensuring the health and safety of its workers and the public. To this end, selected elements of the QAPD are also applied to certain equipment and activities that are not safety-related, but support safe, economic, and reliable plant operations, or where other NRC guidance establishes quality assurance requirements. Implementing documents establish program element applicability.

The definitions provided in ASME NQA-1-1994, Part I, Section 1.4, apply to select terms as used in this document.

## **PART II QAPD DETAILS**

### **SECTION 1 ORGANIZATION**

This section describes the STPNOC organizational structure, functional responsibilities, levels of authority and interfaces for establishing, executing, and verifying QAPD implementation. The organizational structure includes off-site and on-site functions for STP 3&4 including interface responsibilities for multiple organizations that perform quality-related functions. Implementing documents assign more specific responsibilities and duties, and define the organizational interfaces involved in conducting activities and duties within the scope of the QAPD. Management gives careful consideration to the timing, extent and effects of organizational structure changes.

The Vice President, Oversight and Regulatory Affairs is responsible to size the Quality Assurance organization commensurate with the duties and responsibilities assigned.

The STPNOC (Units 3 & 4) construction/preoperation organization is shown on Figure II.1-1. The STPNOC (Units 1 & 2) organization is shown to illustrate the overall STPNOC company structure. Figure II.1-2 illustrates the STPNOC organization after transition to the operations phase.

During all phases, managers of all departments are responsible for the development and implementation of procedures and the training of personnel, as required, to accomplish their roles with respect to quality.

The President and CEO has overall responsibility for the implementation of this QAPD and approving revisions thereto during all phases.

#### **1.1 Construction/Preoperation Phase**

The following roles and responsibilities correspond to those positions shown on Figure II.1-1 and are applicable during the construction/preoperation phase.

##### **1.1.1 Senior Vice President**

The Senior Vice President reports to the President and CEO and is responsible for implementing quality program requirements applicable to the overall efforts associated with the activities related to the Combined License.

Upon transition to the operations phase this position is eliminated, and the responsibilities of the Senior Vice President will be performed by the Chief Operating Officer/Chief Nuclear Officer (COO/CNO).

##### **1.1.2 Vice President Oversight & Regulatory Affairs**

The Vice President Oversight & Regulatory Affairs reports to the Senior Vice President and is responsible for implementing quality program requirements applicable to activities associated with licensing and independent oversight. The Vice President Oversight & Regulatory Affairs, at his discretion, has unfettered access to the President and CEO and the Board of Directors.

## STP 3&4

### Quality Assurance Program Description

---

The Vice President Oversight & Regulatory Affairs has the independence to conduct Quality activities without undue pressure of cost or schedule and has authority for the following:

- Development, maintenance, and independent verification of implementation of the STP QAP; making periodic reports on its effectiveness; review of selected documents which control activities within its scope;
- Review of the QAPD and revisions thereto;
- Identification, recommendation, initiation, and provision of solutions to quality-related problems and verifying the implementation and effectiveness of the solutions;
- Independent oversight activities, including audits, independent assessments, evaluations, surveillances, and performance monitoring;
- A corrective action program; and
- Stopping work pending problem resolution.

Upon transition to the operations phase this position is eliminated, and the duties and responsibilities above will be transferred to the GM Oversight and Regulatory Affairs.

#### **1.1.3 Manager, Quality**

The Manager, Quality reports directly to the Vice President Oversight & Regulatory Affairs, has unfettered access to the President and CEO, and is responsible for ensuring the QAP is appropriately implemented and maintained. The Manager, Quality has the authority and organizational freedom to conduct quality activities without undue pressure of cost or schedule.

The Manager, Quality is responsible for the overall implementation of the QAP. Additionally, the Manager, Quality ensures the following items are performed:

- Recommending, initiating, and verifying solutions to quality problems through corrective action;
- Developing and revising this QAPD and selected procedures for conformity with NRC requirements;
- Monitoring activities and verifying the effectiveness of the QAP by means of an audit program, and reporting audit results;
- Providing orientation and training to STPNOC (Units 3 & 4) employees in quality assurance, as required for their job;
- Providing oversight of suppliers' quality assurance programs to ensure all appropriate controls are in place;
- Monitoring suppliers for compliance with material and service requirements;
- Reviewing and approving applicable procurement documents and changes thereto;
- Approving and maintaining the list of approved suppliers; and
- Stopping work pending problem resolution.

Upon transition to the operations phase this position is eliminated, and the duties and responsibilities are transferred to the Manager, Quality who reports to the GM Oversight and Regulatory Affairs as shown on Figure II.1-2.

## Quality Assurance Program Description

---

### 1.1.4 Manager, Regulatory Affairs

The Manager, Regulatory Affairs reports directly to the Vice President Oversight & Regulatory Affairs and is responsible for interfacing with the Nuclear Regulatory Commission, siting, and implementation of a:

- Corrective action program;
- Security program; and
- Environmental protection program

Upon transition to the operations phase this position is eliminated, and the duties and responsibilities of the Manager, Regulatory Affairs associated with NRC interface will be transferred to the Manager, Licensing. The responsibilities associated with corrective action, security, and environmental protection programs will be transferred to the GM Generation Support.

### 1.1.5 Vice President, Engineering & Construction

The Vice President, Engineering & Construction reports to the Senior Vice President and is responsible for activities involved with the engineering, design, and construction of STP 3 & 4 including:

- Establishing appropriate interface controls for implementing the QAP requirements of this manual;
- Ensuring appropriate design requirements are included in procurement documentation;
- Preparing, issuing, and reviewing applicable technical specifications, instructions, procedures, and drawings; and
- Planning start-up.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the Vice President, Engineering and Construction associated with engineering activities are transferred to the Vice President Engineering. The responsibilities related to construction are no longer necessary and therefore are eliminated.

### 1.1.6 Manager, Engineering

The Manager, Engineering reports directly to the Vice President, Engineering & Construction and is responsible for:

- Interfacing with the contractor design engineers and the Owners Engineer (OE);
- Ensuring suppliers develop, control, and distribute fabrication drawings in accordance with applicable codes and regulatory requirements;
- Initiating procurement requests for materials and services;
- Ensuring that inspection and test activities performed by suppliers are technically adequate; and
- Reviewing design documentation.

Upon transition to the operations phase this position is eliminated. The duties and responsibilities of the Manager, Engineering will be transferred to the General Manager of Engineering Units 3 & 4.

### 1.1.7 Manager, Turnover/Startup

The Manager, Turnover/Startup reports directly to the Vice President, Engineering & Construction and is responsible for interfacing with the Engineering, Procurement, and Construction (EPC) contractor for activities at STP 3 & 4 related to oversight of the day-to-day activities of the Preoperations/Startup Test Group. The Manager, Turnover/Startup is also

## **Quality Assurance Program Description**

---

responsible for ensuring smooth interface between STP 3 & 4 Plant Staff and the testing organization(s). Prior to fuel load, the Manager, Turnover/Startup is responsible for completion of Inspections, Tests, Analyses and Acceptance Criteria (ITAAC).

Upon completion of Startup and entrance into the operations phase this position is eliminated and the responsibilities of the Manager, Turnover/Startup are transferred to the Plant General Manager Units 3 & 4.

### **1.1.8 Manager, Construction**

The Manager, Construction reports directly to the Vice President, Engineering & Construction and is responsible for interfacing with the EPC contractor for activities at STP 3 & 4 related to: constructing, fabricating, cleaning, handling, erecting, installing, and modifying structures, systems and components.

Upon completion of Startup, and entrance into the operations phase, this position and the responsibilities of the Manager, Construction are no longer necessary and therefore are eliminated.

### **1.1.9 General Manager Support Services**

The General Manager Support Services reports directly to the Senior Vice President and is responsible for implementing QAP requirements applicable to the following functions: Supply Chain, Records Management, and Information Technology.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the General Manager Support Services are transferred to the Vice President Shared Services.

### **1.1.10 Manager, Supply Chain**

The Manager, Supply Chain, reports to the General Manager Support Services and is responsible for:

- Directing procurement of materials, items, and services for STP 3 & 4;
- Coordinating with the Managers, Engineering and Quality to ensure the inclusion of appropriate technical, regulatory, administrative, quality, and reporting requirements in procurement documents; and
- Providing oversight of supplier activities to assure procurement document requirements are met.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the Manager, Supply Chain are transferred to the Manager, Financial Services.

### **1.1.11 Manager, Information Technology/Records Management and Document Control**

The Manager, Information Technology/Records Management and Document Control reports to the General Manager Support Services and is responsible for STP 3 & 4 Software QA administration as well as receipt, storage, and retrieval of documents and Quality Assurance Records.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the Manager, Information Technology/Records Management and Document Control are transferred to the Manager, Information Management.

## STP 3&4 Quality Assurance Program Description

---

### 1.1.12 Plant General Manager

The Plant General Manager reports to the Senior Vice President and is responsible for activities related to the preparation for operation and maintenance of STP 3 & 4. The Plant General Manager's responsibilities include:

- Staffing and training of operations, maintenance, and generation support personnel;
- Interfacing with the EPC contractor to conduct testing of plant equipment; and
- Receiving plant equipment from the EPC contractor and maintaining that equipment thereafter.

Upon entrance into the operations phase this position is eliminated and the responsibilities of the Plant General Manager related to operations and maintenance are transferred to the Plant General Manager Units 3 & 4. Responsibilities associated with training are transferred to the General Manager Generation Support.

### 1.1.13 Manager, Maintenance

The Manager, Maintenance reports to the Plant General Manager and is responsible for developing processes to establish a fully staffed maintenance organization. Additionally, the Manager, Maintenance is responsible for implementing processes related to interfacing with the EPC contractor to receive and maintain plant equipment.

Upon transition to the operations phase this position is eliminated. The roles and responsibilities of the Manager, Maintenance are transferred to the Manager, Maintenance Units 3 & 4.

### 1.1.14 Manager, Operations

The Manager, Operations reports to the Plant General Manager and is responsible for developing processes to establish a fully staffed operations organization. Additionally, the Manager, Operations is responsible for implementing processes related to interfacing with the EPC contractor to test and operate plant equipment.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the Manager, Operations are transferred to the Manager, Operations Units 3 & 4.

### 1.1.15 Manager, Training

The Manager, Training reports to the Plant General Manager and is responsible to develop and implement a process to train a fully staffed STP 3 & 4 operations and maintenance organization.

Upon transition to the operations phase this position is eliminated. Roles and responsibilities of the Manager, Training are transferred to the Manager, Training who reports to the GM Generation Support as shown on Figure II.1-2.

### 1.1.16 Agents and Contractors

STPNOC is the Applicant/Licensee of STP 3 & 4 and maintains control and oversight of design, procurement, construction, and testing performed by Toshiba Corporation, the EPC contractor.

On a case-by-case basis, STPNOC will contract with qualified consultants for Owner's Engineer (OE) functions related to the licensing, oversight, engineering, procurement and construction of STP 3 & 4.

## 1.2 Transition to Operations

No later than six months prior to fuel load of the first unit, those positions which are shown on Figure II.1-2 will be staffed and have the appropriate authority required to perform operations activities. It is anticipated that even after fuel load, construction activities will be ongoing. Those

## STP 3&4 Quality Assurance Program Description

---

positions required to support these activities will retain their applicable construction/preoperation responsibilities until it is deemed that they are no longer necessary.

As the construction of systems (or portions thereof) is completed, all control and authority (including oversight, configuration and operations) is transferred from the EPC contractor to the applicable STPNOC departments having cognizance in the operations phase. During the transition, responsibilities will be clearly defined in instructions and procedures to ensure appropriate authority is always maintained for each structure, system, and component.

### **1.3 Operations Phase**

The following roles and responsibilities correspond to those positions shown on Figure II.1-2 and are applicable only during the operations phase for Units 3 & 4.

#### **1.3.1 Chief Operating Officer/Chief Nuclear Officer (COO/CNO)**

The COO/CNO reports to the President and CEO and is responsible for implementing quality program requirements applicable to the overall efforts associated with STPNOC (Units 1 through 4) activities.

#### **1.3.2 Site Vice President**

The Site Vice President reports to the COO/CNO and has overall responsibility for implementing quality program requirements related to: operations, maintenance, work control, outages, training, chemistry, radiological controls, plant protection, and station support.

#### **1.3.3 Plant General Manager, Units 3 & 4 (PGM)**

The PGM reports to the Site Vice President and is responsible for the overall day-to-day operations of Units 3 & 4. The PGM is responsible for Operations, Maintenance, Work Control and Outage Management. The PGM is also responsible for coordination of activities such as refueling and decommissioning.

#### **1.3.4 Manager, Operations, Units 3 & 4**

The Manager, Operations, Units 3 & 4 reports to the PGM and is responsible for development of operations programs and implementation of quality program requirements associated with the day-to-day operation of Units 3 & 4.

#### **1.3.5 Manager, Maintenance, Units 3 & 4**

The Manager, Maintenance, Units 3 & 4 reports to the PGM and is responsible for development of maintenance programs and implementation of quality program requirements associated with maintenance of Units 3 & 4.

#### **1.3.6 General Manager Generation Support (GMGS)**

The GMGS reports to the Site Vice President and is responsible for providing services which support the day-to-day operations of STPNOC. The GMGS is responsible for Training, Radiation Protection, Chemistry, Environmental, Plant Protection (Nuclear Security and Personnel Access), Performance Improvement (Corrective Action Program), Metrology, and Procedure Development.

#### **1.3.7 Manager, Training**

The Manager, Training reports to the GMGS and is responsible for the development of training programs and implementing quality requirements associated with training.

**Quality Assurance Program Description**

---

**1.3.8 Vice President Engineering**

The Vice President Engineering reports to the COO/CNO and is responsible for quality program requirements applicable to the following functions: fuels & analysis, engineering (testing programs, design engineering, systems engineering, maintenance engineering), and Engineering Programs.

**1.3.9 General Manager of Engineering, Units 3 & 4**

The General Manager of Engineering (GME), Units 3 & 4 reports to the Vice President Engineering and is responsible for the overall day-to-day engineering of Units 3 & 4 including: Maintenance Engineering, Design Engineering, Testing, and Systems Engineering.

**1.3.10 Manager, Fuels**

The Manager, Fuels reports to the Vice President Engineering and is responsible for implementing the fuels management program which includes Fuel Analysis and Fuels Engineering activities.

**1.3.11 Manager, Engineering Programs**

The Manager, Engineering Programs reports to the Vice President Engineering and is responsible for the development and implementation of Engineering Department Programs e.g. Inservice Inspection (ISI), Inservice Testing (IST), and Maintenance History.

**1.3.12 General Manager Projects/Alliances**

The General Manager Projects/Alliances reports to the COO/CNO and is responsible for developing alliances with outside vendors to support STPNOC.

**1.3.13 General Manager Oversight and Regulatory Affairs**

The General Manager Oversight and Regulatory Affairs reports to the President and CEO and is responsible for implementing quality program requirements applicable to the overall efforts of STPNOC (Units 1 through 4) including those listed in paragraph 1.3 of this section.

**1.3.14 Manager, Licensing**

The Manager, Licensing reports directly to the General Manager Oversight & Regulatory Affairs and is responsible for interfacing with the Nuclear Regulatory Commission.

**1.3.15 Manager, Quality**

The Manager, Quality reports directly to the General Manager Oversight & Regulatory Affairs with the authority to go directly to the President and CEO and is responsible for implementing quality program requirements applicable to STPNOC including those listed in paragraph 1.3 of this section.

**1.3.16 Manager, Risk Management**

The Manager, Risk Management reports directly to the General Manager Oversight & Regulatory Affairs and is responsible for implementing Probabilistic Risk Management programs for STPNOC.

**1.3.17 Manager, Employee Concerns Program**

The Manager, Employee Concerns Program reports directly to the President and CEO and is responsible for implementation of the Employee Concerns Program for STPNOC.



## **Quality Assurance Program Description**

---

### **1.3.18 Vice President Shared Services**

The Vice President Shared Services reports directly to the President and CEO and is responsible for implementing QAPD requirements applicable to the following functions: Supply Chain, Records Management, and Information Technology.

### **1.3.19 Manager, Information Management**

The Manager, Information Management reports directly to the Vice President Shared Services and is responsible for information technology programs including administration of the Records Management program for STPNOC (Units 1 through 4)

### **1.3.20 Manager, Financial Services**

The Manager, Financial Services reports directly to the Vice President Shared Services and is responsible for the financial and business programs and process, and the supply chain activities for STPNOC, including the procuring, shipping, receiving, handling, and storing of structures, systems and components prior to installation into Units 3 & 4.

### **1.4 Authority to Stop Work**

The Senior Vice President and the Vice President Oversight & Regulatory Affairs, and the Manager, Quality have the authority to stop work for cause for construction/preoperation activities. The COO/CNO, GM Oversight and Regulatory Affairs, and the Manager, Quality have authority to stop work for cause for operations activities. This authority has been granted by the President and CEO.

Quality assurance and inspection personnel have the authority, and the responsibility, to stop work in progress which is not being done in accordance with approved procedures or where safety or SSC integrity may be jeopardized. This extends to off-site work performed by suppliers that furnish safety-related materials and services to STPNOC.


### **1.5 Quality Assurance Organizational Independence**

For development of safety-related information used to prepare the COL application and construction, independence shall be maintained between the organization or organizations performing the checking (quality assurance and control) functions and the organizations performing the functions. This provision is not applicable to design review/verification.

### **1.6 NQA-1-1994 Commitment**

In establishing its organizational structure, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 1 and Supplement 1S-1.


Figure II.1-1 STPNOC Construction/Preoperation Organization

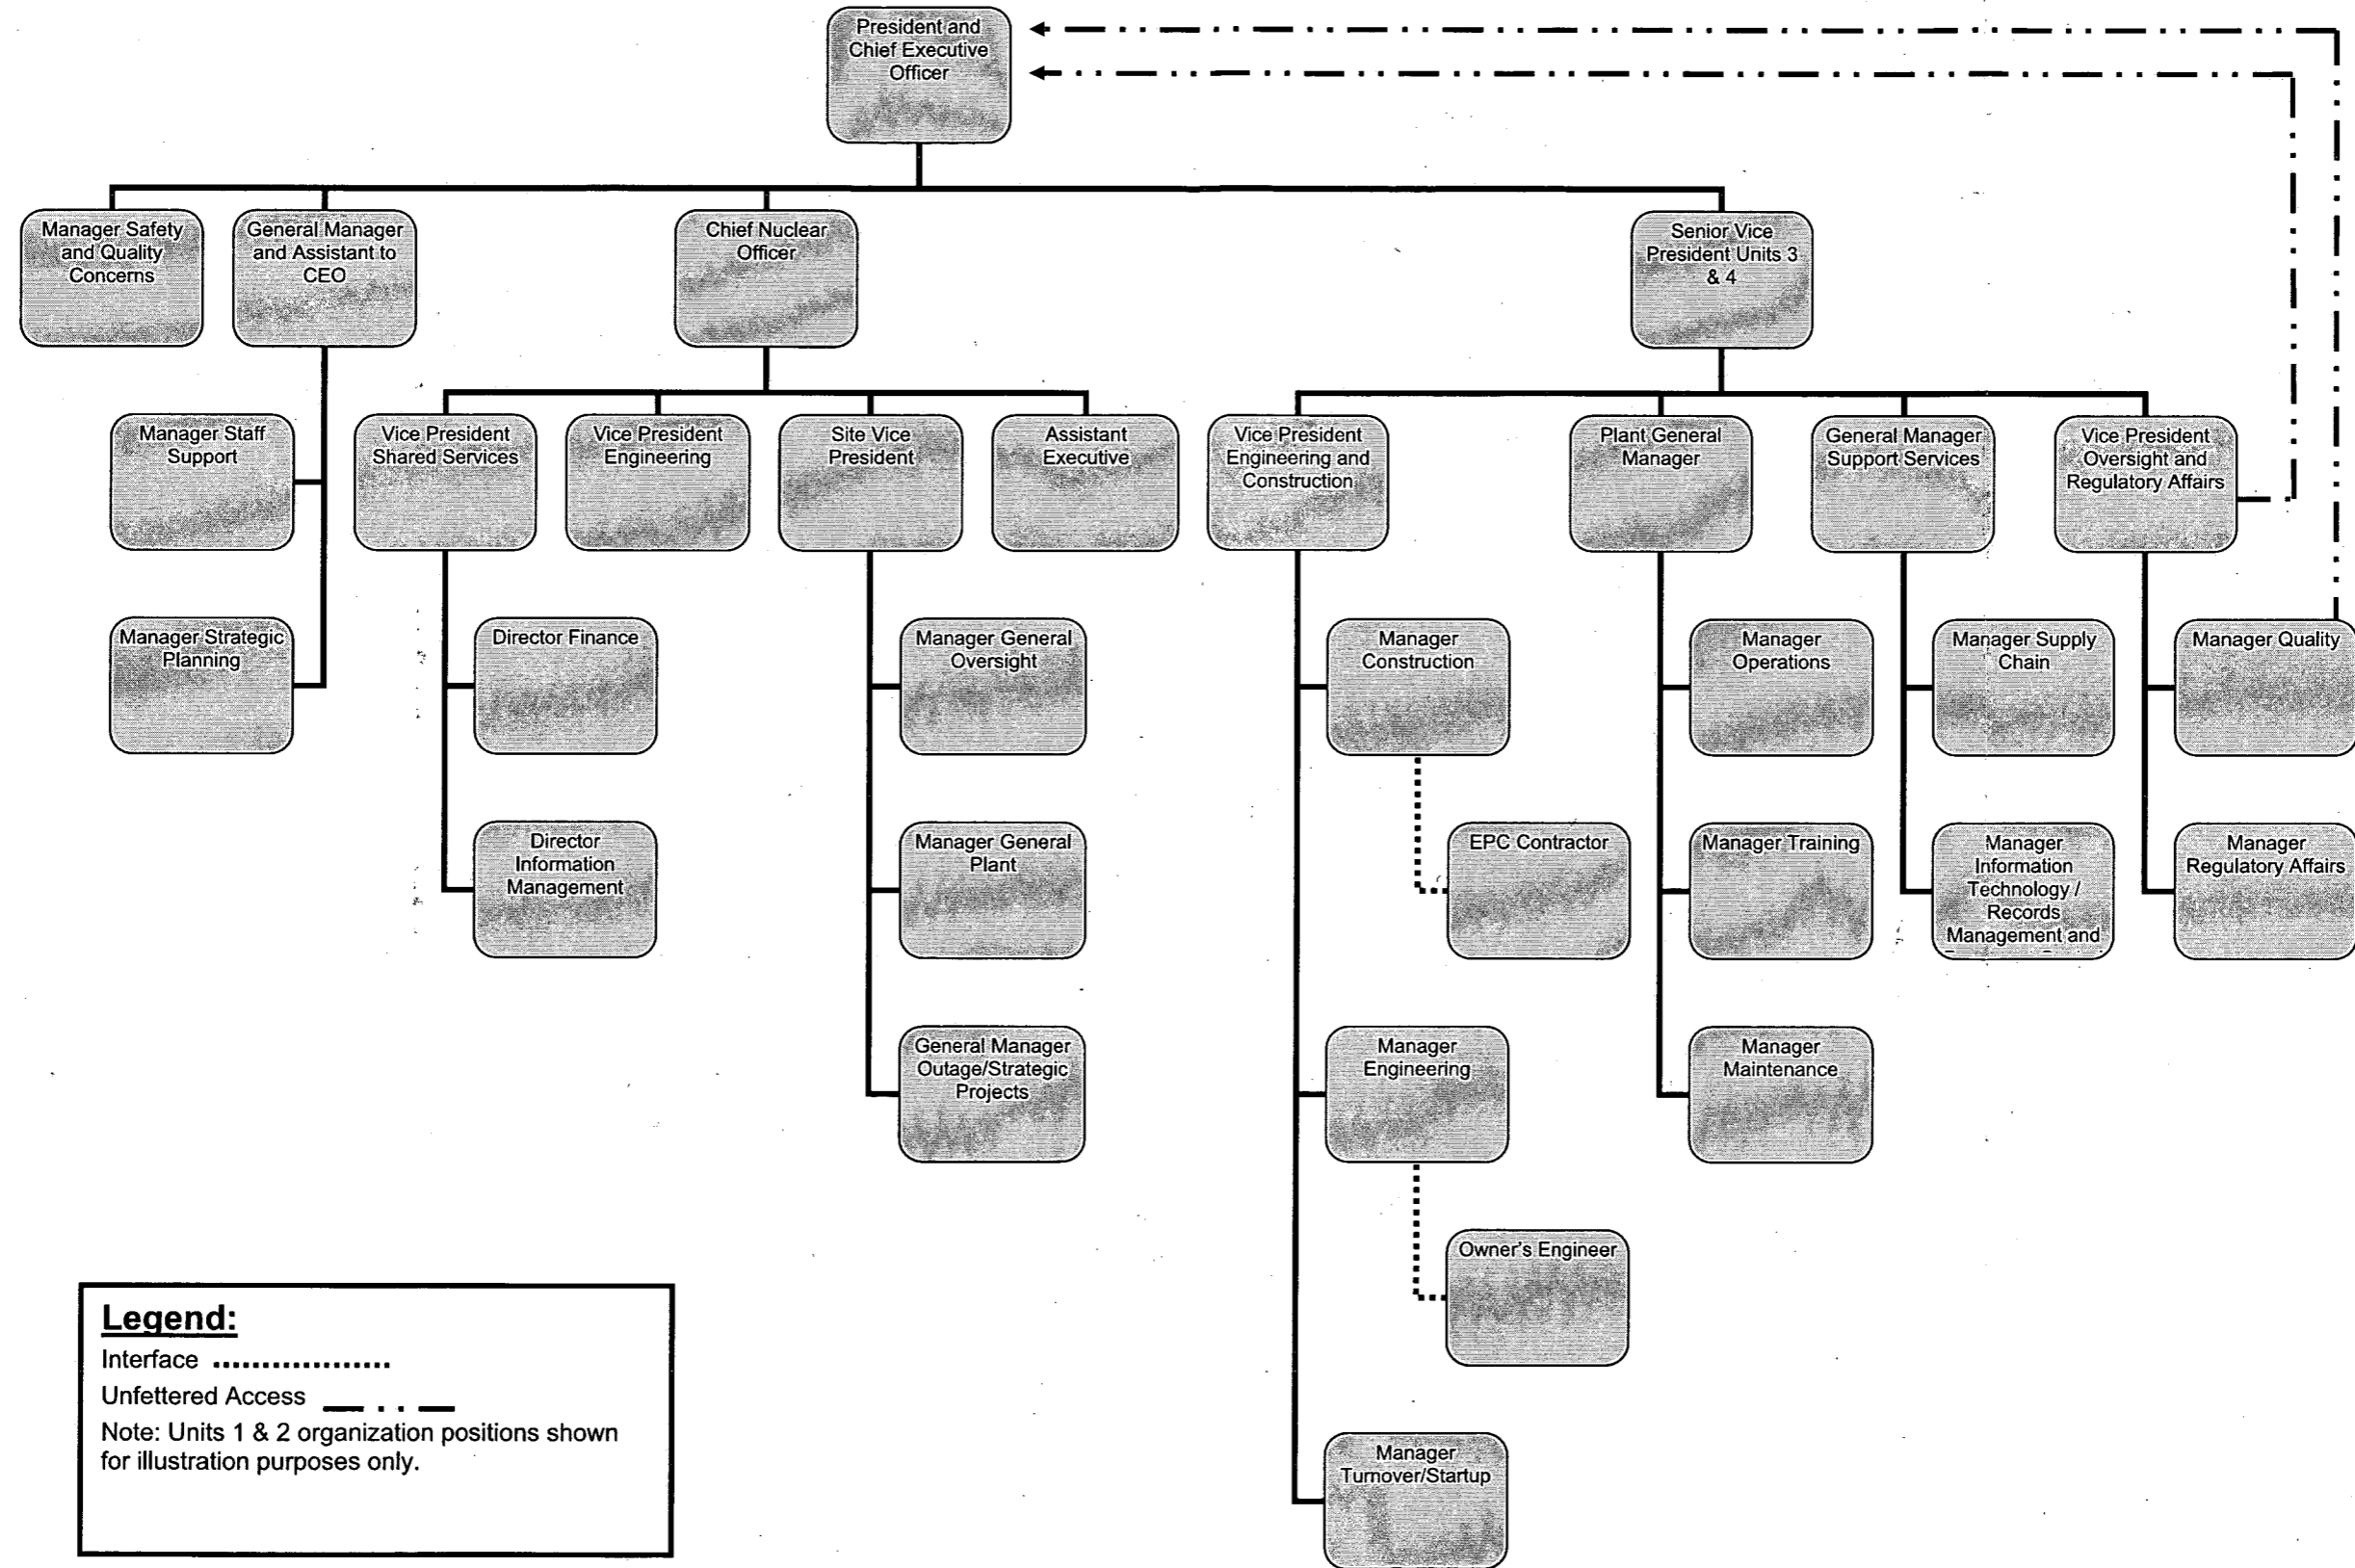

**Legend:**  
 Interface .....  
 Unfettered Access - - - -  
 Note: Units 1 & 2 organization positions shown for illustration purposes only.

# STP 3&4 Quality Assurance Program Description

Figure II.1-2 STPNOC Organization Four Unit Commercial Operation

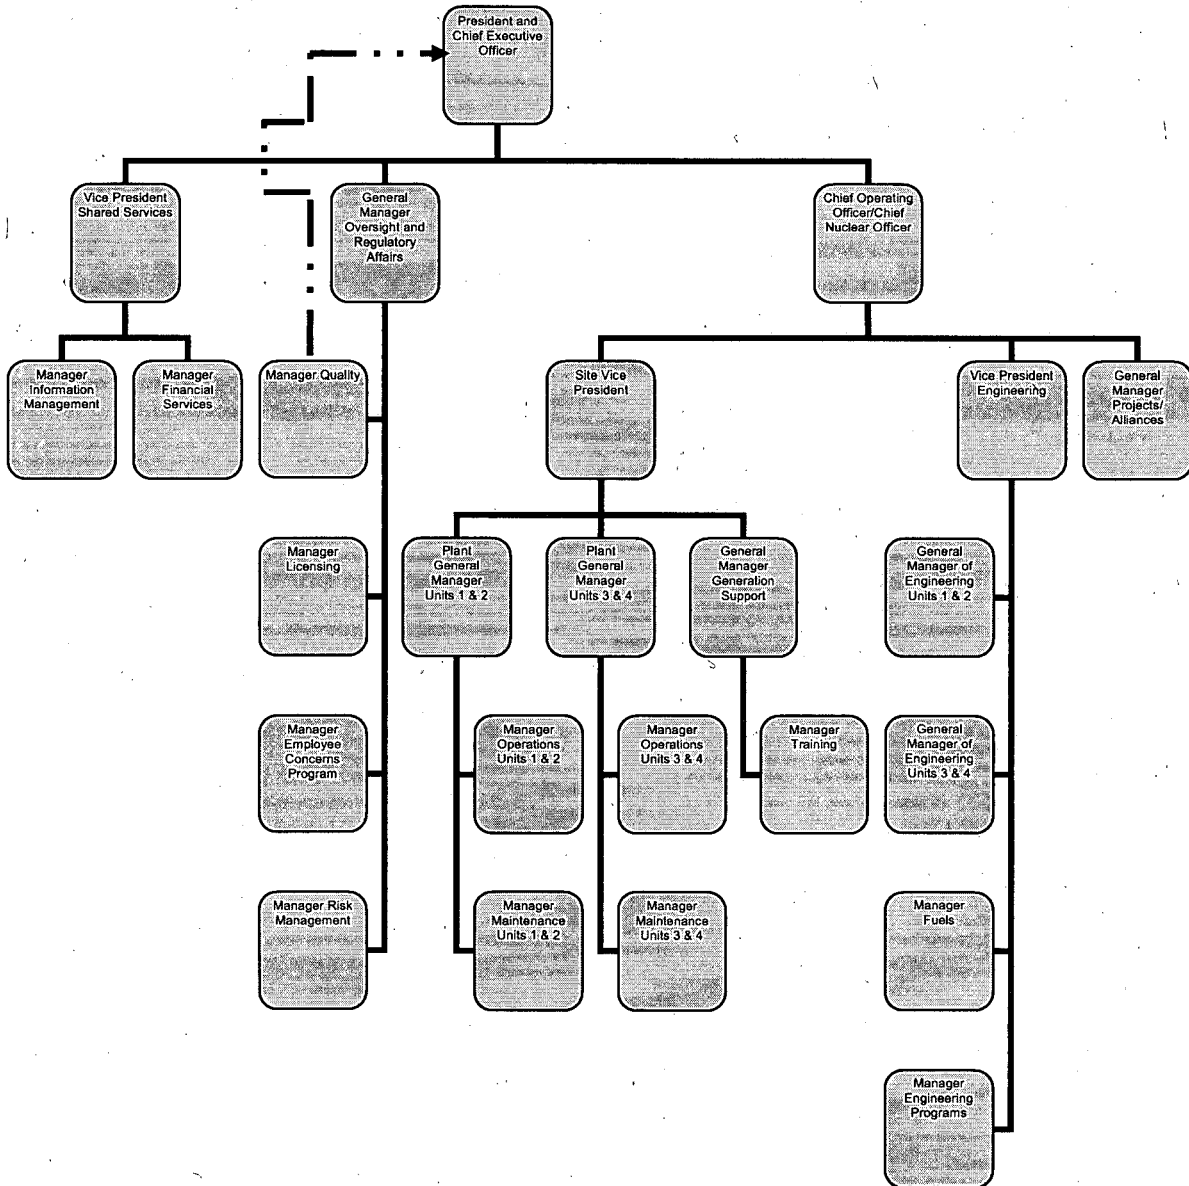

## **SECTION 2      QUALITY ASSURANCE PROGRAM**

STPNOC has established the necessary measures and governing procedures to implement the QAP as described in the QAPD. STPNOC is committed to implementing the QAP in all aspects of work that are important to the safety of the nuclear plants as described and to the extent delineated in the QAPD. Further, STPNOC ensures through the systematic process described herein that its suppliers of safety-related equipment or services meet the applicable requirements of 10 CFR 50, Appendix B. Senior management is regularly apprised of the adequacy of implementation of the QAP through the audit functions described in Part II, Section 18.

The objective of the QAP is to assure that STPNOC's nuclear generating plants are designed, constructed, and operated in accordance with governing regulations and license requirements. The program is based on the requirements of ASME NQA-1-1994, "Quality Assurance Requirements for Nuclear Facility Applications," as further described in this document. The QAP applies to those quality-related activities that involve the functions of safety-related structures, systems, and components (SSCs) associated with the design, fabrication, construction, and testing of the SSCs of the facility and to the managerial and administrative controls to be used to assure safe operations. Examples of COL program safety-related activities include, but are not limited to, site specific engineering related to safety-related SSCs, site geotechnical investigations, site engineering analysis, seismic analysis, and meteorological analysis. A list or system that identifies SSCs and activities to which this program applies is maintained at the appropriate facility. The Design Certification Document is used as the basis for this list. Cost and scheduling functions do not prevent proper implementation of the QAP.

As described in Part III of the QAPD, specific program controls are applied to nonsafety-related SSCs, for which 10 CFR 50, Appendix B, is not applicable, that are significant contributors to plant safety. The specific program controls consistent with applicable sections of the QAPD are applied to those items in a selected manner, targeted at those characteristics or critical attributes that render the SSC a significant contributor to plant safety.

Delegated responsibilities may be performed under a supplier's or principal contractor's QAP, provided that the supplier or principle contractor has been approved as a supplier in accordance with the QAPD. Periodic audits and assessments of supplier QA programs are performed to assure compliance with the supplier's or principle contractor's QAPD and implementing procedures. In addition, routine interfaces with the supplier's personnel provide added assurance that quality expectations are met.

For the COL applications, the QAPD applies to those STP 3&4 and STPNOC activities that can affect either directly or indirectly the safety-related site characteristics or analysis of those characteristics. In addition, the QAPD applies to engineering activities that are used to characterize the site or analyze that characterization.

New nuclear plant construction will be the responsibility of STPNOC's STP 3&4 Engineering & Construction organization. Detailed engineering specifications and construction procedures will be developed to implement the QAPD and EPC QA programs prior to commencement of construction (COL) activities.

In general, the program requirements specified herein are detailed in implementing procedures

## STP 3&4

# Quality Assurance Program Description

---

that are either STPNOC implementing procedures, or supplier implementing procedures governed by a supplier quality assurance program.

A grace period of 90 days may be applied to provisions that are required to be performed on a periodic basis, unless otherwise noted. Annual evaluations and audits that must be performed on a triennial basis are examples where the 90 day general period could be applied. The grace period does not allow the "clock" for a particular activity to be reset forward. The "clock" for an activity is reset backwards by performing the activity early. Audits schedules are based on the month in which the audit starts.

### 2.1 Responsibilities

Personnel who work directly or indirectly for STPNOC are responsible for achieving acceptable quality in the work covered by the QAPD. This includes the activities delineated in Part I, Section 1.1. STPNOC personnel performing verification activities are responsible for verifying the achievement of acceptable quality. Activities governed by the QAPD are performed as directed by documented instructions, procedures and drawings that are of a detail appropriate for the activity's complexity and effect on safety. Instructions, procedures and drawings specify quantitative or qualitative acceptance criteria as applicable or appropriate for the activity, and verification is against these criteria. Provisions are established to designate or identify the proper documents to be used in an activity, and to ascertain that such documents are being used. The Quality Manager is responsible to verify that processes and procedures comply with QAPD and other applicable requirements, that such processes or procedures are implemented, and that management appropriately ensures compliance.

### 2.2 Delegation of Work

STPNOC retains and exercises the responsibility for the scope and implementation of an effective QAP. Positions identified in Part II, Section 1, may delegate all or part of the activities of planning, establishing, and implementing the program for which they are responsible to others, but retain the responsibility for the program's effectiveness. Decisions affecting safety are made at the level appropriate for its nature and effect, and with any necessary technical advice or review.

### 2.3 Site-specific Safety-Related Design Basis Activities

Site-specific safety-related design basis activities are defined as those activities, including sampling, testing, data collection, and supporting engineering calculations and reports, that will be used to determine the bounding physical parameters of the site. Appropriate quality assurance measures are applied.

### 2.4 Periodic Review of the Quality Assurance Program

Management of those organizations implementing the QA program, or portions thereof, assess the adequacy of that part of the program for which they are responsible to assure its effective implementation at least once each year or at least once during the life of the activity, whichever is shorter. However, the period for assessing QA programs during the operations phase may be extended to once every two years.

## STP 3&4 Quality Assurance Program Description

---

### 2.5 Issuance and Revision to Quality Assurance Program

Administrative control of the QAPD will be in accordance with 10 CFR 50.55(f) and 10 CFR 50.54(a). Changes to the QAPD are evaluated by the Quality Manager to ensure that such changes do not degrade previously approved quality assurance controls specified in the QAPD. This document shall be revised as appropriate to incorporate additional QA commitments that may be established during the COL application development process. New revisions to the document will be reviewed, at a minimum, by the Quality Manager and approved by the Senior Vice President, Units 3 & 4 (during construction) or the General Manager, Oversight and Regulatory Affairs (during operations).

Regulations require that the Final Safety Analysis Report (FSAR) include, among other things, the managerial and administrative controls to be used to assure safe operation, including a discussion of how the applicable requirements of Appendix B will be satisfied. In order to comply with this requirement, the FSAR references the QAPD and, as a result, the requirements of 10 CFR 50.54(a) are satisfied by and apply to the QAPD.

### 2.6 Personnel Qualifications

Personnel assigned to implement elements of the QAPD shall be capable of performing their assigned tasks. To this end, STPNOC establishes and maintains formal indoctrination and training programs for personnel performing, verifying, or managing activities within the scope of the QAPD to assure that suitable proficiency is achieved and maintained. Plant and support staff minimum qualification requirements are as delineated in the unit Technical Specifications. Other qualification requirements may be established but will not reduce those required by Technical Specifications. Sufficient managerial depth is provided to cover absences of incumbents. When required by code, regulation, or standard, specific qualification and selection of personnel is conducted in accordance with those requirements as established in the applicable STPNOC procedures. Indoctrination includes the administrative and technical objectives, requirements of the applicable codes and standards, and the QAPD elements to be employed. Training for positions identified in 10 CFR 50.120 is accomplished according to programs accredited by the National Nuclear Accrediting Board of the National Academy of Nuclear Training that implement a systematic approach to training. Records of personnel training and qualification are maintained.

The minimum qualifications of the Quality Manager are that he/she holds an engineering or related science degree and a minimum of four years of related experience including two years of nuclear power plant experience, one year of supervisory or management experience, and one year of the experience is in performing quality verification activities. Special requirements shall include management and supervisory skills and experience or training in leadership, interpersonal communication, management responsibilities, motivation of personnel, problem analysis and decision making, and administrative policies and procedures. Individuals who do not possess these formal education and minimum experience requirements should not be eliminated automatically when other factors provide sufficient demonstration of their abilities. These other factors are evaluated on a case-by-case basis and approved and documented by senior management.

The minimum qualifications of the individuals responsible for planning, implementing, and maintaining the programs for the QAPD are that each has a high school diploma or equivalent and has a minimum of one year of related experience. Individuals who do not possess these

formal education and minimum experience requirements should not be eliminated automatically when other factors provide sufficient demonstration of their abilities. These other factors are evaluated on a case-by-case basis and approved and documented by senior management.

## **2.7 NQA-1-1994 Commitment / Exceptions**

In establishing qualification and training programs, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 2 and Supplements 2S-1, 2S-2, 2S-3 and 2S-4, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 2S-1
  - Supplement 2S-1 will include use of the guidance provided in Appendix 2A-1 the same as if it were part of the Supplement.
- NQA-1-1994, Supplement 2S-2
  - In lieu of Supplement 2S-2, for qualification of nondestructive examination personnel, STPNOC will follow the applicable standard cited in the version(s) of Section III and Section XI of the ASME Boiler and Pressure Vessel Code approved by the NRC for use at STPNOC sites.
- NQA-1-1994, Supplement 2S-3
  - The requirement that prospective Lead Auditors have participated in a minimum of five (5) audits in the previous three (3) years is replaced by the following, "The prospective lead auditor shall demonstrate his/her ability to properly implement the audit process, as implemented by STPNOC, to effectively lead an audit team, and to effectively organize and report results, including participation in at least one nuclear audit within the year preceding the date of qualification."

## **SECTION 3      DESIGN CONTROL**

STPNOC has established and implements a process to control the design, design changes, and temporary modifications (e.g., temporary bypass lines, electrical jumpers and lifted wires, and temporary setpoints) of items that are subject to the provisions of the QAPD. The design process includes provisions to control design inputs, outputs, changes, interfaces, records, and organizational interfaces within STPNOC and with suppliers. These provisions assure that design inputs (such as design bases and the performance, regulatory, quality, and quality verification requirements) are correctly translated into design outputs (such as analyses, specifications, drawings, procedures, and instructions) so that the final design output can be related to the design input in sufficient detail to permit verification. Design change processes and the division of responsibilities for design-related activities are detailed in STPNOC and supplier procedures. The design control program includes interface controls necessary to control the development, verification, approval, release, status, distribution, and revision of design inputs and outputs. Design changes and disposition of nonconforming items as "use as is" or "repair" are reviewed and approved by the STPNOC design organization or by other organizations so authorized by STPNOC.

Design documents are reviewed by individuals knowledgeable in QA to ensure the documents contain the necessary QA requirements.

### **3.1      Design Verification**

STPNOC design processes provide for design verification to ensure that items and activities subject to the provisions of the QAPD are suitable for their intended application, consistent with their effect on safety. Design changes are subjected to these controls, which include verification measures commensurate with those applied to original plant design.

Design verifications are performed by competent individuals or groups other than those who performed the original design but who may be from the same organization. The verifier shall not have taken part in the selection of design inputs, the selection of design considerations, or the selection of a singular design approach, as applicable. This verification may be performed by the originator's supervisor provided the supervisor did not specify a singular design approach, rule out certain design considerations, and did not establish the design inputs used in the design, or if the supervisor is the only individual in the organization competent to perform the verification. If the verification is performed by the originator's supervisor, the justification of the need is documented and approved in advance by management.

The extent of the design verification required is a function of the importance to safety of the item under consideration, the complexity of the design, the degree of standardization, the state-of-the-art, and the similarity with previously proven designs. This includes design inputs, design outputs, and design changes. Design verification procedures are established and implemented to assure that an appropriate verification method is used, the appropriate design parameters to be verified are chosen, the acceptance criteria are identified, and the verification is satisfactorily accomplished and documented. Verification methods may include, but are not limited to, design reviews, alternative calculations and qualification testing. Testing used to verify the acceptability of a specific design feature demonstrates acceptable performance under conditions that simulate the most adverse design conditions expected for item's intended use.



## STP 3&4

### Quality Assurance Program Description

---

STPNOC normally completes design verification activities before the design outputs are used by other organizations for design work, and before they are used to support other activities such as procurement, manufacture, or construction. When such timing cannot be achieved, the design verification is completed before relying on the item to perform its intended design or safety function.

#### 3.2 Design Records

STPNOC maintains records sufficient to provide evidence that the design was properly accomplished. These records include the final design output and any revisions thereto, as well as record of the important design steps (e.g., calculations, analyses and computer programs) and the sources of input that support the final output.

Plant design drawings reflect the properly reviewed and approved configuration of the plant.

#### 3.3 Computer Application and Digital Equipment Software

The QAPD governs the development, procurement, testing, maintenance, and use of computer application and digital equipment software when used in safety-related applications and designated nonsafety-related applications. STPNOC and suppliers are responsible for developing, approving, and issuing procedures, as necessary, to control the use of such computer application and digital equipment software. The procedures require that the application software be assigned a proper quality classification and that the associated quality requirements be consistent with this classification. Each application software and revision thereto is documented and approved by authorized personnel. The QAPD is also applicable to the administrative functions associated with the maintenance and security of computer hardware where such functions are considered essential in order to comply with other QAPD requirements such as QA records.

#### 3.4 Setpoint Control

Instrument and equipment setpoints that could affect nuclear safety shall be controlled in accordance with written instructions. As a minimum, these written instructions shall:

- (1) Identify responsibilities and processes for reviewing, approving, and revising setpoints and setpoint changes originally supplied by the EPC, the A/E, and the plant's technical staff.
- (2) Ensure that setpoints and setpoint changes are consistent with design and accident analysis requirements and assumptions.
- (3) Provide for documentation of setpoints, including those determined operationally.
- (4) Provide for access to necessary setpoint information for personnel who write or revise plant procedures, operate or maintain plant equipment, develop or revise design documents, or develop or revise accident analyses.

#### 3.5 NQA-1-1994 Commitment

In establishing its program for design control and verification, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 3, and Supplement 3S-1, the subsurface investigation requirements in Subpart 2.20 and the standards for computer software in Subpart 2.7.

## **SECTION 4      PROCUREMENT DOCUMENT CONTROL**

STPNOC has established the necessary measures and governing procedures to assure that purchased items and services are subject to appropriate quality and technical requirements. Procurement document changes shall be subject to the same degree of control as utilized in the preparation of the original documents. These controls include provisions such that:

- Where original technical or quality assurance requirements cannot be determined, an engineering evaluation is conducted and documented by qualified staff to establish appropriate requirements and controls to assure that interfaces, interchangeability, safety, fit and function, as applicable, are not adversely affected or contrary to applicable regulatory requirements.
- Applicable technical, regulatory, administrative, quality and reporting requirements (such as specifications, codes, standards, tests, inspections, special processes, and 10 CFR 21) are invoked for procurement of items and services. 10 CFR 21 requirements for posting, evaluating, and reporting will be followed and imposed on suppliers when applicable. Applicable design bases and other requirements necessary to assure adequate quality shall be included or referenced in documents for procurement of items and services. To the extent necessary, procurement documents shall require suppliers to have a documented QA program that is determined to meet the applicable requirements of 10 CFR 50, Appendix B, as appropriate to the circumstances of procurements (or the supplier may work under STPNOC's approved QA program).

Reviews of procurement documents shall be performed by personnel who have access to pertinent information and who have an adequate understanding of the requirements and intent of the procurement documents.

### **4.1      NQA-1-1994 Commitment / Exceptions**

In establishing controls for procurement, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 4 and Supplement 4S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 4S-1
  - Section 2.3 of this Supplement 4S-1 includes a requirement that procurement documents require suppliers to have a documented QAP that implements NQA-1-1994, Part 1. In lieu of this requirement, STPNOC may require suppliers to have a documented supplier QAP that is determined to meet the applicable requirements of 10 CFR 50, Appendix B, as appropriate to the circumstances of the procurement.
  - With regard to service performed by a supplier, STPNOC procurement documents may allow the supplier to work under the STPNOC QAP, including implementing procedures, in lieu of the supplier having its own QAP.
  - Section 3 of this supplement 4S-1 requires procurement documents to be reviewed prior to bid or award of contract. The quality assurance review of procurement documents is satisfied through review of the applicable

## STP 3&4 Quality Assurance Program Description

---

procurement specification, including the technical and quality procurement requirements, prior to bid or award of contract. Procurement document changes (e.g., scope, technical or quality requirements) will also receive the quality assurance review.

- Procurement documents for Commercial Grade Items that will be procured by STPNOC for use as safety-related items shall contain technical and quality requirements such that the procured item can be appropriately dedicated.

## **SECTION 5 INSTRUCTIONS, PROCEDURES, AND DRAWINGS**

STPNOC has established the necessary measures and governing procedures to ensure that activities affecting quality are prescribed by and performed in accordance with instructions, procedures or drawings of a type appropriate to the circumstances and which, where applicable, include quantitative or qualitative acceptance criteria to implement the QAPD as described in the QAPD. Such documents are prepared and controlled according to Part II, Section 6. In addition, means are provided to disseminate to the staff instructions of both general and continuing applicability, as well as those of short-term applicability. Provisions are included for reviewing, updating, and canceling such procedures.

### **5.1 Procedure Adherence**

STPNOC's policy is that procedures are followed, and the requirements for use of procedures have been established in administrative procedures. Where procedures cannot be followed as written, provisions are established for making changes in accordance with Part II, Section 6. Requirements are established to identify the manner in which procedures are to be implemented, including identification of those tasks that require: (1) the written procedure to be present and followed step-by-step while the task is being performed, (2) the user to have committed the procedure steps to memory, (3) verification of completion of significant steps, by initials or signatures or use of check-off lists. Procedures that are required to be present and referred to directly are those developed for extensive or complex jobs where reliance on memory cannot be trusted, tasks that are infrequently performed, and tasks where steps must be performed in a specified sequence.

In cases of emergency, personnel are authorized to depart from approved procedures when necessary to prevent injury to personnel or damage to the plant. Such departures are recorded describing the prevailing conditions and reasons for the action taken.

### **5.2 Procedure Content**

The established measures address the applicable content of procedures as described in the introduction to Part II of NQA-1-1994. In addition, procedures governing tests, inspections, operational activities and maintenance will include as applicable, initial conditions and prerequisites for the performance of the activity.

### **5.3 NQA-1-1994 Commitment**

In establishing procedural controls, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 5.

## **SECTION 6 DOCUMENT CONTROL**

STPNOC has established the necessary measures and governing procedures to control the preparation of, issuance of, and changes to documents that specify quality requirements or prescribe how activities affecting quality, including organizational interfaces, are controlled to assure that correct documents are being employed. The control systems (including electronic systems used to make documents available) are documented and provide for the following:

- (a) identification of documents to be controlled and their specified distribution;
- (b) a method to identify the correct document (including revision) to be used and control of superseded documents;
- (c) identification of assignment of responsibility for preparing, reviewing, approving, and issuing documents;
- (d) review of documents for adequacy, completeness, and correctness prior to approval and issuance;
- (e) a method for providing feedback from users to continually improve procedures and work instructions; and
- (f) coordinating and controlling interface documents and procedures.

The types of documents to be controlled include:

- (a) drawings such as design, construction, installation, and as-built drawings;
- (b) engineering calculations;
- (c) design specifications;
- (d) purchase orders and related documents;
- (e) vendor-supplied documents;
- (f) audit, surveillance, and quality verification/inspection procedures;
- (g) inspection and test reports;
- (h) Instructions and procedures for activities covered by the QAPD including design, construction, installation, operating (including normal and emergency operations), maintenance, calibration, and routine testing;
- (i) technical specifications; and
- (j) nonconformance reports and corrective action reports

During the operational phase, where temporary procedures are used, they shall include a designation of the period of time during which it is acceptable to use them.

### **6.1 Review and Approval of Documents**

Documents are reviewed for adequacy by qualified persons other than the preparer. During the construction phase, procedures for design, construction, and installation are also reviewed by STP 3&4 Quality to ensure quality assurance measures have been appropriately applied. The documented review signifies concurrence.

## STP 3&4 Quality Assurance Program Description

---

During the operations phase, documents affecting the configuration or operation of the station as described in the SAR are screened to identify those that require review by the IRB prior to implementation as described in Part II, Section 2.

To ensure effective and accurate procedures during the operational phase, applicable procedures are reviewed, and updated as necessary, based on the following conditions:

- (a) following any modification to a system;
- (b) following an unusual incident, such as an accident, significant operator error, or equipment malfunction;
- (c) when procedure discrepancies are found;
- (d) prior to use if not used in the previous two years; or
- (e) results of QA audits conducted in accordance with Part II, Section 18.1.

Prior to issuance or use, documents including revisions thereto, are approved by the designated authority. A listing of all controlled documents identifying the current approved revision, or date, is maintained so personnel can readily determine the appropriate document for use.

### 6.2 Changes to Documents

Changes to documents, other than those defined in implementing procedures as minor changes, are reviewed and approved by the same organizations that performed the original review and approval unless other organizations are specifically designated. The reviewing organization has access to pertinent background data or information upon which to base their approval. Where temporary procedure changes are necessary during the operations phase, changes that clearly do not change the intent of the approved procedure may be implemented provided they are approved by two members of the staff knowledgeable in the areas affected by the procedures. Minor changes to documents, such as inconsequential editorial corrections, do not require that the revised documents receive the same review and approval as the original documents. To avoid a possible omission of a required review, the type of minor changes that do not require such a review and approval and the persons who can authorize such a classification shall be clearly delineated in implementing procedures.

### 6.3 NQA-1-1994 Commitment

In establishing provisions for document control, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 6 and Supplement 6S-1.

## **SECTION 7 CONTROL OF PURCHASED MATERIAL, EQUIPMENT, AND SERVICES**

STPNOC has established the necessary measures and governing procedures to control the procurement of items and services to assure conformance with specified requirements. Such control provides for the following as appropriate: source evaluation and selection, evaluation of objective evidence of quality furnished by the supplier, source inspection, audit, and examination of items or services.

### **7.1 Acceptance of Item or Service**

STPNOC establishes and implements measures to assess the quality of purchased items and services, whether purchased directly or through contractors, at intervals and to a depth consistent with the item's or service's importance to safety, complexity, quantity, and the frequency of procurement. Verification actions include testing, as appropriate, during design, fabrication, construction, and operation activities. Verifications occur at the appropriate phases of the procurement process, including, as necessary, verification of activities of suppliers below the first tier.

Measures to assure the quality of purchased items and services include the following, as applicable:

- Items are inspected, identified, and stored to protect against damage, deterioration, or misuse.
- Prospective suppliers of safety-related items and services are evaluated to assure that only qualified suppliers are used. Qualified suppliers are audited on a triennial basis. In addition, if a subsequent contract or a contract modification significantly enlarges the scope of, or changes the methods or controls for, activities performed by the same supplier, an audit of the modified requirements is conducted, thus starting a new triennial period. STPNOC may utilize audits conducted by outside organizations for supplier qualification provided that the scope and adequacy of the audits meet STPNOC requirements. Documented annual evaluations are performed for qualified suppliers to assure they continue to provide acceptable products and services. Industry programs, such as those applied by ASME, Nuclear Procurement Issues Committee (NUPIC), or other established utility groups, are used as input or the basis for supplier qualification whenever appropriate. The results of the reviews are promptly considered for effect on a supplier's continued qualification and adjustments made as necessary (including corrective actions, adjustments of supplier audit plans, and input to third party auditing entities, as warranted). In addition, results are reviewed periodically to determine if, as a whole, they constitute a significant condition adverse to quality requiring additional action.
- Provisions are made for accepting purchased items and services, such as source verification, receipt inspection, pre- and post-installation tests, certificates of conformance, and document reviews (including Certified Material Test Report/Certificate). Acceptance actions/documents should be established by the Purchaser with appropriate input from the Supplier and be completed to ensure that procurement, inspection, and test requirements, as applicable, have been satisfied before

## STP 3&4 Quality Assurance Program Description

---

relying on the item to perform its intended safety function.

- Controls are imposed for the selection, determination of suitability for intended use (critical characteristics), evaluation, receipt and acceptance of commercial-grade services or items to assure they will perform satisfactorily in service in safety-related applications.
- If there is insufficient evidence of implementation of a QA program, the initial evaluation is of the existence of a QA program addressing the scope of services to be provided. The initial audit is performed after the supplier has completed sufficient work to demonstrate that its organization is implementing a QA program.

### 7.2 NQA-1-1994 Commitment / Exceptions

In establishing procurement verification controls, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 7 and Supplement 7S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 7S-1
  - STPNOC considers that other 10 CFR 50 licensees, Authorized Nuclear Inspection Agencies, National Institute of Standards and Technology, or other State and Federal agencies which may provide items or services to STPNOC plants are not required to be evaluated or audited.
  - When purchasing commercial grade calibration services from a calibration laboratory, procurement source evaluation and selection measures need not be performed provided each of the following conditions are met:
    - (1) The purchase documents impose any additional technical and administrative requirements, as necessary, to comply with the STPNOC QA program and technical provisions. At a minimum, the purchase document shall require that the calibration certificate/report include identification of the laboratory equipment/standard used.
    - (2) The purchase documents require reporting as-found calibration data when calibrated items are found to be out-of-tolerance.
    - (3) A documented review of the supplier's accreditation will be performed and will include a verification of the following:
      - The calibration laboratory holds a domestic (United States) accreditation by any one of the following accrediting bodies, which are recognized by the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Arrangement (MRA):
        - National Voluntary Laboratory Accreditation Program (NVLAP), administered by the National Institute of Standards & Technology;
        - American Association for Laboratory Accreditation (A2LA);



## Quality Assurance Program Description

---

- ACLASS Accreditation Services (ACLASS);
  - International Accreditation Service (IAS);
  - Laboratory Accreditation Bureau (L-A-B);
  - Other NRC-approved laboratory accrediting body.
- The accreditation encompasses ANS/ISO/IEC 17025, "General Requirements for the Competence of Testing and Calibration Laboratories."
  - The published scope of accreditation for the calibration laboratory covers the necessary measurement parameters, range, and uncertainties.
- For Section 8.1, STPNOC considers documents that may be stored in approved electronic media under STPNOC or vendor control, not physically located on the plant site, but are accessible from the respective nuclear facility site as meeting the NQA-1 requirement for documents to be available at the site. Following completion of the construction period, sufficient as-built documentation will be turned over to STPNOC to support operations. The STPNOC records management system will provide for timely retrieval of necessary records.
  - In lieu of the requirements of Section 10, Commercial Grade Items, controls for commercial grade items and services are established in STPNOC documents using 10 CFR 21 and the guidance of EPRI NP-5652 as discussed in Generic Letter 89-02 and Generic Letter 91-05.
    - For commercial grade items, special quality verification requirements are established and described in STPNOC documents to provide the necessary assurance an item will perform satisfactorily in service. The STPNOC documents address determining the critical characteristics that ensure an item is suitable for its intended use, technical evaluation of the item, receipt requirements, and quality evaluation of the item.
    - STPNOC will also use other appropriate approved regulatory means and controls to support STPNOC commercial grade dedication activities. STPNOC will assume 10 CFR 21 reporting responsibility for all items that STPNOC dedicates as safety-related.

## **SECTION 8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS, AND COMPONENTS**

STPNOC has established the necessary measures and governing procedures to identify and control items to prevent the use of incorrect or defective items. This includes controls for consumable materials and items with limited shelf life. The identification of items is maintained throughout fabrication, erection, installation and use so that the item can be traced to its documentation, consistent with the item's effect on safety. Identification locations and methods are selected so as not to affect the function or quality of the item.

### **8.1 NQA-1-1994 Commitment**

In establishing provisions for identification and control of items, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 8 and Supplement 8S-1.

## **SECTION 9 CONTROL OF SPECIAL PROCESSES**

STPNOC has established the necessary measures and governing procedures to assure that special processes that require interim process controls to assure quality, such as welding, heat treating, and nondestructive examination, are controlled. These provisions include assuring that special processes are accomplished by qualified personnel using qualified procedures and equipment. Personnel are qualified and special processes are performed in accordance with applicable codes, standards, specifications, criteria or other specially established requirements. Special processes are those where the results are highly dependent on the control of the process or the skill of the operator, or both, and for which the specified quality cannot be fully and readily determined by inspection or test of the final product.

### **9.1 NQA-1-1994 Commitment**

In establishing measures for the control of special processes, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 9 and Supplement 9S-1.

## **SECTION 10 INSPECTION**

STPNOC has established the necessary measures and governing procedures to implement inspections that assure items, services, and activities affecting safety meet established requirements and conform to applicable documented specifications, instructions, procedures, and design documents. Inspection may also be applied to items, services, and activities affecting plant reliability and integrity. Types of inspections may include those verifications related to procurement, such as source, in-process, final, and receipt inspection, as well as construction, installation, maintenance, modification, inservice, and operations activities. Inspections are carried out by properly qualified persons independent of those who performed or directly supervised the work. Inspection results are documented.

### **10.1 Inspection Program**

The inspection program establishes inspections (including surveillance of processes), as necessary to verify quality: (1) at the source of supplied items or services, (2) in-process during fabrication at a supplier's facility or at a Company facility, (3) for final acceptance of fabricated and/or installed items during construction, (4) upon receipt of items for a facility, as well as (5) during maintenance, modification, in-service, and operating activities.

The inspection program establishes requirements for planning inspections, such as the group or discipline responsible for performing the inspection, where inspection hold points are to be applied, determining applicable acceptance criteria, the frequency of inspection to be applied, and identification of special tools needed to perform the inspection. Inspection planning is performed by personnel qualified in the discipline related to the inspection and includes qualified inspectors or engineers. Inspection plans are based on, as a minimum, the importance of the item to the safety of the facility, the complexity of the item, technical requirements to be met, and design specifications. Where significant changes in inspection activities for the facilities are to occur, management responsible for the inspection programs evaluate the resource and planning requirements to ensure effective implementation of the inspection program.

Inspection program documents establish requirements for performing the planned inspections, and documenting required inspection information such as rejection, acceptance, and re-inspection results, and the person(s) performing the inspection.

Inspection results are documented by the inspector, reviewed by authorized personnel qualified to evaluate the technical adequacy of the inspection results, and controlled by instructions, procedures, and drawings.

### **10.2 Inspector Qualification**

STPNOC has established qualification programs for personnel performing quality inspections. The qualification program requirements are described in Part II, Section 2. These qualification programs are applied to individuals performing quality inspections regardless of the functional group where they are assigned.

### **10.3 NQA-1-1994 Commitment / Exceptions**

In establishing inspection requirements, STPNOC commits to compliance with

## STP 3&4 Quality Assurance Program Description

---

NQA-1-1994, Basic Requirement 10, Supplement 10S-1 and Subpart 2.4, with the following clarification. In addition, STPNOC commits to compliance with the requirements of Subparts 2.5 and 2.8 for establishing appropriate inspection requirements.

- Subpart 2.4 commits STPNOC to IEEE 336-1985. IEEE 336-1985 refers to IEEE 498-1985. Both IEEE 336 -1985 and IEEE 498-1985 use the definition of "Safety Systems" from IEEE 603-1980. STPNOC commits to the definition of Safety Systems in IEEE 603- 1980, but does not commit to the balance of that standard. This definition is only applicable to equipment in the context of Subpart 2.4.
- An additional exception to Subpart 2.4 is addressed in Part II, Section 12 of the QAPD.

## **SECTION 11 TEST CONTROL**

STPNOC has established the necessary measures and governing procedures to demonstrate that items subject to the provisions of the QAPD will perform satisfactorily in service, that the plant can be operated safely and as designed, and that the coordinated operation of the plant as a whole is satisfactory. These programs include criteria for determining when testing is required, such as proof tests before installation, pre-operational tests, post-maintenance tests, post-modification tests, in-service tests, and operational tests (such as surveillance tests required by Plant Technical Specifications), to demonstrate that performance of plant systems is in accordance with design. Programs also include provisions to establish and adjust test schedules, and to maintain status for periodic or recurring tests. Tests are performed according to applicable procedures that include, consistent with the effect on safety: (1) instructions and prerequisites to perform the test, (2) use of proper test equipment, (3) acceptance criteria, and (4) mandatory verification points as necessary to confirm satisfactory test completion. Test results are documented and evaluated by the organization performing the test and reviewed by a responsible authority to assure that the test requirements have been satisfied. If acceptance criteria are not met, re-testing is performed as needed to confirm acceptability following correction of the system or equipment deficiencies that caused the failure.

The initial start-up test program is planned and scheduled to permit safe fuel loading and start-up; to increase power in safe increments; and to perform major testing at specified power levels. If tests require the variation of operating parameters outside of their normal range, the limits within which such variation is permitted will be prescribed. The scope of the testing demonstrates, insofar as practicable, that the plant is capable of withstanding the design transients and accidents. For new facility construction, the suitability of facility operating procedures is checked to the maximum extent possible during the pre-operational and initial start-up test programs.

Tests are performed and results documented in accordance with applicable technical and regulatory requirements, including those described in the Technical Specifications and SAR. Test programs ensure appropriate retention of test data in accordance with the records requirements of the QAPD. Personnel that perform or evaluate tests are qualified in accordance with the requirements established in Part II, Section 2.

### **11.1 NQA-1-1994 Commitment**

In establishing provisions for testing, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 11 and Supplement 11S-1.

### **11.2 NQA-1-1994 Commitment for Computer Program Testing**

STPNOC establishes and implements provisions to assure that computer software used in applications affecting safety is prepared, documented, verified and tested, and used such that the expected output is obtained and configuration control maintained. To this end STPNOC commits to compliance with the requirements of NQA-1-1994, Supplement 11S-2, and Subpart 2.7 to establish the appropriate provisions.

## **SECTION 12 CONTROL OF MEASURING AND TEST EQUIPMENT**

STPNOC has established the necessary measures and governing procedures to control the calibration, maintenance, and use of measuring and test equipment (M&TE) that provides information important to safe plant operation. The provisions of such procedures cover equipment such as indicating and actuating instruments and gages, tools, reference and transfer standards, and nondestructive examination equipment. The suppliers of commercial-grade calibration services are controlled as described in Part II, Section 7.

### **12.1 Installed Instrument and Control Devices**

For the operations phase of the facilities, STPNOC has established and implements procedures for the calibration and adjustment of instrument and control devices installed in the facility. The calibration and adjustment of these devices is accomplished through the facility maintenance programs to ensure the facility is operated within design and technical requirements. Appropriate documentation will be maintained for these devices to indicate the control status, when the next calibration is due, and identify any limitations on use of the device.

### **12.2 NQA-1-1994 Commitment / Exceptions**

In establishing provisions for control of measuring and test equipment, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 12 and Supplement 12S-1 with the following clarification and exception:

- The out of calibration conditions described in paragraph 3.2 of Supplement 12S-1 refers to when the M&TE is found out of the required accuracy limits (i.e., out of tolerance) during calibration.
- Measuring and test equipment are not required to be marked with the calibration status where it is impossible or impractical due to equipment size or configuration (such as the label will interfere with operation of the device) provided the required information is maintained in suitable documentation traceable to the device. This exception also applies to the calibration labeling requirement stated in NQA-1-1994, Subpart 2.4, Section 7.2.1 (ANSI/IEEE Std. 336-1985).

## **SECTION 13 HANDLING, STORAGE, AND SHIPPING**

STPNOC has established the necessary measures and governing procedures to control the handling, storage, packaging, shipping, cleaning, and preservation of items to prevent inadvertent damage or loss, and to minimize deterioration. These provisions include specific procedures, when required to maintain acceptable quality of the items important to the safe operations of the plant. Items are appropriately marked and labeled during packaging, shipping, handling and storage to identify, maintain, and preserve the item's integrity and indicate the need for special controls. Special controls (such as containers, shock absorbers, accelerometers, inert gas atmospheres, specific moisture content levels and temperature levels) are provided when required to maintain acceptable quality.

Special or additional handling, storage, shipping, cleaning and preservation requirements are identified and implemented as specified in procurement documents and applicable procedures. Where special requirements are specified, the items and containers (where used) are suitably marked.

Special handling tools and equipment are used and controlled as necessary to ensure safe and adequate handling. Special handling tools and equipment are inspected and tested at specified time intervals and in accordance with procedures to verify that the tools and equipment are adequately maintained.

Operators of special handling and lifting equipment are experienced or trained in the use the equipment. During the operational phase, STPNOC establishes and implements controls over hoisting, rigging and transport activities to the extent necessary to protect the integrity of the items involved, as well as potentially affected nearby structures and components. Where required, STPNOC complies with applicable hoisting, rigging and transportation regulations and codes.

### **13.1 Housekeeping**

Housekeeping practices are established to account for conditions or environments that could affect the quality of structures, systems and components within the plant. This includes control of cleanliness of facilities and materials, fire prevention and protection, disposal of combustible material and debris, control of access to work areas, protection of equipment, radioactive contamination control and storage of solid radioactive waste. Housekeeping practices help assure that only proper materials, equipment, processes and procedures are used and that the quality of items is not degraded. Necessary procedures or work instructions, such as for electrical bus and control center cleaning, cleaning of control consoles, and radioactive decontamination are developed and used.

### **13.2 NQA-1-1994 Commitment / Exceptions**

In establishing provisions for handling, storage and shipping, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 13 and Supplement 13S-1. STPNOC also commits, during the construction and operational phase of the plant, to compliance with the requirements of NQA-1-1994, Subpart 2.1, Subpart 2.2, Subpart 2.3, and Subpart 3.2, Appendix 2.1, with the following clarifications and exceptions:



## Quality Assurance Program Description

---

### NQA-1-1994, Subpart 2.1

- Subpart 2.1, Section 3.1 and 3.2 establish criteria for classifying items into cleanliness classes and requirements for each class. Instead of using the cleanliness level system of Subpart 2.1, during the operations phase STPNOC establishes cleanliness requirements on a case-by-case basis, consistent with the other provisions of Subpart 2.1. STPNOC establishes appropriate cleanliness controls for work on safety-related equipment to minimize introduction of foreign material and maintain system/component cleanliness throughout maintenance or modification activities, including documented verification of absence of foreign material prior to system closure.

### NQA-1-1994, Subpart 2.2

- Subpart 2.2, Section 2.2 establishes criteria for classifying items into protection levels. Instead of classifying items into protection levels during the operational phase, STPNOC establishes controls for the packaging, shipping, handling, and storage of such items on a case-by-case basis with due regard for the item's complexity, use, and sensitivity to damage. Prior to installation or use, the items are inspected and serviced as necessary to assure that no damage or deterioration exists which could affect their function.
- Subpart 2.2, Section 6.6, "Storage Records:" This section requires written records be prepared containing information on personnel access. As an alternative to this requirement, STPNOC documents establish controls for storage areas that describe those authorized to access areas and the requirements for recording access of personnel. However, these records of access are not considered quality records and will be retained in accordance with the administrative controls of the applicable plant.
- Subpart 2.2, Section 7.1 refers to Subpart 2.15 for requirements related to handling of items. The scope of Subpart 2.15 includes hoisting, rigging and transporting of items for the nuclear power plants during construction.

### NQA-1-1994, Subpart 2.3

- Subpart 2.3, Section 2.3 requires the establishment of five zone designations for housekeeping cleanliness controls. Instead of the five-level zone designation, STPNOC bases its control over housekeeping activities during the operations phase on a consideration of what is necessary and appropriate for the activity involved. The controls are implemented through procedures or instructions which, in the case of maintenance or modification work, are developed on a case-by-case basis. Factors considered in developing the procedures and instructions include cleanliness control, personnel safety, fire prevention and protection, radiation control and security. The procedures and instructions make use of standard janitorial and work practices to the extent possible.

### NQA-1-1994, Subpart 3.2

- Subpart 3.2, Appendix 2.1: Only Section 3 precautions are being committed to in accordance with RG 1.37. In addition, a suitable chloride stress-cracking inhibitor should be added to the fresh water used to flush systems containing austenitic stainless steels.

**STP 3&4**  
**Quality Assurance Program Description**

---

- The water quality for final flushes of fluid systems and associated components shall be at least equivalent to the quality of the operating system water.

## **SECTION 14 INSPECTION, TEST, AND OPERATING STATUS**

STPNOC has established the necessary measures and governing procedures to identify the inspection, test, and operating status of items and components subject to the provisions of the QAPD in order to maintain personnel and reactor safety and avoid inadvertent operation of equipment. Where necessary to preclude inadvertent bypassing of inspections or tests, or to preclude inadvertent operation, these measures require the inspection, test or operating status be verified before release, fabrication, receipt, installation, test or use. These measures also establish the necessary authorities and controls for the application and removal of status indicators or labels.

In addition, temporary design changes (temporary modifications), such as temporary bypass lines, electrical jumpers and lifted wires, and temporary trip-point settings, are controlled by procedures that include requirements for appropriate installation and removal, independent/concurrent verifications and status tracking.

Administrative procedures also describe the measures taken to control altering the sequence of required tests, inspections, and other operations. Review and approval for these actions is subject to the same control as taken during the original review and approval of tests, inspections, and other operations.

### **14.1 NQA-1-1994 Commitment**

In establishing measures for control of inspection, test and operating status, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 14.

## **SECTION 15 NONCONFORMING MATERIALS, PARTS, OR COMPONENTS**

STPNOC has established the necessary measures and governing procedures to control items, including services that do not conform to specified requirements to prevent inadvertent installation or use. Instructions require that the individual discovering a nonconformance identify, describe, and document the nonconformance in accordance with the requirements of Part II, Section 16. Controls provide for identification, documentation, evaluation, segregation when practical, and disposition of nonconforming items, and for notification to affected organizations. Controls are provided to address conditional release of nonconforming items for use on an at-risk basis prior to resolution and disposition of the nonconformance, including maintaining identification of the item and documenting the basis for such release. Conditional release of nonconforming items for installation requires the approval of the designated management. Nonconformances are corrected or resolved prior to depending on the item to perform its intended safety function. Nonconformances are evaluated for impact on operability of quality structures, systems, and components to assure that the final condition does not adversely affect safety, operation, or maintenance of the item or service. Nonconformances to design requirements dispositioned repair or use-as-is are subject to design control measures commensurate with those applied to the original design. Nonconformance dispositions are reviewed for adequacy, analysis of quality trends, and reports provided to the designated management. Significant trends are reported to management in accordance with STPNOC procedures, regulatory requirements, and industry standards.

### **15.1 Interface with the Reporting Program**

STPNOC has appropriate interfaces between the QAP for identification and control of nonconforming materials, parts, or components and the non-QA Reporting Program to satisfy the requirements of 10 CFR 52, 10 CFR 50.55 and 10 CFR 21 during COL design and construction and 10 CFR 21 during operations.

### **15.2 NQA-1-1994 Commitment**

In establishing measures for nonconforming materials, parts, or components, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 15, and Supplement 15S-1.

## **SECTION 16 CORRECTIVE ACTION**

STPNOC has established the necessary measures and governing procedures to promptly identify, control, document, classify and correct conditions adverse to quality. STPNOC procedures assure that corrective actions are documented and initiated following the determination of conditions adverse to quality in accordance with regulatory requirements and applicable quality standards. STPNOC procedures require personnel to identify known conditions adverse to quality. When complex issues arise where it cannot be readily determined if a condition adverse to quality exists, STPNOC documents establish the requirements for documentation and timely evaluation of the issue. Reports of conditions adverse to quality are analyzed to identify trends. Significant conditions adverse to quality and significant adverse trends are documented and reported to responsible management. In the case of a significant condition adverse to quality, the cause is determined and actions to preclude recurrence are taken.

In the case of suppliers working on safety-related activities, or other similar situations, STPNOC may delegate specific responsibilities for corrective actions but STPNOC maintains responsibility for the effectiveness of corrective action measures.

### **16.1 Interface with the Reporting Program**

STPNOC has appropriate interfaces between the QAP for corrective actions and the non-QA Reporting Program to satisfy the requirements of 10 CFR 52, 10 CFR 50.55 and 10 CFR 21 during ESP/COL design and construction, and 10 CFR 21 during operations.

### **16.2 NQA-1-1994 Commitment**

In establishing provisions for corrective action, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 16.

## **SECTION 17 QUALITY ASSURANCE RECORDS**

STPNOC has the necessary measures and governing procedures to ensure that sufficient records of items and activities affecting quality are developed, reviewed, approved, issued, used, and revised to reflect completed work. The provisions of such procedures establish the scope of the records retention program for STPNOC and include requirements for records administration, including receipt, preservation, retention, storage, safekeeping, retrieval, access controls, user privileges, and final disposition.

### **17.1 Record Retention**

Measures are established that ensure that sufficient records of completed items and activities affecting quality are appropriately stored. Records of activities for design, engineering, procurement, manufacturing, construction, inspection and test, installation, pre-operation, startup, operations, maintenance, modification, decommissioning, and audits and their retention times are defined in appropriate procedures. The records and retention times comply with Regulatory Position C.2 and Table 1, of Regulatory Guide 1.28, Revision 3 for design, construction, and initial start-up. STPNOC commits to Regulatory Position C.2 and Table 1. Retention times for operations phase records are based on construction records that are similar in nature. In all cases where state, local, or other agencies have more restrictive requirements for record retention, those requirements will be met.

### **17.2 Electronic Records**

When using electronic records storage and retrieval systems, STPNOC complies with NRC guidance Generic Letter 88-18, "Plant Record Storage on Optical Disks." STPNOC will manage the storage of QA Records in electronic media consistent with the intent of RIS 2000-18 and associated NIRMA Guidelines TG 11-1998, TG15-1998, TG16-1998, and TG21-1998.

### **17.3 NQA-1-1994 Commitment / Exceptions**

In establishing provisions for records, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 17 and Supplement 17S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 17S-1
  - Supplement 17S-1, Section 4.2(b), requires records to be firmly attached in binders or placed in folders or envelopes for storage in steel file cabinets or on shelving in containers. For hard-copy records maintained by STPNOC, the records are suitably stored in steel file cabinets or on shelving in containers, except that methods other than binders, folders or envelopes may be used to organize the records for storage.

## **SECTION 18    AUDITS**

STPNOC has established the necessary measures and governing procedures to implement audits to verify that activities covered by the QAPD are performed in conformance with the requirements established. The audit programs are themselves reviewed for effectiveness as a part of the overall audit process.

### **18.1    Performance of Audits**

Internal audits of selected aspects of licensing, design, construction phase and operating activities are performed with a frequency commensurate with safety significance and in a manner which assures that audits of safety-related activities are completed. During the early portions of STP 3&4 activities, audits will focus on areas including, but not limited to, site investigation, procurement, and corrective action. Functional areas of an organization's QA program for auditing include, at a minimum, verification of compliance and effectiveness of implementation of internal rules, procedures (e.g., operating, design, procurement, maintenance, modification, refueling, surveillance, test, security, radiation control procedures, and the emergency plan), Technical Specifications, regulations and license conditions, programs for training, retraining, qualification and performance of operating staff, corrective actions, and observation of performance of operating, refueling, maintenance and modification activities, including associated record keeping.

The audits are scheduled on a formal preplanned audit schedule. The audit system is reviewed periodically and revised as necessary to assure coverage commensurate with current and planned activities. Additional audits may be performed as deemed necessary by management. The scope of the audit is determined by the quality status and safety importance of the activities being performed. These audits are conducted by trained personnel not having direct responsibilities in the area being audited and in accordance with preplanned and approved audit plans or checklists, under the direction of a qualified lead auditor and the cognizance of the Manager, Quality.

STPNOC is responsible for conducting periodic internal and external audits. Internal audits are conducted to determine the adequacy of programs and procedures (by representative sampling), and to determine if they are meaningful and comply with the overall QAPD. External audits determine the adequacy of supplier and contractor quality assurance program.

The results of each audit are reported in writing to the responsible senior management, and the President and CEO, or designee, as appropriate. Additional internal distribution is made to other concerned management levels in accordance with approved procedures.

Management responds to all audit findings and initiates corrective action where indicated. Where corrective action measures are indicated, documented follow-up of applicable areas through inspections, review, re-audits, or other appropriate means is conducted to verify implementation of assigned corrective action.

Audits of suppliers of safety-related components and/or services are conducted as described in Section 7.1.

## **18.2 Internal Audits**

Internal audits of organization and facility activities, conducted prior to placing the facility in operation, should be performed in such a manner as to assure that an audit of all applicable QA program elements is completed for each functional area at least once each year or at least once during the life of the activity, whichever is shorter.

Internal audits of activities, conducted after placing the facility in operation, should be performed in such a manner as to assure that an audit of all applicable QA program elements is completed for each functional area within a period of two years. Internal audit frequencies of well established activities, conducted after placing the facility in operation, may be extended one year at a time beyond the above two-year interval based on the results of an annual evaluation of the applicable functional area and objective evidence that the functional area activities are being satisfactorily accomplished. The evaluation should include a detailed performance analysis of the functional area based upon applicable internal and external source data and due consideration of the impact of any functional area changes in responsibility, resources, or management. However, the internal audit frequency interval should not exceed a maximum of four years. If an adverse trend is identified in the applicable functional area, the extension of the internal audit frequency interval should be rescinded and an audit scheduled as soon as practicable.

During the operations phase audits are performed at a frequency commensurate with the safety significance of the activities and in such a manner to assure audits of all applicable QA program elements are completed within a period of two years. These audits will include, as a minimum, activities in the following areas:

- (1) The conformance of facility operation to provisions contained within the Technical Specifications and applicable license conditions including administrative controls.
- (2) The performance, training, and qualifications of the facility staff.
- (3) The performance of activities required by the QAPD to meet the criteria of 10 CFR 50, Appendix B.
- (4) The Fire Protection Program and implementing procedures. A fire protection equipment and program implementation inspection and audit are conducted utilizing either a qualified off-site licensed fire protection engineer or an outside qualified fire protection consultant.
- (5) Other activities and documents considered appropriate by the General Manager, Oversight and Regulatory Affairs or the COO/CNO.

Audits may also be used to meet the periodic review requirements of the code for the Security, Emergency Preparedness, and Radiological Protection programs within the provisions of the applicable code.

Internal audits include verification of compliance and effectiveness of the administrative controls established for implementing the requirements of the QAPD; regulations and license provisions; provisions for training, retraining, qualification, and performance of personnel performing activities covered by the QAPD; corrective actions taken following abnormal occurrences; and, observation of the performance of construction, fabrication, operating, refueling, maintenance, and modification activities including associated record keeping.



### **18.3 NQA-1-1994 Commitment**

In establishing the independent audit program, STPNOC commits to compliance with NQA-1-1994, Basic Requirement 18 and Supplement 18S-1.

## Quality Assurance Program Description

---

### **PART III NONSAFETY-RELATED SSC QUALITY CONTROL**

#### **SECTION 1 Nonsafety-Related SSCs - Significant Contributors to Plant Safety**

Specific program controls are applied to nonsafety-related SSCs, for which 10 CFR 50, Appendix B is not applicable, that are significant contributors to plant safety. The specific program controls consistent with applicable sections of the QAPD are applied to those items in a selected manner, targeted at those characteristics or critical attributes that render the SSC a significant contributor to plant safety.

The following clarify the applicability of the QA Program to the nonsafety-related SSCs and related activities, including the identification of exceptions to the QA Program described in Part II, Sections 1 through 18 taken for nonsafety-related SSCs.

##### **1.1 Organization**

The verification activities described in this part may be performed by the STPNOC line organization. The QA organization described in Part II is not required to perform these functions.

##### **1.2 QA Program**

STPNOC QA requirements for nonsafety-related SSCs are established in the QAPD and appropriate procedures. Suppliers of these SSCs or related services describe the quality controls applied in appropriate procedures. A new or separate QA program is not required.

##### **1.3 Design Control**

STPNOC has design control measures to ensure that the contractually established design requirements are included in the design. These measures ensure that applicable design inputs are included or correctly translated into the design documents, and deviations from those requirements are controlled. Design verification is provided through the normal supervisory review of the designer's work.

##### **1.4 Procurement Document Control**

Procurement documents for items and services obtained by or for STPNOC include or reference documents describing applicable design bases, design requirements, and other requirements necessary to ensure component performance. The procurement documents are controlled to address deviations from the specified requirements.

##### **1.5 Instructions, Procedures, and Drawings**

STPNOC provides documents such as, but not limited to, written instructions, plant procedures, drawings, vendor technical manuals, and special instructions in work orders, to direct the performance of activities affecting quality. The method of

## Quality Assurance Program Description

---

instruction employed provides an appropriate degree of guidance to the personnel performing the activity to achieve acceptable functional performance of the SSC.

### **1.6 Document Control**

STPNOC controls the issuance and change of documents that specify quality requirements or prescribe activities affecting quality to ensure that correct documents are used. These controls include review and approval of documents, identification of the appropriate revision for use, and measures to preclude the use of superseded or obsolete documents.

### **1.7 Control of Purchased Items and Services**

STPNOC employs measures, such as inspection of items or documents upon receipt or acceptance testing, to ensure that all purchased items and services conform to appropriate procurement documents.

### **1.8 Identification and Control of Purchased Items**

STPNOC employs measures where necessary, to identify purchased items and preserve their functional performance capability. Storage controls take into account appropriate environmental, maintenance, or shelf life restrictions for the items.

### **1.9 Control of Special Processes**

STPNOC employs process and procedure controls for special processes, including welding, heat treating, and nondestructive testing. These controls are based on applicable codes, standards, specifications, criteria, or other special requirements for the special process.

### **1.10 Inspection**

STPNOC uses documented instructions to ensure necessary inspections are performed to verify conformance of an item or activity to specified requirements or to verify that activities are satisfactorily accomplished. These inspections may be performed by knowledgeable personnel in the line organization. Knowledgeable personnel are from the same discipline and have experience related to the work being inspected.

### **1.11 Test Control**

STPNOC employs measures to identify required testing that demonstrates that equipment conforms to design requirements. These tests are performed in accordance with test instructions or procedures. The test results are recorded, and authorized individuals evaluate the results to ensure that test requirements are met.

### **1.12 Control of Measuring and Test Equipment (M&TE)**

STPNOC employs measures to control M&TE use, and calibration and adjustment at

## Quality Assurance Program Description

---

specific intervals or prior to use.

### **1.13 Handling, Storage, and Shipping**

STPNOC employs measures to control the handling, storage, cleaning, packaging, shipping, and preservation of items to prevent damage or loss and to minimize deterioration. These measures include appropriate marking or labels, and identification of any special storage or handling requirements.

### **1.14 Inspection, Test, and Operating Status**

STPNOC employs measures to identify items that have satisfactorily passed required tests and inspections and to indicate the status of inspection, test, and operability as appropriate.

### **1.15 Control of Nonconforming Items**

STPNOC employs measures to identify and control items that do not conform to specified requirements to prevent their inadvertent installation or use.

### **1.16 Corrective Action**

STPNOC employs measures to ensure that failures, malfunctions, deficiencies, deviations, defective components, and nonconformances are properly identified, reported, and corrected.

### **1.17 Records**

STPNOC employs measures to ensure records are prepared and maintained to furnish evidence that the above requirements for design, procurement, document control, inspection, and test activities have been met.

### **1.18 Audits**

STPNOC employs measures for line management to periodically review and document the adequacy of the process, including taking any necessary corrective action. Audits independent of line management are not required. Line management is responsible for determining whether reviews conducted by line management or audits conducted by any organization independent of line management are appropriate. If performed, audits are conducted and documented to verify compliance with design and procurement documents, instructions, procedures, drawings, and inspection and test activities. Where the measures of this part (Part III) are implemented by the same programs, processes, or procedures as the comparable activities of Part II, the audits performed under the provisions of Part II may be used to satisfy the review requirements of this Section (Part III, Section 1.18).

## **Quality Assurance Program Description**

---

### **SECTION 2      Nonsafety-Related SSCs Credited for Regulatory Events**

The following criteria apply to fire protection (10 CFR 50.48), anticipated transients without scram (ATWS) (10 CFR 50.62), the station blackout (SBO) (10 CFR 50.63) SSCs that are not safety-related;

- STPNOC implements quality requirements for the fire protection system in accordance with Regulatory Position 1.7, "Quality Assurance," in Regulatory Guide 1.189, "Fire Protection for Operating Nuclear Power Plants" as identified in FSAR Chapter 1.
- STPNOC implements the quality requirements for ATWS equipment in accordance with Part III, Section 1.
- STPNOC implements quality requirements for SBO equipment in accordance with Part III, Section 1.

## PART IV REGULATORY COMMITMENTS

### NRC Regulatory Guides and Quality Assurance Standards

This section identifies the NRC Regulatory Guides (RG) and the other quality assurance standards which have been selected to supplement and support the STPNOC QAPD. STPNOC complies with these standards to the extent described or referenced. Commitment to a particular RG or standard does not constitute a commitment to other RGs or standards that may be referenced therein.

#### Regulatory Guides:

Note: The Regulatory Guide revisions listed below are only applied to site specific activities at STP Units 3 & 4. For implementation of these Regulatory Guides related to the certified ABWR design see Chapter 1 of the FSAR.

#### Regulatory Guide 1.8, Rev. 3, May 2000, Qualification and Training of Personnel for Nuclear Power Plants

Regulatory Guide 1.8 provides guidance that is acceptable to the NRC staff regarding qualifications and training for nuclear power plant personnel.

STPNOC identifies conformance and exceptions for the applicable regulatory position guidance provided in this regulatory guide in the text below:

- Regulatory positions C.1.1 through C.1.4 are addressed in Chapter 13 of the FSAR.
- Regulatory position C.2.1 addresses alternatives and substitutions for education and experience for quality assurance personnel. Those alternatives and substitutions are reflected in Part II, Section 2.6 of the QAPD.
- Regulatory Positions C.2.2 through C.2.10 are addressed in Chapter 13 of the FSAR.
- Regulatory Position C.2.11 addresses ANSI/ANS-3.1-1993 Section 4.5.5, Quality Control. The QAPD identifies an alternative for this regulatory position in Part II, Section 2.6.
- Regulatory Position C.2.12 addresses ANSI/ANS-3.1-1993 Section 4.5.6, Quality Assurance. The QAPD identifies an alternative for this regulatory position in Part II, Section 2.8.
- Regulatory Position C.2.13 is addressed in Chapter 13 of the FSAR.
- Regulatory Positions C.2.14 and C.2.15 address ANSI/ANS-3.1-1993 Sections 4.7.1 and 4.7.2 relative to Independent Review qualifications. The QAPD identifies an alternative for this regulatory position in Part V, Section 2.2.

## Quality Assurance Program Description

---

### **Regulatory Guide 1.26**, Revision 4, March, 2007 – Quality Group Classifications and Standards for Water-, Steam-, and Radioactive-Waste-Containing Components of Nuclear Power Plants

Regulatory Guide 1.26 defines classification of systems and components.

STPNOC identifies conformance and exceptions with the applicable regulatory position guidance provided in this regulatory guide through FSAR (and associated DCD) Section 3.2. The application of specific standards are addressed in the FSAR/DCD sections that describe the identified components.

### **Regulatory Guide 1.28**, Revision 3, August 1985, Quality Assurance Program Requirements (Design and Construction)

Regulatory Guide 1.28 describes a method acceptable to the NRC staff for complying with the provisions of Appendix B with regard to establishing and implementing the requisite quality assurance program for the design and construction of nuclear power plants.

STPNOC identifies conformance and exceptions for the applicable regulatory position guidance provided in this regulatory guide in the text below:

- This regulatory guide endorses the basic and supplementary requirements in ANSI/ASME NQA-1-1983, "Quality Assurance Program Requirements for Nuclear Power Plants" and the ANSI/ ASME NQA-1a-1983 Addenda along with the regulatory positions discussed below for the establishment and execution of quality assurance programs during the design and construction phases of nuclear power plants. The QAPD provides adequate guidance for establishing a quality assurance program that complies with Appendix B to 10 CFR Part 50 by using ASME NQA standard NQA-1-1994, as supplemented by additional regulatory guidance and industry guidance.
- Regulatory Position C.1 addresses the qualification of inspection and test personnel. The QAPD identifies an alternative for this regulatory position in Part II, Section 2.7. As documented in SER ML070510300, the qualification criteria in the QAPD is acceptable and consistent with SRP Section 17.5, paragraph II.T.
- Regulatory Position C.2 is addressed through Part II, Section 17.1 of the QAPD.
- Regulatory Position C.3 addresses scheduling of audits. In establishing the independent audit program, the STPNOC commits to comply with the quality standards described in NQA-1-1994, Basic Requirement 18 and Supplement 18S-1 which follows SRP Section 17.5, paragraph II.R for establishing the necessary measures to implement audits to verify that activities covered by the QAPD are performed in conformance with the requirements established. The scheduling of Internal Audits is addressed in QAPD Part II Section 18.2 and is consistent with position C.3.1 for the phase prior to placing the facility into operation. External Audits are addressed in QAPD Part II Section 7.1. The requirements are consistent with SRP paragraph II.R.11 and II.R.12. These requirements address regulatory position C.3.2.

## Quality Assurance Program Description

---

### **Regulatory Guide 1.29**, Revision 4, March 2007, Seismic Design Classification

Regulatory Guide 1.29 defines systems required to withstand a safe shutdown earthquake (SSE).

This Regulatory Guide describes an acceptable method for identifying and classifying the features of nuclear power plants that must be designed to withstand the effects of the Safe Shutdown Earthquake(SSE).

STPNOC identifies conformance and exceptions for the applicable regulatory position guidance provided in this regulatory guide in the text below:

- Regulatory Positions C.1 through C.3 provide guidance in establishing the SSCs, or portions thereof, classified as needing to meet seismic design requirements. The seismic design classification of SSCs is addressed through the FSAR (and associated DCD) Section 3.2.
- Regulatory Position C.4 addresses the application of the QA requirements of Appendix B to 10 CFR Part 50 to all activities affecting the safety-related functions of those portions of the SSCs that are covered by Regulatory Positions 2 and 3. Those in Regulatory Position 1 are considered safety-related. The QAPD described in Section 17.5 of the FSAR addresses the QA program requirements applied to safety-related activities.

### **Regulatory Guide 1.33**, Revision 2, February 1978, Quality Assurance Program Requirements (Operations)

Regulatory Guide 1.33 describes a method acceptable to the NRC staff for complying with the Commission's regulations with regard to overall quality assurance program requirements for the operation phase of nuclear power plants.

STPNOC identifies conformance and exceptions for the applicable regulatory position guidance provided in this regulatory guide in the text below:

- This Regulatory Guide endorses ANSI N18.7-1976/ANS-3.2 for complying with the quality assurance program requirements for the operation phase of nuclear power plants, subject to five regulatory positions. STPNOC provides adequate guidance for establishing a quality assurance program that complies with Appendix B to 10 CFR Part 50 by using ASME NQA standard NQA-1-1994, as supplemented by additional guidance and controls contained in the STP Units 3 & 4 FSAR and QAPD. This represents an approved alternative for Regulatory Positions C.2, C.3, C.4, and C.5
- Regulatory Positions C.1 is addressed in Chapter 13 of the FSAR.
- Regulatory Position C.2 identifies additional standards referenced by ANSI N18.7-1976/ANS-3.2 and provides a cross reference for a regulatory Guide that addressed each of those standards. The QAPD identifies commitments to ASME NQA-1-1994 instead of the listed ANSI N45.2 series standards listed.



## Quality Assurance Program Description

---

- Regulatory Position C.3 identifies a position related to Independent Review. The QAPD provides an alternative for this position by addressing Independent Review requirements specifically in Part V, Section 2.7 consistent with SRP 17.5 Section II.W
- Regulatory Position C.4 relates to provisions of the audit program. In establishing the independent audit program, the QAPD provides an alternative for this position by committing the applicant to comply with the quality standards described in NQA-1-1994, Basic Requirement 18 and Supplement 18S-1.
- Regulatory Position C.5 identifies concerns of the NRC with the usage of the verbs "should" and "shall" in ANSI N18.7-1976. QAPD Part V provides an alternative to this position by providing adequate guidance for establishing a quality assurance program that complies with Appendix B to 10 CFR Part 50 by using ASME NQA standard NQA-1-1994.

### **Regulatory Guide 1.37**, Revision 1, March 2007 – Quality Assurance Requirements for Cleaning of Fluid Systems and Associated Components of Water-Cooled Nuclear Power Plants

Regulatory Guide 1.37 provides guidance on specifying water quality and precautions related to the use of alkaline cleaning solutions and chelating agents.

STPNOC identifies conformance and exceptions for the applicable regulatory position guidance provided in this regulatory guide in the text below:

- This Regulatory Guide finds that the provisions and recommendations included in ASME NQA-1-1994, Part II, Subpart 2.1 are generally acceptable for onsite cleaning of materials and components, cleanliness control, and preoperational cleaning and layup of water-cooled nuclear power plant fluid systems with three regulatory positions. QAPD Part II, Section 13.2 addresses the commitment to NQA-1-1994, Part II, Subpart 2.1
- Regulatory Position C.1 identifies that the applicability and acceptability of any of the codes, standards, and specifications referenced in the text are or will be addressed through other regulations or NRC guidance. Chapter 1 of the FSAR addresses the codes, standards, and other documents that are used in the COL and any exceptions or alternatives to those documents.
- Regulatory Positions C.2 requires that "the water quality for final flushes of fluid systems and associated components should be at least equivalent to the quality of the operating system water". QAPD Part II Section 13.2 addresses this commitment.
- Regulatory Position C.3 recommends following Sections 8.2.2 and 8.2.3 of ASME NQA-1-1994, Part II, Subpart 2.1 precautions related to the use of alkaline cleaning solutions and chelating agents, respectively, by the use of the guidance in nonmandatory Appendix 2.1 to ASME NQA-1-1994, Part III, Subpart 3.2. In addition, this position recommends that a suitable chloride stress-cracking inhibitor be added

## Quality Assurance Program Description

---

to the fresh water used to flush systems containing austenitic stainless steels. QAPD Part II, Section 13.2 addresses the commitment to NQA-1-1994, Part II, Subpart 3.2.

**Regulatory Guide 1.54** Revision 1, July 2000, Service Level I, II, and III Protective, Coatings Applied to Nuclear Power Plants

Regulatory Guide 1.54 describes the methods acceptable to the NRC staff for complying with the Commission's regulation with regard to Service Level I, II, and III Protective, Coatings Applied to Nuclear Power Plants.

STPNOC implements RG 1.54 Revision 1, July 2000.

**Standards:**

**ASME NQA-1-1994 Edition** – Quality Assurance Requirements for Nuclear Facility Applications  
STPNOC commits to NQA-1-1994, Parts I, II and III; as described in Parts II and V of this document.

**Nuclear Information and Records Management Association, Inc. (NIRMA) Technical Guides (TGs)**

STPNOC commits to NIRMA TGs as described in Part II, Section 17.

## **PART V ADDITIONAL QUALITY ASSURANCE AND ADMINISTRATIVE CONTROLS FOR THE PLANT OPERATIONAL PHASE**

STPNOC includes the requirements of Part V that follow when establishing the necessary measures and governing procedures for the operations phase of the plant.

### **SECTION 1 Definitions**

STPNOC uses the definitions of terms as provided in Section 4 of the Introduction of NQA-1-1994 in interpreting the requirements of NQA-1-1994 and the other standards to which the QAPD commits. In addition, definitions are provided for the following terms not covered in NQA-1-1994:

**administrative controls:** rules, orders, instructions, procedures, policies, practices and designations of authority and responsibility

**experiments:** performance of plant operations carried out under controlled conditions in order to establish characteristics or values not previously known

**nuclear power plant:** any plant using a nuclear reactor to produce electric power, process steam or space heating

**on-site operating organization:** on-site personnel concerned with the operation, maintenance and certain technical services

**operating activities:** work functions associated with normal operation and maintenance of the plant, and technical services routinely assigned to the on-site operating organization

**operational phase:** that period of time during which the principal activity is associated with normal operation of the plant. This phase of plant life is considered to begin formally with commencement of initial fuel loading, and ends with plant decommissioning

**review:** a deliberately critical examination, including observation of plant operation, evaluation of assessment results, procedures, certain contemplated actions, and after-the-fact investigations of abnormal conditions

**supervision:** direction of personnel activities or monitoring of plant functions by an individual responsible and accountable for the activities they direct or monitor

**surveillance testing:** periodic testing to verify that safety related structures, systems, and components continue to function or are in a state of readiness to perform their functions

**system:** an integral part of nuclear power plant comprising components which may be operated or used as a separate entity to perform a specific function

## **SECTION 2      Review of Activities Affecting Safe Plant Operation**

### **2.1      Onsite Operating Organization Review**

The STPNOC onsite organization employs reviews, both periodic and as situations demand, to evaluate plant operations and plan future activities. The important elements of the reviews are documented and subjects of potential concern for the independent review described below are brought to the attention of the Plant General Manager. The reviews are part of the normal duties of plant supervisory personnel in order to provide timely and continuing monitoring of operating activities in order to assist the Plant General Manager in keeping abreast of general plant conditions and to verify that day-to-day operations are conducted safely in accordance with the established administrative controls. The Plant General Manager ensures the timely referral of the applicable matters discussed in the reviews to appropriate management and independent reviewers.

### **2.2      Independent Review**

Activities occurring during the operational phase shall be independently reviewed on a periodic basis. The independent review program shall be functional prior to initial core loading. The independent review function performs the following:

- a. Reviews proposed changes to the facility as described in the safety analysis report (SAR). The Independent Review Body (IRB) also verifies that changes do not adversely affect safety and if a technical specification change or NRC review is required.
- b. Reviews proposed tests and experiments not described in the SAR prior to implementation. Verifies the determination of whether changes to proposed tests and experiments not described in the SAR require a technical specification change or license amendment..
- c. Reviews proposed technical specification changes and license amendments relating to nuclear safety prior to NRC submittal and implementation, except in those cases where the change is identical to a previously approved change.
- d. Reviews violations, deviations, and events that are required to be reported to the NRC. This review includes the results of investigations and recommendations resulting from such investigations to prevent or reduce the probability of recurrence of the event.
- e. Reviews any matter related to nuclear safety that is requested by the Site Vice President or any IRB member.
- f. Reviews corrective actions for significant conditions adverse to quality.
- g. Reviews internal audit reports.
- g. Reviews the adequacy of the internal audit program every 24 months.

## Quality Assurance Program Description

---

A group functions as an independent review body (IRB). In discharging its review responsibilities, the IRB keeps safety considerations paramount when opposed to cost or schedule considerations. One or more organizational units may collectively perform this function.

1. IRB reviews are supplemented as follows:
  - a. A qualified person, independent of the preparer, reviews proposed changes in the procedures as described in the SAR prior to implementation of the change to determine if a technical specification change or NRC approval is required.
  - b. Audits of selected changes in the procedures described in the SAR are performed to verify that procedure reviews and revision controls are effectively implemented.
  - c. Competent individual(s) or group(s) other than those who performed the original design but who may be from the same organization verify that changes to the facility do not result in a loss of adequate design or safety margins.
2. The results of IRB reviews of matters involving the safe operation of the facility are periodically independently reviewed. This review is intended to support management in identifying and resolving issues potentially affecting safe plant operation. This review supplements the existing corrective action programs and audits.
  - a. The review is performed by a team consisting of personnel with experience and competence in the activities being reviewed, but independent from cost and schedule considerations and from the organizations responsible for those activities. The IRB supervisor or chairman has a minimum six (6) years combined managerial and technical support experience. The members of the IRB have a minimum of five years of experience in their own area of responsibility as applicable to the activities being reviewed (i.e., a minimum of five years of experience in one of the twelve areas listed below:
    - (1) Nuclear power plant operations
    - (2) Nuclear engineering
    - (3) Chemistry and radiochemistry
    - (4) Metallurgy
    - (5) Nondestructive testing
    - (6) Instrumentation and control
    - (7) Radiological safety
    - (8) Mechanical engineering
    - (9) Electrical engineering
    - (10) Administrative control and quality assurance practices

(11) Training

(12) Emergency plans and related procedures and equipment).

- b. The review is supplemented by outside consultants or organizations as necessary to ensure the team has the requisite expertise and competence.
- c. Results of the review are documented and reported to responsible management.
- d. Management periodically consider issues they determine warrant special attention, such as deficient plant programs, declining performance trends, employee concerns, or other issues related to safe plant operations and determine what issues warrant the review.
- e. Management determines the scheduling and scope of review and the composition of the team performing the review.

### **SECTION 3      Operational Phase Procedures**

The following is a description of the various types of procedures used by STPNOC to govern the design, operation, and maintenance of its nuclear generating plants. STPNOC follows the guidance of Appendix A to Regulatory Guide 1.33 in identifying the types of activities that should have procedures or instructions to control the activity. Each procedure shall be sufficiently detailed for a qualified individual to perform the required function without direct supervision, but need not provide a complete description of the system or plant process.

#### **3.1      Format and Content**

Procedure format and content may vary from one location to the other. However, procedures include the following elements as appropriate to the purpose or task to be described.

- **Title/Status**

Each procedure is given a title descriptive of the work or subject it addresses, and includes a revision number and/or date and an approval status.

- **Purpose/Statement of Applicability/Scope**

The purpose for which the procedure is intended is clearly stated (if not clear from the title). The systems, structures, components, processes or conditions to which the procedure applies are also clearly described.

- **References**

Applicable references, including reference to appropriate Technical Specifications, are required. References are included within the body of the procedure when the sequence of steps requires other tasks to be performed (according to the reference) prior to or concurrent with a

## Quality Assurance Program Description

---

particular step.

- **Prerequisites/Initial Conditions**

Prerequisites/initial conditions identify those independent actions or procedures that must be accomplished and plant conditions which must exist prior to performing the procedure. A prerequisite applicable to only a specific portion of a procedure is so identified.

- **Precautions**

Precautions alert the user to those important measures to be used to protect equipment and personnel, including the public, or to avoid an abnormal or emergency situation during performance of the procedure. Cautionary notes applicable to specific steps are included in the main body of the procedure and are identified as such.

- **Limitations and actions**

Limitations on the parameters being controlled and appropriate corrective measures to return the parameter to the normal control band are specified.

- **Main body**

The main body of the procedure contains the step-by-step instructions in the degree of detail necessary for performing the required function or task.

- **Acceptance criteria**

The acceptance criteria provide the quantitative or qualitative criteria against which the success or failure (as of a test-type activity) of the step or action would be judged.

- **Checklists**

Complex procedures utilize checklists which may be included as part of the procedure or appended to it.

### 3.2 Procedure Types

#### Administrative Control Procedures

These include administrative procedures, directives, policies, standards, and similar documents that control the programmatic aspects of facility activities. These administrative documents ensure that the requirements of regulatory and license commitments are implemented. Several levels of administrative controls are applied ranging from those affecting the entire Company to those prepared at the implementing group level. These documents establish responsibilities, interfaces, and standard methods (rules of practice) for implementing programs. In addition to the administrative controls described throughout this QAPD, instructions governing the following

---

**Quality Assurance Program Description**

---

activities are provided:

- **Operating Orders/Procedures**

Instructions of general and continuing applicability to the conduct of business to the plant staff are provided. Examples where these are applied include, but are not limited to, job turnover and relief, designation of confines of control room, definition of duties of operators and others, transmittal of operating data to management, filing of charts, limitations on access to certain areas and equipment, shipping and receiving instructions. Provisions are made for periodic review and updating of these documents, where appropriate.

- **Special Orders**

Management instructions, which have short-term applicability and require dissemination, are issued to encompass special operations, housekeeping, data taking, publications and their distribution, plotting process parameters, personnel actions, or other similar matters. Provisions are made for periodic review, updating, and cancellation of these documents, where appropriate.

- **Plant Security and Visitor Control**

Procedures or instructions are developed to supplement features and physical barriers designed to control access to the plant and, as appropriate, to vital areas within the plant. Information concerning specific design features and administrative provisions of the plant security program is confidential and thus accorded limited distribution. The security and visitor control procedures consider, for example, physical provisions, such as: fences and lighting; lock controls for doors, gates and compartments containing sensitive equipment; and provisions for traffic and access control. Administrative provisions, such as: visitor sign-in and sign-out procedures; escorts and badges for visitors; emphasis on inspection, observation and challenging of strangers by operating crews; and a program of pre-employment screening for potential employees are also considered.

- **Temporary Procedures**

Temporary procedures may be used to direct operations during testing, refueling, maintenance, and modifications to provide guidance in unusual situations not within the scope of the normal procedures. These procedures ensure orderly and uniform operations for short periods when the plant, a system, or a component of a system is performing in a manner not covered by existing detailed procedures or has been modified or extended in such a manner that portions of existing procedures do not apply. Temporary Procedures include designation of the period of time during which they may be used and are subject to the procedure review process as applicable.

### **Engineering Procedures**

These documents provide instructions for the preparation of engineering documents, engineering analysis, and implementation of engineering programs. This includes activities such as designs; calculations; fabrication, equipment, construction, and installation specifications; drawings; analysis and topical reports; and testing plans or procedures. They include



## Quality Assurance Program Description

---

appropriate references to industry codes and standards, design inputs, and technical requirements.

### **Installation Procedures**

These documents provide instructions for the installation of components generally related to new construction and certain modification activities. They include appropriate reference to industry standards, installation specifications, design drawings, and supplier and technical manuals for the performance of activities. These documents include provisions, such as hold or witness points, for conducting and recording results of required inspections or tests. These documents may include applicable inspection and test instructions subject to the requirements for test and inspection procedures below.

### **System Procedures**

These documents contain instructions for energizing, filling, venting, draining, starting up, shutting down, changing modes of operation, and other instructions appropriate for operations of systems related to the safety of the plant. Separate procedures may be developed for correcting off-normal conditions for those events where system complexity may lead to operator uncertainty. Appropriate procedures will also be developed for the fire protection program.

### **Start-up Procedures**

These documents contain instructions for starting the reactor from cold or hot conditions and establishing power operation. This includes documented determination that prerequisites have been met, including confirmation that necessary instruments are operable and properly set; valves are properly aligned, necessary system procedures, tests and calibrations have been completed; and required approvals have been obtained.

### **Shutdown Procedures**

These documents contain guidance for operations during controlled shutdown and following reactor trips, including instructions for establishing or maintaining hot shutdown/standby or cold shutdown conditions, as applicable. The major steps involved in shutting down the plant are specified, including instructions for such actions as monitoring and controlling reactivity, load reduction and cooldown rates, sequence for activating or deactivating equipment, requirements for prompt analysis for causes of reactor trips or abnormal conditions requiring unplanned controlled shutdowns, and provisions for decay heat removal.

### **Power Operation and Load Changing Procedures**

These documents contain instructions for steady-state power operation and load changing. These type documents include, as examples, provisions for use of control rods, chemical shim, coolant flow control, or any other system available for short-term or long-term control of reactivity, making deliberate load changes, responding to unanticipated load changes, and adjusting operating parameters.

### **Process Monitoring Procedures**

These documents contain instructions for monitoring performance of plant systems to assure that core thermal margins and coolant quality are maintained in acceptable status at all times,

## Quality Assurance Program Description

---

that integrity of fission product barriers is maintained, and that engineered safety features and emergency equipment are in a state of readiness to keep the plant in a safe condition if needed. Maximum and minimum limits for process parameters are appropriately identified. Operating procedures address the appropriate nature and frequency of this monitoring.

### **Fuel Handling Procedures**

These documents contain instructions for core alterations, accountability of fuel and partial or complete refueling operations that include, for example, continuous monitoring of neutron flux throughout core loading, periodic data recording, audible annunciation of abnormal flux increases, and evaluation of core neutron multiplication to verify safety of loading increments. Procedures are also provided for receipt and inspection of new fuel, and for fuel movements in the spent fuel storage areas. Fuel handling procedures include prerequisites to verify the status of systems required for fuel handling and movement; inspection of replacement fuel and control rods; designation of proper tools, proper conditions for spent fuel movement, proper conditions for fuel cask loading and movement; and status of interlocks, reactor trip circuits and mode switches. These procedures provide requirements for refueling, including proper sequence, orientation and seating of fuel and components, rules for minimum operable instrumentation, actions for response to fuel damage, verification of shutdown margin, communications between the control room and the fuel handling station, independent verification of fuel and component locations, criteria for stopping fuel movements, and documentation of final fuel and component serial numbers (or other unique identifiers) and locations.

### **Maintenance Procedures**

These documents contain instructions in sufficient detail to permit maintenance work to be performed correctly and safely, and include provisions, such as hold or witness points, for conducting and recording results of required inspections or tests. These documents may include applicable inspection or test instructions subject to the requirements for test and inspection procedures below. Appropriate referencing to other procedures, standards, specifications, or supplier manuals is provided. When not provided through other documents, instructions for equipment removal and return to service, and applicable radiation protection measures (such as protective clothing and radiation monitoring) will be included. Additional maintenance procedure requirements are addressed in NQA-1-1994, Subpart 2.18, Section 2.2, Procedures.

### **Radiation Control Procedures**

These documents contain instructions for implementation of the radiation control program requirements necessary to meet regulatory commitments, including acquisition of data and use of equipment to perform necessary radiation surveys, measurements and evaluations for the assessment and control of radiation hazards. These procedures provide requirements for monitoring both external and internal exposures of employees, utilizing accepted techniques; routine radiation surveys of work areas; effluent and environmental monitoring in the vicinity of the plant; radiation monitoring of maintenance and special work activities, and for maintaining records demonstrating the adequacy of measures taken to control radiation exposures to employees and others.

### **Calibration and Test Procedures**

These documents contain instructions for periodic calibration and testing of instrumentation and control systems, and for periodic calibration of measuring and test equipment used in activities

## Quality Assurance Program Description

---

affecting the quality of these systems. These documents provide for meeting surveillance requirements and for assuring measurement accuracy adequate to keep safety-related parameters within operational and safety limits.

### **Chemical and Radiochemical Control Procedures**

These documents contain instructions for chemical and radiochemical control activities and include: the nature and frequency of sampling and analyses; instructions for maintaining coolant quality within prescribed limits; and limitations on concentrations of agents that could cause corrosive attack, foul heat transfer surfaces, or become sources of radiation hazards due to activation. These documents also provide for the control, treatment and management of radioactive wastes, and control of radioactive calibration sources.

### **Emergency Operating Procedures**

These documents contain instructions for response to potential emergencies so that a trained operator will know in advance the expected course of events that will identify an emergency and the immediate actions that should be taken in response. Format and content of emergency procedures are based on regulatory and Owner's Group(s) guidance that identify potential emergency conditions and generally require such procedures to include a title, symptoms to aid in identification of the nature of the emergency, automatic actions to be expected from protective systems, immediate operator actions for operation of controls or confirmation of automatic actions, and subsequent operator actions to return the reactor to a normal condition or provide for a safe extended shutdown period under abnormal or emergency conditions.

### **Emergency Plan Implementing Procedures**

These documents contain instructions for activating the Emergency Response Organization and facilities, protective action levels, organizing emergency response actions, establishing necessary communications with local, state and federal agencies, and for periodically testing the procedures, communications and alarm systems to assure they function properly. Format and content of such procedures are such that requirements of each facility's NRC approved Emergency Plan are met.

### **Test and Inspection Procedures**

These documents provide the necessary measures to assure quality is achieved and maintained for the nuclear facilities. The instructions for tests and inspections may be included within other procedures, such as installation and maintenance procedures, but will contain the objectives, acceptance criteria, prerequisites for performing the test or inspection, limiting conditions, and appropriate instructions for performing the test or inspection, as applicable. These procedures also specify any special equipment or calibrations required to conduct the test or inspection and provide for appropriate documentation and evaluation by responsible authority to assure test or inspection requirements have been satisfied. Where necessary, hold or witness points are identified within the procedures and require appropriate approval for the work to continue beyond the designated point. These procedures provide for recording the date, identification of those performing the test or inspection, as-found condition, corrective actions performed (if any), and as-left condition, as appropriate for the subject test or inspection.

## Quality Assurance Program Description

---

### SECTION 4 Control of Systems and Equipment in the Operational Phase

Permission to release systems and equipment for maintenance or modification is controlled by designated operating personnel and documented. Measures, such as installation of tags or locks and releasing stored energy, are used to ensure personnel and equipment safety. When entry into a closed system is required, STPNOC has established control measures to prevent entry of extraneous material and to assure that foreign material is removed before the system is reclosed.

Administrative procedures require the designated operating personnel to verify that the system or equipment can be released and determine the length of time it may be out of service. In making this determination, attention is given to the potentially degraded degree of protection where one subsystem of a redundant safety system is not available for service. Conditions to be considered in preparing equipment for maintenance include, for example: shutdown margin; method of emergency core cooling; establishment of a path for decay heat removal; temperature and pressure of the system; valves between work and hazardous material; venting, draining and flushing; entry into closed vessels; hazardous atmospheres; handling hazardous materials; and electrical hazards.

When systems or equipment are ready to be returned to service, designated operating personnel control placing the items in service and document its functional acceptability. Attention is given to restoration of normal conditions, such as removal of jumpers or signals used in maintenance or testing, or actions such as returning valves, breakers or switches to proper start-up or operating positions from "test" or "manual" positions. Where necessary, the equipment placed into service receives additional surveillance during the run-in period.

Independent verifications, where appropriate, are used to ensure that the necessary measures have been implemented correctly. The minimum requirements and standards for using independent verification are established in company documents.

### SECTION 5 Plant Maintenance

STPNOC establishes controls for the maintenance or modification of items and equipment subject to this QAPD to ensure quality at least equivalent to that specified in original design bases and requirements, such that safety-related structures, systems and components are maintained in a manner that assures their ability to perform their intended safety function(s). Maintenance activities (both corrective and preventive) are scheduled and planned so as not to unnecessarily compromise the safety of the plant.

In establishing controls for plant maintenance, STPNOC commits to compliance with NQA-1-1994, Subpart 2.18, with the following clarifications:

- Where Subpart 2.18 refers to the requirements of ANS-3.2, it shall be interpreted to mean the applicable standards and requirements established within the STP 3&4 QAPD
- Section 2.3 requires cleanliness during maintenance to be in accordance with Subpart 2.1. The commitment to Subpart 2.1 is described in the STP 3&4 QAPD, Part II, Section 13.