

Chapter 2 Site Characteristics

2.0 Introduction

This section of the referenced DCD is incorporated by reference with the following departures and/or supplements.

Replace the last two paragraphs with the following paragraphs.

EF3 COL 2.0-1-A

DCD site parameter values for the ESBWR standard plant are identified in [DCD Table 2.0-1](#) and [DCD Tier 1, Table 5.1-1](#). DCD site parameter values for the ESBWR standard plant are identified in [DCD Table 2.0-1](#) and [DCD Tier 1, Table 5.1-1](#).

[Table 2.0-201](#) identifies each DCD site parameter value and the corresponding Fermi 3 site characteristic values. In accordance with 10 CFR 52.79(b) and (d); and SRP Section 2.0, Part 1 of [Table 2.0-201](#) evaluates, as applicable, whether the Fermi 3 site characteristic values fall within DCD site parameter values.

EF3 SUP 2.0-1

Appendix 2A provides site specific input values used in ARCON96 analysis of on-site X/Q values.

EF3 COL 2.0-2-A through 2.0-30-A

Information on Fermi 3 site characteristics is provided in [Section 2.1](#) through [Section 2.5](#). This information addresses NRC guidance in NUREG-0800 as identified in [Table 2.0-2R](#). In the “COL Information” column, the COL Item from the DCD is replaced with information responding to the COL Item and identifying the FSAR section which addresses the SRP section invoked by the COL Item.

2.0.1 COL Information

2.0-1-A Site Characteristics Demonstration

EF3 COL 2.0-1-A

This COL item is addressed in [Section 2.0](#).

2.0-2-A through 2.0-30-A Standard Review Plan Conformance

EF3 COL 2.0-2-A through 2.0-30-A

These COL items are addressed in [Section 2.0](#).

Table 2.0-2R

Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 1 of 5)

[EF3 COL 2.0-2-A through 2.0-30-A]

	Section	Subject	ESBWR DCD Parameters, Considerations and/or Limits	COL Information
EF3 COL 2.0-2-A	2.1.1	Site Location and Description	None	COL Item 2.0-2-A is addressed in Subsection 2.1.1 .
EF3 COL 2.0-3-A	2.1.2	Exclusion Area Authority and Control	None	COL Item 2.0-3-A is addressed in Subsection 2.1.2 .
EF3 COL 2.0-4-A	2.1.3	Population Distribution	ESBWR Probabilistic Risk Assessment in DCD Reference 2.0-1 considers a population density of 305 people per square kilometer (790 per square mile), but that is not a limitation for plant siting considerations.	COL Item 2.0-4-A is addressed in Subsection 2.1.3 . The population density for offsite analysis provided in Subsection 2.1.3 falls within (is less than) the density used in DCD Reference 2.0-1 .
EF3 COL 2.0-5-A	2.2.1–2.2.2	Identification of Potential Hazards in Site Vicinity	Per DCD Table 2.0-1	COL Item 2.0-5-A is addressed in Section 2.2 .
EF3 COL 2.0-6-A	2.2.3	Evaluation of Potential Accidents	None considered in vicinity of plant	COL Item 2.0-6-A is addressed in Subsection 2.2.3 .
EF3 COL 2.0-7-A	2.3.1	Regional Climatology	Per DCD Table 2.0-1	COL Item 2.0-7-A is addressed in Subsection 2.3.1 .
EF3 COL 2.0-8-A	2.3.2	Local Meteorology	None	COL Item 2.0-8-A is addressed in Subsection 2.3.2 .
EF3 COL 2.0-9-A	2.3.3	Onsite Meteorological Measurements Programs	None	COL Item 2.0-9-A is addressed in Subsection 2.3.3 .

Table 2.0-2R

Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 2 of 5)

[EF3 COL 2.0-2-A through 2.0-30-A]

	Section	Subject	ESBWR DCD Parameters, Considerations and/or Limits	COL Information
EF3 COL 2.0-10-A	2.3.4	Short-Term Dispersion Estimates for Accidental Atmospheric Releases	Per DCD Table 2.0-1 . See also Chapter 15 .	The portion of COL Item 2.0-10-A to supply information in accordance with SRP 2.3.4 is addressed in Subsection 2.3.4 . Information provided in Table 2.0-201 shows that the site characteristic short-term meteorological dispersion values fall within the site parameter values. This means that dispersion values given in DCD Chapter 15 remain bounding for this FSAR and less than stipulated in 10 CFR 52.79(a)(1)(vi) and the applicable portions of SRP Sections 11 and 15.
EF3 COL 2.0-11-A	2.3.5	Long-Term Diffusion Estimates	Per DCD Table 2.0-1 . See Subsection 2.3.5 and Subsection 12.2.2.1 for a discussion of the generation of these values.	COL Item 2.0-11-A is addressed in Subsection 2.3.5 .
EF3 COL 2.0-12-A	2.4.1	Hydraulic Description Maximum Groundwater Level	Per DCD Table 2.0-1	COL Item 2.0-12-A is addressed in Subsection 2.4.1 .
EF3 COL 2.0-13-A	2.4.2	Floods	Per DCD Table 2.0-1	COL Item 2.0-13-A is addressed in Subsection 2.4.2 .
EF3 COL 2.0-14-A	2.4.3	Probable Maximum Flood on Streams and Rivers	Probable maximum flooding level on streams and rivers does not exceed the maximum flood level defined in DCD Table 2.0-1 .	COL Item 2.0-14-A is addressed in Subsection 2.4.3 .
EF3 COL 2.0-15-A	2.4.4	Potential Dam Failures	Potential dam failures do not cause flooding to exceed the maximum flood level defined in DCD Table 2.0-1 .	COL Item 2.0-15-A is addressed in Subsection 2.4.4 .

Table 2.0-2R

Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 3 of 5)

[EF3 COL 2.0-2-A through 2.0-30-A]

	Section	Subject	ESBWR DCD Parameters, Considerations and/or Limits	COL Information
EF3 COL 2.0-16-A	2.4.5	Probable Maximum Surge and Seiche Flooding	Probable maximum surge and seiche flooding level does not exceed the maximum flood level defined in DCD Table 2.0-1 .	COL Item 2.0-16-A is addressed in Subsection 2.4.5 .
EF3 COL 2.0-17-A	2.4.6	Probable Maximum Tsunami Flooding	Probable maximum tsunami flooding level does not exceed the maximum flood level defined in DCD Table 2.0-1 .	COL Item 2.0-17-A is addressed in Subsection 2.4.6 .
EF3 COL 2.0-18-A	2.4.7	Ice Effects	None	COL Item 2.0-18-A is addressed in Subsection 2.4.7 .
EF3 COL 2.0-19-A	2.4.8	Cooling Water Canals and Reservoirs	None	COL Item 2.0-19-A is addressed in Subsection 2.4.8 .
EF3 COL 2.0-20-A	2.4.9	Channel Diversions	None	COL Item 2.0-20-A is addressed in Subsection 2.4.9 .
EF3 COL 2.0-21-A	2.4.10	Flooding Protection Requirements	None	COL Item 2.0-21-A is addressed in Subsection 2.4.10 .
EF3 COL 2.0-22-A	2.4.11	Cooling Water Supply	None	COL Item 2.0-22-A is addressed in Subsection 2.4.11 .
EF3 COL 2.0-23-A	2.4.12	Groundwater	Per DCD Table 2.0-1	COL Item 2.0-23-A is addressed in Subsection 2.4.12 .
EF3 COL 2.0-24-A	2.4.13	Accidental Releases of Liquid Effluents in Ground and Surface Waters	The source term provided in DCD Table 12.2-13a , "Liquid Waste Management System Equipment Drain Collection Tank Activity," is used in the effects analysis.	COL Item 2.0-24-A is addressed in Subsection 2.4.13 .

Table 2.0-2R

Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 4 of 5)

[EF3 COL 2.0-2-A through 2.0-30-A]

	Section	Subject	ESBWR DCD Parameters, Considerations and/or Limits	COL Information
EF3 COL 2.0-25-A	2.4.14	Technical Specifications and Emergency Operation Requirements	None	COL Item 2.0-25-A is addressed in Subsection 2.4.14 .
EF3 COL 2.0-26-A	2.5.1	Basic Geologic and Seismic Information	None	COL Item 2.0-26-A is addressed in Subsection 2.5.1 .
EF3 COL 2.0-27-A	2.5.2	Vibratory Ground Motion	Per DCD Table 2.0-1 (and DCD Figures 2.0-1 and 2.0-2)	The portion of COL Item 2.0-27-A to provide information in accordance with SRP 2.5.2 is addressed in Subsection 2.5.2 . Information provided in Table 2.0-201 confirms that reactor building/fuel building (RB/FB), control building (CB), and firewater service complex (FWSC) foundation input response spectra (FIRS) (developed in accordance with the guidance in DCD References 2.0-7 and 2.0-8) are enveloped by the ESBWR certified seismic design response spectra (CSDRS) referenced at foundation level.
EF3 COL 2.0-28-A	2.5.3	Surface Faulting	ESBWR design assumes no permanent ground deformation from tectonic or non-tectonic faulting.	COL Item 2.0-28-A is addressed in Subsection 2.5.3 . Information to address permanent ground deformation from tectonic or non-tectonic faulting is provided in Subsection 2.5.3 .

Table 2.0-2R

Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 5 of 5)

[EF3 COL 2.0-2-A through 2.0-30-A]

	Section	Subject	ESBWR DCD Parameters, Considerations and/or Limits	COL Information
EF3 COL 2.0-29-A	2.5.4	Stability of Subsurface Materials and Foundations	Per DCD Table 2.0-1	The portion of COL Item 2.0-29-A to provide information in accordance with SRP 2.5.4 is addressed in Subsection 2.5.4 . Information to address localized liquefaction potential under other than Seismic Category I structures is provided in Subsection 2.5.4.8 . Information to address settlements and differential settlements is provided in Subsection 2.5.4.10.2 .
EF3 COL 2.0-30-A	2.5.5	Stability of Slopes	Per DCD Table 2.0-1	COL Item 2.0-30-A is addressed in Subsection 2.5.5 .

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 1 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Part 1 – Evaluation of DCD Site Parameters			
Maximum Groundwater Level	0.61 m (2 ft) below plant grade	1.2 m (3.9 ft) below design plant grade	<p>The DCD site parameter of maximum groundwater level of 0.61 m (2 ft) below plant grade is the same as the design groundwater level in DCD Table 3.4-1. The design plant grade elevation identified in DCD Table 3.4-1 is at 4650 mm, which corresponds to 179.6 m (589.3 ft) NAVD88 for the Fermi 3 site as described in Subsection 2.1.1. Therefore, the DCD site parameter value of 0.61 m (2 ft) below plant grade corresponds to a maximum groundwater level no higher than 179.0 m (587.3 ft) NAVD88 for the Fermi 3 site.</p> <p>The Fermi 3 site characteristic value for maximum groundwater level below design plant grade is 1.2 m (3.9 ft) in the power block area based on the assumed maximum groundwater elevation of 178.4 m (585.4 ft) NAVD 88 from Subsection 2.4.12 and by reference 2.4.5.2.2.2, and the design plant grade elevation of 179.6 m (589.3 ft) NAVD 88. Therefore, the Fermi 3 site characteristic value for maximum groundwater level below design plant grade falls within (is lower than) the DCD site parameter value.</p>
Extreme Wind			
Seismic Category I, II and Radwaste Building Structures			
100-year Wind Speed (3-sec gust) ⁽¹³⁾	67.1 m/s (150 mph)	42.9 m/s (96 mph), 3-second gust	The site characteristic value for basic wind speed is defined as the 3-second gust wind speed at 10 m (33 ft) above the ground that has a 1 percent annual probability of being exceeded (100-year mean recurrence interval). The site characteristic value for basic wind speed falls within (is lower than) the DCD site parameter value.
Exposure Category D		Exposure Category C	<p>Exposure category is determined by a number of variables including wind speed, building shape and location, and surface roughness. A DCD site parameter of Exposure Category D results in the most severe design wind pressures.</p> <p>The Fermi 3 site characteristic is Exposure Category C . The Fermi 3 site characteristic falls within (is less than) the DCD site parameter value for extreme wind exposure category, i.e., Exposure Category D.</p>

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 2 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Other Seismic Category NS Standard Plant Structures			
50-year Wind Speed (3-sec gust)	58.1 m/s (130 mph)	40.2 m/s (90 mph) 3-second gust,	The Fermi 3 site characteristic value of 40.2 m/s (90 mph) for the 50-year wind speed (3-sec gust) falls within (is less than) the DCD site parameter value for the 50-year wind speed (3-sec gust) of 58.1 m/s (130 mph).
Maximum Flood (or Tsunami) Level ⁽²⁾	0.3 m (1 ft) below plant grade	1.2 m (3.9 ft) below design plant grade based on PMP	<p>The DCD site parameter of maximum flood (or tsunami) water level of 0.3 m (1 ft) below plant grade is the same as the design flood level in DCD Table 3.4-1. The design plant grade elevation identified in DCD Table 3.4-1 is at 4650 mm, which corresponds to 179.6 m (589.3 ft) NAVD 88 for the Fermi 3. Therefore, the DCD site parameter value of 0.3 m (1 ft) below plant grade corresponds to a maximum flood water level below 179.3 m (588.3 ft) for the Fermi 3 site.</p> <p>The Fermi 3 site characteristic value for PMF of 178.4 m (585.4 ft) NAVD 88 is provided in Subsection 2.4.5, and falls within (is less than) the DCD site parameter value. The Fermi 3 site characteristic value for maximum flood water level below design plant grade is due to the 100-year still-water level in addition to the 100-year storm surge. Therefore, the Fermi 3 site characteristic value for maximum flood water level below design plant grade falls within (is lower than) the DCD site parameter value.</p>
Tornado			
Maximum Tornado Wind Speed ⁽³⁾	147.5 m/s (330 mph)	102.8 m/s (230 mph)	The site characteristic value for design basis tornado maximum wind speed is defined as the maximum wind speed resulting from passage of a tornado having a probability of occurrence of 10 ⁻⁷ per year. The site characteristic value falls within (is lower than) the DCD site parameter value.
Maximum Rotational Speed	116.2 m/s (260 mph)	82.3 m/s (184 mph)	The site characteristic value for design basis tornado maximum rotational speed is defined as the rotation component of the maximum tornado wind speed. The site characteristic value falls within (is lower than) the DCD site parameter value.
Translational Speed	31.3 m/s (70 mph)	20.6 m/s (46 mph)	The site characteristic value for design basis tornado maximum translational speed is defined as the translational component of the maximum tornado wind speed. The site characteristic value falls within (is lower than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 3 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Tornado (continued)			
Radius	45.7 m (150 ft)	45.7 m (150 ft)	The site characteristic value for design basis tornado radius of maximum rotational speed is defined as the distance from the center of the tornado at which the maximum rotational wind speed occurs. The site characteristic value falls within (is the same as) the DCD site parameter value.
Pressure Drop	16.6 kPa (2.4 psi)	8.3 kPa (1.2 psi)	The site characteristic value for design basis tornado pressure drop is defined as the decrease in ambient pressure from normal atmospheric pressure resulting from passage of the tornado. The site characteristic value falls within (is lower than) the DCD site parameter value.
Rate of Pressure Drop	11.7 kPa/s (1.7 psi/s)	3.4 kPa/s (0.5 psi/s)	The site characteristic value for design basis tornado maximum rate of pressure drop is defined as the rate of pressure drop resulting from the passage of the tornado. The site characteristic value falls within (is lower than) the DCD site parameter value.
Missile Spectrum ⁽³⁾	Spectrum I of SRP 3.5.1.4, Rev. 2 applied to full building height.	Spectrum I of SRP 3.5.1.4, Rev. 2 applied to full building height	The Fermi 3 site characteristic for tornado missile spectrum is Spectrum I of SRP 3.5.1.4, Rev. 2, applied to full building height. This spectrum fully addresses variations in grade levels at the Fermi 3 site and this Fermi 3 site characteristic value falls within (is the same as) the DCD site parameter value for tornado missile spectrum.
Precipitation (for Roof Design)			
Maximum Rainfall Rate ⁽⁴⁾	49.3 cm/hr (19.4 in/hr)	43.9 cm/hr (17.3 in/hr)	The Fermi 3 site characteristic value of 43.9 cm/hr for the Maximum Rainfall Rate is less than the Maximum Rainfall Rate precipitation value provided in the DCD site parameter value.
Maximum Short Term Rate	15.7 cm (6.2 in) in 5 min	15 cm (5.8 in) in 5 min	The Fermi 3 site characteristic value for the Maximum Short Term Rate as shown in Table 2.4-202 is less than the Maximum Short Term (5 min) precipitation value provided in the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 4 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Precipitation (for Roof Design) (continued)			
Maximum Ground Snow Load for Normal Winter Precipitation Event ⁽⁵⁾	2394 Pa (50 lbf/ft ²)	1403 Pa (29.3 lbf/ft ²)	The Fermi 3 site characteristic value for maximum Ground Snow Load for Normal Winter Precipitation Event is based on site characteristic value for the 100-yr return period snow pack. The Fermi 3 site characteristic value of 1403 pa (29.3 lbf/ft ²) falls within (is lower than) the DCD site parameter value of 2394 pa (50 lbf/ft ²).
Maximum Ground Snow Load for Extreme Winter Precipitation Event ⁽⁵⁾	7757 Pa (162 lbf/ft ²)	7378 Pa (154.1 lbf/ft ²)	The site characteristic value for maximum ground snow load for Extreme Winter Precipitation Event is defined as the combined weight of the 100-year return period snowpack and the 48-hour probable maximum winter precipitation. The site characteristic value falls within (is lower than) the DCD site parameter value.
Ambient Design Temperature⁽⁶⁾			
2% Annual Exceedance Values			
Maximum	35.6°C (96°F) dry bulb 26.1°C (79°F) wet bulb (mean coincident)	29.3°C (84.7°F) dry bulb with 21.6°C (70.8°F) wet bulb (mean coincident) (2% Annual exceedance values)	The Fermi 3 site characteristic values for maximum dry-bulb temperature with mean coincident wet-bulb temperature for 2% annual exceedance are the ambient dry-bulb temperature (and mean coincident wet-bulb temperature) that will be exceeded 2% of the time annually. The site characteristic values fall within (are lower than) the DCD site parameter values.
	27.2°C (81°F) wet bulb (non-coincident)	22.8°C (73.1°F) wet bulb (non-coincident)	The Fermi 3 site characteristic value for the maximum wet bulb temperature (non-coincident) for 2% annual exceedance is defined as the ambient wet-bulb temperature that will be exceeded 2% of the time annually. This value falls within (is less than) the DCD site parameter value for 2% exceedance.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 5 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Minimum	-23.3°C (-10°F)	-14.8°C (5.3°F) (99% Annual exceedance value)	The Fermi 3 site characteristic value is the site characteristic value for the minimum dry bulb temperature for 1% annual exceedance. This value is defined as the ambient dry-bulb temperature below which dry-bulb temperatures will fall 1% of the time annually. This value falls within (is higher than) the DCD site parameter value for 2% Annual exceedance (i.e., the ambient dry-bulb temperature below which dry-bulb temperatures will fall 2% of the time annually). Because the minimum temperature site characteristic value for 2% is even higher than the 1% value, the site's 2% value also falls within (is higher than) the DCD site parameter value for 1% annual exceedance.
1% Annual Exceedance Values			
Maximum	37.8°C (100°F) dry bulb 26.1°C (79°F) wet bulb (mean coincident)	30.7°C (87.3°F) dry bulb with 22.3°C (72.2°F) wet bulb (mean coincident)	The Fermi 3 site characteristic values for the maximum dry bulb temperature with mean coincident wet bulb temperatures for 1% annual exceedance. These values are the ambient dry-bulb temperature (and mean coincident wet-bulb temperature) that will be exceeded 1 percent of the time annually. These values are 30.7°C (87.3°F) dry bulb with 22.3°C (72.2°F) wet bulb (mean coincident) and fall within (are less than) the DCD site parameter values for 1% exceedance.
Ambient Design Temperature (continued)			
1% Annual Exceedance Values (continued)			
Maximum	27.8°C (82°F) wet bulb (non-coincident)	23.8°C (74.8°F) wet-bulb (non-coincident)	The Fermi 3 site characteristic value for the maximum wet bulb temperature (non-coincident) for 0.4% annual exceedance. This value is defined as the ambient wet-bulb temperature that will be exceeded 1% of the time annually. This value is 23.8°C (74.8°F) wet bulb (non-coincident) and falls within (is less than) the DCD site parameter value for 1% Annual exceedance.
Minimum	-23.3°C (-10°F)	-14.8°C (5.3°F) (1% Annual exceedance value)	The Fermi 3 site characteristic value is the site characteristic value for the minimum dry bulb temperature for 1% annual exceedance. This value is defined as the ambient dry-bulb temperature below which dry-bulb temperatures will fall 1% of the time annually. This value falls within (is less than) the DCD site parameter value for 1% Annual exceedance.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 6 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
0% Exceedance Values			
Maximum	47.2°C (117°F) dry bulb 26.7°C (80°F) wet bulb (mean coincident)	40.1°C (104.1°F) dry-bulb with 23.3°C (73.9°F) wet bulb coincident (0% exceedance values)	The Fermi 3 site characteristic values for the 0% maximum dry bulb and wet bulb, coincident temperatures are the 100-year return period values. These values are 40.1°C (104.1°F) dry-bulb with 23.3°C (73.9°F) wet bulb coincident fall within (are less than) the DCD site parameter values for 0% exceedance.
	31.1°C (88°F) wet bulb (non-coincident)	30.0°C (86.0°F) wet-bulb (non-coincident) (0% exceedance value)	The Fermi 3 site characteristic value for the 0% maximum wet bulb temperature (non-coincident) is the 100-year return period value . This value is 30.0°C (86.0°F) wet-bulb (non-coincident) and falls within (is less than) the DCD site parameter value for 0% exceedance.
Minimum	-40°C (-40°F)	-34.9°C (-30.8°F)	The Fermi 3 site characteristic value for minimum temperature is the 100-year return period value. This value is -34.9°C (-30.8°F) and falls within (is higher than) the DCD site parameter value for 0% exceedance.
Soil Properties			
Maximum Static Bearing Demand⁽⁷⁾			
Reactor/Fuel Building	699 kPa (14,600 lbf/ft ²)	4,500 kPa (94,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable bearing capacity from Table 2.5.4-227 for the R/FB falls within (is greater than) the DCD site parameter value.
Control Building	292 kPa (6,100 lbf/ft ²)	14,029 kPa (293,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable bearing capacity from Table 2.5.4-227 for the CB falls within (is greater than) the DCD site parameter value.
Firewater Service Complex	165 kPa (3450 lbf/ft ²)	1,532 kPa (32,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable bearing capacity from Table 2.5.4-227 for the FWSC falls within (is greater than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 7 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Soil Properties (continued)			
Maximum Dynamic Bearing Demand (continued)			
Reactor/Fuel Building			
Soft	1,100 kPa (23,000 lbf/ft ²)	5,980 kPa (125,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the RB/FB structure is from Table 2.5.4-227 and falls within (is greater than) the DCD site parameter value .
Medium	2,700 kPa (56,400 lbf/ft ²)		
Hard	1,100 kPa (23,000 lbf/ft ²)		
Control Building			
Soft	500 kPa (10,500 lbf/ft ²)	18,700 kPa (391,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the CB structure is from Table 2.5.4-227 and falls within (is greater than) the DCD site parameter value .
Medium	2,200 kPa (46,000 lbf/ft ²)		
Hard	420 kPa (8,800 lbf/ft ²)		
Firewater Service Complex (FWSC)			
Soft	460 kPa (9,600 lbf/ft ²)	2100 kPa (43,000 lbf/ft ²)	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the FWSC structure is from Table 2.5.4-227 and falls within (is greater than) the DCD site parameter value .
Medium	690 kPa (14,400 lbf/ft ²)		
Hard	1,200 kPa (25,100 lbf/ft ²)		

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 8 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Soil Properties (continued)			
Minimum Shear Wave Velocity ⁽⁸⁾	300 m/s (1000 ft/s)	Value for each Seismic Category I structure: greater than 1,000 ft/sec for the reactor building/fuel building greater than 1,000 ft/sec for the control building greater than 1,000 ft/sec for the FWSC	The Fermi 3 site characteristic value for each Seismic Category I structure is based on the shear wave velocity of the supporting foundation material associated with seismic strains for lower bound soil properties at minus one sigma from the mean. The value for each structure falls within (is greater than) the DCD site parameter minimum value. As shown in Figure 2.5.4-215 and Figure 2.5.4-216 , the FB/RB, CB, and FWSC foundations are founded on uniform material. Therefore, the ratio of the largest to the smallest shear wave velocity over each mat foundation level does not exceed 1.7.
Liquefaction Potential			
Seismic Category I structures	None under footprint of Seismic Category I structures resulting from site-specific SSE	None at site-specific SSE under Seismic Category I structures	The Fermi 3 Category I structures are founded on bedrock or lean concrete and there is no potential for liquefaction under Fermi 3 Seismic Category I structures at the site-specific SSE ground motion.
Other than Seismic Category I structures	See Note (14)	See Evaluation column	Note (14) in DCD Table 2.0-1 identifies a requirement to address liquefaction potential under other than Seismic Category I structures. Subsection 2.5.4.8 provides the results of the analysis for the glacial till at the Fermi 3 site and addresses potential liquefaction under other than Seismic Category I structures. Based on the analysis provided, the glacial till is not susceptible to liquefaction.
Angle of Internal Friction	≥35 degrees	≥35 degrees	The Fermi 3 site characteristic value for angle of internal friction is provided in Subsection 2.5.4.10 and falls within (is the same as) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 9 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Backfill on sides of and underneath Seismic Category structures (not applicable if the fill material is concrete)		See Evaluation Column	The Fermi 3 site characteristic values for the backfill on the sides of Category structures are specified in Subsection 2.5.4.5.4.2 and fall within (is the same as) the DCD site parameter value. For Fermi 3, the fill material used underneath Seismic Category I structures is concrete.
i. Product of peak ground acceleration α (in g), Poisson's ratio ν and density γ	$\alpha(0.95\nu + 0.65)\gamma$: 1220 kg/m ³ (76 lbf/ft ³) maximum		
ii. Product of at-rest pressure coefficient k_0 and density:	$k_0\gamma$: 750 kg/m ³ (471 lbf/ft ³) minimum		
iii. At-rest pressure coefficient:	k_0 : 0.36 minimum		
iv. Soil density	γ : 1900 kg/m ³ (119 lbf/ft ³) minimum		

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 10 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Seismology			
SSE Horizontal Ground Response Spectra ⁽⁹⁾	See DCD Figure 2.0-1	See Figure 2.5.2-289 through Figure 2.5.2-291	The DCD site parameter values for SSE response spectra at foundation level are identified as the certified seismic design response spectra (CSDRS). The CSDRS for the control building (CB) and reactor building/fuel building (RB/FB) are shown in DCD Figure 2.0-1 (horizontal) and in DCD Figure 2.0-2 (vertical). The CSDRS for the firewater service complex (FWSC) are 1.35 times the accelerations shown in DCD Figure 2.0-1 (horizontal) and in DCD Figure 2.0-2 (vertical) per Note (9) in DCD Table 2.0-1 .
SSE Vertical Ground Response Spectra ⁽⁹⁾	See DCD Figure 2.0-2	See Figure 2.5.2-289 through Figure 2.5.2-291	The Fermi 3 site characteristic values are identified as the foundation input response spectra (FIRS). The CB FIRS are shown in Figure 2.5.2-290 . The RB/FB FIRS are shown in Figure 2.5.2-289 . The FWSC FIRS are shown in Figure 2.5.2-291 . The comparisons of the DCD site parameter (CSDRS for the CB and RB/FB) and Fermi 3 site characteristic values (FIRS for the CB and RB/FB) are provided in Figure 2.0-201 for the horizontal spectra and in Figure 2.0-202 for the vertical spectra. These comparisons demonstrate that the Fermi 3 site characteristic values fall within (are less than) the values established by the DCD site parameters. The comparisons of the DCD site parameter (CSDRS for the FWSC) and Fermi 3 site characteristic values (FIRS for the FWSC) are provided in Figure 2.0-203 for the horizontal spectra and in Figure 2.0-204 for the vertical spectra. These comparisons demonstrate that the Fermi 3 site characteristic values fall within (are less than) the values established by the DCD site parameters.
Hazards in Site Vicinity			
Site Proximity Missiles and Aircraft	< about 10 ⁻⁷ per year (for site proximity missile hazards)	No site proximity missile hazards identified	The Fermi 3 site characteristic value for site proximity missiles value is that there are no site proximity missile sources identified. As provided in Subsection 2.2.1 , there are no missile sources identified in the site vicinity and this value falls within (is less than) the DCD site parameter value.
	< about 10 ⁻⁷ per year (for aircraft hazards)	Annual aircraft crash probability of < 1 × 10 ⁻⁷ (includes civil and military aircraft)	The Fermi 3 site characteristic value for total probability per year of a civil or military aircraft crashing was estimated per NUREG-0800 as shown in Subsection 2.2.3.1.3 and the total accident probability falls within (is the same as) the DCD site parameter value except as noted for Mills Field in Subsection 2.2.3.1.3.1 .

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 11 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Hazards in Site Vicinity (continued)			
Volcanic Activity	None	No volcanic activity at the site	The Fermi 3 site characteristic value for volcanic activity is that there is no evidence of non-tectonic deformation at the site, such as volcanic intrusion, as presented in Subsection 2.5.3 . The Fermi 3 site characteristic value falls within (is the same as) the DCD site parameter value.
Toxic Gases	None*	<toxicity limits	The Fermi 3 site characteristic value for toxic gases is that the control room concentration for each chemical analyzed does not exceed the applicable toxicity limit. Based on this result, Seismic Category I Class 1E toxic gas monitoring instrumentation is not required for the MCR HVAC air intakes. The Fermi 3 site characteristic value for toxic gases (control room concentrations < toxicity limits) is presented in Subsection 6.4.5 and falls within (is the same as) the DCD site parameter value for toxic gases (control room concentrations < toxicity limits).
Required Stability of Slopes⁽¹⁰⁾			Note (10) in DCD Table 2.0-1 identifies that factors of safety for stability of slopes are not site parameters. These factors are used with slope design features to ensure stability for static and dynamic loading.
Factor of safety for static (non-seismic) loading	1.5	See Evaluation column	As described in Subsection 2.5.5 , there are no natural or man-made slopes that could adversely affect Fermi 3 Seismic Category I structures. Figure 2.4-214 and Figure 2.4-215 present ground surface contours for the existing and final site grade, and shows the site is relatively level. The foundations for all Category I structures are founded on the bedrock, or lean concrete fill that extends to the bedrock. Therefore, slope stability in the fill will not impact Category I structures
Factor of safety for dynamic (seismic) loading due to site-specific SSE	1.1	See Evaluation column	
Maximum Settlement Values for Seismic Category I Buildings⁽¹⁵⁾			
Maximum Settlement at any corner of basemat			
Under Reactor/Fuel Building	103 mm (4.0 inches)	13.2 mm (0.52 in) for the maximum settlement of a RB/FB corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the reactor building/fuel building (RB/FB) foundation is provided in Table 2.5.4-232 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 12 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Maximum Settlement Values for Seismic Category I Buildings (continued)			
Maximum Settlement at any corner of basemat (continued)			
Under Control Building	18 mm (0.7 inches)	14.2 mm (0.56 in) for the maximum settlement of a CB corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the control building (CB) foundation is provided in Table 2.5.4-232 and falls within (is less than) the DCD site parameter value.
Under FWSC Structure	17 mm (0.7 inches)	4.6 mm (0.18 in) for the maximum settlement of a FWSC corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the firewater service complex (FWSC) foundation is provided in Table 2.5.4-232 and falls within (is less than) the DCD site parameter value.
Averaged Settlement at four corners of basemat			
Under Reactor/Fuel Building	65 mm (2.6 inches)	12.2 mm (0.48 in) for the maximum settlement of a RB/FB corner	The maximum settlement of a corner for the RB/FB foundation is provided in Table 2.5.4-231 and falls within (is less than) the DCD site parameter value.
Under Control Building	12 mm (0.5 inches)	11.9 mm (0.47 in) for the maximum settlement of a CB corner	The maximum settlement of a corner for the CB foundation is provided in Table 2.5.4-231 and falls within (is less than) the DCD site parameter value.
Under FWSC Structure	10 mm (0.4 inches)	3.6 mm (0.14 in) for the maximum settlement of a FWSC corner	The maximum settlement of a corner for the FWSC foundation is provided in Table 2.5.4-231 and falls within (is less than) the DCD site parameter value.
Maximum Differential Settlement along the longest mat foundation dimension			
Within Reactor/Fuel Building	77 mm (3.0 inches)	8.6 mm (0.34 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in Table 2.5.4-232 which, as shown, falls within (is less than) the DCD site parameter value.
Within Control Building	14 mm (0.6 inches)	4.3 mm (0.17 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in Table 2.5.4-232 which, as shown, falls within (is less than) the DCD site parameter value.
Under FWSC Structure	12 mm (0.5 inches)	1.8 mm (0.07 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in Table 2.5.4-232 which, as shown, falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 13 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Maximum Settlement Values for Seismic Category I Buildings (continued)			
Maximum Differential Displacement between Reactor/Fuel Buildings and Control Building			
	85 mm (3.3 inches)	9.4 mm (0.37 in)	The Fermi 3 site characteristic value for the maximum differential displacement between the RB/FB foundation and the CB foundation is provided in Table 2.5.4-232 which, as shown, falls within (is less than) the DCD site parameter value.
Meteorological Dispersion (X/Q)⁽¹¹⁾			
EAB X/Q			
0–2 hours	2.00E-03 s/m ³	3.66E-04 s/m ³	The site characteristic value for short-term (accident release) atmospheric dispersion for 0–2 hr X/Q value at the EAB is defined as the 0–2 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the EAB. The site characteristic value falls within (is lower than) the DCD site parameter value.
LPZ X/Q			
0–8 hours	1.90E-04 s/m ³	3.23E-05 s/m ³	The site characteristic value for short-term (accident release) atmospheric dispersion for 0–8 hr X/Q value at the LPZ is defined as the 0–8 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.
8–24 hours	1.40E-04 s/m ³	2.23E-05 s/m ³	The site characteristic value for short-term (accident release) atmospheric dispersion for 8–24 hr X/Q value at the LPZ is defined as the 8–24 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.
1–4 days	7.50E-05 s/m ³	9.95E-06 s/m ³	The site characteristic value for short-term (accident release) atmospheric dispersion for 1–4 day X/Q value at the LPZ is defined as the 1–4 day atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 14 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
4–30 days	3.00E-05 s/m ³	3.13E-06 s/m ³	The site characteristic value for short-term (accident release) atmospheric dispersion for 4–30 day X/Q value at the LPZ is defined as the 4–30 day atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.
Control Room X/Q ^{*(17)}			Control Room X/Q values shown on the same row in DCD Table 2.0-1 are in sets below: first a set for unfiltered inleakage, followed by a set for air intakes (emergency and normal).
* First value is for unfiltered inleakage. Second value is for air intakes (emergency and normal).			
Reactor Building			
Unfiltered inleakage			
0–2 hours	1.90E-03 s/m ³	1.69E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value
2–8 hours	1.30E-03 s/m ³	1.19E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	5.90E-04 s/m ³	4.56E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	5.00E-04 s/m ³	3.57E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	4.40E-04 s/m ³	2.70E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Air intakes (maximum of emergency and normal)			
0–2 hours	1.50E-03 s/m ³	1.22E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	1.10E-03 s/m ³	8.93E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 15 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q ⁽¹⁷⁾ (continued)			
Reactor Building – (continued)			
Air intakes (maximum of emergency and normal) (continued)			
8–24 hours	5.00E-04 s/m ³	3.46E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	4.20E-04 s/m ³	2.75E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	3.80E-04 s/m ³	2.20E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Passive Containment Cooling System/Reactor Building Roof			
Unfiltered inleakage			
0–2 hours	3.40E-03 s/m ³	1.83E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	2.70E-03 s/m ³	1.29E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.40E-03 s/m ³	4.48E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m ³	3.11E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	7.90E-04 s/m ³	2.68E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Air intakes (maximum of emergency and normal)			
0–2 hours	3.00E-03 s/m ³	1.45E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 16 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q ⁽¹⁷⁾ (continued)			
Passive Containment Cooling System/Reactor Building Roof (continued)			
Air intakes (maximum of emergency and normal) (continued)			
2–8 hours	2.50E-03 s/m ³	1.14E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.20E-03 s/m ³	4.06E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	9.00E-04 s/m ³	3.11E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	7.00E-04 s/m ³	2.94E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Blowout Panels/Reactor Building Roof			
Unfiltered inleakage			
0–2 hours	7.00E-03 s/m ³	2.37E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	5.00E-03 s/m ³	1.89E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 days	2.10E-03 s/m ³	7.13E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	1.70E-03 s/m ³	6.54E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	1.50E-03 s/m ³	5.67E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 17 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q ⁽¹⁷⁾ (continued)			
Blowout Panels/Reactor Building Roof (continued)			
Air intakes (maximum of emergency and normal)			
0–2 hours	5.90E-03 s/m ³	2.27E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	4.70E-03 s/m ³	1.77E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 days	1.50E-03 s/m ³	6.30E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m ³	5.47E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m ³	5.48E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Turbine Building			
Unfiltered inleakage			
0–2 hours	1.20E-03 s/m ³	5.99E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	9.80E-04 s/m ³	3.27E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	3.90E-04 s/m ³	1.35E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	3.80E-04 s/m ³	9.62E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	3.20E-04 s/m ³	8.34E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 18 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q ⁽¹⁷⁾ (continued)			
Turbine Building (continued)			
Air intakes (maximum of emergency and normal)			
0–2 hours	1.20E-03 s/m ³	7.43E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	9.80E-04 s/m ³	4.05E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	3.90E-04 s/m ³	1.65E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	3.80E-04 s/m ³	1.18E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	3.20E-04 s/m ³	9.87E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Fuel Building			
Unfiltered inleakage			
0–2 hours	2.80E-03 s/m ³	2.70E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value
2–8 hours	2.50E-03 s/m ³	2.28E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.25E-03 s/m ³	9.11E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 19 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q (continued)			
Fuel Building (continued)			
Unfiltered inleakage (continued)			
1–4 days	1.10E-03 s/m ³	8.20E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m ³	7.18E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Air intakes (maximum of normal and emergency)			
0–2 hours	2.80E-03 s/m ³	2.23E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value
2–8 hours	2.50E-03 s/m ³	1.88E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.25E-03 s/m ³	7.48E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m ³	6.22E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m ³	5.59E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Radwaste Building Unfiltered inleakage			
The PCCS vent X/Q values are assumed to bound the X/Q values for any release from the RW Building based on distance and direction to the CR receptors, and the PCCS vent X/Q values are used to evaluate releases from the RW Building in the DCD (Section 15.3.16). The PCCS X/Q values are compared to the RW Building X/Q results.			
0–2 hours	3.40E-03 s/m ³	1.83E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 20 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Control Room X/Q (continued)			
Radwaste Building (continued)			
Unfiltered inleakage (continued)			
2–8 hours	2.70E-03 s/m ³	1.29E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.40E-03 s/m ³	4.48E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m ³	3.11E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	7.90E-04 s/m ³	2.68E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Air Intakes (maximum of normal and emergency)			
0–2 hours	3.00E-03 s/m ³	1.45E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	2.50E-03 s/m ³	1.14E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	1.20E-04 s/m ³	4.06E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	9.00E-04 s/m ³	3.11E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	7.00E-04 s/m ³	2.94E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 21 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Reactor Building ⁽¹⁷⁾			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	1.00E-03 s/m ³	2.73E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	6.00E-04 s/m ³	2.28E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	3.00E-04 s/m ³	9.48E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	2.00E-04 s/m ³	8.06E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-04 s/m ³	6.78E-05 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Turbine Building ⁽¹⁷⁾			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	2.00E-03 s/m ³	1.65E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	1.50E-03 s/m ³	1.09E-03 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	8.00E-04 s/m ³	4.35E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	6.00E-04 s/m ³	3.84E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	5.00E-04 s/m ³	3.10E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 22 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Meteorological Dispersion (X/Q) (continued)			
Passive Containment Cooling System/Reactor Building Roof ⁽¹⁷⁾			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	2.00E-03 s/m ³	4.65E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
2–8 hours	1.10E-03 s/m ³	3.58E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
8–24 hours	5.00E-04 s/m ³	1.40E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
1–4 days	4.00E-04 s/m ³	1.19E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
4–30 days	3.00E-04 s/m ³	1.00E-04 s/m ³	The Fermi 3 site characteristic value is provided in Table 2.3-303 and falls within (is less than) the DCD site parameter value.
Long Term Dispersion Estimates⁽¹²⁾			
X/Q	3.0E-07 s/m ³	The site characteristic values for long term (routine release) atmospheric dispersion estimates are based on the maximally exposed individual (MEI) for each pathway.	The site characteristic values for long term (routine release) atmospheric dispersion estimates are defined based on type of sensitive receptor (MEI) and decay time. Each of these values is compared with the appropriate DCD site parameter value, X/Q or D/Q, below. Each site characteristic value that is equal to or less than the DCD site parameter value results in a lower estimated dose for the same source term, and conversely, a higher X/Q or D/Q results in a higher estimated dose.
RB/FB Vent Stack	2.0E-07 s/m ³		
TB Vent Stack	2.0E-05 s/m ³		
RWB Vent Stack			

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
D/Q			
RB/FB Vent Stack	1.0E-08 m ⁻²	The characteristic values assume conservatively, that each sensitive receptor (meat animal, vegetable garden, residence) is at the location of the closest receptor.	As shown below, every site characteristic value does not fall within (some are greater than) the DCD site parameter value. Per Note (12) of DCD Table 2.0-1 , if a site-specific X/Q value exceeds the site parameter value, the release concentrations in DCD Table 12.2-17 must be adjusted proportionate to the change in X/Q values using the stack release information in DCD Table 12.2-16 to show the 10 CFR 20 limits are met; and the annual average doses in DCD Table 12.2-18b must be changed to show the 10 CFR 50 Appendix I doses are met. Per DCD COL Item 12.2-2-A, calculation bases in DCD Tables 12.2-15 and 12.2-18a are replaced with site-specific values for calculation of airborne concentrations and doses. Table 12.2-15R and identify the replacement DCD information. This table identifies that there are Fermi 3 site characteristic values that do not fall within (are greater than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
TB Vent Stack	6.0E-09 m ⁻²		
RWB Vent Stack	3.0E-08 m ⁻²		
Site Boundary Annual Average			
X/Q			
RB/FB Vent Stack	3.0E-07 s/m ³	5.0 × 10 ⁻⁷ s/m ³	The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary undepleted/no decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in Table 2.3-307 , Table 2.3-308 and Table 2.3-309 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
TB Vent Stack	2.0E-07 s/m ³	5.5 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	9.3 × 10 ⁻⁶ s/m ³ undepleted/no decay	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 24 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
Site Boundary Annual Average (continued)			
X/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary undepleted/2.26-day decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in Table 2.3-307 , Table 2.3-308 and Table 2.3-309 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	5.0 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.5 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	9.3 × 10 ⁻⁶ s/m ³ undepleted/2.26-day	
X/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary depleted/8.00-day decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in Table 2.3-307 , Table 2.3-308 and Table 2.3-309 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	4.7 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.1 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	8.3 × 10 ⁻⁶ s/m ³ depleted/8.00-day decay	
D/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary D/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in Table 2.3-307 , Table 2.3-308 and Table 2.3-309 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	1.4 × 10 ⁻⁸ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	1.3 × 10 ⁻⁸ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	3.5 × 10 ⁻⁸ 1/m ²	
Annual Average Nearest Residence			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-310 , Table 2.3-311 and Table 2.3-312 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.8 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.0 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.9 × 10 ⁻⁶ s/m ³ undepleted/no decay	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 25 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
Annual Average Nearest Residence (continued)			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-310 , Table 2.3-311 and Table 2.3-312 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.8 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.0 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.9 × 10 ⁻⁶ s/m ³ undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-310 , Table 2.3-311 and Table 2.3-312 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.6 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	3.7 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.3 × 10 ⁻⁶ s/m ³ depleted/8.00-day decay,	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-310 , Table 2.3-311 and Table 2.3-312 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	1.1 × 10 ⁻⁸ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	9.9 × 10 ⁻⁹ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	2.5 × 10 ⁻⁸ 1/m ²	
Annual Average Nearest Meat Animal			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-322 , Table 2.3-323 and Table 2.3-324 . The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	4.8 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.1 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	1.9 × 10 ⁻⁷ s/m ³ undepleted/no decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-322 , Table 2.3-323 and Table 2.3-324 . The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	4.7 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.1 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	1.9 × 10 ⁻⁷ s/m ³ undepleted/2.26-day decay	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 26 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
Annual Average Nearest Meat Animal (continued)			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-322 , Table 2.3-323 and Table 2.3-324 . The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	4.3 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	3.6 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	1.4 × 10 ⁻⁷ s/m ³ depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-322 , Table 2.3-323 and Table 2.3-324 . The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	3.0 × 10 ⁻¹⁰ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	2.9 × 10 ⁻¹⁰ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	6.0 × 10 ⁻¹⁰ 1/m ²	
Annual Average Nearest Garden			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-313 , Table 2.3-314 and Table 2.3-315 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.8 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.0 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.6 × 10 ⁻⁶ s/m ³ undepleted/no decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-313 , Table 2.3-314 and Table 2.3-315 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.8 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.0 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.6 × 10 ⁻⁶ s/m ³ undepleted/2.26-day decay	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 27 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
Annual Average Nearest Garden (continued)			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in Table 2.3-313 , Table 2.3-314 and Table 2.3-315 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	3.6 × 10 ⁻⁷ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	3.7 × 10 ⁻⁷ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	4.1 × 10 ⁻⁶ s/m ³ depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate taken is provided in Table 2.3-313 , Table 2.3-314 and Table 2.3-315 . The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	1.1 × 10 ⁻⁸ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	9.8 × 10 ⁻⁹ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	2.5 × 10 ⁻⁸ 1/m ²	
Annual Average Nearest Milk Cow			
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-325 , Table 2.3-326 and Table 2.3-327 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	6.7 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.8 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	3.0 × 10 ⁻⁷ s/m ³ undepleted/no decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-325 , Table 2.3-326 and Table 2.3-327 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	6.6 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.8 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	2.9 × 10 ⁻⁷ s/m ³ undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-325 , Table 2.3-326 and Table 2.3-327 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	6.1 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.3 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	2.4 × 10 ⁻⁷ s/m ³ depleted/8.00-day decay	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 28 of 28)

[EF3 COL 2.0-1-A]

Subject ⁽¹⁶⁾	DCD Site Parameter Value ⁽¹⁾⁽¹⁶⁾	Fermi 3 Site Characteristic	Evaluation
Long Term Dispersion Estimates (continued)			
Annual Average Nearest Milk Cow (continued)			
D/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-325 , Table 2.3-326 and Table 2.3-327 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	8.7 × 10 ⁻¹⁰ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	8.3 × 10 ⁻¹⁰ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	1.5 × 10 ⁻⁹ 1/m ²	
Annual Average Nearest Milk Goat			
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-319 , Table 2.3-320 and Table 2.3-321 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	6.1 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.4 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	2.6 × 10 ⁻⁷ s/m ³ undepleted/no decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-319 , Table 2.3-320 and Table 2.3-321 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	6.1 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	5.3 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m ³	2.6 × 10 ⁻⁷ s/m ³ undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-319 , Table 2.3-320 and Table 2.3-321 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	3.0E-07 s/m ³	5.6 × 10 ⁻⁸ s/m ³	
TB Vent Stack	2.0E-07 s/m ³	4.8 × 10 ⁻⁸ s/m ³	
RWB Vent Stack	2.0E-05 s/m	2.2 × 10 ⁻⁷ s/m ³ depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in Table 2.3-319 , Table 2.3-320 and Table 2.3-321 . The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See Section 12.2 for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.0E-08 m ⁻²	7.7 × 10 ⁻¹⁰ 1/m ²	
TB Vent Stack	6.0E-09 m ⁻²	7.4 × 10 ⁻¹⁰ 1/m ²	
RWB Vent Stack	3.0E-08 m ⁻²	1.4 × 10 ⁻⁹ 1/m ²	

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Notes) (Sheet 1 of 2)

[EF3 COL 2.0-1-A]

1. The site parameters defined in this table are applicable to Seismic Category I, II, and Radwaste Building structures, unless noted otherwise.
2. Probable maximum flood level (PMF), as defined in Table 1.2-6 of Volume III of [DCD Reference 2.0-4](#).
3. Maximum speed selected is based on Attachment I of [DCD Reference 2.0-5](#), which summarizes the NRC Interim Position on RG 1.76. Concrete structures designed to resist Spectrum I missiles of SRP 3.5.1.4, Rev. 2, will also resist missiles postulated in RG 1.76, Revision 1. Tornado missiles do not apply to Seismic Category II buildings. For the Radwaste building, the tornado missiles defined in Regulatory Guide 1.143, Table 2, Class RW-IIa apply.
4. Based on probable maximum precipitation (PMP) for one hour over 2.6 km² (one square mile) with a ratio of 5 minutes to one hour PMP of 0.32 as found in [DCD Reference 2.0-3](#). See also [DCD Table 3G.1-2](#).
5. See DCD Reference 2.0-9 for the definition of normal winter precipitation and extreme winter precipitation events. The maximum ground snow load for extreme winter precipitation event includes the contribution from the normal winter precipitation event. See also DCD Table 3G.1-2.
6. Zero percent exceedance values are based on conservative estimates of historical high and low values for potential sites. They represent historical limits excluding peaks of less than one hour: which are conservative relative to DCD Reference 2.0-4. One and two percent exceedance values were selected in order to bound the values presented in [DCD Reference 2.0-4](#) and available Early Site Permit applications.
7. At the foundation level of Seismic Category I structures. The static bearing pressure is the average pressure. The dynamic bearing pressure is the toe pressure. To compare with the maximum bearing demand, the allowable bearing pressure is developed from the site-specific bearing capacity divided by a factor of safety appropriate for the design load combination. The maximum dynamic bearing demand to be compared with the site-specific allowable dynamic bearing pressure is the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level. The shear wave velocities of soft, medium and hard soils are 300 m/sec (1000 ft/sec), 800 m/sec (2600 ft/sec) and greater than or equal to 1700 m/sec (5600 ft/sec), respectively.
8. This is the minimum shear wave velocity of the supporting foundation material associated with seismic strains for lower bound soil properties at minus one sigma from the mean. The ratio of the largest to the smallest shear wave velocity over the mat foundation width of the supporting foundation material does not exceed 1.7.
9. Safe Shutdown Earthquake (SSE) design ground response spectra of 5% damping, also termed Certified Seismic Design Response Spectra (CSDRS), are defined as free-field outcrop spectra at the foundation level (bottom of the base slab) of the Reactor/Fuel and Control Building structures. For the Firewater Service Complex, which is essentially a surface founded structure, the CSDRS is 1.35 times the values shown in DCD Figures 2.0-1 and 2.0-2 and is defined as free-field outcrop spectra at the foundation level (bottom of the base slab) of the Firewater Service Complex structure.
10. Values reported here are actually design criteria rather than site parameters. They are included here because they don't appear elsewhere in the DCD.
11. If a selected site has a X/Q value that exceeds the ESBWR reference site value, the COL applicant will address how the radiological consequences associated with the controlling design basis accident continue to meet the dose reference values provided in 10 CFR 52.79(a)(1)(vi) and control room operator dose limits provided in General Design Criterion 19 using site-specific X/Q values.

Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Notes) (Sheet 2 of 2)

[EF3 COL 2.0-1-A]

12. If a selected site has a X/Q value that exceeds the ESBWR reference site value, the release concentrations in [DCD Table 12.2-17](#) would be adjusted proportionate to the change in X/Q values using the stack release information in [DCD Table 12.2-16](#). In addition, for a site selected that exceeds the bounding X/Q or D/Q values, the COL applicant will address how the resulting annual average doses ([DCD Table 12.2-18b](#)) continue to meet the dose reference values provided in 10 CFR 50 Appendix I using site-specific X/Q and D/Q values.
13. Value was selected to comply with expected requirements of southeastern coastal locations.
14. Localized liquefaction potential under other than Seismic Category I structures is addressed per SRP 2.5.4 in [DCD Table 2.0-2](#).
15. Settlement values are long-term (post-construction) values except for differential settlement within the foundation mat. The design of the foundation mat accommodates immediate and long-term (post-construction) differential settlements after the installation of the basemat.
16. Information in this column and notes (1) through (15) are from [DCD Table 2.0-1](#). In these notes, "DCD" was added before cited tables, figures, and references from the DCD.
17. **[START COM 2.3-204]** The atmospheric dispersion factors (X/Qs) calculated for the Control Room and Technical Support Center using ARCON96 are currently under revision as part of the effort described in Detroit Edison letter NRC3-10-003, dated February 8, 2010. Detroit Edison will provide the COLA revision to reflect the new atmospheric dispersion factors (X/Qs) calculated for the Control Room and Technical Support Center under separate correspondence to the NRC by March 25, 2010. **[END COM 2.3-204]**

Figure 2.0-201 Comparison of Horizontal CSDRS with the Unit 3 FIRS for the R/FB and CB [EF3 COL 2.0-1-A]

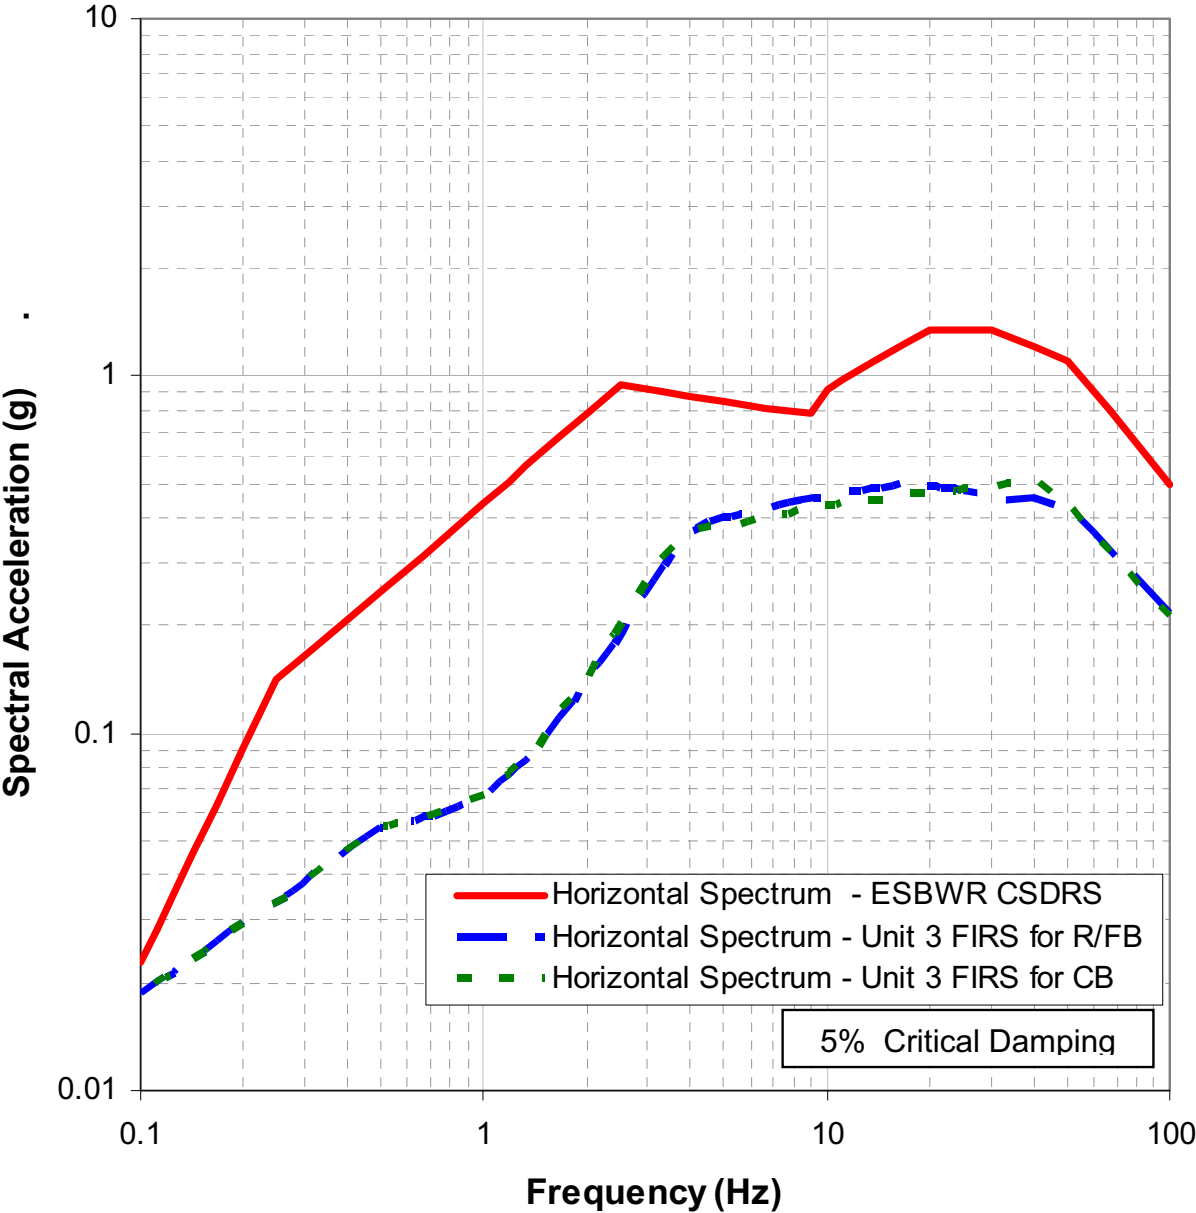


Figure 2.0-202 Comparison of Vertical CSDRS with the Unit 3 FIRS for the R/FB and CB [EF3 COL 2.0-1-A]

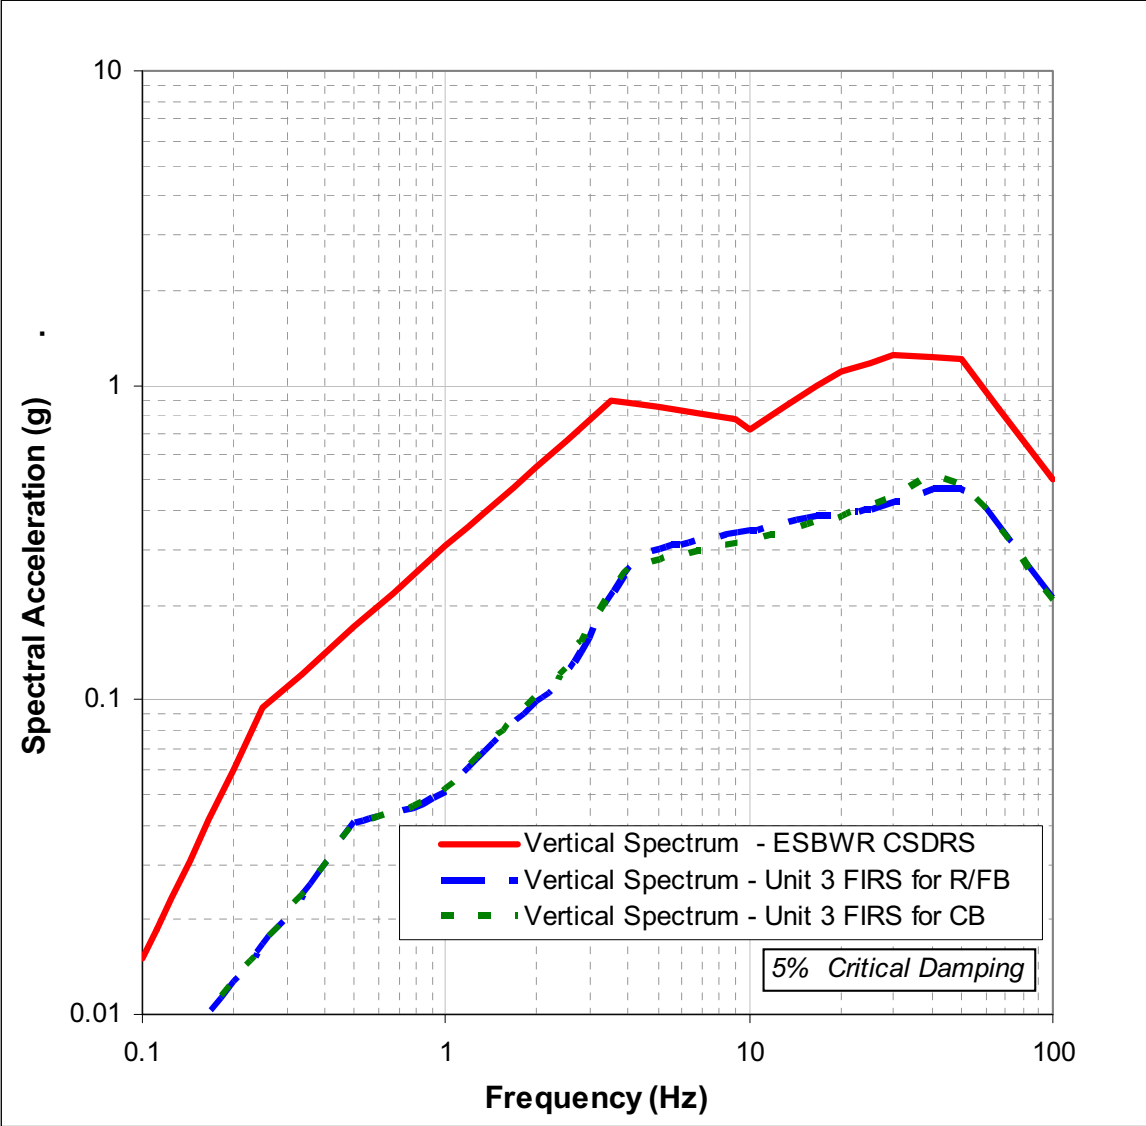


Figure 2.0-203 Comparison of Horizontal CSDRS with the Unit 3 FIRS for the FWSC [EF3 COL 2.0-1-A]

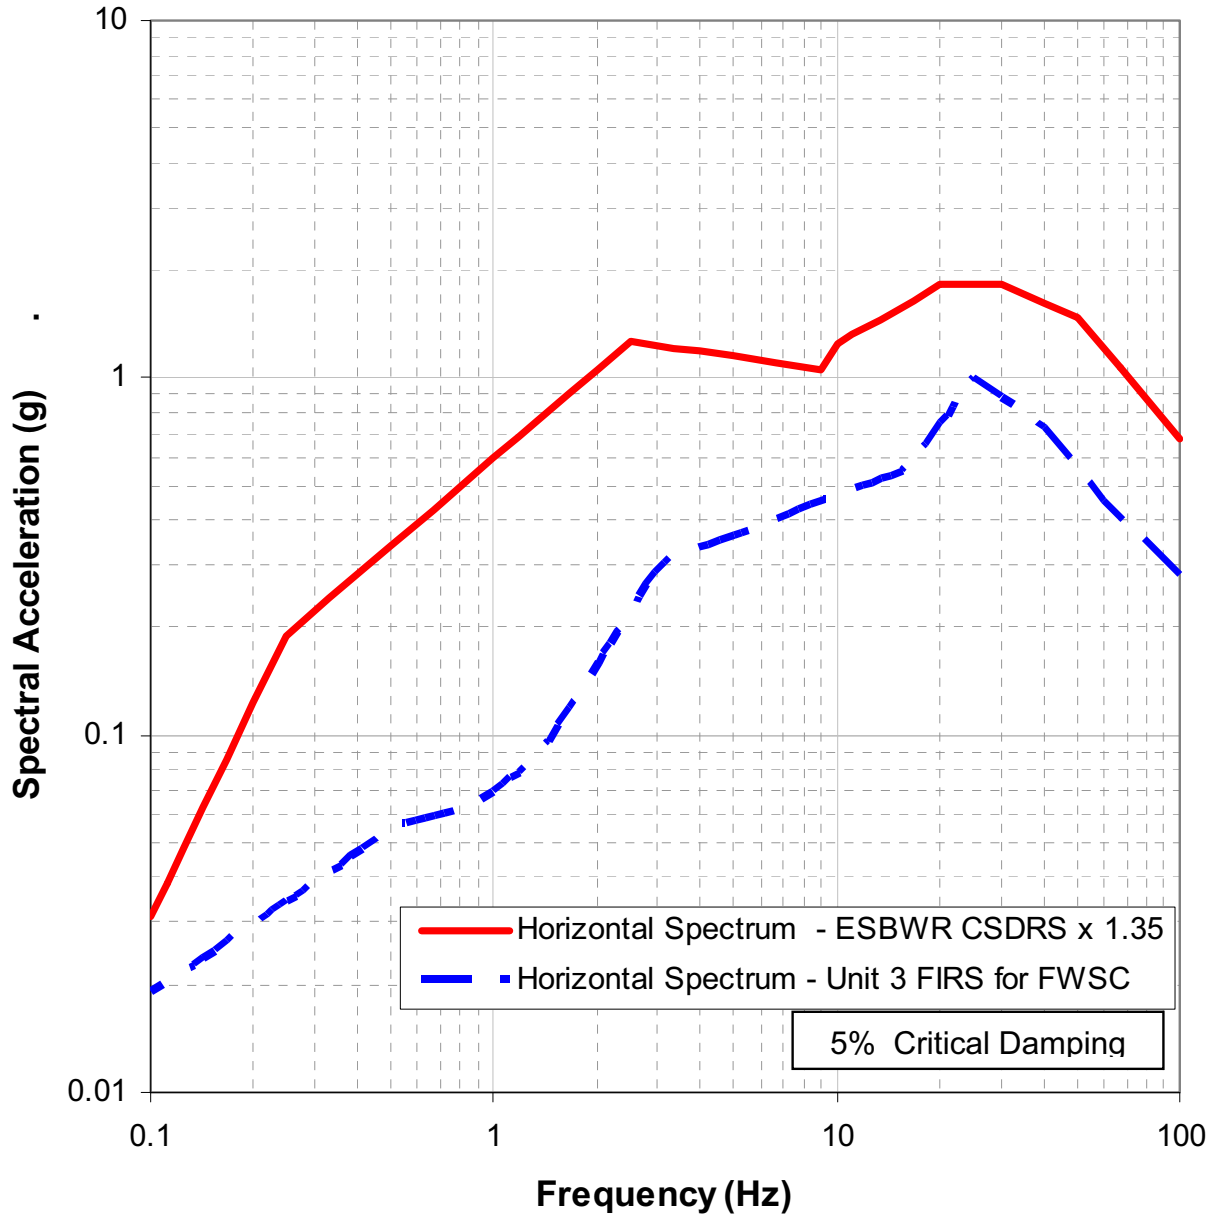


Figure 2.0-204 Comparison of Vertical CSDRS with the Unit 3 FIRS for the FWSC [EF3 COL 2.0-1-A]

