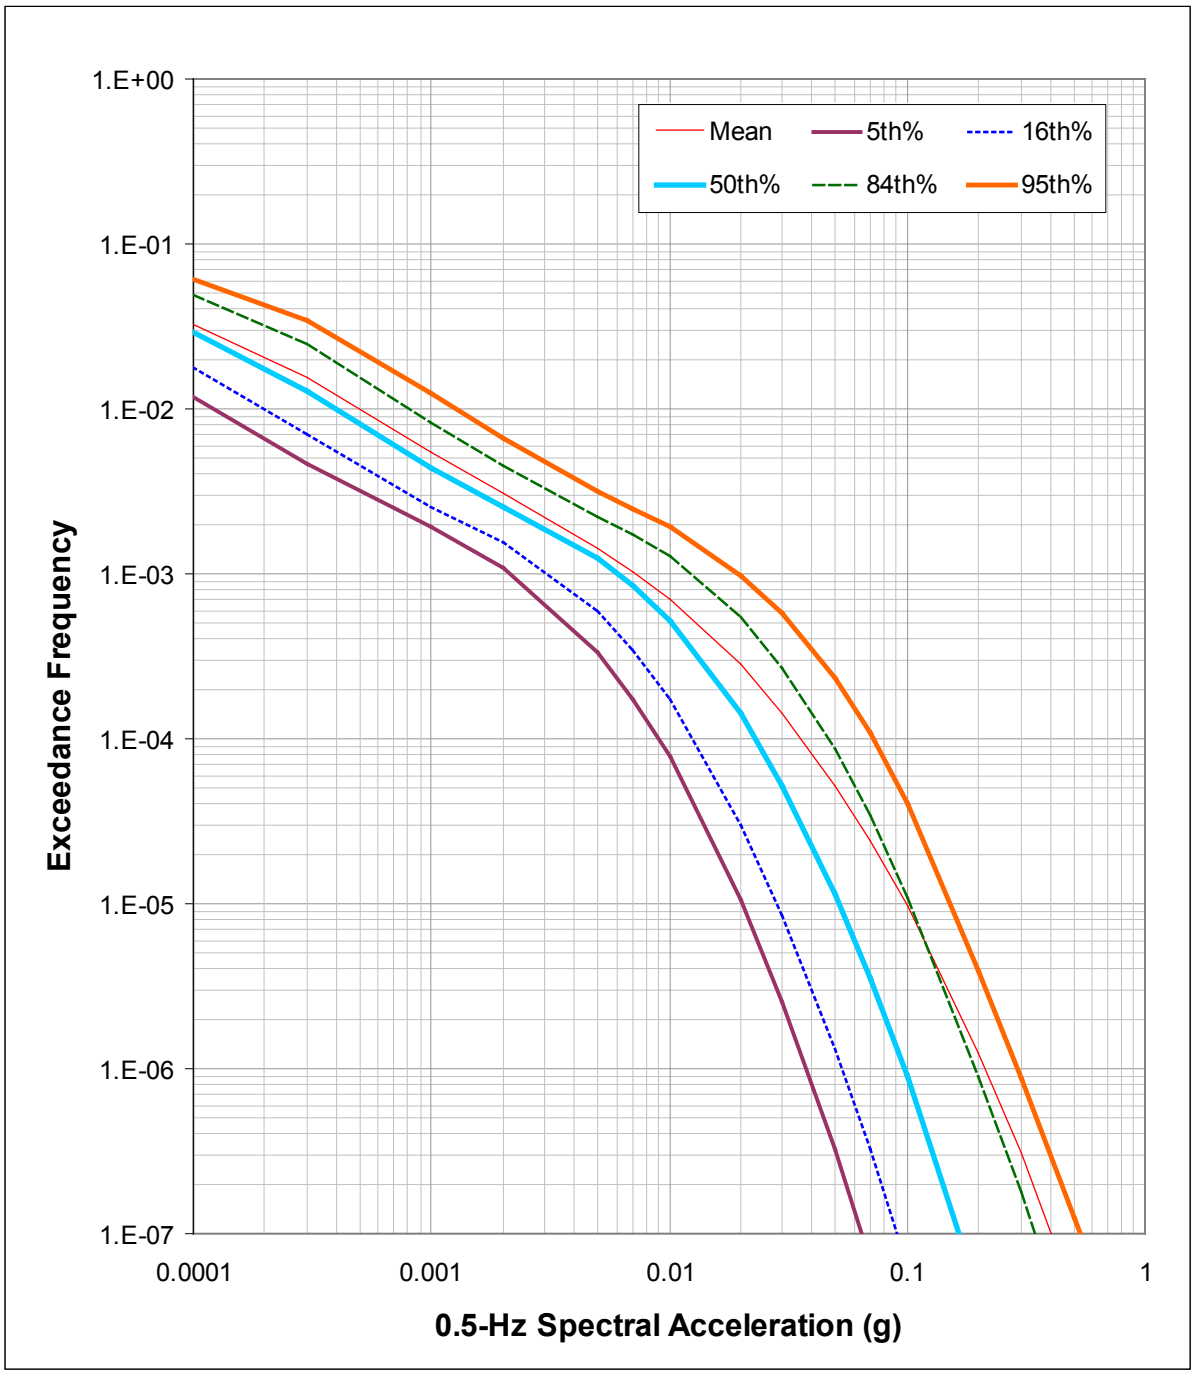

Progress Energy Carolinas

Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 2, Final Safety Analysis Report

New Hill, North Carolina

Generic CEUS Hard Rock Hazard Results for 0.5-Hz Spectral Accelerations for the HAR Site
FIGURE 2.5.2-230

Rev. 0