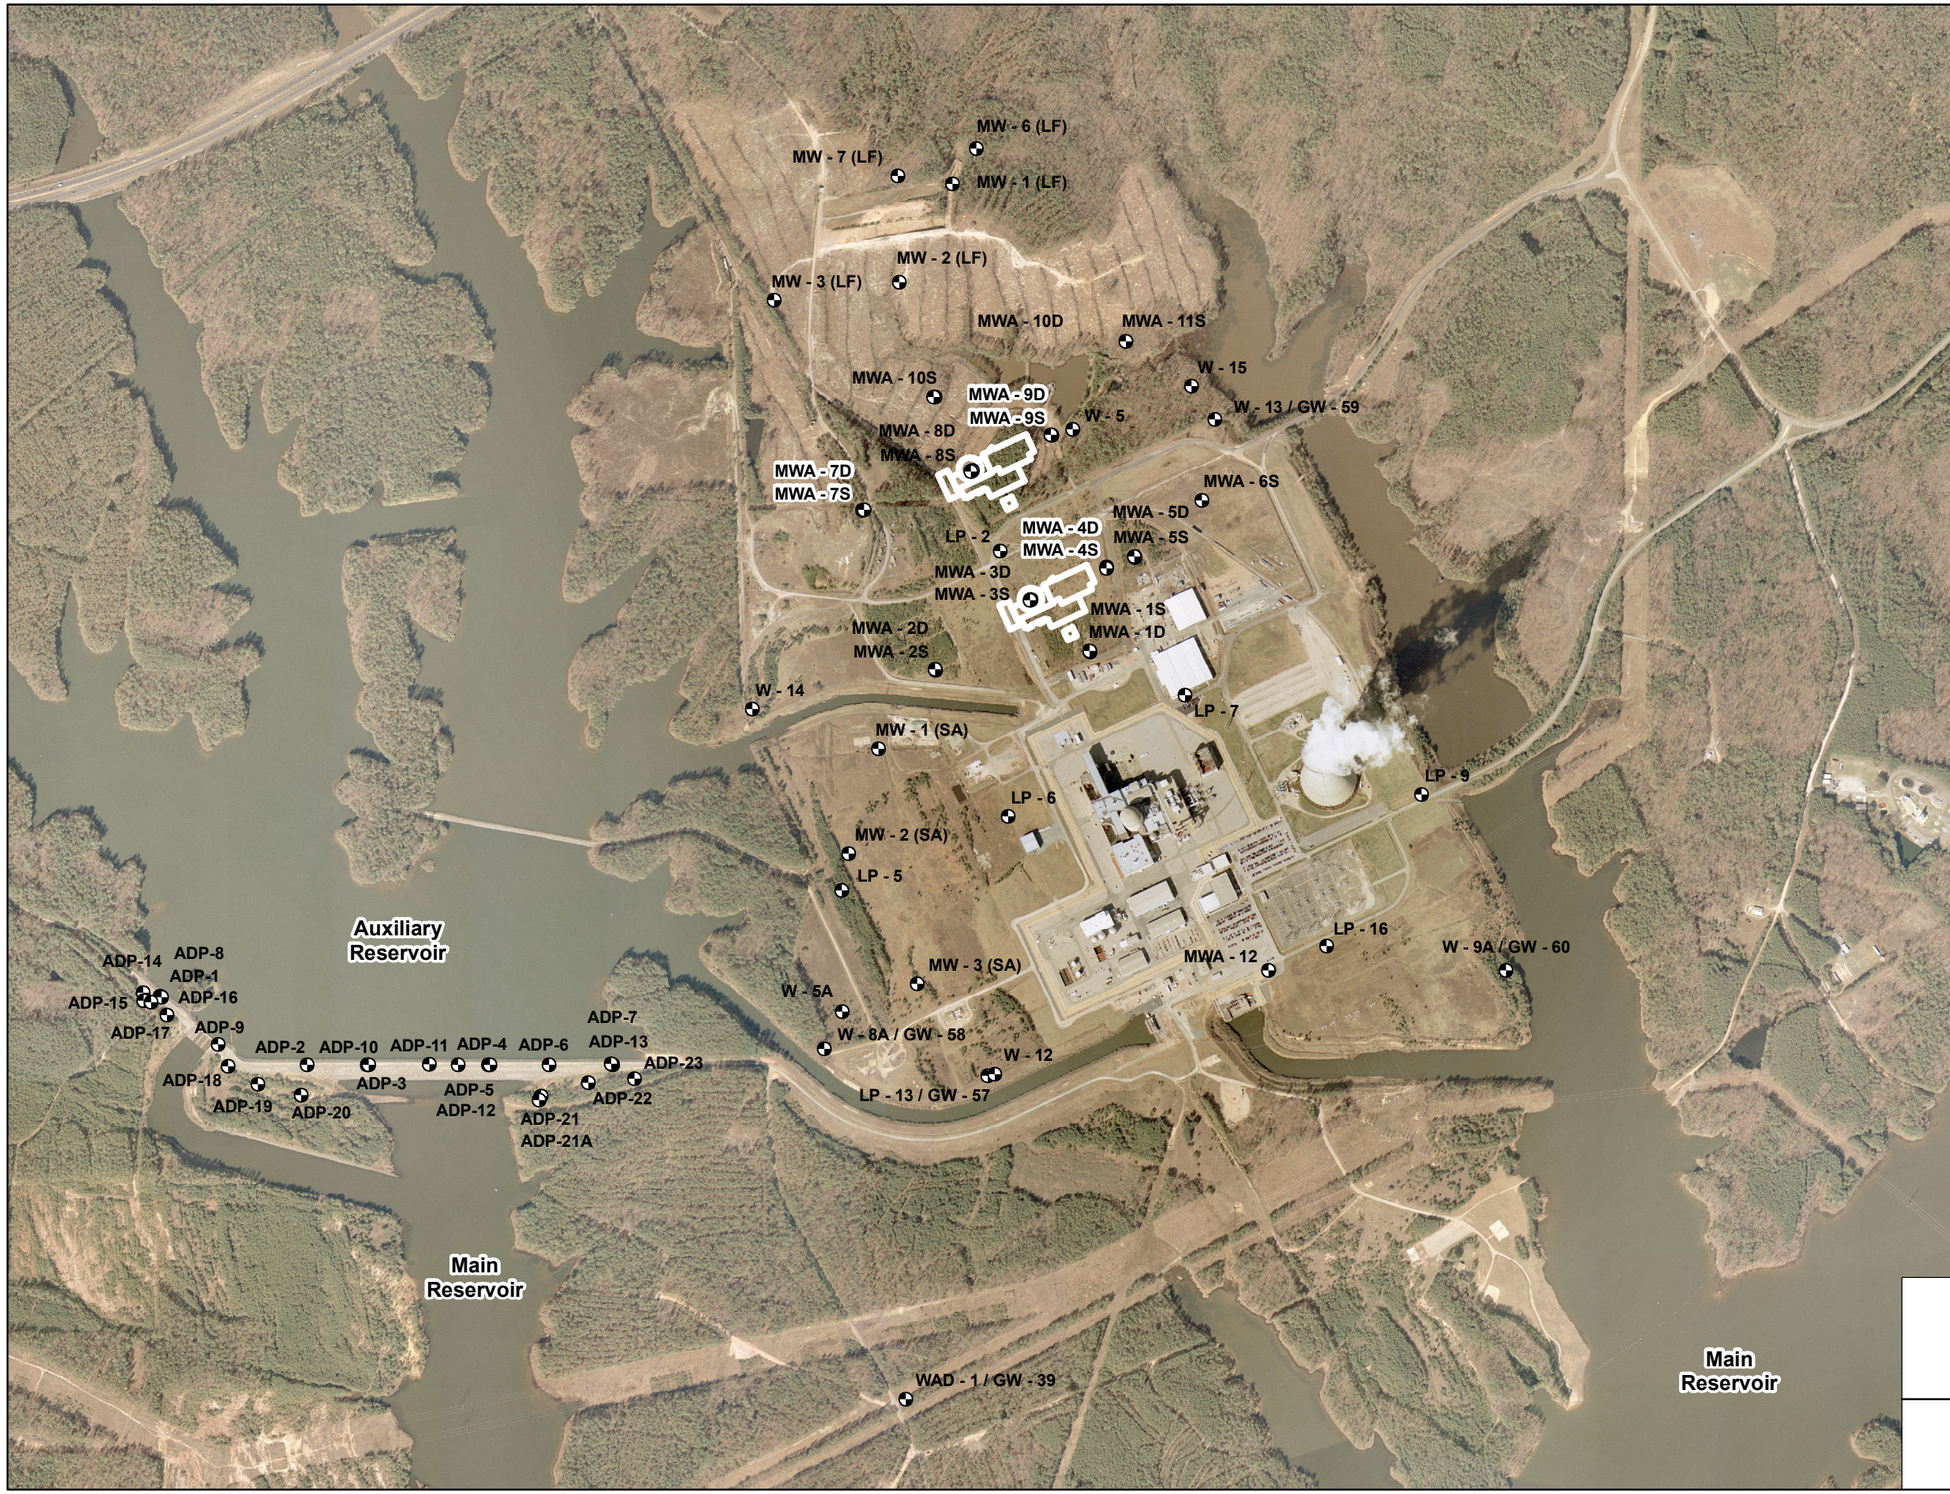

N
W E
S

LEGEND

HNP Monitoring Wells and Piezometers

Proposed Safety-Related Structures

Note:

1) Main Reservoir normal pool elevation is 220 feet NGVD29

2) Auxiliary Reservoir normal pool elevation is 252 feet NGVD29

0 125 250 375 500
Meters

0 500 1,000 1,500 2,000
Feet

Progress Energy Carolinas

Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 3, Environmental Report

New Hill, North Carolina

Pre-Application Water Quality
Groundwater Sampling Locations
FIGURE 6.6-1

Rev 0