


Palisades Nuclear Plant NRC Safety Performance Assessment Meeting

Date: May 11, 2010





2010

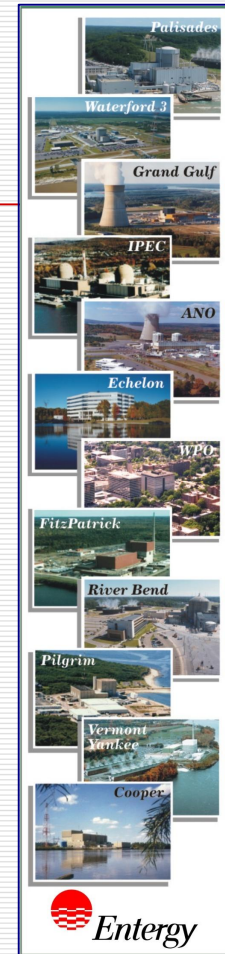

Plant Status

- ❑ 100% Power
- ❑ 375 days online
- ❑ Refuel Outage October 2010

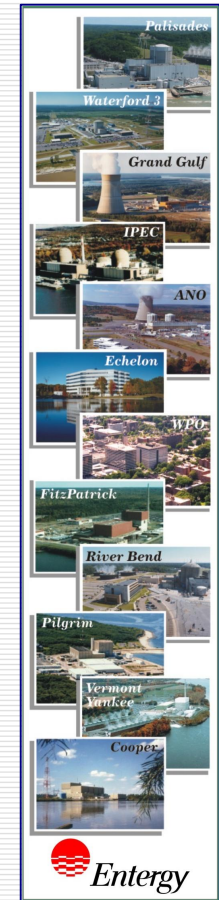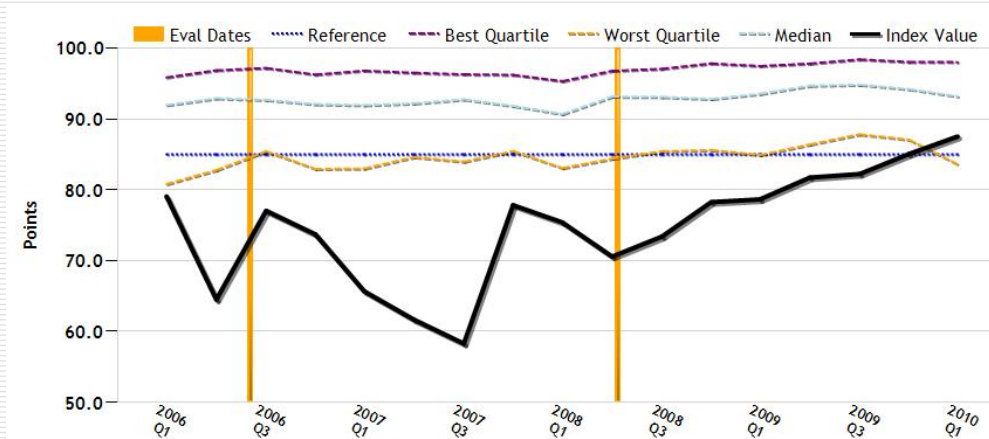


2010



Continued Commitment:

- Palisades Five Focus Areas
 - Alignment
 - Operational Focus
 - Equipment Reliability
 - Human Performance
 - Outage Performance

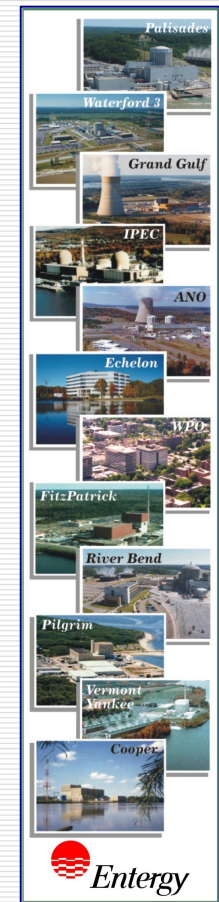


2010



Human Performance

- 2008 White finding (closed in 2009)
Occupational Radiation Safety
Cornerstone
- Closed cross cutting issues
 - Procedure Adequacy
 - Work Planning

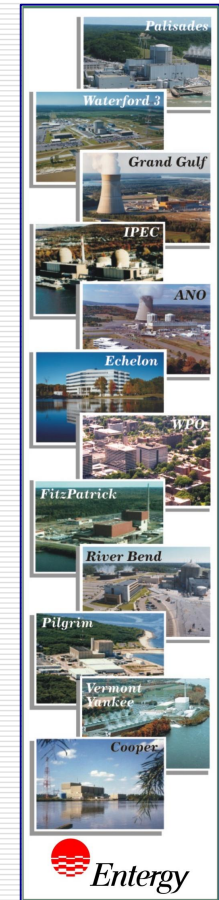


2010



□ 2009 White Finding

- Degradation of the neutron absorption capability of the Spent Fuel Pool plates
 - Promptly restored design basis margin
 - Root cause evaluation completed to identify any necessary additional corrective actions

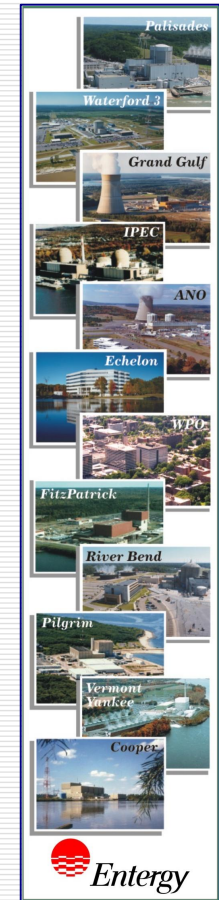

2010



- Security Upgrades
- Emergency Planning Improvements
- Discovery of tritium

