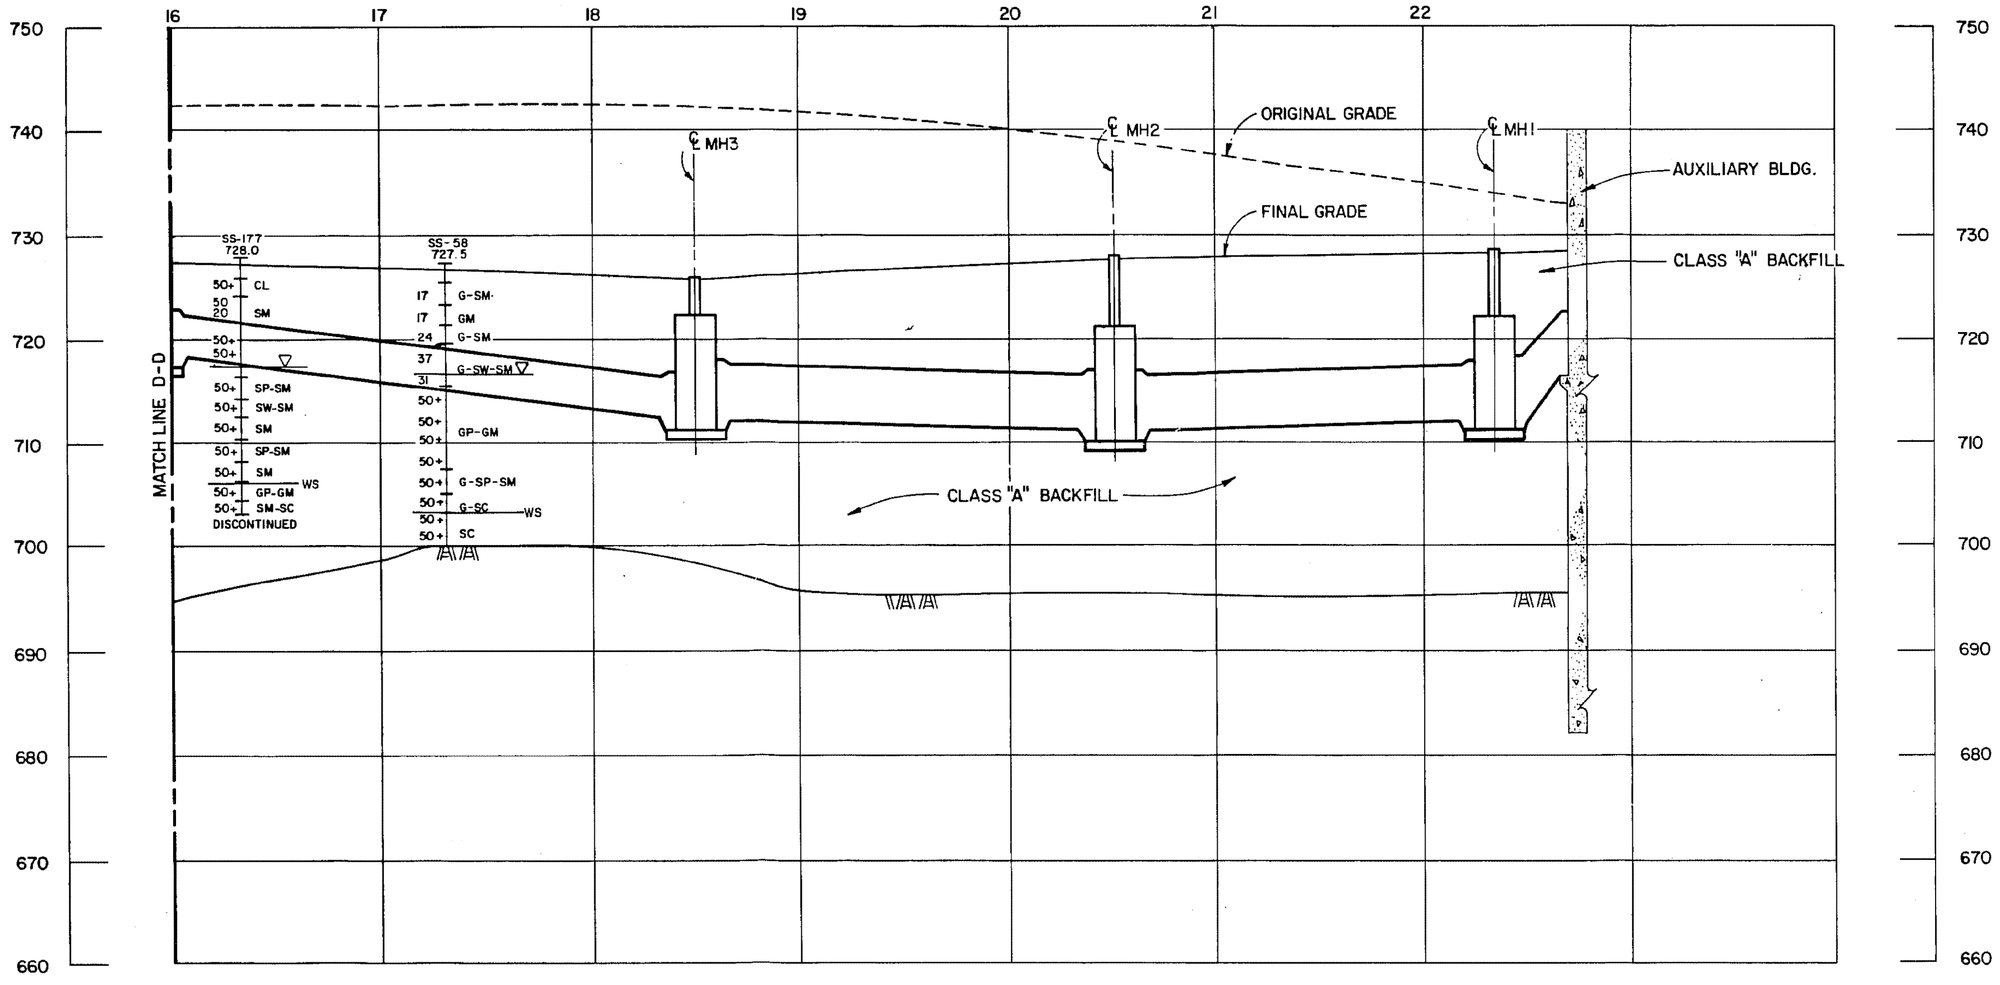

F-F

▽ DESIGN WATER TABLE
▼ WATER TABLE (24HR)
MH SOIL CLASSIFICATION
13 BLOW COUNT
▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
_WS WEATHERED SHALE

NOTE: LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.22g AND SEE-IDRISS (1981) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

CATEGORY I ELECTRICAL CONDUITS
SECTION F-F SHEET 2 OF 2
FIGURE 2.5-554