


14

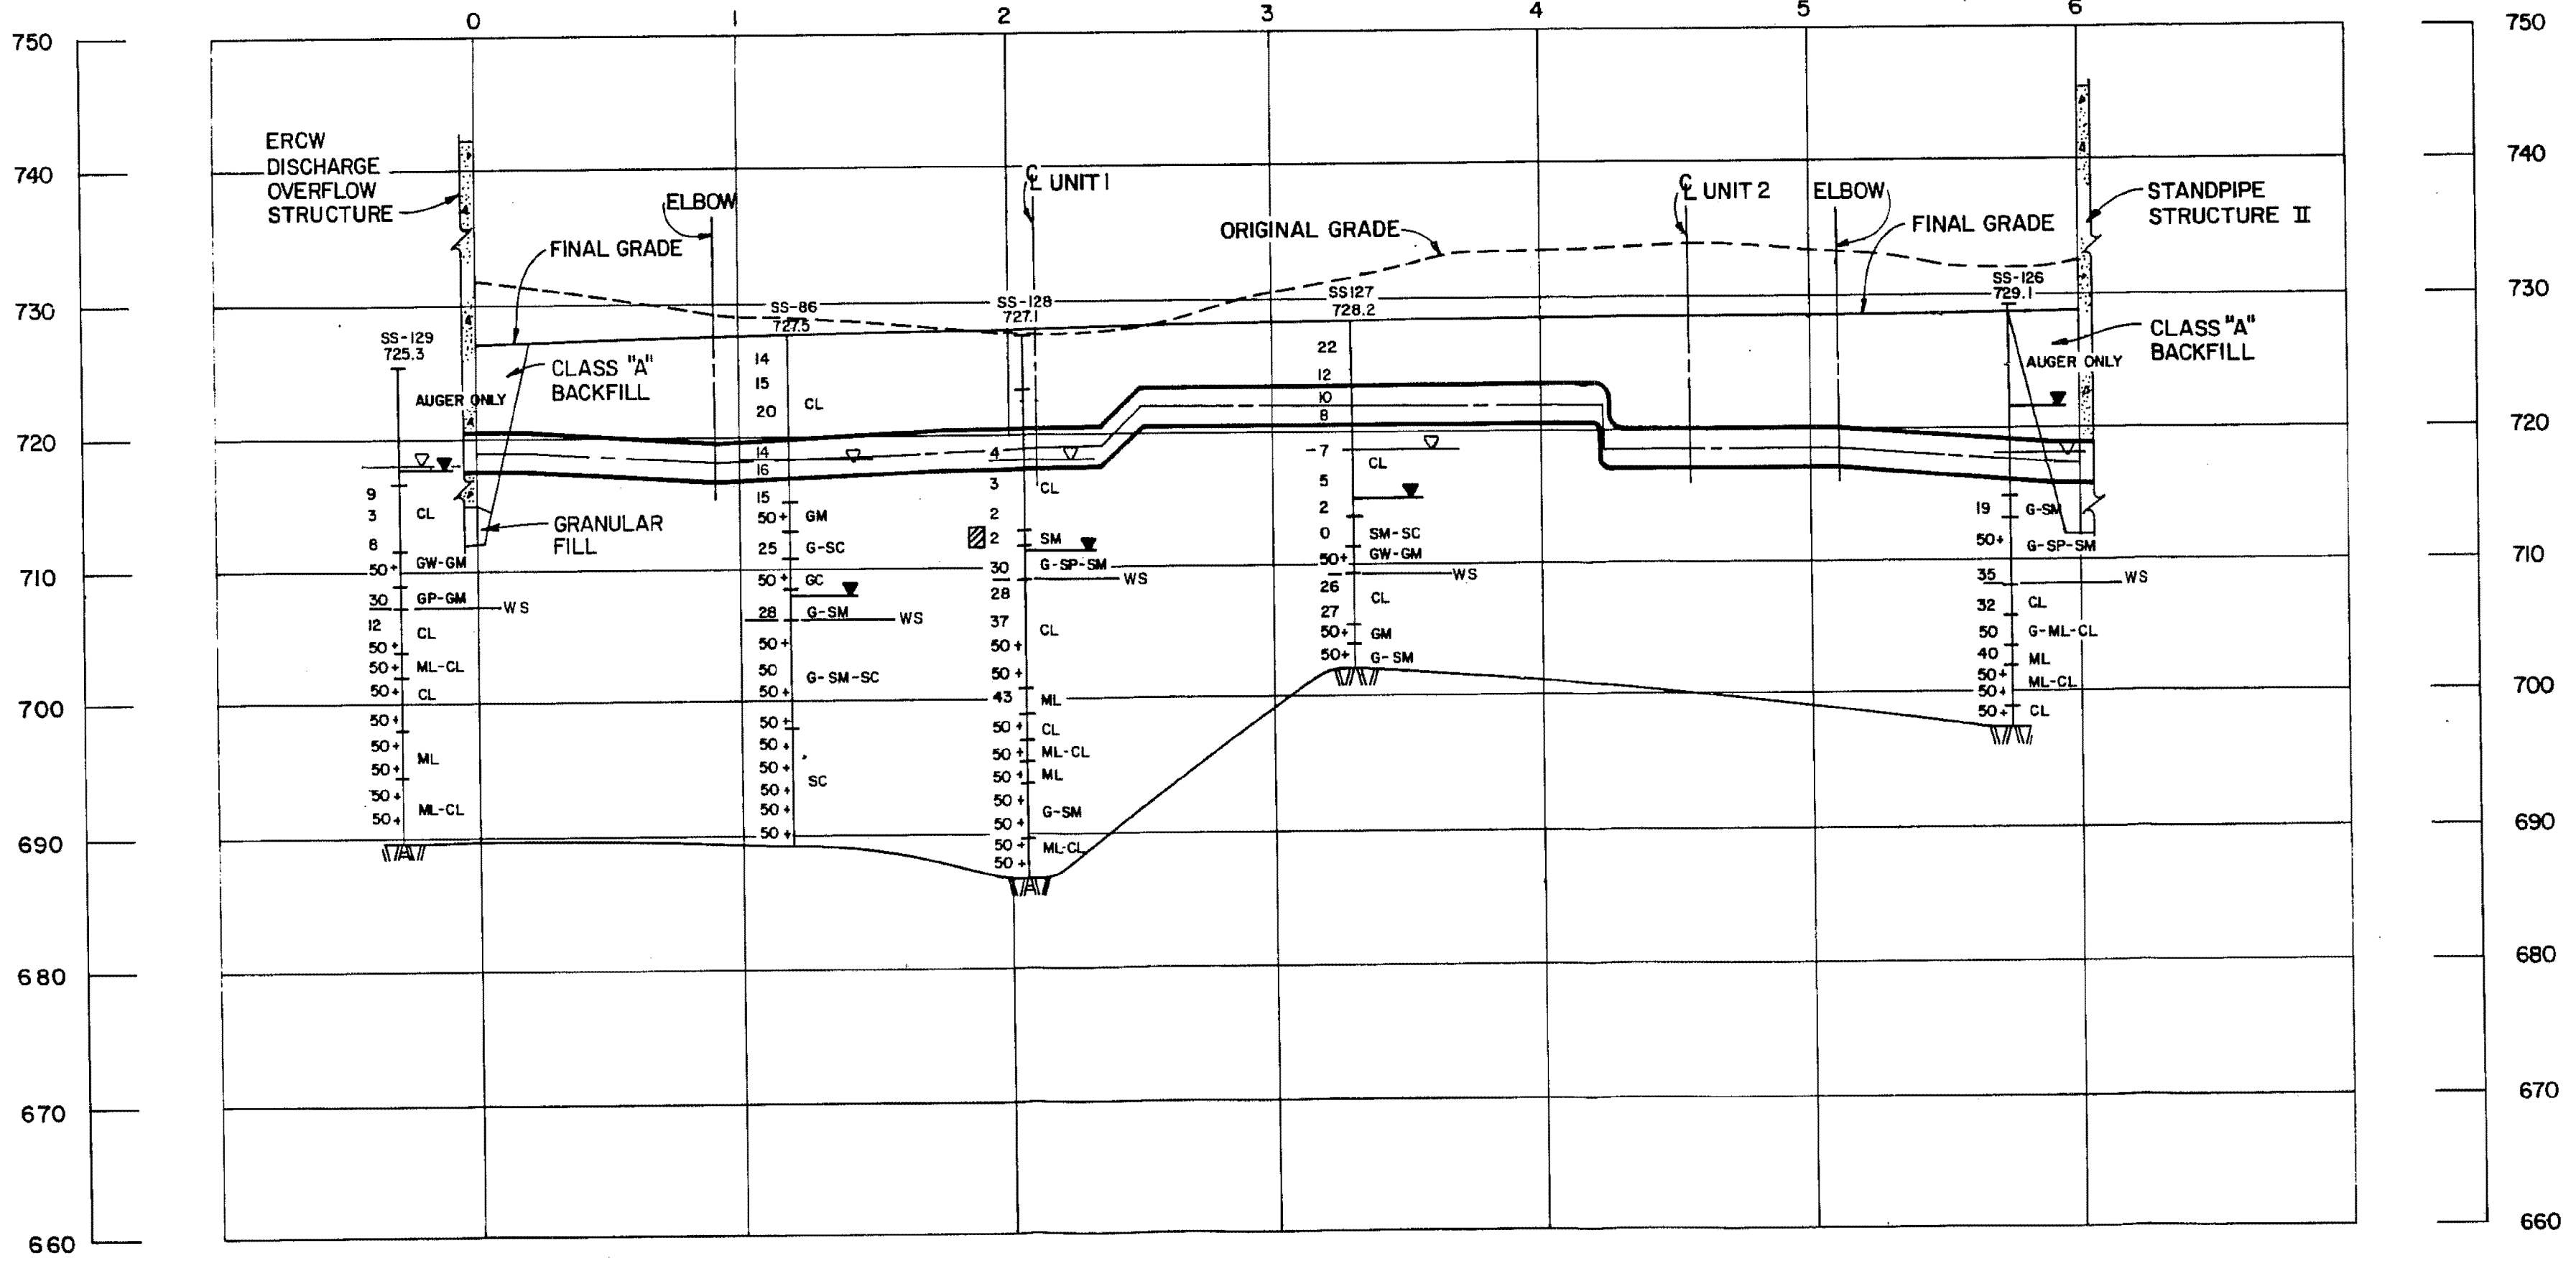

- ▽ DESIGN WATER TABLE
- ▼ WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION
- 13 BLOW COUNT
- ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE: LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.22g AND SEED-IDRISS(1981) CORRELATION FOR SANDS.

Added by Amendment 50

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ERCW PIPELINE SECTION C-C FIGURE 2.5-551</p>

C-C