


28

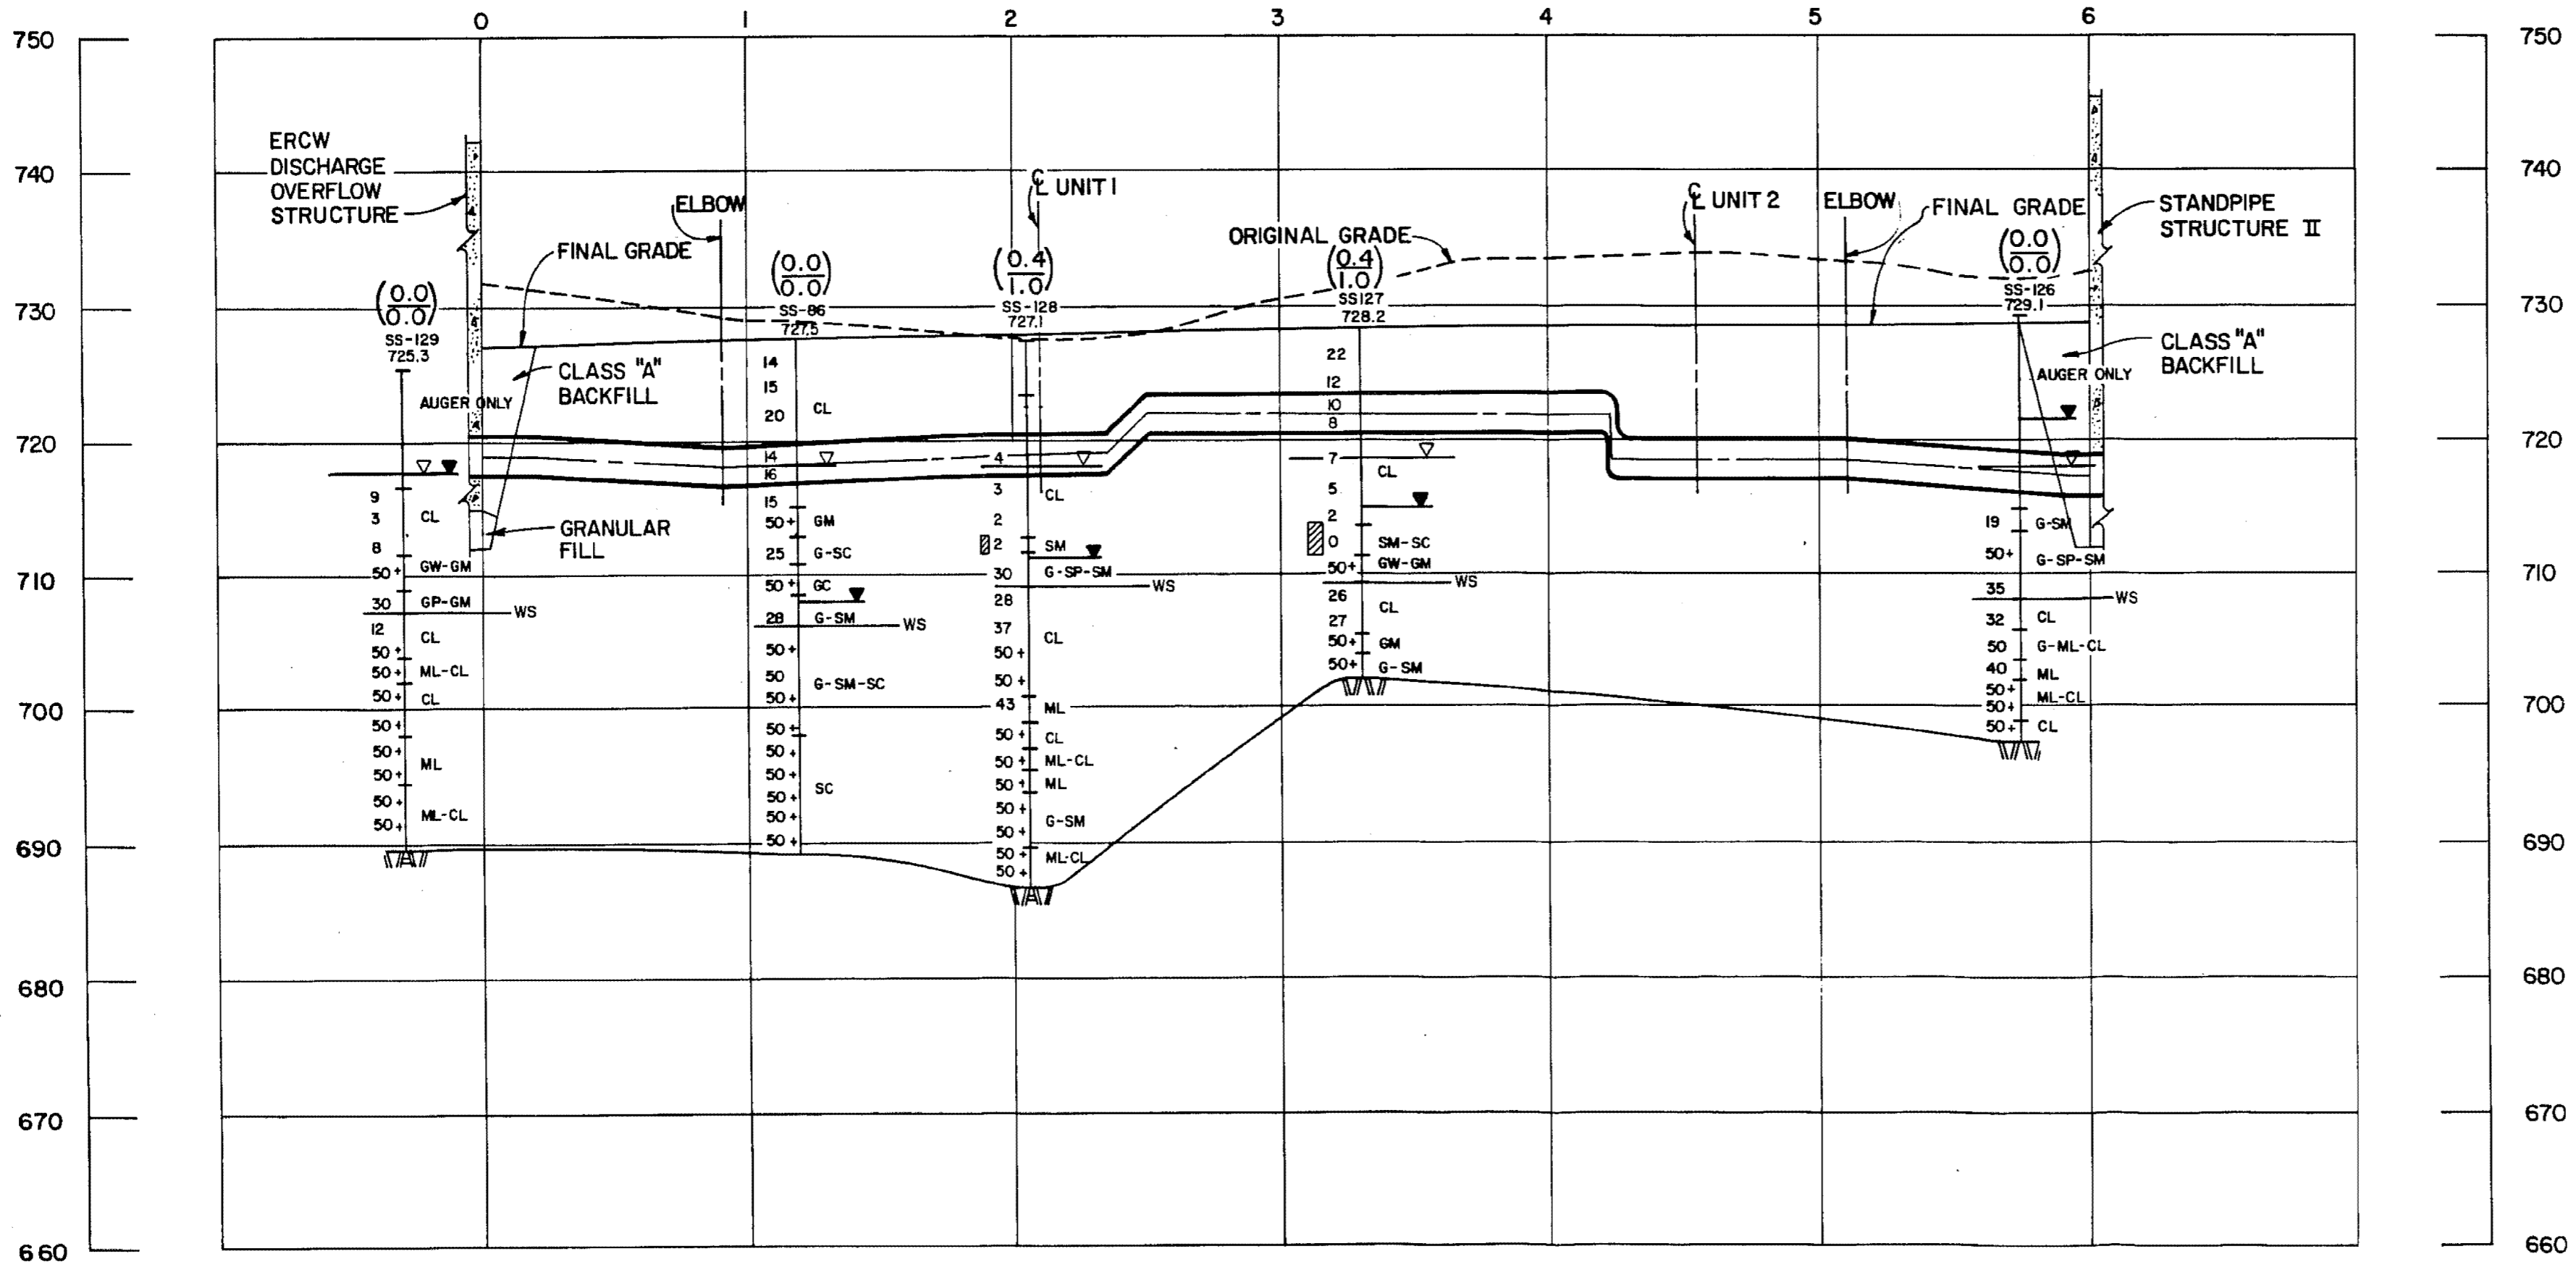

(0.4)
(1.0)

POTENTIAL SETTLEMENT BASED ON 1.5% ϵ CRITERIA (INCHES)
POTENTIAL SETTLEMENT BASED ON 6% ϵ CRITERIA (INCHES)

- ▽ DESIGN WATER TABLE
 - ▼ WATER TABLE (24 HR)
 - MH SOIL CLASSIFICATION
 - I3 BLOW COUNT
 - ▨ POTENTIALLY LIQUEFIABLE SOIL
- (SEE NOTE)

-WS WEATHERED SHALE

NOTE:
1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED-IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

ERCW PIPELINE
SECTION C-C
FIGURE 2.5-573

C-C