


34

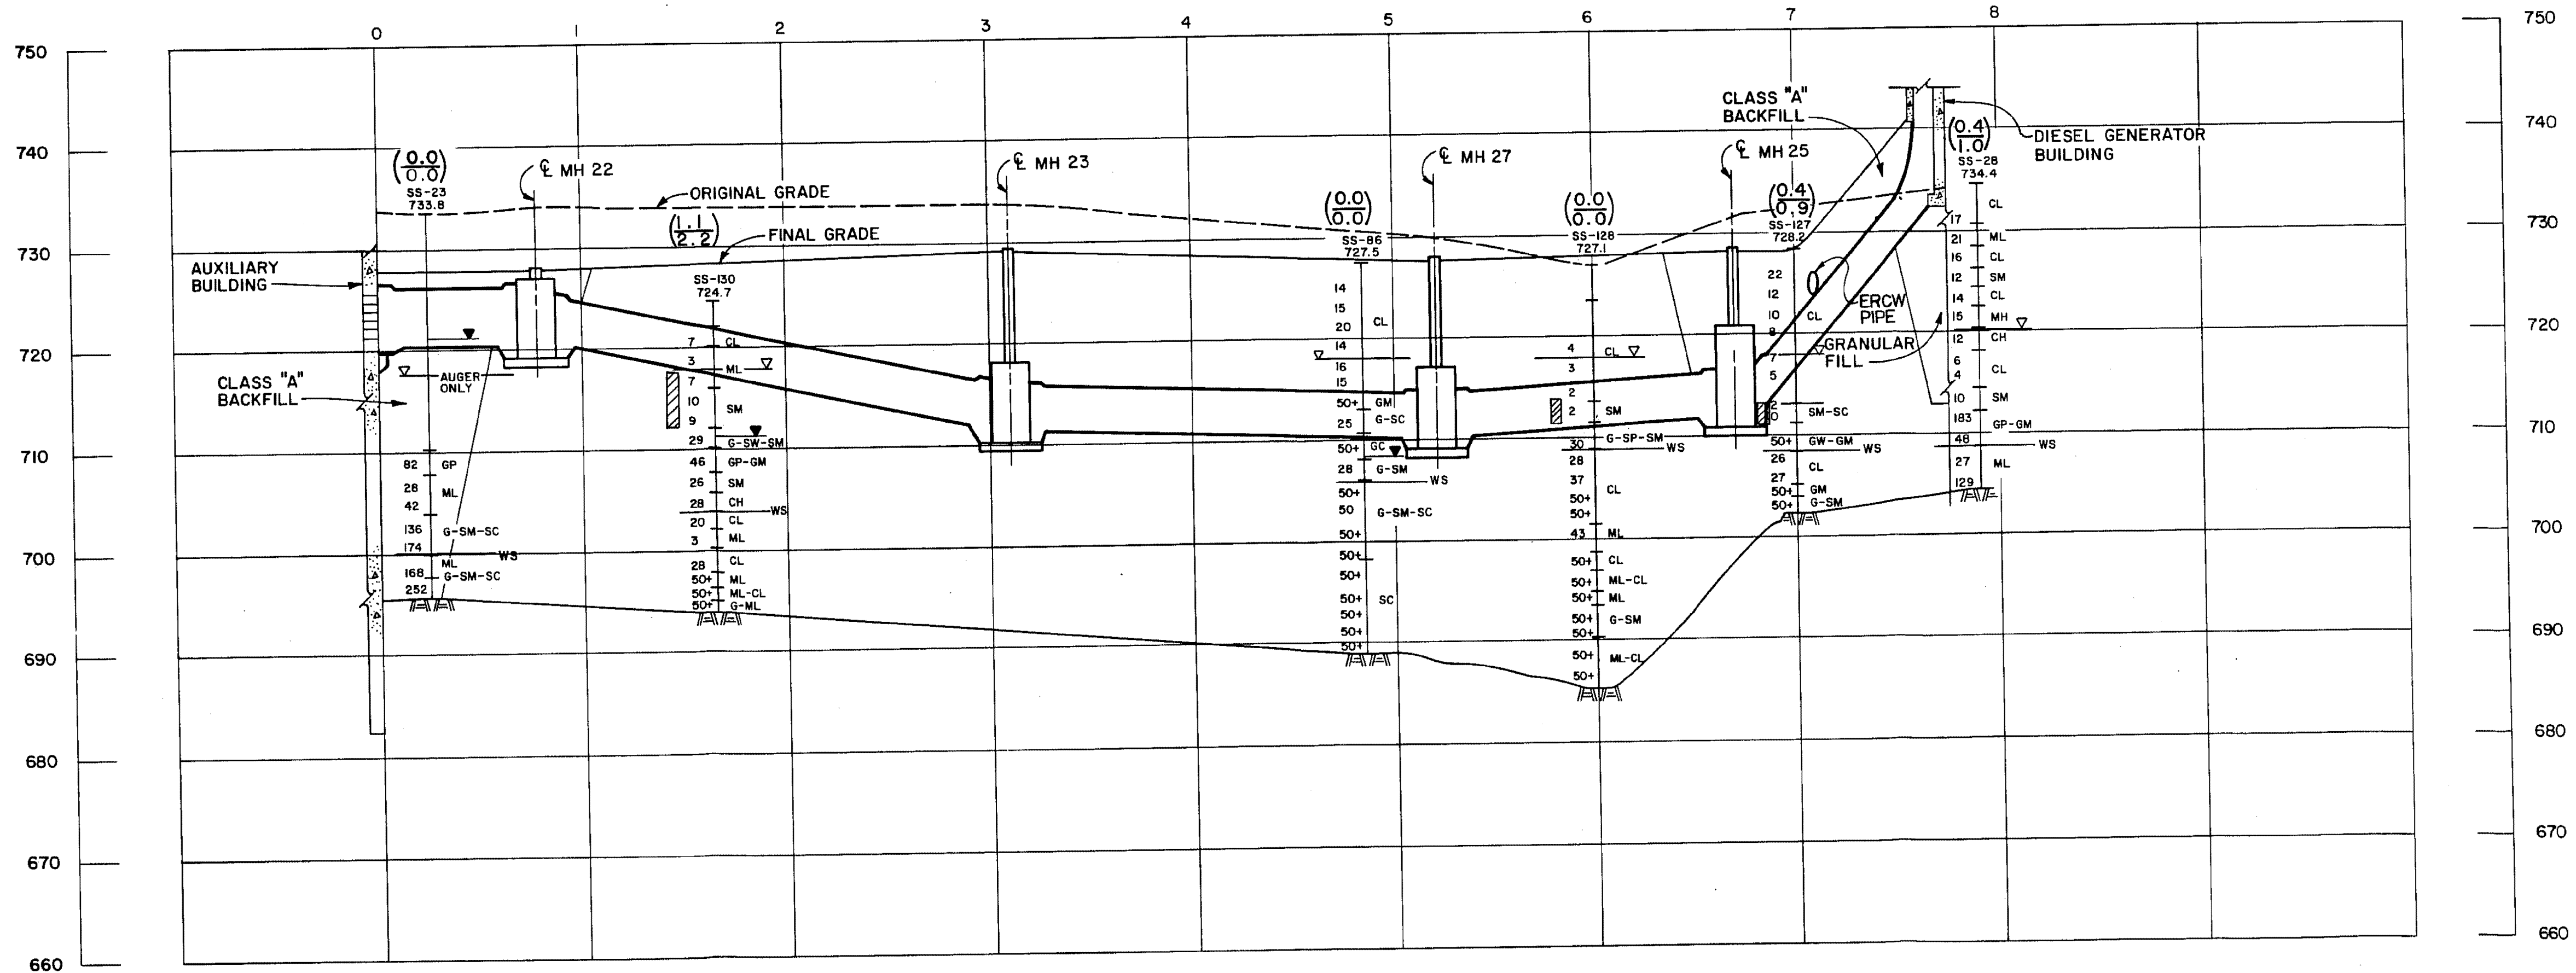

POTENTIAL SETTLEMENT BASED ON
 (0.4) 1.5% ϵ CRITERIA (INCHES)
 (1.0) POTENTIAL SETTLEMENT BASED ON
 6% ϵ CRITERIA (INCHES)

- ∇ DESIGN WATER TABLE
- \blacktriangledown WATER TABLE (24HR)
- MH SOIL CLASSIFICATION
- 13 BLOW COUNT
- POTENTIALLY LIQUEFIABLE SOIL
- (SEE NOTE)
- WS WEATHERED SHALE

NOTE:
 1. LIQUEFACTION BASED ON TOP OF
 GROUND ACCELERATION OF 0.4g
 AND SEED - IDRIS (1971)
 CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

CATEGORY I ELECTRICAL CONDUITS
 SECTION H-H
 FIGURE 2.5-578

H-H