



8-12

	BD-MW1	BD-MW2	BD-MW3	BD-MW5	BD-MW6	BD-MW7	BD-MW8
3/4/2009	372	373	1060	1260	1450	<234	<232
4/8/2009	371	456	1010	1430	1220	294	275
5/14/09	<232	513	994	1100	1580	N/A	<233

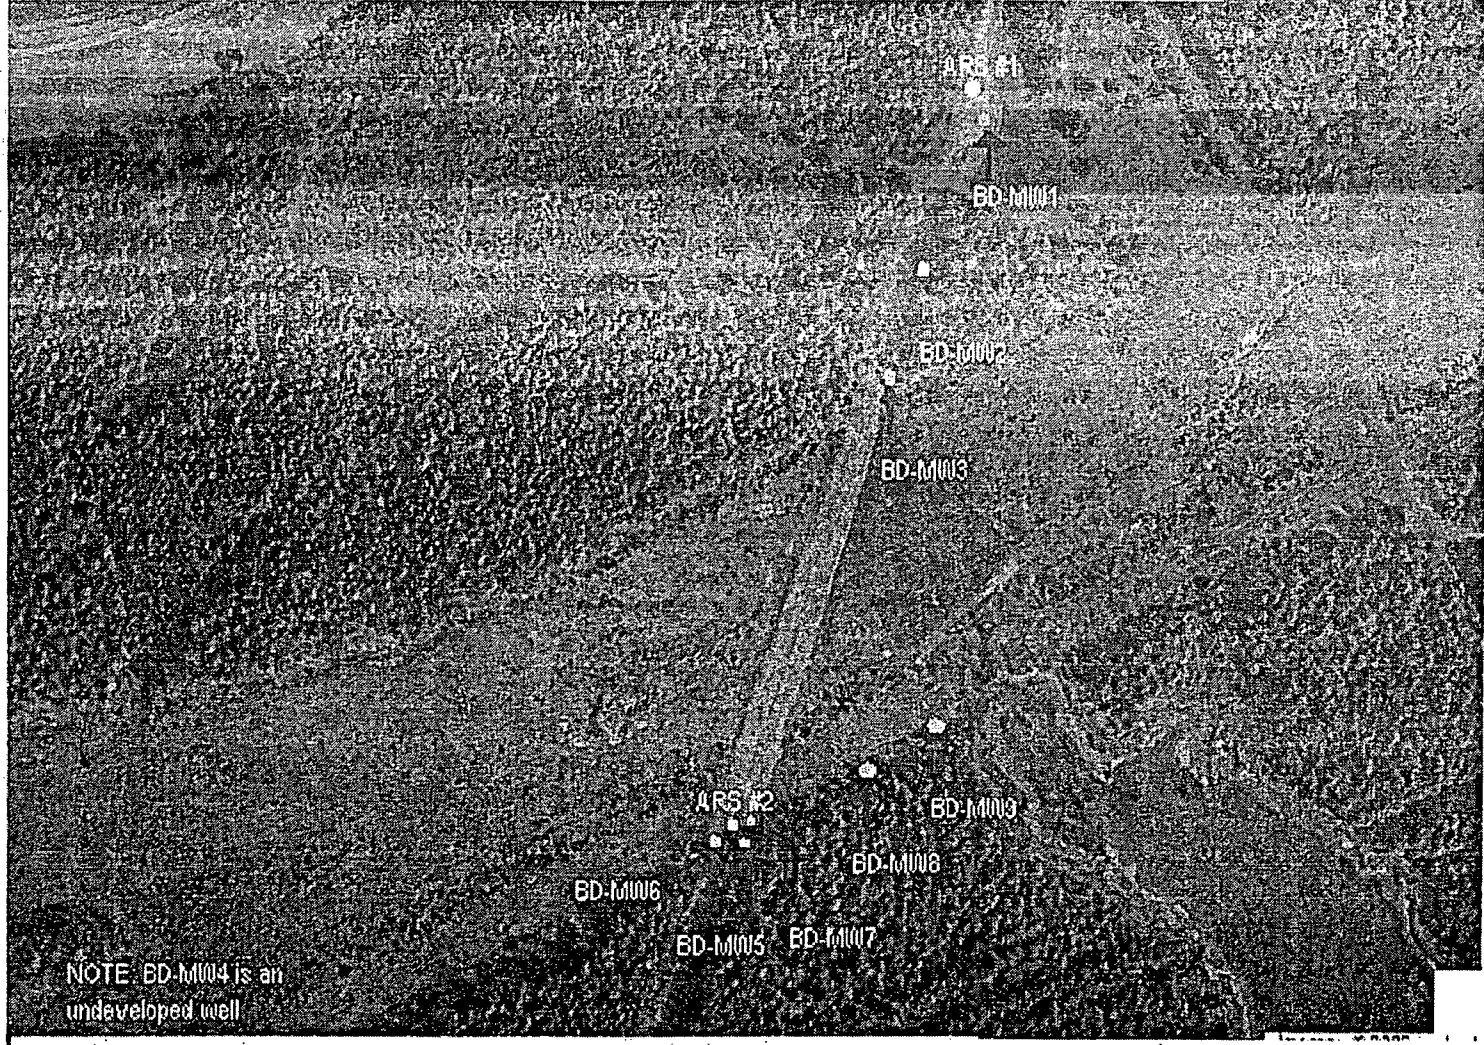

NOTE: BD-MW4 is an undeveloped well

Figure 1  
 Shearon Harris Nuclear Power Plant  
 Cooling Tower Blowdown Line

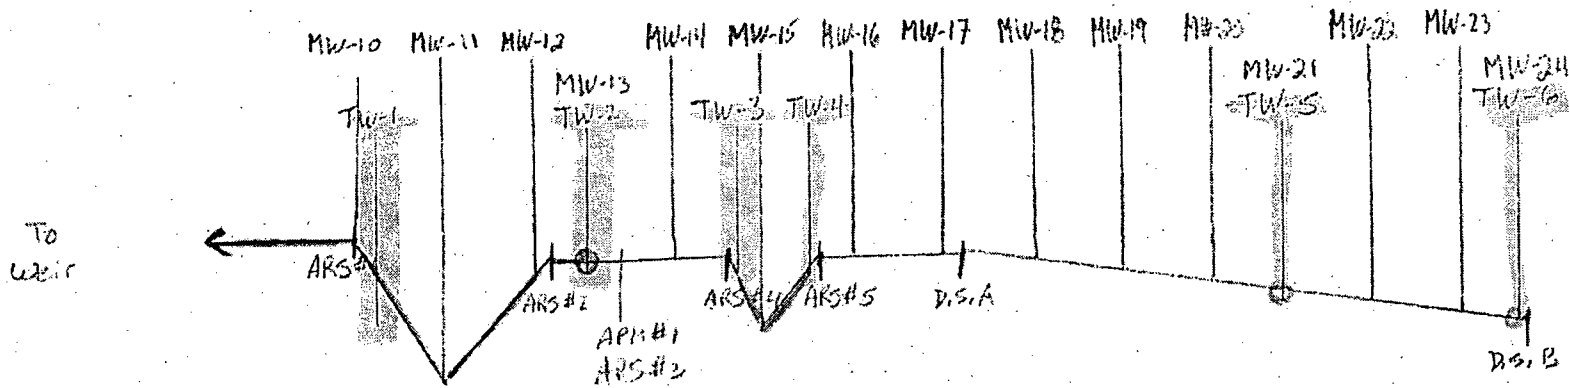

10ft vertical scale

- 200 ft horizontal scale.
- o Potential leaks identified
- Portion of pipeline not visually inspected