


0-11


pci/L LLD <250	BD- MW1	BD- MW2	BD- MW3	BD- MW5	BD- MW6	BD- MW7	BD- MW8	BD- MW9	BD- MW11
6/9/2009	<234	689	878	1200	737	359	<234	<234	N/A +
7/16/2009	752	717	724	1290	956	445	<232	<231	N/A +
8/10/2009	<232	552	704	1200	273	452	<232	<231	N/A +
9/10/2009	<231	684	831	1140	586	453	<232	<233	N/A +
10/15/2009	<241	529	588	1070	473	326	<241	<241	N/A +
11/23/2009	403	679	814	1180	361	462	<234	<234	N/A +
12/14/2009	347	612	875	988	334	553	262	<236	N/A +
1/15/2010	335	540	820	944	415	550	<233	<233	<233
2/18/2010	427	434	759	1140	282	564	<234	<235	<235

*Unable to sample
+ Well didn't exist

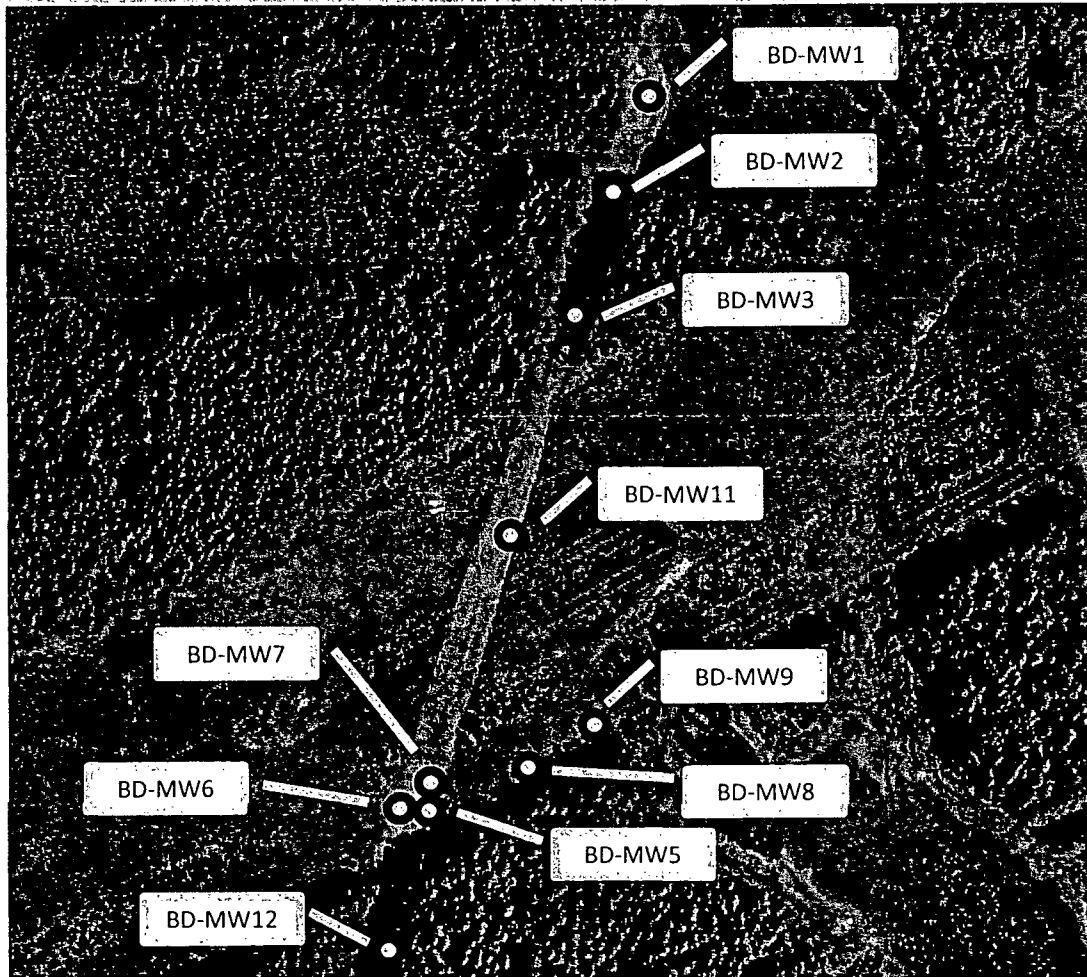

pCi/L	BD- MW12	BD- MW13	BD- MW14	BD- MW15	BD- MW16	Harris Lake
LLD <250						
1/15/2010	<233	262	Dry *	<233	1910	3720
2/18/2010	<235	<235	Dry *	<235	2120	3190

* Unable to sample

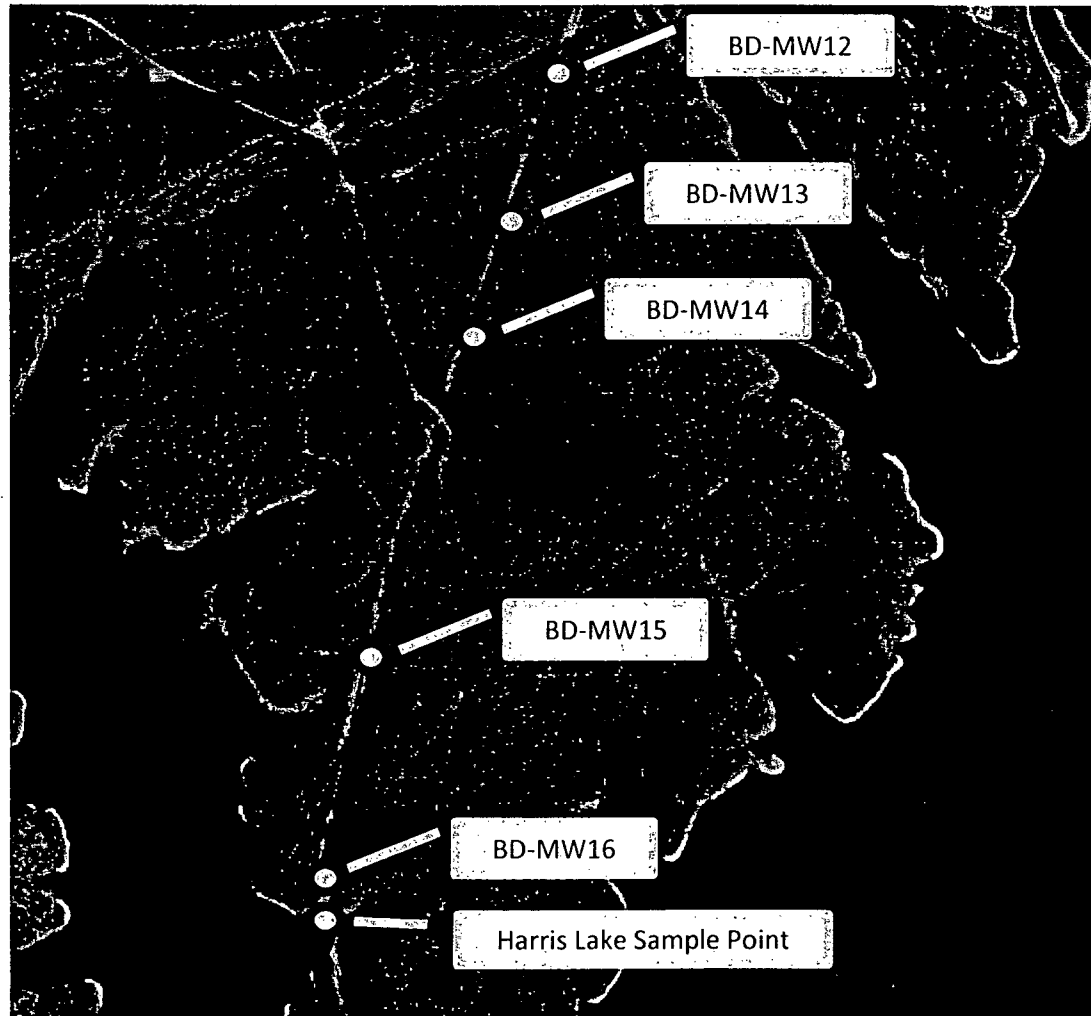

Cooling Tower Blowdown Line Wells (BD-MW1 through BD-MW9)

