



FJ ENERCON		CALCULATION COVER SHEET	TXUT-001-FSAR 2.4.3-CALC-011
			REV. 2
			PAGE NO. 1 of 47
Title:	Probable Maximum Precipitation Calculation for Comanche Peak Nuclear Power Plant Units 3 and 4 using HMR 51 & HMR 52.		
Client:	Luminant		
Project:	MITS116 – Luminant COLA		
Item	Cover Sheet Items	Yes	No
1	Does this calculation contain any open assumptions that require confirmation? (If YES, identify the assumptions.)		X
2	Does this calculation serve as an "Alternate Calculation"? (If YES, identify the design verified calculation.) Design Verified Calculation No. _____		X
3	Does this calculation supersede an existing calculation? (If YES, identify the superseded calculation.) Superseded Calculation No. _____		X
<p>Scope of Revision: The calculation was revised to include the Probable Maximum Precipitation (PMP) computation for the Squaw Creek Reservoir (SCR) watershed (PMP within Basin 1 only). The calculation was also updated to utilize the revised HEC-HMS model which is described in detail in calculation TXUT-001-FSAR 2.4.3-CALC-012. Some minor editorial changes have also been addressed.</p>			
<p>Revision Impact on Results: The critical storm centers for overall watershed remain the same. However, the critical storm for the CPNPP Units 3 and 4 was revised to be within the Squaw Creek Reservoir watershed (Basin 1 only). The critical temporal distribution for the Paluxy River watershed was revised to center distribution.</p>			
Study Calculation <input type="checkbox"/>		Final Calculation <input checked="" type="checkbox"/>	
Safety-Related <input checked="" type="checkbox"/>		Non-safety-Related <input type="checkbox"/>	
<i>(Print Name and Sign)</i>			
Originator: Suraj Balan			Date: 6/11/10
Design Verifier: Dr. Randall Kolar			Date: 6/11/10
Dr. Kendra Dresback			
Approver: Joe Mancinelli			Date: 6/24/10



CALCULATION
REVISION STATUS SHEET

TXUT-001-FSAR 2.4.3-
CALC-011

REV. 2

PAGE NO. 2 of 47

CALCULATION REVISION STATUS

<u>REVISION</u>	<u>DATE</u>	<u>DESCRIPTION</u>
0	August 04, 2008	Original Calculation
1	August 14, 2009	Revision 1 – The revised calculation accounts for updated Snyder's unit hydrograph coefficients.
2		Included PMP computation within the Squaw Creek Reservoir watershed (Basin 1 only) and also utilized revised HEC-HMS Model from Calc 012.

PAGE REVISION STATUS

<u>PAGE NO.</u>	<u>REVISION</u>
All	2

APPENDIX REVISION STATUS

APPENDIX NO. PAGE NO. REVISION NO. APPENDIX NO. PAGE NO. REVISION NO.

A All 2

F3 ENERCON	CALCULATION	TXUT-001-FSAR 2.4.3-CALC-011
	DESIGN VERIFICATION PLAN	REV. 2
	AND SUMMARY SHEET	PAGE NO. 3 of 47

Calculation Design Verification Plan:

Apply CSP Number 3.01 Revision 6, Section 4.5a Design Review Methods and to include at a minimum:

1. Review the changes due to Revision 2 and determine if the calculation provides a reasonable estimate of the PMP and the resulting water surface elevation.
2. Review design methodology and determine if it is appropriate, correctly applied, and accurate.

(Print Name and Sign for Approval – mark “N/A” if not required)

Approver: Joe Mancinelli		Date: 6/24/10
------------------------------------	---	-------------------------

Calculation Design Verification Summary:

After reviewing the Comanche Peak PMP calculation Revision 2, we have come to the following conclusions:

1. Revision 2 introduces PMP calculations within the Squaw Creek Reservoir watershed; used revised HEC-HMS results from the Comanche Peak PMF calculations;
2. The methodology applied to this set of calculations is appropriate and has been applied correctly;
3. The calculation provides a reasonable estimate of the PMP for the Squaw River, Paluxy River and the Squaw Creek Reservoir watersheds and was done in accordance with HMR 51 and HMR 52 reports;
4. The Originator has considered all recommendations given during the review process and has made appropriate revisions;
5. The calculations were independently checked and any errors that were discovered have been corrected in the final version of the calculation sheets;
6. The Revision 2 calculation methodology, assumptions and inputs applied are reasonable and are in accordance with CSP Number 3.01 Revision 6.

Based on the above summary, the calculation is determined to be acceptable.

(Print Name and Sign)

Design Verifier: Dr. Randall Kolar Dr. Kendra Dresback	 	Date: 6/11/10
Others:	Date:	

E3 ENERCON		CALCULATION DESIGN VERIFICATION CHECKLIST	TXUT-001-FSAR 2.4.3-CALC-011		
			REV. 2		
			PAGE NO. 4 of 47		
Item	Cover Sheet Items		Yes	No	N/A
1	Design Inputs - Were the design inputs correctly selected, referenced (latest revision), consistent with the design basis and incorporated in the calculation?		X		
2	Assumptions - Were the assumptions reasonable and adequately described, justified and/or verified, and documented?		X		
3	Quality Assurance - Were the appropriate QA classification and requirements assigned to the calculation?		X		
4	Codes, Standard and Regulatory Requirements - Were the applicable codes, standards and regulatory requirements, including issue and addenda, properly identified and their requirements satisfied?		X		
5	Construction and Operating Experience - Have applicable construction and operating experience been considered?				X
6	Interfaces - Have the design interface requirements been satisfied, including interactions with other calculations?		X		
7	Methods - Was the calculation methodology appropriate and properly applied to satisfy the calculation objective?		X		
8	Design Outputs - Was the conclusion of the calculation clearly stated, did it correspond directly with the objectives and are the results reasonable compared to the inputs?		X		
9	Radiation Exposure - Has the calculation properly considered radiation exposure to the public and plant personnel?				X
10	Acceptance Criteria - Are the acceptance criteria incorporated in the calculation sufficient to allow verification that the design requirements have been satisfactorily accomplished?		X		
11	Computer Software - Is a computer program or software used, and if so, are the requirements of CSP 3.02 met?		X		
COMMENTS:					
(Print Name and Sign)					
Design Verifier: Dr. Randall Kolar <i>Randall Kolar</i>				Date: 6/11/10	
Dr. Kendra Dresback <i>Kendra Dresback</i>					
Others:				Date:	

**CALCULATION CONTROL SHEET**

TXUT-001-FSAR 2.4.3-CALC-011

REV. 2

PAGE NO. 5 of 47

Table of Contents

Table of Contents	5
1.0 Purpose and Scope	8
2.0 Summary of Results and Conclusion	8
3.0 References	9
4.0 Assumptions	10
5.0 Design Inputs.....	11
6.0 Methodology	11
7.0 Calculations	12
8.0 Appendices	47

List of Tables

Table 2-1. 6-Hour Incremental PMP Estimates	8
Table 7-1. Watershed Drainage Areas.....	14
Table 7-2. Depth Area Duration PMP Values	15
Table 7-3. Basin 1 Drainage Basin Coordinates.....	15
Table 7-4. Basin 2 Drainage Basin Coordinates.....	16
Table 7-5. Basin 3 Drainage Basin Coordinates.....	16
Table 7-6. Basin 4 Drainage Basin Coordinates.....	17
Table 7-7. Overall Watershed Drainage Basin Coordinates	18
Table 7-8. Critical Storm Center Determination	19
Table 7-9. Rainfall-Runoff Analysis for Paluxy River Watershed (Basin 3 & 4) Using HEC-HMS and Overall PMP with Four Temporal Distributions at the Critical Storm Center PR Y.....	20
Table 7-10. Rainfall-Runoff Analysis for Squaw Creek Reservoir Watershed (Basin 1) Using HEC-HMS and Overall PMP with Four Temporal Distributions at the Critical Storm Center SC X	20
Table 7-11. Rainfall-Runoff Analysis for Squaw Creek Reservoir Watershed (Basin 1) Using HEC-HMS and Squaw Creek Reservoir PMP with Four Temporal Distributions at the Critical Storm Center SC X	21
Table 7-12. Sub-basin Hourly Cumulative PMP - Overall PMP with Critical Storm Center at PR Y	22
Table 7-13. Sub-basin Hourly Cumulative PMP - Overall PMP with Critical Storm Center at SC X	23
Table 7-14. Hourly Cumulative PMP – Squaw Creek Reservoir PMP with Storm Center at SC X	24
Table 7-15. One-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	25
Table 7-16. Center Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	26
Table 7-17. Two-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	27
Table 7-18. End Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	28
Table 7-19. One-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	29
Table 7-20. Center Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	30
Table 7-21. Two-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	31

	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 6 of 47

Table of Contents (Continued)

List of Tables (Continued)

Table 7-22. End Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	32
Table 7-23. One-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	33
Table 7-24. Center Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	34
Table 7-25. Two-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	35
Table 7-26. End Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	36
Table 7-27. One-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	37
Table 7-28. Center Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	38
Table 7-29. Two-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	39
Table 7-30. End Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	40
Table 7-31. One-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	41
Table 7-32. Center Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	42
Table 7-33. Two-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	43
Table 7-34. End Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	44

List of Figures

Figure 7-1. Drainage Basin Map with Storm Centers	13
Figure 7-2. All-Season PMP (inch) for 6 hr. 10 sq. mi Basin	14
Figure 7-3. One-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	25
Figure 7-4. Center Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y ..	26
Figure 7-5. Two-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y	27
Figure 7-6. End Peaking Temporal Distribution (Basin4) – Overall PMP with Storm Center at PR Y ..	28
Figure 7-7. One-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	29
Figure 7-8. Center Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y ..	30

List of Figures (Continued)

Figure 7-9. Two-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y	31
Figure 7-10. End Peaking Temporal Distribution (Basin4) – Overall PMP with Storm Center at PR Y.....	32
Figure 7-11. One-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	33
Figure 7-12. Center Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X 34	
Figure 7-13. Two-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X	35
Figure 7-14. End Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X....	36
Figure 7-15. One-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	37
Figure 7-16. Center Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X 38	
Figure 7-17. Two-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X	39
Figure 7-18. End Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X.....	40
Figure 7-19. One-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	41
Figure 7-20. Center Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	42
Figure 7-21. Two-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X.....	43
Figure 7-22. End Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X	44
Figure 7-23. Mass Curves for Overall PMP with Storm Center at PR Y (Basin 4)	45
Figure 7-24. Mass Curves for Overall PMP with Storm Center at PR Y (Basin 3)	45
Figure 7-25. Mass Curves for Overall PMP with Storm Center at SC X (Basin 1)	46
Figure 7-26. Mass Curves for Overall PMP with Storm Center at SC X (Basin 2)	46
Figure 7-27. Mass Curves for Squaw Creek Reservoir PMP with Storm Center at SC X (Basin 1).....	47

List of Appendices

Appendix A – HMR 52 Analysis Output



CALCULATION CONTROL SHEET

TXUT-001-FSAR 2.4.3-CALC-011

REV. 2

PAGE NO. 8 of 47

1.0 Purpose and Scope

The purpose of this calculation is to determine the 72-hour Probable Maximum Precipitation (PMP) distributions using Hydrometeorological Report (HMR) 51 (Reference 2) and HMR 52 (Reference 3) for the Comanche Peak Nuclear Power Plant (CPNPP) Units 3 and 4. The PMP distributions are used as input to determine the Probable Maximum Flood (PMF).

2.0 Summary of Results and Conclusions

The PMP distributions are calculated for the following scenarios:

- Overall PMP for storm centers within the Squaw Creek watershed
- Overall PMP for storm centers within the Paluxy River watershed
- Squaw Creek Reservoir PMP for storm centers within the Squaw Creek watershed

The Squaw Creek and Paluxy River watersheds are shown in Figure 7-1. The critical storm center within the Paluxy River watershed (Basin 4) results in the maximum PMP for the overall watershed (Basins 1, 2, 3 and 4 combined) at the confluence of Paluxy River and Squaw Creek. Additionally, when the storm center was kept in the Squaw Creek watershed (Basin 1), it resulted in a higher PMP for the Squaw Creek watershed. A higher PMP for the Squaw Creek watershed can result in a higher water surface elevation at CPNPP Units 3 and 4. The PMP for the critical storm center and each basin for the above mentioned scenarios was analyzed individually to determine the resulting peak runoff and the water surface elevation.

Table 2-1 summarizes the 6-hour incremental PMP estimates in inches (in.). The PMP estimates for different trial centers are presented in Section 7.0, Table 7-8.

Table 2-1. 6-Hour Incremental PMP Estimates

6-hour increment (hour from 0)	Overall PMP (with storm center in Paluxy River watershed) (in.)	Overall PMP (with storm center in Squaw Creek watershed) (in.)	Squaw Creek Reservoir PMP (Basin 1 Only) (in.)
6	0.60	0.59	0.61
12	0.72	0.72	0.74
18	0.92	0.91	0.94
24	1.25	1.24	1.28
30	1.97	1.96	2.02
36	4.64	5.10	5.01
42	18.18	21.10	24.93
48	2.77	2.82	2.87
54	1.52	1.52	1.57
60	1.06	1.05	1.08
66	0.81	0.80	0.82
72	0.65	0.65	0.66
Total	35.08	38.46	42.53

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011 REV. 2 PAGE NO. 9 of 47
--	----------------------------------	---

The storm rainfall total for the Overall PMP is 35.08 in. for a 450 square mile (sq. mi.) storm, centered near the overall watershed centroid with an orientation of 172 degrees. The storm rainfall total for the Overall PMP is 38.46 in. for a 700 sq. mi. storm, centered near the Squaw Creek watershed centroid with an orientation of 145 degrees. The storm rainfall total for the Squaw Creek Reservoir PMP (Basin 1 Only) is 42.53 in. for a 100 sq. mi. storm, centered near the Squaw Creek watershed centroid with an orientation of 181 degrees. The critical storm centers for the Paluxy River and the Squaw Creek are indicated as PR Y and SC X, respectively, as shown in Figure 7-1. The center peaking temporal distribution with the storm center at PR Y is the critical distribution for the Paluxy River watershed. The two-third peaking temporal distribution with the storm center at SC X is the critical distribution for the Squaw Creek watershed.

3.0 References

1. Autodesk, AutoCAD Civil 3D 2009 software.
2. National Oceanic and Atmospheric Administration, "Hydrometeorological Report No. 51, Probable Maximum Precipitation Estimates, United States East of the 105th Meridian," Prepared by Louis C. Scheriner and John T. Riedel, Hydrometeorological Branch, Office of Hydrology, National Weather Services, Washington D.C. 1978, Reprinted August 1980.
3. National Oceanic and Atmospheric Administration, National Weather Service, Hydrometeorological Report No. 52, Application of Probable Maximum Precipitation Estimates – United States East of the 105th Meridian, August 1982.
4. U.S. Army Corps of Engineers, Hydrologic Engineering Center, Generalized Computer Program, HMR 52, Probable Maximum Storm (Eastern United States), User's Manual, CPD-46, Revised April 1987.
5. U.S. Army Corps of Engineers, Hydrologic Engineering Center, Generalized Computer Program, HMR 52, Probable Maximum Storm, Revised April 1991.
6. U.S. Army Corps of Engineers, Hydrologic Engineering Center, Hydrologic Modeling System, HEC-HMS computer software, version 3.4.
7. U.S. Geological Survey, Geospatial Data Gateway Website, <http://datagateway.nrcs.usda.gov/gatewayhome.html>, accessed December 27, 2007.
8. ESRI ArcGIS, Release 9.2, Copyright 1999-2006.
9. Enercon Calculation, "TXUT-001-FSAR 2.4.3 CALC-012, Rev 2 MITS004 – Probable Maximum Flood Calculation for Comanche Peak Nuclear Power Plant Units 3 and 4 (HEC-HMS & HEC-RAS)."
10. Squaw Creek Dam TX04627 Breach Analysis, April 2008, Prepared for TXU by Freese and Nichols Inc.
11. U.S. Nuclear Regulatory Commission, "Design Basis Floods for Nuclear Power Plants," Regulatory Guide 1.59, August 1977.

	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 10 of 47

- 12. American Nuclear Society, "American National Standard for Determining Design Basis Flooding at Power Reactor Sites," ANSI/ANS-2.8-1992, American Nuclear Society, La Grange Park, Illinois, July 28, 1992.
- 13. U.S. Nuclear Regulatory Commission, "Standard Format and Content of Safety Analysis Reports for Nuclear Power Plants," Regulatory Guide 1.70, November 1978.
- 14. U.S. Nuclear Regulatory Commission, "Flood Protection for Nuclear Power Plants," Regulatory Guide 1.102, September 1976.
- 15. U.S. Nuclear Regulatory Commission, "Combined License Applications for Nuclear Power Plants," Regulatory Guide 1.206, June 2007.
- 16. U.S. Nuclear Regulatory Commission, "Standard Review Plan for the Review of Safety Analysis Reports for Nuclear Power Plants," NUREG-0800, May 2007.
- 17. U.S. Nuclear Regulatory Commission, "Early Site Permits; Standard design Certifications; and Combined Licenses for Nuclear Power Plants," 10 CFR Part 52, August 2007.
- 18. U.S. Nuclear Regulatory Commission, "Industry Guidelines for Combined License Applicants under 10 CFR Part 52," NEI 04-05, October 2005.
- 19. Texas Utilities Services Inc., Comanche Peak Stream Electric Station CPSES 1980-1982, Units 1 and 2, "Safe Shutdown Impoundment Dam, Design Calculations and Calculations Check," Volume 1, by Freese and Nichols.
- 20. Texas Utilities Services Inc., Comanche Peak Stream Electric Station CPSES 1980-1982, Units 1 and 2, "Safe Shutdown Impoundment Dam, Design Calculations and Calculations Check," Volume 2, by Freese and Nichols.

4.0 Assumptions

None.

5.0 Design Inputs

Drainage basin location is the input needed for HMR 51. The CPNPP Units 3 and 4 locations from the USGS Hill City, TX Quadrangle NAD83 (Reference 7) are as follows:

32° 18' 10" N
97° 47' 30" W

Input to the HMR 52 software includes the coordinates defining the drainage basins shown in Figure 7-1. The drainage area boundaries shown in the Dam Breach Analysis (Reference 10) were digitized in AutoCAD (Reference 1). The drainage basin coordinates for the digitized sub-basin shapes were input to HMR 52 (Reference 5). HMR 52 determines the basin area using the X, Y coordinates input. The basin areas were adjusted by utilizing a scale factor to represent the drainage areas for the sub-basins. A scale factor of 0.05827 in HMR 52 (Reference 5) corresponds to the drainage areas for the sub-basins. The watershed shape and areas were also compared by superimposing the United States Geological Survey's (USGS) topographical map on AutoCAD drawing. USGS topographic maps were obtained from the USDA's Geospatial Data

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3- CALC-011
		REV. 2
		PAGE NO. 11 of 47

Gateway (Reference 7), and the drainage basin boundaries were mapped using ArcGIS software (Reference 8). The drainage areas reported for the sub-basins in the Dam Breach Analysis (Reference 10) were verified to be an acceptable representation for the watershed. The drainage area coordinates for the sub-basins and overall watershed are provided in Tables 7-3 through 7-7.

HMR 51 resulted in all-season PMP estimates, which are then used as input for the HMR 52. The basin and sub-basin geometry, preferred storm orientation, HMR 51 PMP estimates, storm center, and isohyet A ratio were included as input data into the HMR 52 software.

6.0 Methodology

Reference to and compliance with the following listed design guides was considered in evaluating the PMP for CPNPP Units 3 and 4 using HMR 51 & HMR 52. All other procedures, instructions and design guides listed in Section 5.4 of Project Planning Document (PPD No. TXUT-001, Rev. 3) are not specifically applicable in evaluating the PMP.

- U.S. Nuclear Regulatory Commission, "Standard Review Plan," NUREG-0800, March 2007, (Reference 16).
- U.S. Nuclear Regulatory Commission, "Design Basis Floods for Nuclear Power Plants, Alternative Methods of Estimating Probable Maximum Floods," Regulatory Guide 1.59, August 1977, (Reference 11).
- American Nuclear Society, "Determining Design Basis Flooding at Power Reactor Sites," ANSI/ANS-2.8-1992, July 28, 1992, (Reference 12).
- U.S. Nuclear Regulatory Commission, "Standard Format and Content of Safety Analysis Reports for Nuclear Power Plants", Regulatory Guide 1.70, November 1978, (Reference 13).
- U.S. Nuclear Regulatory Commission, "Flood Protection for Nuclear Power Plants", Regulatory Guide 1.102, September 1976, (Reference 14).
- U.S. Nuclear Regulatory Commission, "Combined License Applications for Nuclear Power Plants (LWR Edition)," Regulatory Guide 1.206, June 2007, (Reference 15).
- U.S. Nuclear Regulatory Commission, "Early Site Permits; Standard design Certifications; and Combined Licenses for Nuclear Power Plants", 10 CFR Part 52, August 2007 (Reference 17).
- U.S. Nuclear Regulatory Commission, "Industry Guidelines for Combined License Applicants under 10 CFR Part 52", NEI 04-05, October 2005, (Reference 18).

The Regulatory Guide 1.59 (Reference 11) indicates use of ANSI N170-1976 "Standards for Determining Design Basis Flooding at Power Reactor Sites," (Reference 12). ANSI/ANS-2.8-1992 was issued to supersede ANSI N170-1976. Although ANSI/ANS-2.8-1992 has been withdrawn, a replacement standard has not been issued by the American Nuclear Society as of June 2010. The NRC NUREG-0800, March 2007 (Reference 16), includes ANSI/ANS-2.8-1992 as a historical technical reference.

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011 REV. 2 PAGE NO. 12 of 47
--	----------------------------------	--

HMR 52 applies to areas in the United States east of the 105th Meridian. The HMR 52 software iterates to achieve the optimal storm area size that maximizes precipitation. The resulting storm area size may differ from the actual drainage area of the basin. The HMR 52 software also iterates to achieve the optimal storm orientation that maximizes precipitation. As identified by HMR 52 guidance (Reference 3), when the optimal storm orientation differs from the preferred storm orientation by more than 40 degrees, a reduction to the precipitation should be made. This reduction happens automatically within the HMR 52 software.

An antecedent storm equal to 40 percent of the PMP precedes the PMP storm with a 3-day dry period between the storms, as described in Nuclear Regulatory Commission (NRC) Regulatory Guide 1.59 (Reference 11) and ANSI/ANS-2.8-1992 (Reference 12), and was considered for the PMF analysis. HMR 52 guidance provides a stepwise approach to determine spatial and temporal distribution of the all-season PMP estimates derived from HMR 51 for incremental durations less than or equal to 6 hours (hr.). HMR 52 provides a recommended elliptical isohyetal pattern (Reference 3, Figure 5) to be used. The critical PMP storm was determined through several iterations of storm center locations within Squaw Creek and Paluxy River watersheds. In addition, HMR 52 recommends a temporal distribution that includes arranging the individual 6-hour increments such that they decrease progressively to either side of the greatest 6-hr. increment. Furthermore, the four greatest 6-hr. increments should be placed at any position except within the first 24-hr. period. The temporal distributions used herein are explained in Section 7.0

Complete descriptions of the HMR 52 process and the HMR 52 software are provided in the HMR 52 guidance (Reference 3) and HMR 52 software user's manual (Reference 4).

HEC-HMS 3.4, HMR 52, AutoCAD Civil 3D 2009 and ESRI ArcGIS Release 9.2 software have been verified and validated in accordance with CSP 3.02, Revision 5. The verification and validation documents are maintained by Enercon as part of the Quality Assurance program.

7.0 Calculations

Scenarios

The CPNPP Units 3 and 4 are located just upstream of Squaw Creek Dam, which is located upstream of the confluence of Squaw Creek and Paluxy River shown in Figure 7-1. Therefore, the critical PMP resulting in the PMF for the site may be one of the following:

- Overall PMP with critical storm center within the Squaw Creek watershed
- Overall PMP with critical storm center within the Paluxy River watershed
- Squaw Creek Reservoir PMP with critical storm center within the Squaw Creek watershed

Drainage Areas

The CPNPP Units 3 and 4 are located within the Squaw Creek watershed. Squaw Creek is a tributary of the Paluxy River, and in turn the Paluxy River is a tributary of the Brazos River.

The Squaw Creek and Paluxy River watersheds are divided into four basins, as shown in Figure 7-1. Basins 1 and 2 represent the Squaw Creek watershed, and Basins 3 and 4 represent the Paluxy River watershed. The area upstream of the Squaw Creek Reservoir is steeper and has different basin properties compared to the area around and within the Squaw Creek Reservoir. Due to the variation of slope, Basin 1 has been further subdivided into three sub-basins 1a, 1b and 1c. Basin 1a represents the drainage area above Squaw Creek Reservoir, Basin 1b represents the contributing area adjacent to Squaw Creek Reservoir, and Basin 1c represents Squaw Creek

Reservoir. Basin 2 represents the Squaw Creek watershed downstream of the dam to the confluence of the Paluxy River. Basin 3 represents the Paluxy River watershed from the confluence of Squaw Creek to the city of Glen Rose. Basin 4 represents the drainage area north of Glen Rose. The general drainage pattern is to the southeast and ultimately drains into the Brazos River.

The watershed areas were obtained from the Dam Breach Analysis (Reference 10). The area for the Squaw Creek watershed was also similar to that used in Texas Utilities Services Inc., Comanche Peak Steam Electric Station Units 1 and 2 CPSES SSI Dam Design Calculation and Calculation Check, Volume 1 and 2 (Reference 19 and Reference 20), hereafter referred as the SSI Dam Design Calculation. Figure 7-1 illustrates the watershed sub-basins and boundaries. The drainage areas are shown in Table 7-1.

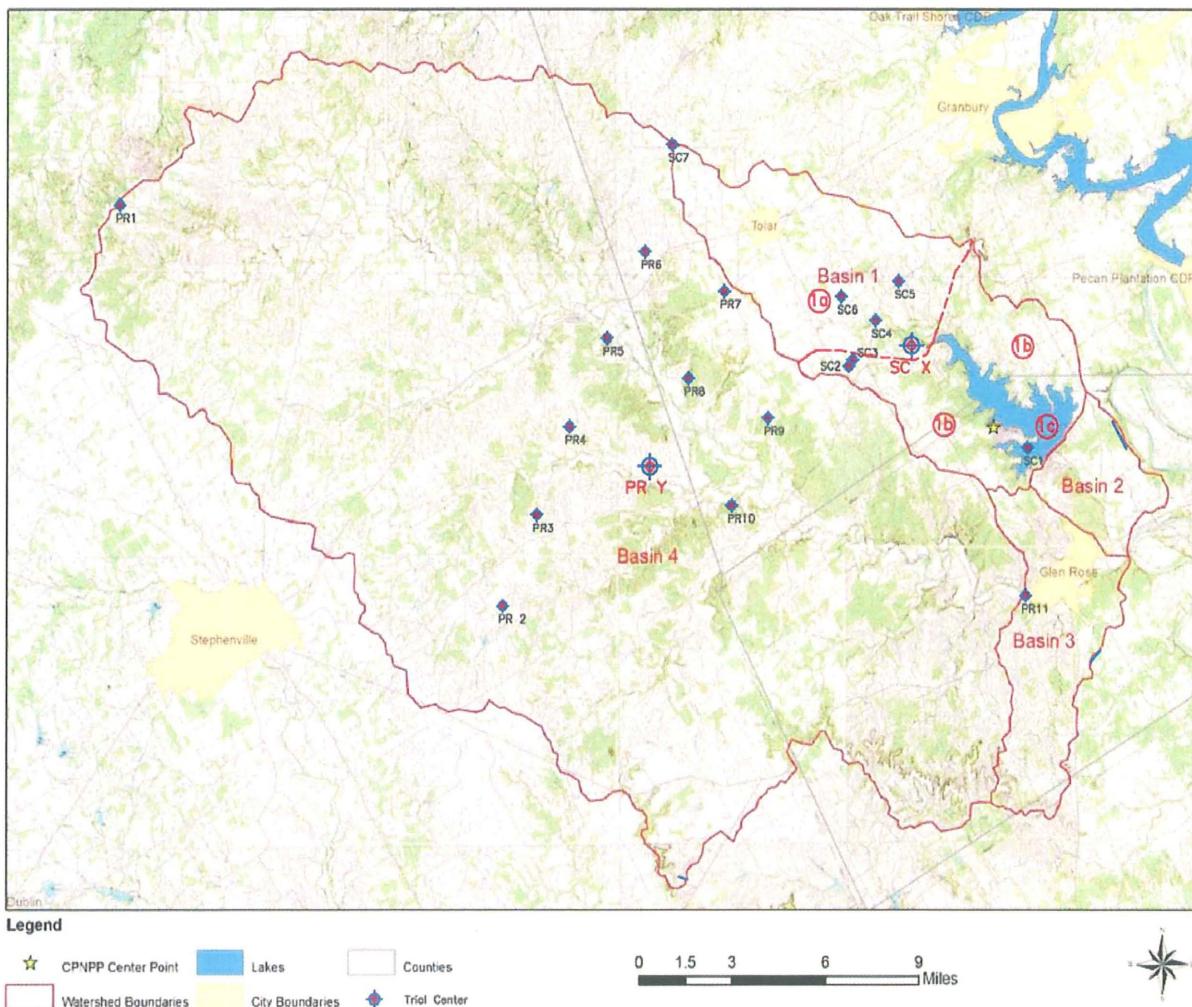


Figure 7-1. Drainage Basin Map with Storm Centers

Table 7-1. Watershed Drainage Areas

Watershed	Drainage Area (sq. mi.)
Basin 1	64.2
Basin 2	10.65
Basin 3	24.3
Basin 4	410.0

PMP Estimates – HMR 51 and HMR 52

HMR 51 applies to areas in the United States east of the 105th Meridian. The all-season PMP estimates for drainage areas from 10 to 20,000 sq. mi. for durations from 6 to 72 hours are obtained using HMR 51 PMP charts (Reference 2, Figures 18-47) and are shown in Table 7-2. An example of a PMP estimate employing Reference 2, Figure 18 with a basin area of 10 sq. mi. and for duration of 6 hours is shown in Figure 7-2. The CPNPP location is used to determine the PMP estimates in Table 7-2; linear interpolation between contours was used (Reference 2 Figure 19-47).

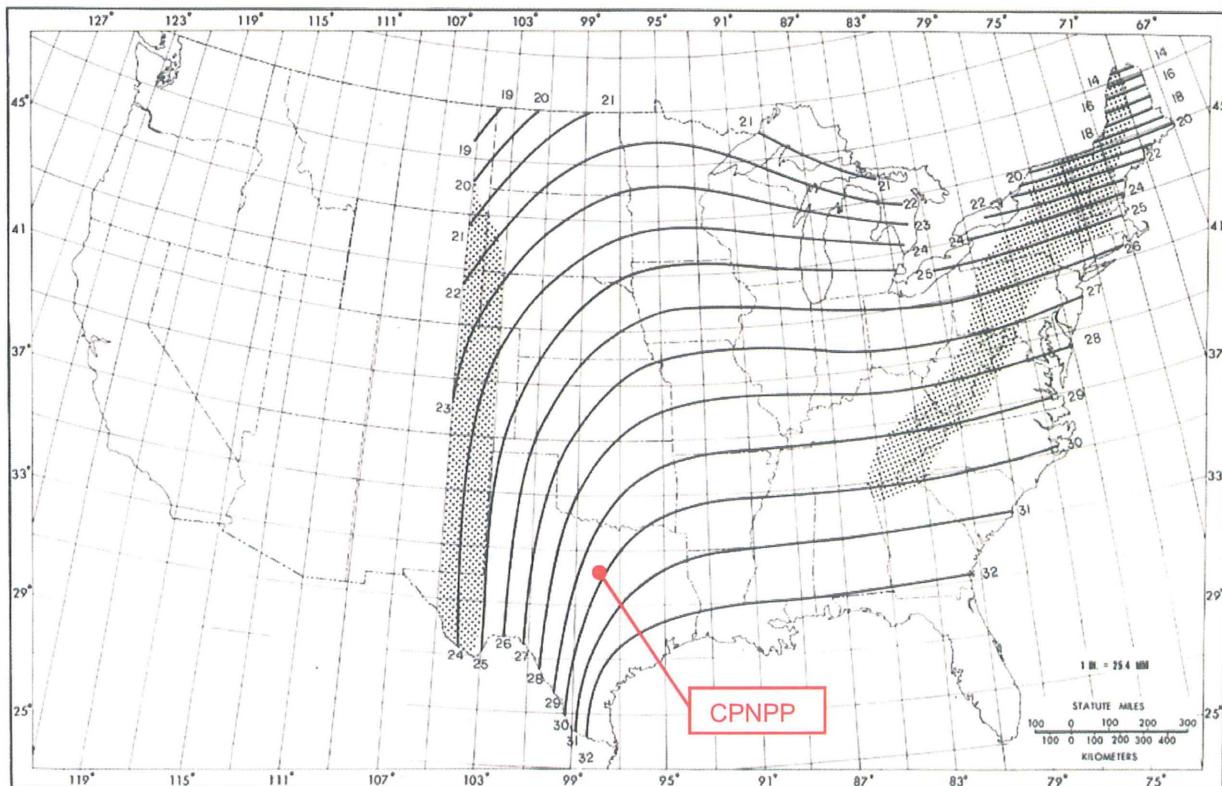


Figure 7-2. All-Season PMP (inch) for 6 hr. 10 sq. mi Basin

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 15 of 47

Table 7-2. Depth Area Duration PMP Values (inches)

		duration (hr.)				
		6	12	24	48	72
area sq. mi.	10	29.7	35.3	40.0	45.0	48.0
	200	22.2	26.8	32.0	36.0	39.6
	1000	15.9	20.7	25.8	30.0	33.4
	5000	9.3	13.1	17.8	22.0	25.0
	10000	7.1	10.3	14.4	18.5	21.0
	20000	5.1	8.3	11.5	15.0	17.8

USGS topographic maps were obtained from the USDA's Geospatial Data Gateway (Reference 7), and the drainage basin boundaries were mapped using ArcGIS software (Reference 8). The drainage basin coordinates are shown in Table 7-3. HMR 52 determines the basin area using the X, Y coordinates specified in Tables 7-3 through 7-7. The coordinates are provided in counter-clockwise order to describe the Paluxy River and Squaw Creek watersheds. The coordinates were drawn in AutoCAD (Reference 1), and line segments between each set of coordinates were connected with a continuous AutoCAD polyline. The last coordinate was connected to the first coordinate to describe the complete watershed. The CPNPP location as described in Section 5.0 corresponds to X, Y coordinate of 326 feet (ft.) and 215 ft. respectively in AutoCAD (Reference 1).

Table 7-3. Basin 1 Drainage Basin Coordinates

Basin 1		Basin 1	
X (ft.)	Y(ft.)	X (ft.)	Y(ft.)
352.79	439.49	377.46	249.82
330.08	425.42	398.65	273.83
309.24	374.54	380.84	307.02
294.79	331.20	385.89	320.85
305.63	266.57	375.51	358.76
288.78	244.31	379.90	370.70
298.06	211.25	370.35	385.48
296.58	200.39	371.38	393.09
308.64	181.51	365.40	396.82
318.80	185.02	356.46	395.52
322.02	180.91	349.53	405.43
356.16	177.00	353.98	411.90
364.98	179.72	353.13	420.90
366.54	181.01	356.42	429.53
386.16	198.56	352.83	441.22
392.28	228.19		

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 16 of 47

Table 7-4. Basin 2 Drainage Basin Coordinates

Basin2		Basin2	
X (ft.)	Y(ft.)	X (ft.)	Y(ft.)
367.42	181.89	331.83	122.14
364.98	179.72	340.98	122.91
356.16	177.00	349.67	115.82
322.02	180.58	353.27	123.27
318.79	183.71	349.84	135.16
308.87	181.13	354.39	137.78
307.93	169.52	357.02	149.00
308.46	141.75	364.94	163.23
303.88	128.54	364.65	170.54
308.51	116.39	367.19	172.22
315.41	121.11		

Table 7-5. Basin 3 Drainage Basin Coordinates

Basin3		Basin3	
X (ft.)	Y(ft.)	X (ft.)	Y(ft.)
296.69	200.58	200.78	92.18
291.69	192.59	217.93	92.91
285.04	188.09	233.49	104.32
281.37	177.77	243.97	104.64
281.37	167.45	247.19	101.71
275.37	160.46	253.98	106.79
260.06	154.76	261.76	105.33
251.89	154.76	272.19	107.43
246.63	153.56	277.06	101.45
240.75	156.62	287.20	107.36
230.63	153.31	290.72	107.36
225.36	145.58	294.55	114.21
219.86	135.17	306.52	114.52
200.07	125.34	308.51	116.39
164.07	115.41	303.88	128.54
168.68	94.86	308.46	141.75
175.89	88.63	307.93	169.52
172.76	82.92	308.87	181.13
198.29	85.08		

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 17 of 47

Table 7-6. Basin 4 Drainage Basin Coordinates

Basin 4		Basin 4		Basin 4	
X (ft.)	Y(ft.)	X (ft.)	Y(ft.)	X (ft.)	Y(ft.)
352.83	441.55	85.17	547.94	126.58	225.30
348.27	481.91	76.93	530.64	133.09	225.30
349.06	512.52	85.92	505.20	136.39	213.74
345.02	515.46	75.56	501.21	145.99	213.23
347.40	523.63	77.81	486.11	138.58	195.37
339.30	523.40	82.63	484.73	143.21	187.20
323.65	550.24	84.80	480.07	127.17	150.20
325.81	562.78	70.55	471.39	137.74	138.83
317.65	565.85	66.09	460.51	139.10	127.70
314.81	571.38	56.79	459.91	151.01	120.25
317.41	574.39	57.55	445.42	157.40	124.31
315.60	579.23	49.52	431.26	164.07	115.41
306.50	582.39	51.04	423.96	200.07	125.34
302.11	600.03	40.80	416.89	219.86	135.17
295.40	600.45	40.05	406.78	230.63	153.31
295.40	611.99	54.76	378.07	240.75	156.62
289.69	617.28	61.58	377.45	246.73	153.56
284.22	639.95	65.82	347.05	251.89	154.76
279.71	643.97	47.95	304.18	260.06	154.76
267.30	640.65	62.30	290.43	275.37	160.46
258.73	651.35	35.02	242.80	281.37	167.45
236.42	648.71	36.56	238.08	281.37	177.77
226.97	677.81	46.93	239.96	285.03	188.09
213.99	664.96	55.09	236.18	291.70	192.59
161.34	685.28	63.69	238.71	296.69	200.58
123.53	676.86	73.84	233.34	298.06	211.24
111.32	664.03	72.72	225.26	288.52	244.00
96.22	593.06	84.03	226.56	305.69	264.84
102.62	588.70	92.24	224.02	294.79	331.20
97.35	567.83	97.83	224.87	330.09	425.42
81.49	554.59	121.92	215.42		

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 18 of 47

Table 7-7. Overall Watershed Drainage Basin Coordinates

Overall		Overall		Overall	
X (ft.)	Y(ft.)	X (ft.)	Y(ft.)	X (ft.)	Y(ft.)
352.83	441.55	82.63	484.73	198.29	85.08
348.27	481.91	84.80	480.07	200.78	92.18
349.06	512.52	66.09	460.51	217.93	92.91
345.02	515.46	56.79	459.91	233.49	104.32
347.40	523.63	57.55	445.42	243.97	104.64
339.30	523.40	49.52	431.26	277.06	101.45
323.65	550.24	51.04	423.96	294.55	114.21
325.81	562.78	40.80	416.89	315.41	121.11
317.65	565.85	40.05	406.78	331.83	122.14
314.81	571.38	54.76	378.07	340.98	122.91
317.41	574.39	65.82	347.05	349.67	115.82
315.60	579.23	47.95	304.18	353.27	123.27
306.50	582.39	62.30	290.43	349.84	135.16
302.11	600.03	35.02	242.80	354.39	137.78
295.40	600.45	36.56	238.08	367.19	172.22
295.40	611.99	63.69	238.71	367.42	181.89
289.69	617.28	73.84	233.34	386.16	198.56
284.22	639.95	72.72	225.26	392.28	228.19
279.71	643.97	84.03	226.56	377.46	249.82
267.30	640.65	121.92	215.42	398.65	273.83
258.73	651.35	126.58	225.30	380.84	307.02
236.42	648.71	133.09	225.30	385.89	320.85
226.97	677.81	136.39	213.74	375.51	358.76
213.99	664.96	145.99	213.23	379.90	370.70
161.34	685.28	138.58	195.37	370.35	385.48
123.53	676.86	143.21	187.20	371.38	393.09
111.32	664.03	127.17	150.20	365.40	396.82
96.22	593.06	137.74	138.83	356.46	395.52
102.62	588.70	151.01	120.25	349.53	405.43
85.17	547.94	157.40	124.31	353.98	411.90
76.93	530.64	164.07	115.41	353.13	420.90
85.92	505.20	168.68	94.86	356.42	429.53
75.56	501.21	175.89	88.63		
77.81	486.11	486.11	172.76		



CALCULATION CONTROL SHEET

TXUT-001-FSAR 2.4.3-CALC-011

REV. 2

PAGE NO. 19 of 47

HMR 52 (Reference 4, Figure 3) was used to determine the preferred orientation of 215 degrees for the storm. HMR 52 (Reference 5) software iterates to achieve the optimal storm orientation that maximizes precipitation. As identified by HMR 52 guidance (Reference 3), when the optimal storm orientation differs from the preferred storm orientation by more than 40 degrees, a reduction to the precipitation should be made. This reduction occurs automatically within the HMR 52 software. The optimal storm orientation calculated by HMR 52 software is 172 degrees and 145 degrees for storm centers at PR Y and SC X, respectively. HMR 52 (Reference 4, Figure 8) was used to determine the 1-hr. to 6-hr. precipitation ratio of 0.308 for isohyet A of a 20,000 sq. mi. storm.

Determining the critical storm center is an iterative process of computing the hourly PMP and rainfall runoff for several storm centers. The trial centers are shown in Figure 7-1. The HMR 52 analysis indicates that the trial centers PR Y and SC X result in the maximum rainfall runoff estimates for the overall watershed and the Squaw Creek watershed (Basin 1), respectively.

The PMP obtained for each storm center is analyzed to calculate the runoff using HEC-HMS (Reference 6). The HEC-HMS model and inputs are described in detail within a separate Enercon Calculation entitled "TXUT-001-FSAR 2.4.3-CALC-012, MITS004 – Probable Maximum Flood Calculation for Comanche Peak Nuclear Power Plant Units 3 and 4 (HEC-HMS & HEC-RAS)" (Reference 9), hereafter referred to as the Enercon PMF Calculation. The trial centers PR Y and SC X result in the maximum runoff and are used as critical storm centers. The storm center SC2 results in the greatest rainfall estimates for the Squaw Creek watershed. However, due to the location of storm centers and flood routing, the storm center SC X, with just slightly less cumulative rainfall, results in higher runoff at the CPNPP Units 3 and 4, for the overall PMP scenario, as indicated in Table 7-8.

Table 7-8. Critical Storm Center Determination

Overall PMP (with storm center in Paluxy River watershed - Basin 4)			Overall PMP (with storm center in Squaw Creek watershed - Basin 1)			Squaw Creek Reservoir PMP (Basin 1 only with storm center in Squaw Creek watershed)		
Storm center	PMP estimates using HMR 52 (in.)	Runoff estimates using HEC-HMS (at junction of Paluxy & Squaw Creek) (cfs)	Storm center	PMP estimates using HMR 52 (in.)	Runoff estimates using HEC-HMS (Basin 1) (cfs)	Storm center	PMP estimates using HMR 52 (in.)	Runoff estimates using HEC-HMS (Basin 1) (cfs)
PR1	31.11	523,200	SC1	36.49	199,700	SC1	40.21	280,500
PR2	31.22	520,200	SC2	38.53	228,400	SC2	40.76	287,700
PR3	33.79	598,800	SC3	38.44	228,300	SC3	40.96	296,700
PR4	34.86	619,700	SC4	38.39	228,400	SC4	42.52	318,700
PR5	34.77	594,400	SC5	36.80	205,200	SC5	41.91	310,500
PR6	33.49	544,700	SC6	38.27	227,100	SC6	42.24	314,600
PR7	33.37	533,000	SC7	34.47	175,900	SC7	38.31	247,100
PR8	34.77	587,800	SC X	38.46	229,100	SC X	42.53	318,800
PR9	34.56	577,200						
PR10	35.06	603,100						
PR11	33.03	521,800						
PR Y	35.08	619,900						

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 20 of 47

The critical temporal distribution of the PMP for each storm center is determined by watershed rainfall runoff analysis using HEC-HMS (Reference 6). In order to reduce the number of distributions for evaluation, four distributions were chosen that bracket the range of possible hyetographs. The four temporal distributions are one-third peaking event, center peaking event, two-third peaking event, and end peaking event. Results are summarized in Tables 7-9, 7-10 and 7-11, which show the runoff obtained using the four distributions for the Paluxy River and Squaw Creek watersheds.

The analysis (Table 7-9) shows that the center temporal distribution is the critical storm distribution for the Paluxy River watershed, resulting in higher runoff at the confluence of the Squaw Creek and the Paluxy River watersheds. Therefore, the Overall PMP center distribution of the HMR 52 estimates obtained at PR Y was used as the critical PMP for Basin 3 and Basin 4 in the HEC-HMS rainfall runoff analysis.

Similarly, the analysis (Table 7-10) shows that the two-third temporal distribution for the overall basin with the storm center at SC X produces the highest runoff for an overall PMP within the Squaw Creek watershed. The corresponding overall PMP two-third temporal distribution for Basin 2 was used as the critical PMP for Basin 2 in the HEC-HMS rainfall-runoff analysis.

Finally, the analysis (Table 7-11) shows that the two-third temporal distribution for the Squaw Creek Reservoir PMP (Basin 1 only) results in the higher outflow from the Squaw Creek Reservoir, which will result in higher water surface elevation for the Squaw Creek Reservoir, and it was chosen as the critical storm distribution. Therefore, the Squaw Creek Reservoir PMP two-third temporal distribution for Basin 1 was used as the critical PMP for Basin 1 in the HEC-HMS rainfall runoff analysis.

Table 7-9. Rainfall-Runoff Analysis for Paluxy River Watershed (Basin 3 & 4) Using HEC-HMS and Overall PMP with Four Temporal Distributions at the Critical Storm Center PR Y.

Peak flow at junction of Paluxy River & Squaw Creek for Overall PMP with Storm Center at PR Y				
Temporal Distribution	One-Third (cfs)	Center (cfs)	Two- Third (cfs)	End (cfs)
Peak Outflow	619,792	619,925	619,906	566,547

Table 7-10. Rainfall-Runoff Analysis for Squaw Creek Reservoir Watershed (Basin 1) Using HEC-HMS and Overall PMP with Four Temporal Distributions at the Critical Storm Center SC X.

Peak flow at Squaw Creek Reservoir watershed (Basin 1) for Overall PMP with Storm Center at SC X							
One-Third		Center		Two-Third		End	
Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)
229,006	156,510	229,006	158,721	229,006	159,772	189,556	115,483

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 21 of 47

Table 7-11. Rainfall-Runoff Analysis for Squaw Creek Reservoir Watershed (Basin 1) Using HEC-HMS and Squaw Creek Reservoir PMP with Four Temporal Distributions at the Critical Storm Center **SC X**.

Peak flow at Squaw Creek Reservoir for Squaw Creek Reservoir PMP with Storm Center at SC X							
One-Third		Center		Two-Third		End	
Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)	Peak Inflow (cfs)	Peak Outflow (cfs)
318,715	202,598	318,715	205,079	318,715	206,225	237,174	118,878

Table 7-12 shows the hourly cumulative Overall PMP at critical storm center PR Y for each sub-basin. Table 7-13 shows the hourly cumulative Overall PMP at critical storm center SC X for each sub-basin. Table 7-14 shows the hourly cumulative Squaw Creek Reservoir PMP at critical storm center SC X for the Squaw Creek Reservoir watershed (Basin 1 Only).

The four temporal distributions discussed above were selected in accordance with HMR guidelines; they are tabulated and graphed below. The distributions for the Paluxy River watershed (Basin 3 & 4), using Overall PMP with the storm center at PR Y are shown in Tables 7-15 through 7-22 and the corresponding figures are shown in Figures 7-3 through 7-10, respectively.

The temporal distributions for the Squaw Creek watershed (Basin 1 and Basin 2), using the Overall PMP with the storm center at SC X are shown in Tables 7-23 through 7-30, and the corresponding figures are shown in Figures 7-11 through 7-18.

Similarly, the temporal distributions for the Squaw Creek Reservoir PMP with the storm center at SC X are shown in Tables 7-31 through 7-34, and the corresponding figures are shown in Figures 7-19 through 7-22.

Cumulative mass curves comparing all four temporal distributions are provided in Figure 7-23 (Basin 4) and 7-24 (Basin 3) for Overall PMP with the storm center at PR Y in the Paluxy River watershed. Cumulative mass curves comparing all four temporal distributions are provided in Figure 7-25 (Basin 1) and Figure 7-26 (Basin 2) for Overall PMP with the storm center at SC X in the Squaw Creek watershed. Cumulative mass curves comparing all four temporal distributions are provided in Figure 7-27 for Squaw Creek Reservoir PMP with the storm center at SC X in the Squaw Creek watershed.

	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 22 of 47

Table 7-12. Sub-basin Hourly Cumulative PMP - Overall PMP with Critical Storm Center at PR Y

Time (hr.)	Overall (in.)	Basin 1 (in.)	Basin 2 (in.)	Basin 3 (in.)	Basin 4 (in.)	Time (hr.)	Overall (in.)	Basin 1 (in.)	Basin 2 (in.)	Basin 3 (in.)	Basin 4 (in.)
01:00	0.10	0.10	0.10	0.10	0.10	37:00	11.49	10.71	10.81	11.52	11.63
02:00	0.20	0.19	0.19	0.20	0.20	38:00	13.60	12.60	12.69	13.51	13.79
03:00	0.30	0.29	0.29	0.30	0.30	39:00	16.76	15.31	15.39	16.51	17.04
04:00	0.40	0.38	0.38	0.40	0.40	40:00	23.70	20.47	20.56	23.37	24.31
05:00	0.50	0.48	0.48	0.51	0.50	41:00	26.39	22.82	22.90	25.90	27.07
06:00	0.59	0.57	0.58	0.61	0.60	42:00	28.27	24.51	24.58	27.67	28.99
07:00	0.71	0.69	0.69	0.73	0.72	43:00	28.82	25.03	25.11	28.23	29.54
08:00	0.83	0.80	0.81	0.85	0.84	44:00	29.33	25.51	25.59	28.74	30.06
09:00	0.95	0.92	0.92	0.98	0.96	45:00	29.80	25.95	26.04	29.21	30.53
10:00	1.07	1.03	1.04	1.10	1.08	46:00	30.23	26.37	26.46	29.66	30.97
11:00	1.19	1.15	1.16	1.22	1.21	47:00	30.64	26.76	26.86	30.07	31.38
12:00	1.31	1.26	1.27	1.34	1.33	48:00	31.03	27.13	27.24	30.47	31.77
13:00	1.47	1.41	1.42	1.50	1.48	49:00	31.29	27.37	27.48	30.73	32.03
14:00	1.62	1.55	1.57	1.65	1.63	50:00	31.54	27.61	27.73	30.99	32.28
15:00	1.77	1.70	1.71	1.81	1.79	51:00	31.79	27.86	27.97	31.24	32.54
16:00	1.93	1.84	1.86	1.96	1.94	52:00	32.05	28.10	28.22	31.50	32.80
17:00	2.08	1.99	2.01	2.12	2.10	53:00	32.30	28.34	28.46	31.76	33.05
18:00	2.23	2.13	2.15	2.27	2.25	54:00	32.56	28.58	28.71	32.02	33.31
19:00	2.44	2.33	2.36	2.49	2.46	55:00	32.73	28.75	28.88	32.20	33.49
20:00	2.65	2.53	2.56	2.70	2.67	56:00	32.91	28.92	29.05	32.38	33.66
21:00	2.86	2.72	2.76	2.91	2.88	57:00	33.08	29.09	29.22	32.56	33.84
22:00	3.06	2.92	2.96	3.12	3.09	58:00	33.26	29.25	29.39	32.74	34.02
23:00	3.27	3.12	3.16	3.33	3.30	59:00	33.44	29.42	29.56	32.92	34.19
24:00	3.48	3.32	3.36	3.55	3.51	60:00	33.61	29.59	29.73	33.10	34.37
25:00	3.77	3.60	3.64	3.84	3.80	61:00	33.75	29.72	29.86	33.23	34.51
26:00	4.07	3.89	3.93	4.15	4.11	62:00	33.88	29.85	29.99	33.37	34.64
27:00	4.39	4.19	4.24	4.47	4.43	63:00	34.02	29.97	30.12	33.51	34.78
28:00	4.72	4.50	4.56	4.81	4.76	64:00	34.15	30.10	30.25	33.64	34.91
29:00	5.07	4.84	4.90	5.17	5.12	65:00	34.29	30.23	30.38	33.78	35.05
30:00	5.45	5.19	5.26	5.55	5.49	66:00	34.42	30.36	30.51	33.92	35.19
31:00	6.04	5.75	5.82	6.15	6.09	67:00	34.53	30.46	30.61	34.03	35.30
32:00	6.68	6.34	6.41	6.79	6.74	68:00	34.64	30.57	30.72	34.14	35.41
33:00	7.39	6.98	7.07	7.50	7.46	69:00	34.75	30.67	30.82	34.25	35.52
34:00	8.18	7.70	7.79	8.29	8.27	70:00	34.86	30.77	30.93	34.36	35.63
35:00	9.08	8.52	8.61	9.18	9.18	71:00	34.97	30.88	31.03	34.47	35.74
36:00	10.09	9.44	9.54	10.17	10.21	72:00	35.08	30.98	31.14	34.58	35.85

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 23 of 47

Table 7-13. Sub-basin Hourly Cumulative PMP - Overall PMP with Critical Storm Center at SC X

Time (hr.)	Overall (in.)	Basin 1 (in.)	Basin 2 (in.)	Basin 3 (in.)	Basin 4 (in.)	Time (hr.)	Overall (in.)	Basin 1 (in.)	Basin 2 (in.)	Basin 3 (in.)	Basin 4 (in.)
01:00	0.10	0.10	0.10	0.09	0.10	37:00	11.05	12.16	11.60	10.36	10.92
02:00	0.19	0.20	0.20	0.18	0.19	38:00	13.01	14.68	13.72	12.09	12.80
03:00	0.29	0.30	0.30	0.27	0.29	39:00	15.82	18.39	16.82	14.50	15.48
04:00	0.38	0.40	0.40	0.36	0.38	40:00	21.26	26.17	23.23	18.75	20.60
05:00	0.48	0.50	0.50	0.46	0.48	41:00	23.70	29.38	25.90	20.87	22.93
06:00	0.57	0.59	0.59	0.55	0.57	42:00	25.45	31.62	27.79	22.42	24.62
07:00	0.69	0.71	0.71	0.66	0.69	43:00	25.98	32.19	28.35	22.93	25.14
08:00	0.80	0.83	0.83	0.77	0.80	44:00	26.48	32.71	28.86	23.40	25.63
09:00	0.92	0.95	0.95	0.88	0.92	45:00	26.93	33.19	29.32	23.83	26.08
10:00	1.03	1.07	1.07	0.99	1.03	46:00	27.35	33.63	29.76	24.23	26.50
11:00	1.15	1.19	1.19	1.10	1.15	47:00	27.75	34.05	30.17	24.61	26.89
12:00	1.26	1.31	1.31	1.21	1.26	48:00	28.12	34.44	30.56	24.97	27.27
13:00	1.41	1.47	1.47	1.35	1.41	49:00	28.37	34.69	30.81	25.20	27.51
14:00	1.55	1.62	1.62	1.49	1.55	50:00	28.61	34.95	31.06	25.44	27.76
15:00	1.70	1.77	1.77	1.63	1.70	51:00	28.86	35.20	31.32	25.67	28.00
16:00	1.84	1.92	1.92	1.77	1.84	52:00	29.10	35.45	31.57	25.90	28.24
17:00	1.99	2.07	2.07	1.91	1.99	53:00	29.35	35.70	31.82	26.14	28.49
18:00	2.14	2.23	2.23	2.05	2.14	54:00	29.59	35.96	32.08	26.37	28.73
19:00	2.34	2.43	2.43	2.24	2.34	55:00	29.76	36.13	32.25	26.53	28.90
20:00	2.54	2.64	2.64	2.43	2.53	56:00	29.93	36.31	32.43	26.70	29.07
21:00	2.74	2.85	2.85	2.62	2.73	57:00	30.10	36.48	32.60	26.86	29.24
22:00	2.94	3.05	3.05	2.81	2.93	58:00	30.27	36.66	32.78	27.02	29.40
23:00	3.14	3.26	3.26	3.00	3.13	59:00	30.44	36.83	32.95	27.18	29.57
24:00	3.34	3.47	3.47	3.19	3.33	60:00	30.61	37.01	33.13	27.34	29.74
25:00	3.62	3.76	3.76	3.46	3.61	61:00	30.74	37.14	33.26	27.47	29.87
26:00	3.91	4.06	4.06	3.74	3.90	62:00	30.86	37.28	33.39	27.59	30.00
27:00	4.21	4.37	4.38	4.03	4.20	63:00	30.99	37.41	33.53	27.71	30.13
28:00	4.53	4.70	4.71	4.34	4.52	64:00	31.12	37.54	33.66	27.84	30.26
29:00	4.87	5.06	5.06	4.66	4.86	65:00	31.25	37.68	33.80	27.96	30.39
30:00	5.23	5.43	5.43	5.00	5.22	66:00	31.38	37.81	33.93	28.08	30.51
31:00	5.81	6.06	6.03	5.54	5.79	67:00	31.48	37.92	34.04	28.18	30.62
32:00	6.43	6.75	6.69	6.13	6.40	68:00	31.59	38.03	34.15	28.28	30.72
33:00	7.12	7.52	7.42	6.77	7.08	69:00	31.69	38.14	34.25	28.38	30.83
34:00	7.89	8.40	8.23	7.48	7.84	70:00	31.80	38.24	34.36	28.48	30.93
35:00	8.75	9.39	9.15	8.27	8.68	71:00	31.90	38.35	34.47	28.58	31.03
36:00	9.73	10.53	10.18	9.16	9.64	72:00	32.00	38.46	34.58	28.68	31.14

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 24 of 47

Table 7-14. Hourly Cumulative PMP - Squaw Creek Reservoir PMP with Critical Storm Center at SC X.

Time (hr.)	Basin 1 (in.)	Time (hr.)	Basin 1 (in.)	Time (hr.)	Basin 1 (in.)
01:00	0.10	25:00	3.86	49:00	38.65
02:00	0.20	26:00	4.17	50:00	38.91
03:00	0.30	27:00	4.49	51:00	39.18
04:00	0.40	28:00	4.84	52:00	39.44
05:00	0.51	29:00	5.20	53:00	39.70
06:00	0.61	30:00	5.58	54:00	39.96
07:00	0.73	31:00	6.21	55:00	40.14
08:00	0.85	32:00	6.90	56:00	40.32
09:00	0.98	33:00	7.66	57:00	40.50
10:00	1.10	34:00	8.52	58:00	40.68
11:00	1.22	35:00	9.49	59:00	40.86
12:00	1.34	36:00	10.59	60:00	41.04
13:00	1.50	37:00	12.10	61:00	41.18
14:00	1.66	38:00	14.43	62:00	41.31
15:00	1.81	39:00	18.27	63:00	41.45
16:00	1.97	40:00	30.38	64:00	41.59
17:00	2.12	41:00	33.49	65:00	41.72
18:00	2.28	42:00	35.53	66:00	41.86
19:00	2.49	43:00	36.11	67:00	41.97
20:00	2.71	44:00	36.63	68:00	42.08
21:00	2.92	45:00	37.12	69:00	42.19
22:00	3.13	46:00	37.57	70:00	42.30
23:00	3.35	47:00	37.99	71:00	42.42
24:00	3.56	48:00	38.39	72:00	42.53

E N E R C O N	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3- CALC-011
		REV. 2
		PAGE NO. 25 of 47

Table 7-15. One-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	2.7580	49	0.1540
1	0.1000	26	1.9150	50	0.1540
2	0.1000	27	0.5580	51	0.1360
3	0.2100	28	0.5120	52	0.1360
4	0.2100	29	0.4720	53	0.1360
5	0.2100	30	0.4390	54	0.1360
6	0.2100	31	0.4130	55	0.1360
7	0.2100	32	0.3930	56	0.1360
8	0.2100	33	0.2560	57	0.1210
9	0.2930	34	0.2560	58	0.1210
10	0.3050	35	0.2560	59	0.1210
11	0.3190	36	0.2560	60	0.1210
12	0.3350	37	0.2560	61	0.1210
13	0.3540	38	0.2560	62	0.1210
14	0.3750	39	0.1770	63	0.1100
15	0.6020	40	0.1770	64	0.1100
16	0.6510	41	0.1770	65	0.1100
17	0.7180	42	0.1770	66	0.1100
18	0.8040	43	0.1770	67	0.1100
19	0.9090	44	0.1770	68	0.1100
20	1.0320	45	0.1540	69	0.1000
21	1.4260	46	0.1540	70	0.1000
22	2.1610	47	0.1540	71	0.1000
23	3.2460	48	0.1540	72	0.1000
24	7.2720				

**Overall PMP - One-Third Temporal Distribution (Basin 4)
Hyetograph
(Storm center at PR Y)**

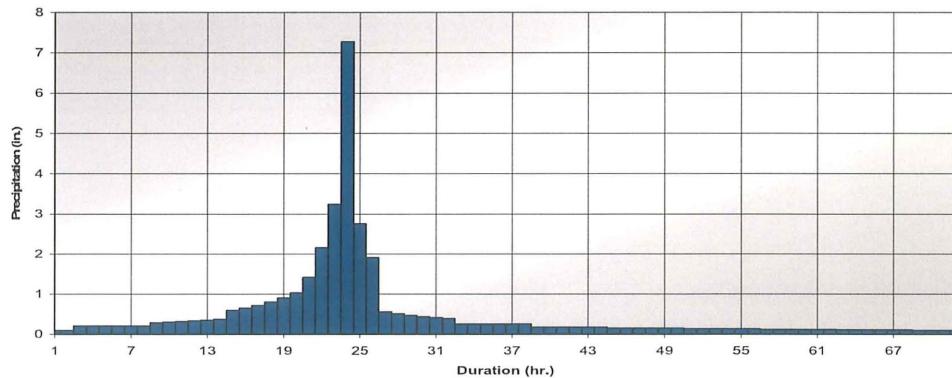


Figure 7-3. One-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 26 of 47

Table 7-16. Center Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1000	25	0.3540	49	0.2560
2	0.1000	26	0.3750	50	0.2560
3	0.1210	27	0.6020	51	0.1770
4	0.1210	28	0.6510	52	0.1770
5	0.1210	29	0.7180	53	0.1770
6	0.1210	30	0.8040	54	0.1770
7	0.1210	31	0.9090	55	0.1770
8	0.1210	32	1.0320	56	0.1770
9	0.1540	33	1.4260	57	0.1360
10	0.1540	34	2.1610	58	0.1360
11	0.1540	35	3.2460	59	0.1360
12	0.1540	36	7.2720	60	0.1360
13	0.1540	37	2.7580	61	0.1360
14	0.1540	38	1.9150	62	0.1360
15	0.2100	39	0.5580	63	0.1100
16	0.2100	40	0.5120	64	0.1100
17	0.2100	41	0.4720	65	0.1100
18	0.2100	42	0.4390	66	0.1100
19	0.2100	43	0.4130	67	0.1100
20	0.2100	44	0.3930	68	0.1100
21	0.2930	45	0.2560	69	0.1000
22	0.3050	46	0.2560	70	0.1000
23	0.3190	47	0.2560	71	0.1000
24	0.3350	48	0.2560	72	0.1000

Overall PMP - Center Temporal Distribution (Basin 4)
Hyetograph
(Storm center at PR Y)

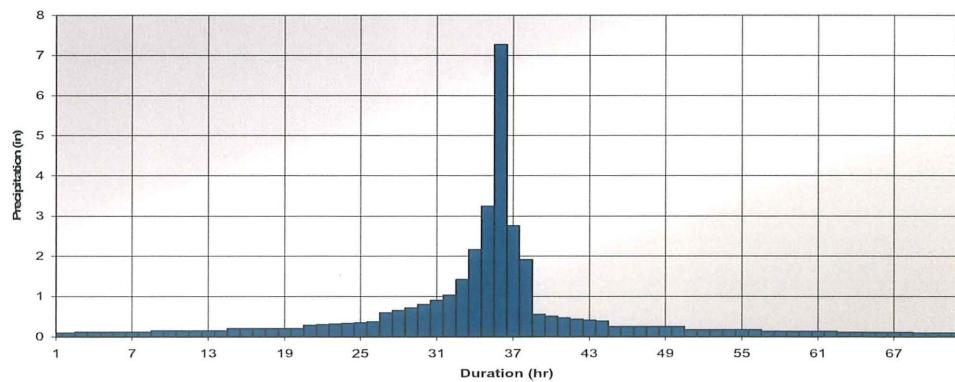


Figure 7-4. Center Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Table 7-17. Two-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1000	25	0.1540	49	2.7580
2	0.1000	26	0.1540	50	1.9150
3	0.1000	27	0.2100	51	0.5580
4	0.1000	28	0.2100	52	0.5120
5	0.1000	29	0.2100	53	0.4720
6	0.1000	30	0.2100	54	0.4390
7	0.1100	31	0.2100	55	0.4130
8	0.1100	32	0.2100	56	0.3930
9	0.1100	33	0.2930	57	0.2560
10	0.1100	34	0.3050	58	0.2560
11	0.1100	35	0.3190	59	0.2560
12	0.1100	36	0.3350	60	0.2560
13	0.1210	37	0.3540	61	0.2560
14	0.1210	38	0.3750	62	0.2560
15	0.1210	39	0.6020	63	0.1770
16	0.1210	40	0.6510	64	0.1770
17	0.1210	41	0.7180	65	0.1770
18	0.1210	42	0.8040	66	0.1770
19	0.1360	43	0.9090	67	0.1770
20	0.1360	44	1.0320	68	0.1770
21	0.1540	45	1.4260	69	0.1360
22	0.1540	46	2.1610	70	0.1360
23	0.1540	47	3.2460	71	0.1360
24	0.1540	48	7.2720	72	0.1360

Overall PMP - Two-Third Temporal Distribution (Basin 4)
Hyetograph
(Storm center at PR Y)

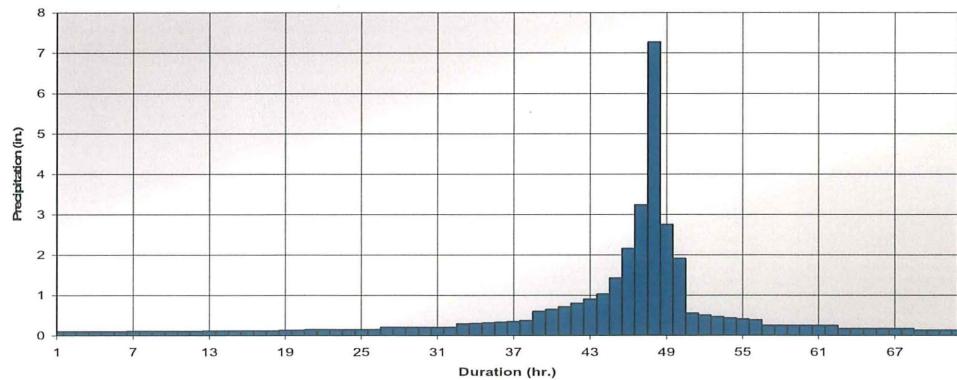


Figure 7-5. Two-Third Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Table 7-18. End Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1000	25	0.1540	49	0.2930
2	0.1000	26	0.1540	50	0.3050
3	0.1000	27	0.1540	51	0.3190
4	0.1000	28	0.1540	52	0.3350
5	0.1000	29	0.1540	53	0.3540
6	0.1000	30	0.1540	54	0.3750
7	0.1100	31	0.1770	55	0.3930
8	0.1100	32	0.1770	56	0.4130
9	0.1100	33	0.1770	57	0.4390
10	0.1100	34	0.1770	58	0.4720
11	0.1100	35	0.1770	59	0.5120
12	0.1100	36	0.1770	60	0.5580
13	0.1210	37	0.2100	61	0.6020
14	0.1210	38	0.2100	62	0.6510
15	0.1210	39	0.2100	63	0.7180
16	0.1210	40	0.2100	64	0.8040
17	0.1210	41	0.2100	65	0.9090
18	0.1210	42	0.2100	66	1.0320
19	0.1360	43	0.2560	67	1.4260
20	0.1360	44	0.2560	68	1.9150
21	0.1360	45	0.2560	69	2.1610
22	0.1360	46	0.2560	70	2.7580
23	0.1360	47	0.2560	71	3.2460
24	0.1360	48	0.2560	72	7.2720

Overall PMP - End Temporal Distribution (Basin 4)
Hyetograph
(Storm center at PR Y)

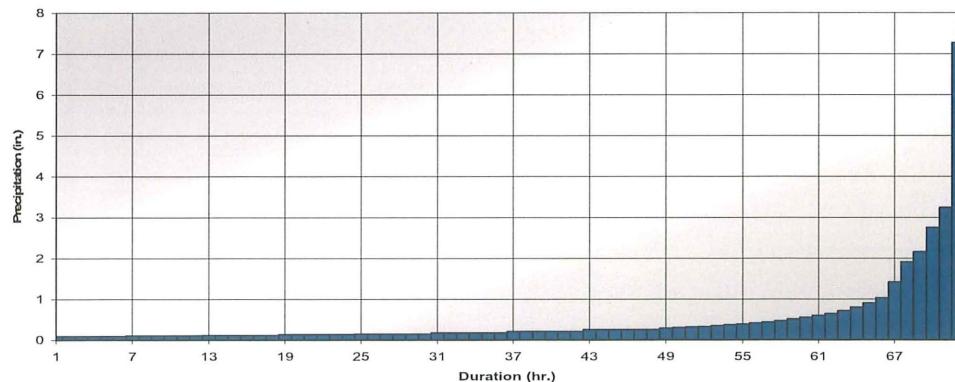


Figure 7-6. End Peaking Temporal Distribution (Basin 4) – Overall PMP with Storm Center at PR Y

E ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 29 of 47

Table 7-19. One-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	2.5370	49	0.1550
1	0.1010	26	1.7680	50	0.1550
2	0.1010	27	0.5570	51	0.1370
3	0.2120	28	0.5120	52	0.1370
4	0.2120	29	0.4740	53	0.1370
5	0.2120				
6	0.2120	30	0.4420	54	0.1370
7	0.2120	31	0.4160	55	0.1370
8	0.2120	32	0.3960	56	0.1370
9	0.2970	33	0.2590	57	0.1230
10	0.3080	34	0.2590	58	0.1230
11	0.3220	35	0.2590	59	0.1230
12	0.3380	36	0.2590	60	0.1230
13	0.3570	37	0.2590	61	0.1230
14	0.3780	38	0.2590	62	0.1230
15	0.5990	39	0.1790	63	0.1110
16	0.6460	40	0.1790	64	0.1110
17	0.7090	41	0.1790	65	0.1110
18	0.7890	42	0.1790	66	0.1110
19	0.8860	43	0.1790	67	0.1110
20	0.9990	44	0.1790	68	0.1110
21	1.3420	45	0.1550	69	0.1010
22	1.9920	46	0.1550	70	0.1010
23	3.0050	47	0.1550	71	0.1010
24	6.8520	48	0.1550	72	0.1010

**Overall PMP - One-Third Temporal Distribution (Basin 3)
Hyetograph
(Storm center at PR Y)**

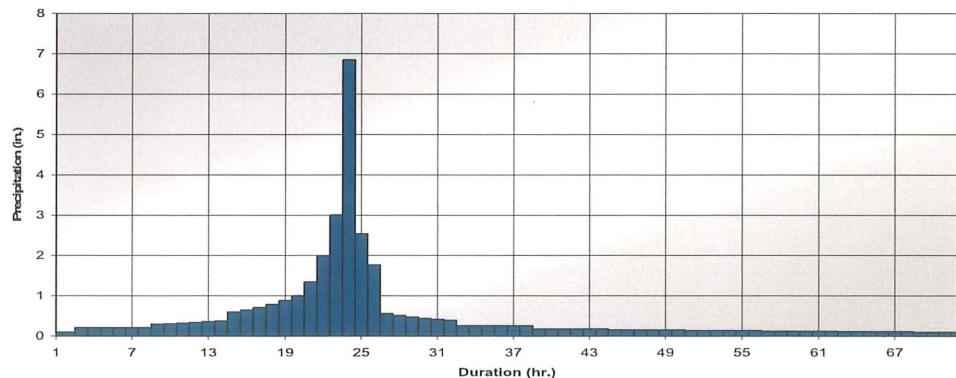


Figure 7-7. One-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 30 of 47

Table 7-20. Center Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	0.3570	49	0.2590
1	0.1010	26	0.3780	50	0.2590
2	0.1010	27	0.5990	51	0.1790
3	0.1230	28	0.6460	52	0.1790
4	0.1230	29	0.7090	53	0.1790
5	0.1230				
6	0.1230	30	0.7890	54	0.1790
7	0.1230	31	0.8860	55	0.1790
8	0.1230	32	0.9990	56	0.1790
9	0.1550	33	1.3420	57	0.1370
10	0.1550	34	1.9920	58	0.1370
11	0.1550	35	3.0050	59	0.1370
12	0.1550	36	6.8520	60	0.1370
13	0.1550	37	2.5370	61	0.1370
14	0.1550	38	1.7680	62	0.1370
15	0.2120	39	0.5570	63	0.1110
16	0.2120	40	0.5120	64	0.1110
17	0.2120	41	0.4740	65	0.1110
18	0.2120	42	0.4420	66	0.1110
19	0.2120	43	0.4160	67	0.1110
20	0.2120	44	0.3960	68	0.1110
21	0.2970	45	0.2590	69	0.1010
22	0.3080	46	0.2590	70	0.1010
23	0.3220	47	0.2590	71	0.1010
24	0.3380	48	0.2590	72	0.1010

Overall PMP - Center Temporal Distribution (Basin 3)
Hyetograph
(Storm center at PR Y)

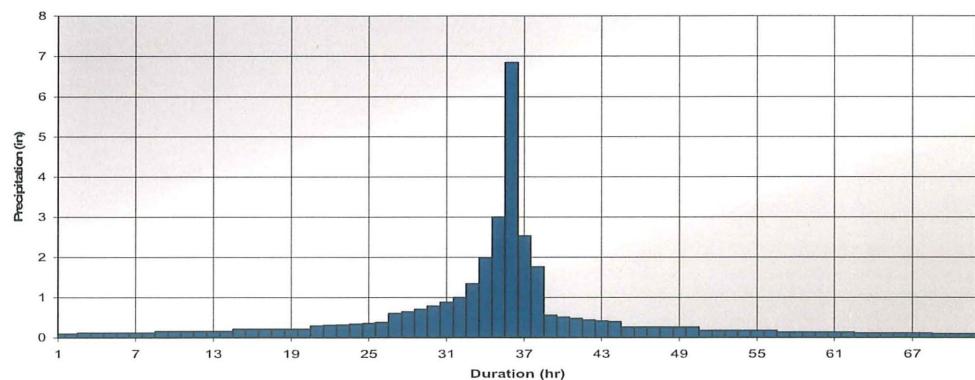


Figure 7-8. Center Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

E ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3- CALC-011
		REV. 2
		PAGE NO. 31 of 47

Table 7-21. Two-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1010	25	0.1550	49	2.5370
2	0.1010	26	0.1550	50	1.7680
3	0.1010	27	0.2120	51	0.5570
4	0.1010	28	0.2120	52	0.5120
5	0.1010	29	0.2120	53	0.4740
6	0.1010	30	0.2120	54	0.4420
7	0.1110	31	0.2120	55	0.4160
8	0.1110	32	0.2120	56	0.3960
9	0.1110	33	0.2970	57	0.2590
10	0.1110	34	0.3080	58	0.2590
11	0.1110	35	0.3220	59	0.2590
12	0.1110	36	0.3380	60	0.2590
13	0.1230	37	0.3570	61	0.2590
14	0.1230	38	0.3780	62	0.2590
15	0.1230	39	0.5990	63	0.1790
16	0.1230	40	0.6460	64	0.1790
17	0.1230	41	0.7090	65	0.1790
18	0.1230	42	0.7890	66	0.1790
19	0.1370	43	0.8860	67	0.1790
20	0.1370	44	0.9990	68	0.1790
21	0.1550	45	1.3420	69	0.1370
22	0.1550	46	1.9920	70	0.1370
23	0.1550	47	3.0050	71	0.1370
24	0.1550	48	6.8520	72	0.1370

Overall PMP - Two-Third Temporal Distribution (Basin 3)
Hyetograph
(Storm center at PR Y)

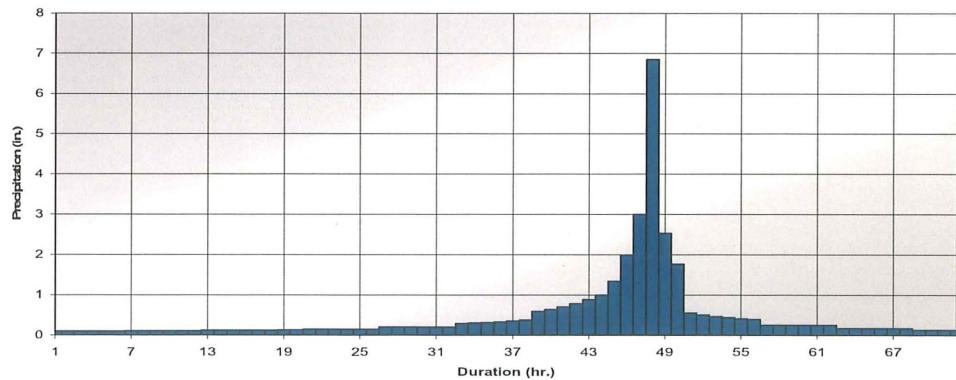


Figure 7-9. Two-Third Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 32 of 47

Table 7-22. End Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1010	25	0.1550	49	0.2970
2	0.1010	26	0.1550	50	0.3080
3	0.1010	27	0.1550	51	0.3220
4	0.1010	28	0.1550	52	0.3380
5	0.1010	29	0.1550	53	0.3570
6	0.1010	30	0.1550	54	0.3780
7	0.1110	31	0.1790	55	0.3960
8	0.1110	32	0.1790	56	0.4160
9	0.1110	33	0.1790	57	0.4420
10	0.1110	34	0.1790	58	0.4740
11	0.1110	35	0.1790	59	0.5120
12	0.1110	36	0.1790	60	0.5570
13	0.1230	37	0.2120	61	0.5990
14	0.1230	38	0.2120	62	0.6460
15	0.1230	39	0.2120	63	0.7090
16	0.1230	40	0.2120	64	0.7890
17	0.1230	41	0.2120	65	0.8860
18	0.1230	42	0.2120	66	0.9990
19	0.1370	43	0.2590	67	1.3420
20	0.1370	44	0.2590	68	1.7680
21	0.1370	45	0.2590	69	1.9920
22	0.1370	46	0.2590	70	2.5370
23	0.1370	47	0.2590	71	3.0050
24	0.1370	48	0.2590	72	6.8520

**Overall PMP - End Temporal Distribution (Basin 3)
Hyetograph
(Storm center at PR Y)**

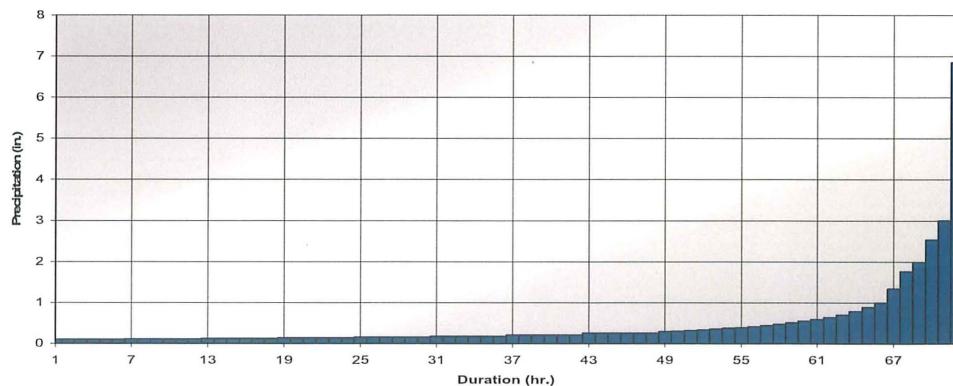


Figure 7-10. End Peaking Temporal Distribution (Basin 3) – Overall PMP with Storm Center at PR Y

E N E R C O N	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 33 of 47

Table 7-23. One-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	3.2050	49	0.1520
1	0.0990	26	2.2360	50	0.1520
2	0.0990	27	0.5760	51	0.1340
3	0.2070	28	0.5230	52	0.1340
4	0.2070	29	0.4780	53	0.1340
5	0.2070	30	0.4410	54	0.1340
6	0.2070	31	0.4130	55	0.1340
7	0.2070	32	0.3930	56	0.1340
8	0.2070	33	0.2530	57	0.1200
9	0.2900	34	0.2530	58	0.1200
10	0.3010	35	0.2530	59	0.1200
11	0.3140	36	0.2530	60	0.1200
12	0.3310	37	0.2530	61	0.1200
13	0.3510	38	0.2530	62	0.1200
14	0.3730	39	0.1750	63	0.1080
15	0.6300	40	0.1750	64	0.1080
16	0.6910	41	0.1750	65	0.1080
17	0.7720	42	0.1750	66	0.1080
18	0.8740	43	0.1750	67	0.1080
19	0.9960	44	0.1750	68	0.1080
20	1.1370	45	0.1750	69	0.0990
21	1.6270	46	0.1520	70	0.0990
22	2.5230	47	0.1520	71	0.0990
23	3.7160	48	0.1520	72	0.0990
24	7.7800	48			

Overall PMP - One-Third Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

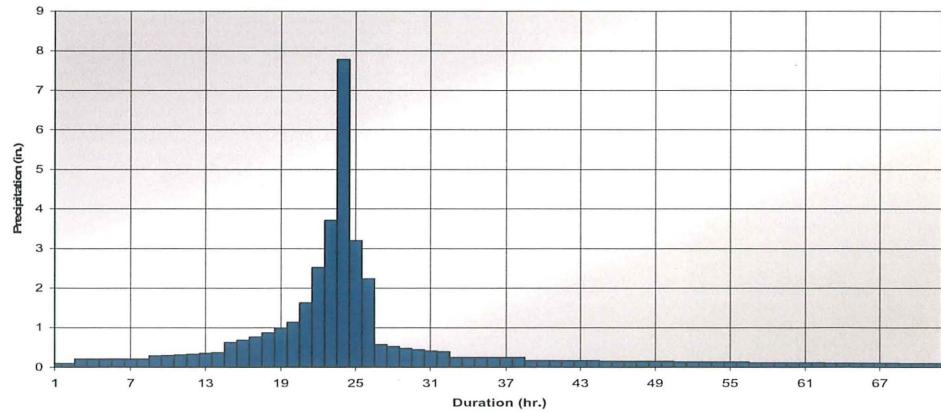


Figure 7-11. One-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Table 7-24. Center Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	0.3510	49	0.2530
2	0.0990	26	0.3730	50	0.2530
3	0.1200	27	0.6300	51	0.1750
4	0.1200	28	0.6910	52	0.1750
5	0.1200	29	0.7720	53	0.1750
6	0.1200	30	0.8740	54	0.1750
7	0.1200	31	0.9960	55	0.1750
8	0.1200	32	1.1370	56	0.1750
9	0.1520	33	1.6270	57	0.1340
10	0.1520	34	2.5230	58	0.1340
11	0.1520	35	3.7160	59	0.1340
12	0.1520	36	7.7800	60	0.1340
13	0.1520	37	3.2050	61	0.1340
14	0.1520	38	2.2360	62	0.1340
15	0.2070	39	0.5760	63	0.1080
16	0.2070	40	0.5230	64	0.1080
17	0.2070	41	0.4780	65	0.1080
18	0.2070	42	0.4410	66	0.1080
19	0.2070	43	0.4130	67	0.1080
20	0.2070	44	0.3930	68	0.1080
21	0.2900	45	0.2530	69	0.0990
22	0.3010	46	0.2530	70	0.0990
23	0.3140	47	0.2530	71	0.0990
24	0.3310	48	0.2530	72	0.0990

Overall PMP - Center Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

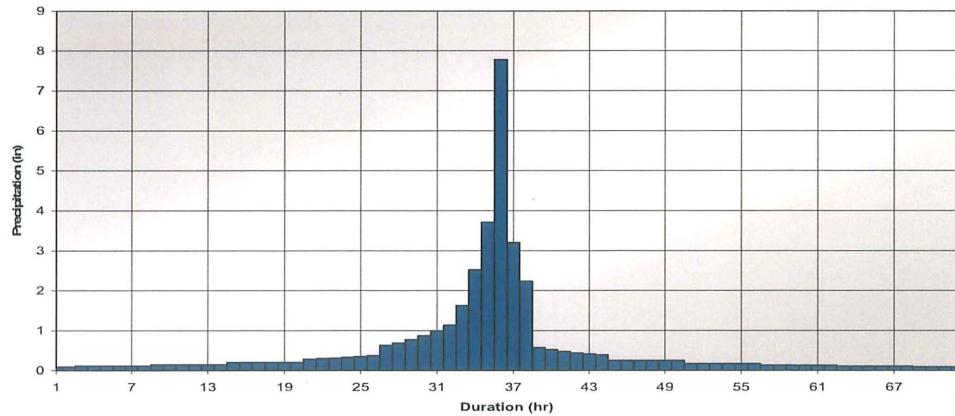


Figure 7-12. Center Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Table 7-25. Two-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	0.1520	49	3.2050
2	0.0990	26	0.1520	50	2.2360
3	0.0990	27	0.2070	51	0.5760
4	0.0990	28	0.2070	52	0.5230
5	0.0990	29	0.2070	53	0.4780
6	0.0990	30	0.2070	54	0.4410
7	0.1080	31	0.2070	55	0.4130
8	0.1080	32	0.2070	56	0.3930
9	0.1080	33	0.2900	57	0.2530
10	0.1080	34	0.3010	58	0.2530
11	0.1080	35	0.3140	59	0.2530
12	0.1080	36	0.3310	60	0.2530
13	0.1200	37	0.3510	61	0.2530
14	0.1200	38	0.3730	62	0.2530
15	0.1200	39	0.6300	63	0.1750
16	0.1200	40	0.6910	64	0.1750
17	0.1200	41	0.7720	65	0.1750
18	0.1200	42	0.8740	66	0.1750
19	0.1340	43	0.9960	67	0.1750
20	0.1340	44	1.1370	68	0.1750
21	0.1520	45	1.6270	69	0.1340
22	0.1520	46	2.5230	70	0.1340
23	0.1520	47	3.7160	71	0.1340
24	0.1520	48	7.7800	72	0.1340

Overall PMP - Two-Third Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

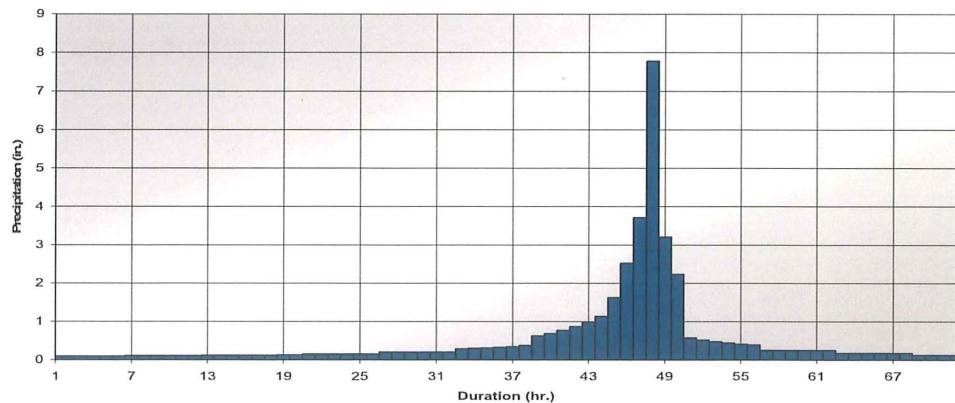


Figure 7-13. Two-Third Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

E ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 36 of 47

Table 7-26. End Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	0.1520	49	0.2900
1	0.0990	26	0.1520	50	0.3010
2	0.0990	27	0.1520	51	0.3140
3	0.0990	28	0.1520	52	0.3310
4	0.0990	29	0.1520	53	0.3510
5	0.0990	30	0.1520	54	0.3730
6	0.0990	31	0.1750	55	0.3930
7	0.1080	32	0.1750	56	0.4130
8	0.1080	33	0.1750	57	0.4410
9	0.1080	34	0.1750	58	0.4780
10	0.1080	35	0.1750	59	0.5230
11	0.1080	36	0.1750	60	0.5760
12	0.1080	37	0.2070	61	0.6300
13	0.1200	38	0.2070	62	0.6910
14	0.1200	39	0.2070	63	0.7720
15	0.1200	40	0.2070	64	0.8740
16	0.1200	41	0.2070	65	0.9960
17	0.1200	42	0.2070	66	1.1370
18	0.1200	43	0.2530	67	1.6270
19	0.1340	44	0.2530	68	2.2360
20	0.1340	45	0.2530	69	2.5230
21	0.1340	46	0.2530	70	3.2050
22	0.1340	47	0.2530	71	3.7160
23	0.1340	48	0.2530	72	7.7800

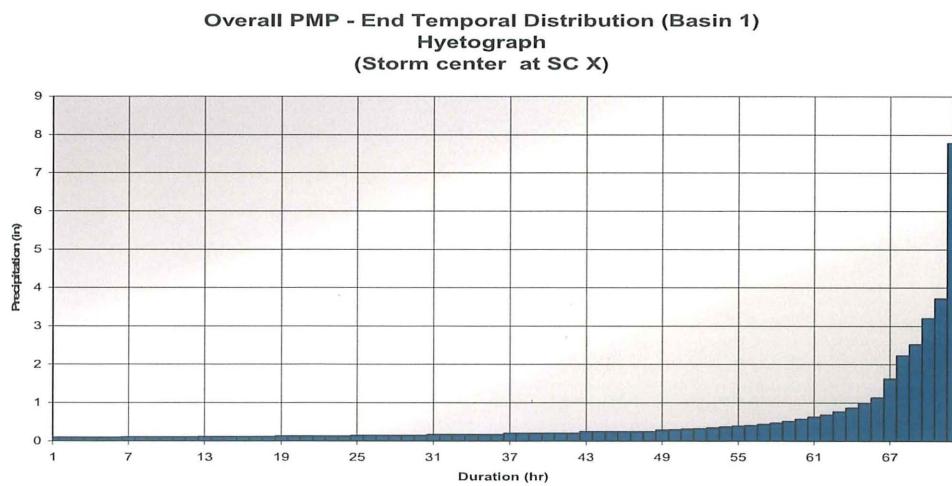


Figure 7-14. End Peaking Temporal Distribution (Basin 1) – Overall PMP with Storm Center at SC X

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 37 of 47

Table 7-27. One-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	2.6670	49	0.1520
2	0.0990	26	1.8890	50	0.1520
3	0.2070	27	0.5570	51	0.1340
4	0.2070	28	0.5090	52	0.1340
5	0.2070	29	0.4680	53	0.1340
6	0.2070	30	0.4350	54	0.1340
7	0.2070	31	0.4090	55	0.1340
8	0.2070	32	0.3900	56	0.1340
9	0.2900	33	0.2530	57	0.1200
10	0.3020	34	0.2530	58	0.1200
11	0.3150	35	0.2530	59	0.1200
12	0.3320	36	0.2530	60	0.1200
13	0.3500	37	0.2530	61	0.1200
14	0.3710	38	0.2530	62	0.1200
15	0.6040	39	0.1750	63	0.1080
16	0.6570	40	0.1750	64	0.1080
17	0.7270	41	0.1750	65	0.1080
18	0.8130	42	0.1750	66	0.1080
19	0.9160	43	0.1750	67	0.1080
20	1.0360	44	0.1750	68	0.1080
21	1.4170	45	0.1520	69	0.0990
22	2.1200	46	0.1520	70	0.0990
23	3.1010	47	0.1520	71	0.0990
24	6.4150	48	0.1520	72	0.0990

Overall PMP - One-Third Temporal Distribution (Basin 2)
Hyetograph
(Storm center at SC X)

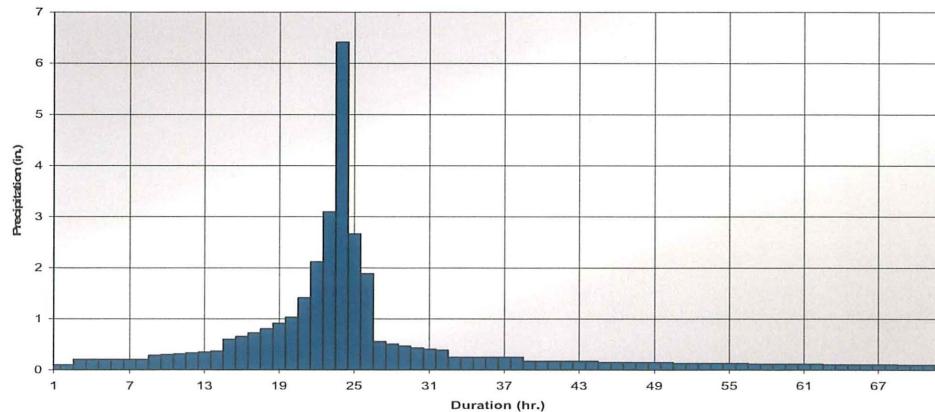


Figure 7-15. One-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

Table 7-28. Center Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	0.3500	49	0.2530
2	0.0990	26	0.3710	50	0.2530
3	0.1200	27	0.6040	51	0.1750
4	0.1200	28	0.6570	52	0.1750
5	0.1200	29	0.7270	53	0.1750
6	0.1200	30	0.8130	54	0.1750
7	0.1200	31	0.9160	55	0.1750
8	0.1200	32	1.0360	56	0.1750
9	0.1520	33	1.4170	57	0.1340
10	0.1520	34	2.1200	58	0.1340
11	0.1520	35	3.1010	59	0.1340
12	0.1520	36	6.4150	60	0.1340
13	0.1520	37	2.6670	61	0.1340
14	0.1520	38	1.8890	62	0.1340
15	0.2070	39	0.5570	63	0.1080
16	0.2070	40	0.5090	64	0.1080
17	0.2070	41	0.4680	65	0.1080
18	0.2070	42	0.4350	66	0.1080
19	0.2070	43	0.4090	67	0.1080
20	0.2070	44	0.3900	68	0.1080
21	0.2900	45	0.2530	69	0.0990
22	0.3020	46	0.2530	70	0.0990
23	0.3150	47	0.2530	71	0.0990
24	0.3320	48	0.2530	72	0.0990

Overall PMP - Center Temporal Distribution (Basin 2)
Hyetograph
(Storm center at SC X)

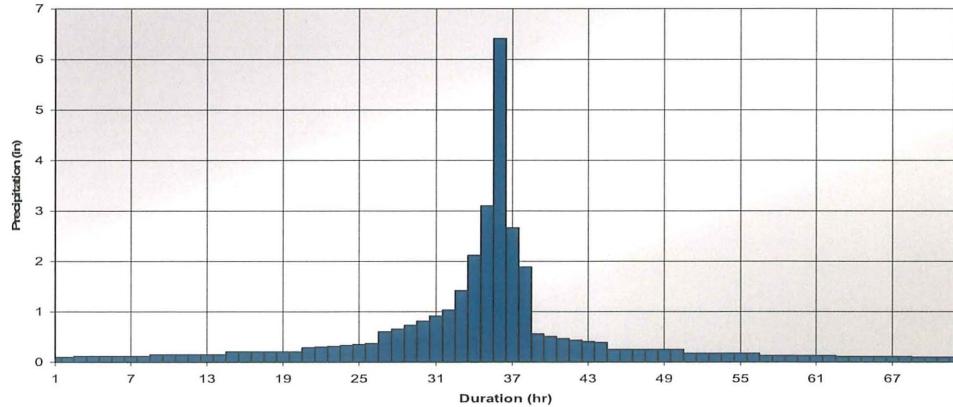


Figure 7-16. Center Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 39 of 47

Table 7-29. Two-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	0.1520	49	2.6670
2	0.0990	26	0.1520	50	1.8890
3	0.0990	27	0.2070	51	0.5570
4	0.0990	28	0.2070	52	0.5090
5	0.0990	29	0.2070	53	0.4680
6	0.0990	30	0.2070	54	0.4350
7	0.1080	31	0.2070	55	0.4090
8	0.1080	32	0.2070	56	0.3900
9	0.1080	33	0.2900	57	0.2530
10	0.1080	34	0.3020	58	0.2530
11	0.1080	35	0.3150	59	0.2530
12	0.1080	36	0.3320	60	0.2530
13	0.1200	37	0.3500	61	0.2530
14	0.1200	38	0.3710	62	0.2530
15	0.1200	39	0.6040	63	0.1750
16	0.1200	40	0.6570	64	0.1750
17	0.1200	41	0.7270	65	0.1750
18	0.1200	42	0.8130	66	0.1750
19	0.1340	43	0.9160	67	0.1750
20	0.1340	44	1.0360	68	0.1750
21	0.1520	45	1.4170	69	0.1340
22	0.1520	46	2.1200	70	0.1340
23	0.1520	47	3.1010	71	0.1340
24	0.1520	48	6.4150	72	0.1340

**Overall PMP - Two-Third Temporal Distribution (Basin 2)
Hyetograph
(Storm center at SC X)**

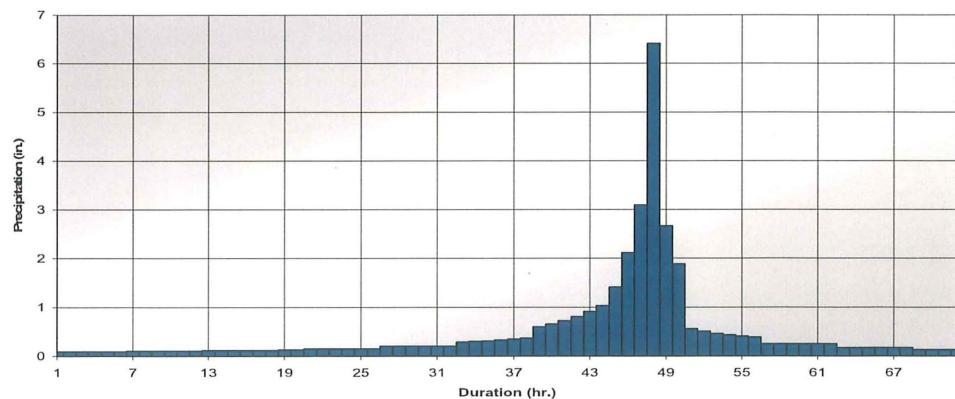


Figure 7-17. Two-Third Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 40 of 47

Table 7-30. End Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.0990	25	0.1520	49	0.2900
2	0.0990	26	0.1520	50	0.3020
3	0.0990	27	0.1520	51	0.3150
4	0.0990	28	0.1520	52	0.3320
5	0.0990	29	0.1520	53	0.3500
6	0.0990	30	0.1520	54	0.3710
7	0.1080	31	0.1750	55	0.3900
8	0.1080	32	0.1750	56	0.4090
9	0.1080	33	0.1750	57	0.4350
10	0.1080	34	0.1750	58	0.4680
11	0.1080	35	0.1750	59	0.5090
12	0.1080	36	0.1750	60	0.5570
13	0.1200	37	0.2070	61	0.6040
14	0.1200	38	0.2070	62	0.6570
15	0.1200	39	0.2070	63	0.7270
16	0.1200	40	0.2070	64	0.8130
17	0.1200	41	0.2070	65	0.9160
18	0.1200	42	0.2070	66	1.0360
19	0.1340	43	0.2530	67	1.4170
20	0.1340	44	0.2530	68	1.8890
21	0.1340	45	0.2530	69	2.1200
22	0.1340	46	0.2530	70	2.6670
23	0.1340	47	0.2530	71	3.1010
24	0.1340	48	0.2530	72	6.4150

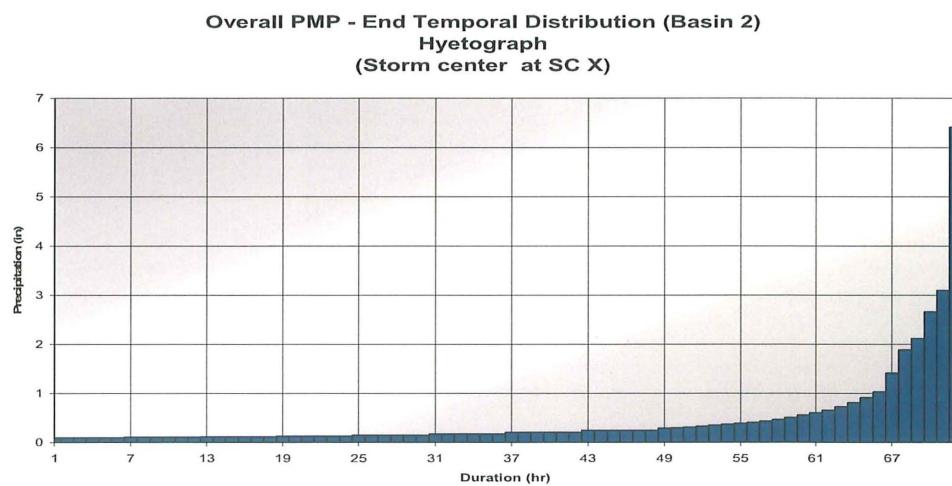


Figure 7-18. End Peaking Temporal Distribution (Basin 2) – Overall PMP with Storm Center at SC X

 ENERCON	CALCULATION CONTROL SHEET	TXUT-001-FSAR 2.4.3-CALC-011
		REV. 2
		PAGE NO. 41 of 47

Table 7-31. One-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	25	3.1160	49	0.1560
1	0.1010	26	2.0310	50	0.1560
2	0.1010	27	0.5800	51	0.1370
3	0.2130	28	0.5280	52	0.1370
4	0.2130	29	0.4850	53	0.1370
5	0.2130	30	0.4500	54	0.1370
6	0.2130	31	0.4220	55	0.1370
7	0.2130	32	0.4020	56	0.1370
8	0.2130	33	0.2610	57	0.1230
9	0.2990	34	0.2610	58	0.1230
10	0.3110	35	0.2610	59	0.1230
11	0.3250	36	0.2610	60	0.1230
12	0.3420	37	0.2610	61	0.1230
13	0.3610	38	0.2610	62	0.1230
14	0.3830	39	0.1800	63	0.1110
15	0.6310	40	0.1800	64	0.1110
16	0.6890	41	0.1800	65	0.1110
17	0.7640	42	0.1800	66	0.1110
18	0.8580	43	0.1800	67	0.1110
19	0.9700	44	0.1800	68	0.1110
20	1.1000	45	0.1560	69	0.1010
21	1.5070	46	0.1560	70	0.1010
22	2.3290	47	0.1560	71	0.1010
23	3.8410	48	0.1560	72	0.1010
24	12.1100	48	0.1560	72	0.1010

**Squaw Creek Reservoir PMP - One-Third Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)**

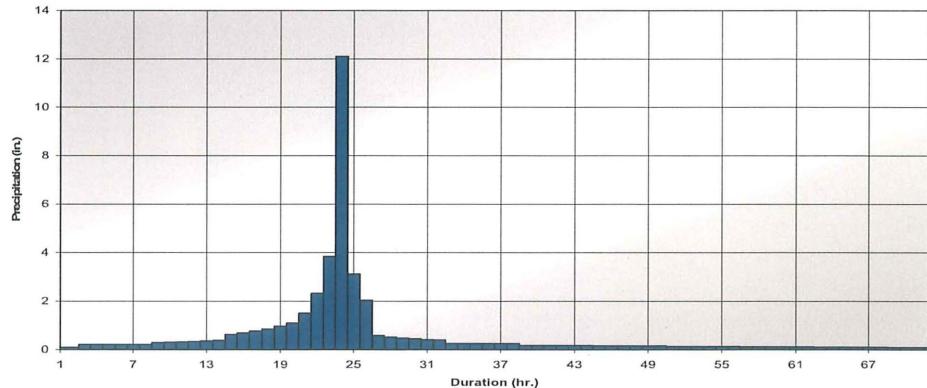


Figure 7-19. One-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Table 7-32. Center Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1010	25	0.3610	49	0.2610
2	0.1010	26	0.3830	50	0.2610
3	0.1230	27	0.6310	51	0.1800
4	0.1230	28	0.6890	52	0.1800
5	0.1230	29	0.7640	53	0.1800
6	0.1230	30	0.8580	54	0.1800
7	0.1230	31	0.9700	55	0.1800
8	0.1230	32	1.1000	56	0.1800
9	0.1560	33	1.5070	57	0.1370
10	0.1560	34	2.3290	58	0.1370
11	0.1560	35	3.8410	59	0.1370
12	0.1560	36	12.1100	60	0.1370
13	0.1560	37	3.1160	61	0.1370
14	0.1560	38	2.0310	62	0.1370
15	0.2130	39	0.5800	63	0.1110
16	0.2130	40	0.5280	64	0.1110
17	0.2130	41	0.4850	65	0.1110
18	0.2130	42	0.4500	66	0.1110
19	0.2130	43	0.4220	67	0.1110
20	0.2130	44	0.4020	68	0.1110
21	0.2990	45	0.2610	69	0.1010
22	0.3110	46	0.2610	70	0.1010
23	0.3250	47	0.2610	71	0.1010
24	0.3420	48	0.2610	72	0.1010

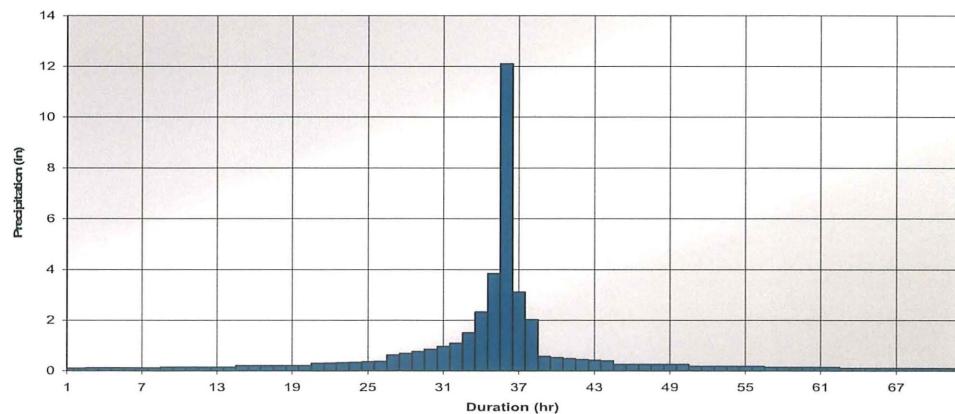
Squaw Creek Reservoir PMP - Center Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

Figure 7-20. Center Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Table 7-33. Two-Third Peaking Temporal Distribution – Squaw Creek Reservoir PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0				
1	0.1010	25	0.1560	49	3.1160
2	0.1010	26	0.1560	50	2.0310
3	0.1010	27	0.2130	51	0.5800
4	0.1010	28	0.2130	52	0.5280
5	0.1010	29	0.2130	53	0.4850
6	0.1010	30	0.2130	54	0.4500
7	0.1110	31	0.2130	55	0.4220
8	0.1110	32	0.2130	56	0.4020
9	0.1110	33	0.2990	57	0.2610
10	0.1110	34	0.3110	58	0.2610
11	0.1110	35	0.3250	59	0.2610
12	0.1110	36	0.3420	60	0.2610
13	0.1230	37	0.3610	61	0.2610
14	0.1230	38	0.3830	62	0.2610
15	0.1230	39	0.6310	63	0.1800
16	0.1230	40	0.6890	64	0.1800
17	0.1230	41	0.7640	65	0.1800
18	0.1230	42	0.8580	66	0.1800
19	0.1370	43	0.9700	67	0.1800
20	0.1370	44	1.1000	68	0.1800
21	0.1560	45	1.5070	69	0.1370
22	0.1560	46	2.3290	70	0.1370
23	0.1560	47	3.8410	71	0.1370
24	0.1560	48	12.1100	72	0.1370

Squaw Creek Reservoir PMP - Two-Third Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

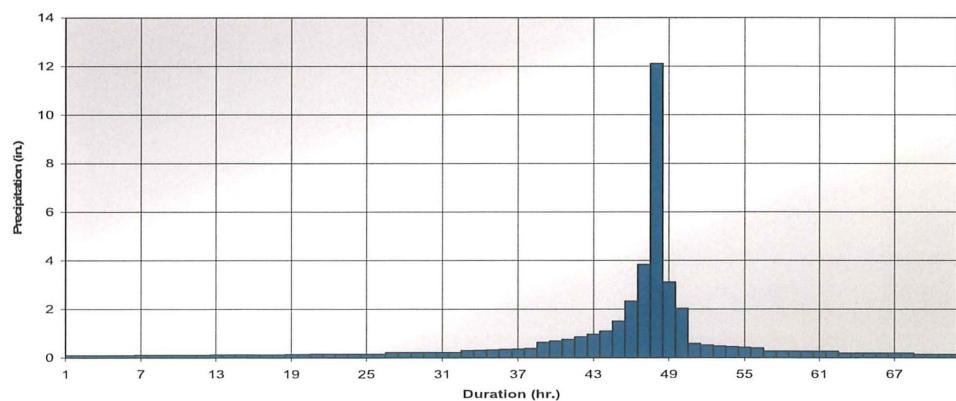


Figure 7-21. Two-Third Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Table 7-34. End Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)	Duration (hr.)	Incremental Depth (in.)
0	0	0	0	0	0
1	0.1010	25	0.1560	49	0.2990
2	0.1010	26	0.1560	50	0.3110
3	0.1010	27	0.1560	51	0.3250
4	0.1010	28	0.1560	52	0.3420
5	0.1010	29	0.1560	53	0.3610
6	0.1010	30	0.1560	54	0.3830
7	0.1110	31	0.1800	55	0.4020
8	0.1110	32	0.1800	56	0.4220
9	0.1110	33	0.1800	57	0.4500
10	0.1110	34	0.1800	58	0.4850
11	0.1110	35	0.1800	59	0.5280
12	0.1110	36	0.1800	60	0.5800
13	0.1230	37	0.2130	61	0.6310
14	0.1230	38	0.2130	62	0.6890
15	0.1230	39	0.2130	63	0.7640
16	0.1230	40	0.2130	64	0.8580
17	0.1230	41	0.2130	65	0.9700
18	0.1230	42	0.2130	66	1.1000
19	0.1370	43	0.2610	67	1.5070
20	0.1370	44	0.2610	68	2.0310
21	0.1370	45	0.2610	69	2.3290
22	0.1370	46	0.2610	70	3.1160
23	0.1370	47	0.2610	71	3.8410
24	0.1370	48	0.2610	72	12.1100

Squaw Creek Reservoir PMP - End Temporal Distribution (Basin 1)
Hyetograph
(Storm center at SC X)

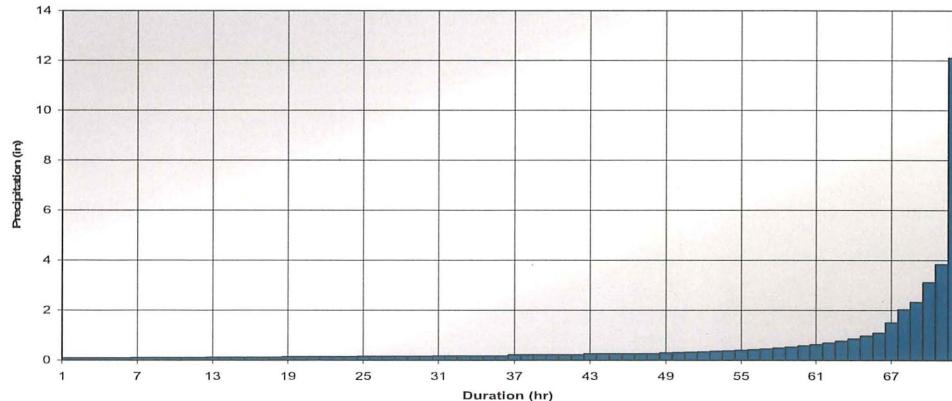


Figure 7-22. End Peaking Temporal Distribution (Basin 1) – Squaw Creek Reservoir PMP with Storm Center at SC X

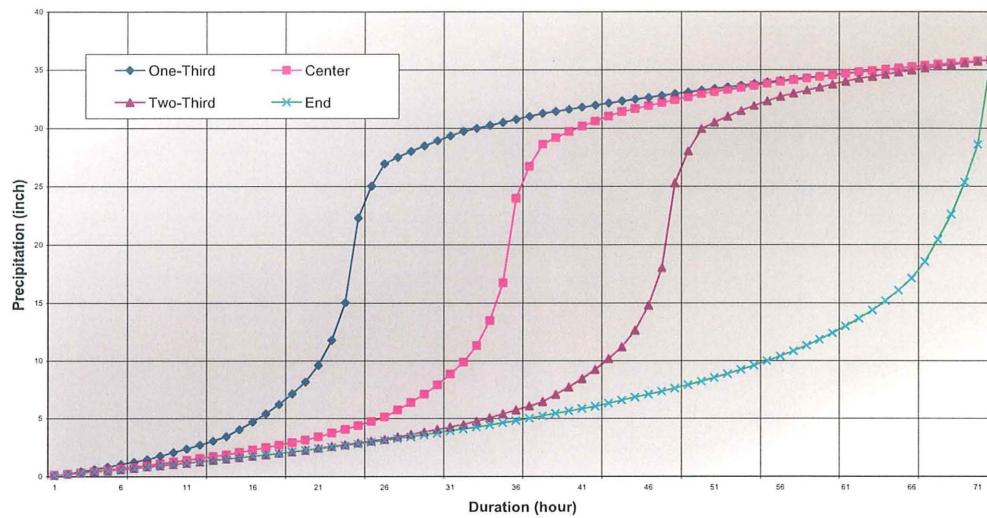
**Mass Curves for Overall PMP (Basin 4)
with Storm Center at PR Y**

Figure 7-23. Mass Curves for Overall PMP with Storm Center at PR Y (Basin 4)

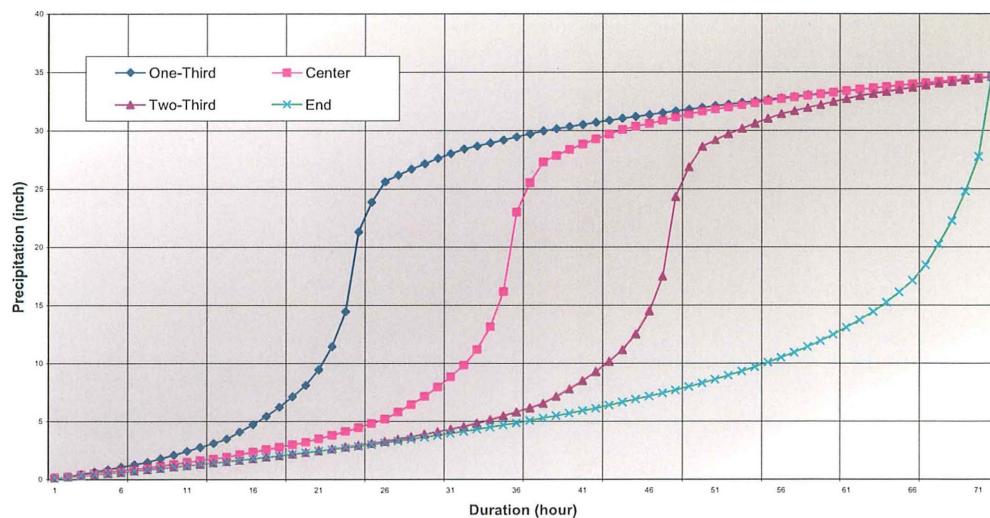
**Mass Curves for Overall PMP (Basin 3)
with Storm Center at PR Y**

Figure 7-24. Mass Curves for Overall PMP with Storm Center at PR Y (Basin 3)

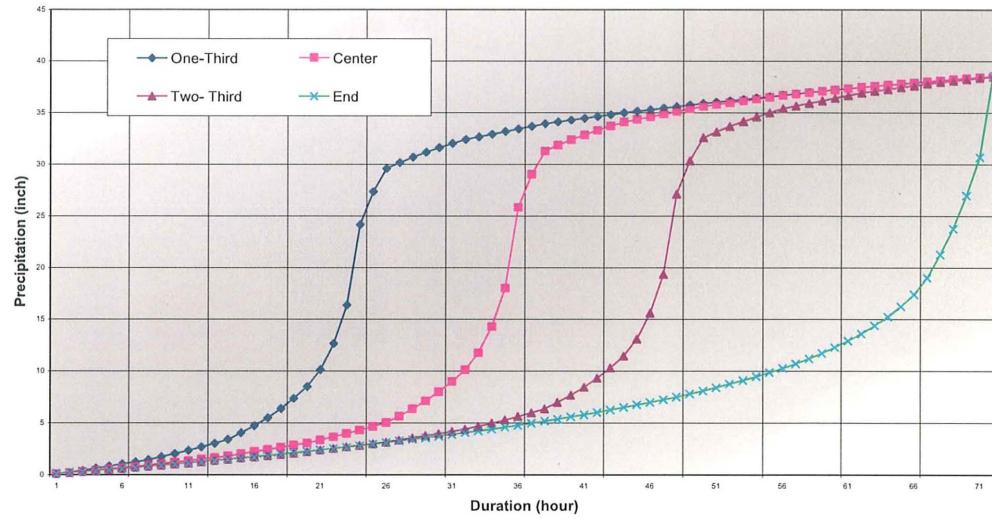
**Mass Curves for Overall PMP (Basin 1)
with Storm Center at SC X**

Figure 7-25. Mass Curves for Overall PMP with Storm Center at SC X (Basin 1)

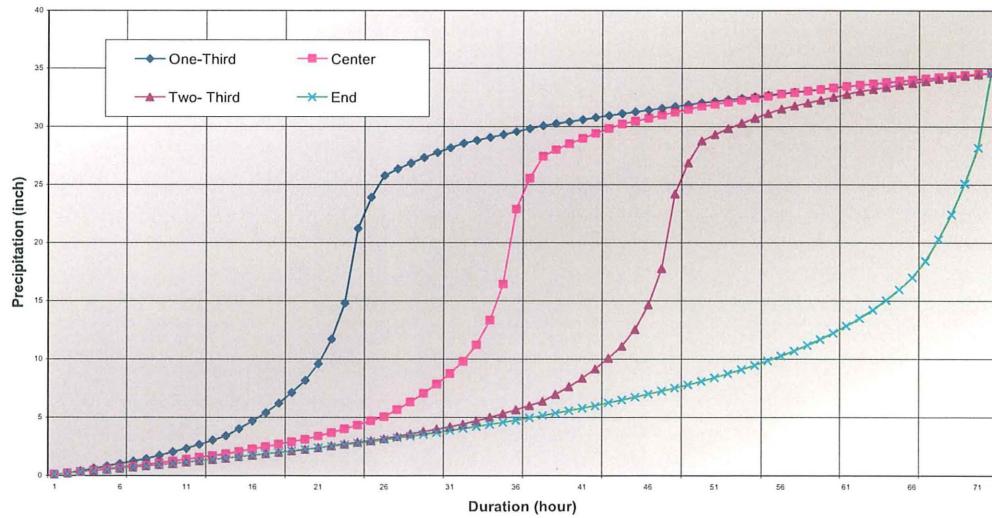
**Mass Curves for Overall PMP (Basin 2)
with Storm Center at SC X**

Figure 7-26. Mass Curves for Overall PMP with Storm Center at SC X (Basin 2)

Mass Curves for Squaw Creek Reservoir PMP (Basin 1)
with Storm Center at SC X

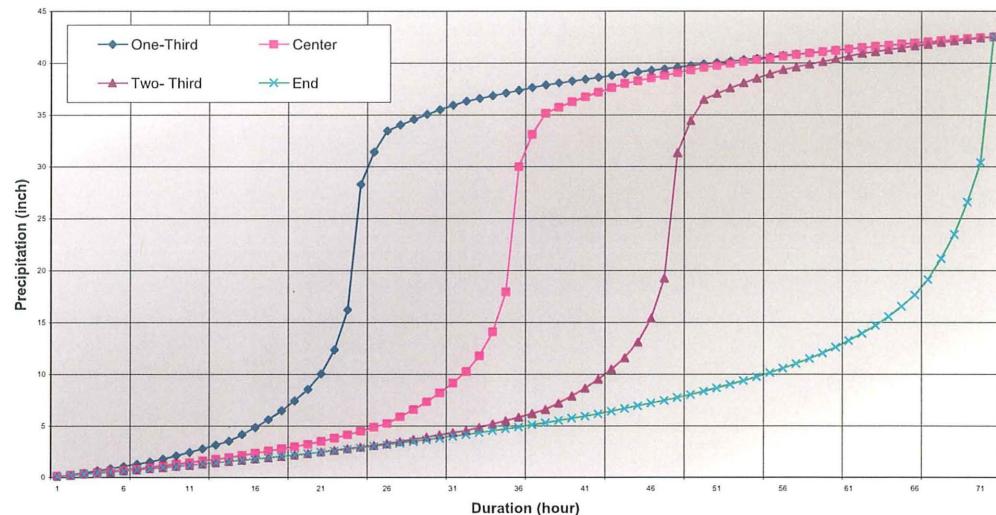


Figure 7-27. Mass Curves for the Squaw Creek Reservoir PMP with Storm Center at SC X (Basin 1)

8.0 Appendices

Appendix A contains the resulting HMR 52 software output file. The output file also includes the input data.

SC 1.OUT

```

1*****  

*  

* PROBABLE MAXIMUM STORM (HMR52) *  

* NOVEMBER 1982 *  

* REVISED APRIL 91 *  

*  

* RUN DATE 08/10/2009 TIME 15:05:57 *  

*  

*****
```

```

H H M M RRRRRR 5555555 22222  

H H MM MM R R 5 2 2  

H H M M M M R R 5 2  

HHHHHHH M M M RRRRRR 555555 2  

H H M M R R 5 5 2  

H H M M R R 5 5 2  

H H M M R R 5 5 2  

H H M M R R 5 5 2  

HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA
```

1

PAGE 1

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
1	ID HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
2	ID ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
3	ID STORM CENTER WITHIN SQUAW CREEK BASIN AT SCL

4	BN CPNPP
5	ID CALCULATE STORM OVER ENTIRE AREA
6	BS .05827
7	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
8	BX 317.41 315.60 306.50 302.11 295.40 289.69 284.22 279.71 267.30
9	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 85.17
10	BX 76.93 85.92 75.56 77.81 82.63 84.8 66.09 56.79 57.55 49.52
11	BX 51.04 40.8 40.05 54.76 65.82 47.95 62.30 35.02 36.56 63.69
12	BX 73.84 72.72 84.03 121.92 126.58 133.09 136.39 145.99 138.58 143.21
13	BX 127.17 137.74 151.01 157.40 164.07 168.68 175.89 172.76 198.29 200.78
14	BX 217.93 233.49 243.97 277.06 294.55 315.41 331.83 340.98 349.67 353.27
15	BX 349.84 354.39 367.19 367.42 386.16 392.28 377.46 398.65 380.84 385.89
16	BX 375.51 379.9 370.35 371.38 365.4 356.46 349.53 353.98 353.13 356.42
17	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
18	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
19	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 547.94
20	BY 530.64 505.2 501.21 486.11 484.73 480.07 460.51 459.91 445.42 431.26
21	BY 423.96 416.89 406.78 378.07 347.05 304.18 290.43 242.80 238.08 238.71
22	BY 233.34 225.26 226.56 215.42 225.3 225.3 213.74 213.23 195.37 187.2
23	BY 150.2 138.83 120.25 124.31 115.41 94.86 88.63 82.92 85.08 92.18
24	BY 92.91 104.32 104.64 101.45 114.21 121.11 122.14 112.91 115.82 123.27
25	BY 135.16 137.78 172.22 181.89 198.56 228.19 249.82 273.83 307.02 320.85
26	BY 358.76 370.7 385.48 393.09 396.82 395.52 405.43 411.9 420.9 429.53
27	HO 215
28	HP 10 29.7 35.3 40.0 45.0 48.0
29	HP 200 22.2 26.8 32.0 36.0 39.6
30	HP 1000 15.9 20.7 25.8 30.0 33.4
31	HP 5000 9.3 13.0 17.8 22.0 25.0
32	HP 10000 7.1 10.3 14.4 18.5 21.0
33	HP 20000 5.1 8.3 11.5 15.0 17.8
34	SA 0 0 3
35	SC 328 196
36	ST 60 0.308 0 1
37	PU ON
38	BN BASIN4
39	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
40	BX 317.41 315.60 306.50 302.11 295.40 289.69 284.22 279.71 267.30
41	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 87.35
42	BX 81.49 85.17 76.93 85.92 75.56 77.81 82.63 84.8 70.55 66.09
43	BX 56.79 57.55 49.52 51.04 40.8 40.05 54.76 61.58 65.82 47.95
44	BX 62.30 35.02 36.56 46.93 55.09 63.69 73.84 72.72 84.03 92.24
45	BX 97.83 121.92 126.58 133.09 136.39 145.99 138.58 143.21 127.17 137.74
46	BX 139.10 151.01 157.40 164.07 200.07 219.86 230.63 240.75 246.73 251.89
47	BX 260.06 275.37 281.37 285.03 291.7 296.69 298.06 288.52 305.69
48	BY 294.79 330.09
49	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
50	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
51	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 567.83
52	BY 554.59 547.94 530.64 505.2 501.21 486.11 484.73 480.07 471.39 460.51
53	BY 459.91 445.42 431.26 423.96 416.89 406.78 378.07 377.45 347.05 304.18

1

PAGE 2

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
54	BY 290.43 242.80 238.08 239.96 236.18 238.71 233.34 225.26 226.56 224.02
55	BY 224.87 215.42 225.3 225.3 213.74 213.23 195.37 187.2 150.2 138.83
56	BY 127.7 120.25 124.31 115.41 125.34 135.17 153.31 156.62 153.56 154.76
57	BY 154.76 160.46 167.45 177.77 188.09 192.59 200.58 211.24 244 264.84
58	BY 331.2 425.42
59	BN BASIN3
60	ID SUBBASIN3
61	BX 296.69 291.69 285.04 281.37 281.37 275.37 260.06 251.89 246.63 240.75
62	BX 230.63 225.36 219.86 200.07 164.07 168.68 175.89 172.76 198.29 200.78
63	BX 217.93 233.49 243.97 247.19 253.98 261.76 272.19 277.06 287.20 290.72
64	BX 294.55 306.52 308.51 303.88 308.46 307.93 308.87
65	BX 200.58 192.59 188.09 177.77 167.45 160.46 154.76 154.76 153.56 156.62
66	BX 153.31 145.58 135.17 125.34 115.41 94.86 88.63 82.92 85.08 92.18
67	BX 92.91 104.32 104.64 101.71 106.79 105.33 107.43 101.45 107.36 107.36
68	BY 114.21 114.52 116.39 128.54 141.75 169.52 181.13
69	BN BASIN2
70	ID SUBBASIN2
71	BX 367.42 364.98 356.16 322.02 318.79 308.87 307.93 308.46 303.88 308.51
72	BX 315.41 331.83 340.98 349.67 353.27 349.84 354.39 357.02 364.94 364.65
73	BX 367.19

Page 1

SC 1.OUT

74	BY	181.89	179.72	177	180.58	183.71	181.13	169.52	141.75	128.54	116.39
75	BY	121.11	122.14	122.91	115.82	123.27	135.16	137.78	149	163.23	170.54
76	BY	172.22									

77	BN	BASIN1									
78	ID	SUBBASIN1									
79	BX	352.79	330.08	309.24	294.79	305.63	288.78	298.06	296.58	308.64	318.8
80	BX	322.02	356.16	364.98	366.54	386.16	392.28	377.46	398.65	380.84	385.89
81	BX	375.51	379.9	370.35	371.38	365.4	356.46	349.53	353.98	353.13	356.42
82	BX	352.83									
83	BY	439.49	425.42	374.54	331.2	266.57	244.31	211.25	200.39	181.51	185.02
84	BY	180.91	177	179.72	181.01	198.56	228.19	249.82	273.83	307.02	320.85
85	BY	358.76	370.7	385.48	393.09	396.82	395.52	405.43	411.9	420.9	429.53
86	BY	441.22									

87	ZZ										
----	----	--	--	--	--	--	--	--	--	--	--

 *

* PROBABLE MAXIMUM STORM (HMR52) *

* NOVEMBER 1982 *

* REVISED APRIL 91 *

* RUN DATE 08/10/2009 TIME 15:05:57 *

 *

***** U.S. ARMY CORPS OF ENGINEERS *****

* THE HYDROLOGIC ENGINEERING CENTER *

* 609 SECOND STREET *

* DAVIS, CALIFORNIA 95616 *

* (916) 551-1748 OR (FTS) 460-1748 *

HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
 ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
 STORM CENTER WITHIN SQUAW CREEK BASIN AT SC1
 CALCULATE STORM OVER ENTIRE AREA

PMP DEPTHS FROM HMR 51

AREA (SQ. MI.)	DURATION						PMP DEPTHS FOR 6-HOUR INCREMENTS							
	6-HR	12-HR	24-HR	48-HR	72-HR		1.59	1.29	1.09	.94	.83	.74	.67	.61
10.	29.70	35.30	40.00	45.00	48.00									
200.	22.20	26.80	32.00	36.00	39.60									
1000.	15.90	20.70	25.80	30.00	33.40									
5000.	9.30	13.00	17.80	22.00	25.00									
10000.	7.10	10.30	14.40	18.50	21.00									
20000.	5.10	8.30	11.50	15.00	17.80									

STORM AREA	PMP DEPTHS FOR 6-HOUR INCREMENTS											
10.	29.67	5.40	2.99	2.08	1.59	1.29	1.09	.94	.83	.74	.67	.61
25.	27.92	5.22	2.95	2.06	1.59	1.29	1.09	.94	.83	.74	.67	.61
50.	26.45	5.09	2.91	2.05	1.58	1.29	1.09	.94	.83	.74	.67	.61
100.	24.29	4.91	2.86	2.02	1.57	1.28	1.08	.94	.82	.74	.67	.61
175.	22.55	4.75	2.81	2.00	1.56	1.28	1.08	.94	.83	.74	.67	.61
300.	20.55	4.76	2.81	2.00	1.55	1.27	1.08	.93	.82	.74	.67	.61
450.	18.97	4.79	2.82	2.00	1.56	1.27	1.08	.93	.82	.74	.67	.61
700.	17.24	4.83	2.83	2.00	1.56	1.27	1.07	.93	.82	.73	.66	.61
1000.	15.84	4.88	2.83	2.01	1.55	1.27	1.07	.93	.82	.73	.66	.60
1500.	14.17	4.63	2.76	1.97	1.53	1.26	1.06	.92	.81	.73	.66	.60
2150.	12.69	4.41	2.69	1.94	1.52	1.25	1.06	.92	.81	.73	.66	.60
3000.	11.31	4.23	2.62	1.91	1.50	1.23	1.05	.91	.81	.72	.66	.60
4500.	9.64	4.00	2.54	1.87	1.48	1.22	1.04	.91	.81	.72	.66	.60
6500.	8.38	3.73	2.41	1.78	1.42	1.18	1.00	.88	.78	.70	.63	.58
10000.	7.02	3.38	2.22	1.66	1.33	1.10	.95	.83	.74	.66	.60	.55
15000.	5.93	3.11	2.07	1.55	1.24	1.04	.89	.78	.69	.62	.57	.52
20000.	5.15	2.92	1.96	1.48	1.19	.99	.85	.75	.66	.60	.54	.50

1

	BOUNDARY	COORDINATES	FOR	CPNPP								
X	352.8	348.3	349.1	345.0	347.4	339.3	323.6	325.8	317.6	314.8		
Y	441.5	481.9	512.5	515.5	523.6	523.4	550.2	562.8	565.8	571.4		
X	317.4	315.6	306.5	302.1	295.4	295.4	289.7	284.2	279.7	267.3		
Y	574.4	579.2	582.4	600.0	600.5	612.0	617.3	640.0	644.0	640.7		
X	258.7	236.4	227.0	214.0	161.3	123.5	111.3	96.2	102.6	85.2		
Y	651.3	648.7	677.8	665.0	685.3	676.9	664.0	593.1	588.7	547.9		
X	76.9	85.9	75.6	77.8	82.6	84.8	66.1	56.8	57.5	49.5		
Y	530.6	505.2	501.2	486.1	484.7	480.1	460.5	459.9	445.4	431.3		
X	51.0	40.8	40.0	54.8	65.8	48.0	62.3	35.0	36.6	63.7		
Y	424.0	416.9	406.8	378.1	347.0	304.2	290.4	242.8	238.1	238.7		
X	73.8	72.7	84.0	121.9	126.6	133.1	136.4	146.0	138.6	143.2		
Y	233.3	225.3	226.6	215.4	225.3	213.7	213.2	195.4	187.2			
X	127.2	137.7	151.0	157.4	164.1	168.7	175.9	172.8	198.3	200.8		
Y	150.2	138.8	120.3	124.3	115.4	94.9	88.6	82.9	85.1	92.2		
X	217.9	233.5	244.0	277.1	294.5	315.4	331.8	341.0	349.7	353.3		
Y	92.9	104.3	104.6	101.4	114.2	121.1	122.1	112.9	115.8	123.3		
X	349.8	354.4	367.2	367.4	386.2	392.3	377.5	398.6	380.8	385.9		
Y	135.2	137.8	172.2	181.9	198.6	228.2	249.8	273.8	307.0	320.9		
X	375.5	379.9	370.4	371.4	365.4	356.5	349.5	354.0	353.1	356.4		
Y	358.8	370.7	385.5	393.1	396.8	395.5	405.4	411.9	420.9	429.5		

SCALE = .0583 MILES PER COORDINATE UNIT

SC 1.OUT

BASIN AREA = 509.4 SQ. MI.

BASIN CENTROID COORDINATES, X = 217.6, Y = 375.6

1

VARYING STORM AREA SIZE AND FIXED ORIENTATION

STORM AREA	ORIEN-	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS
	TATION	1.73	.51	.39	.32	.27	.23	.20	.18	.16	.15	9.26
10.	154.	7.20	1.33	.73	.51	.39	.32	.27	.23	.20	.18	.15
25.	154.	9.60	2.02	1.17	.82	.63	.51	.43	.37	.33	.29	.27
50.	154.	11.28	2.54	1.51	1.06	.82	.67	.56	.49	.43	.38	.35
100.	154.	12.64	3.01	1.82	1.29	1.00	.82	.69	.60	.53	.47	.43
175.	154.	13.73	3.36	2.07	1.47	1.15	.94	.79	.69	.61	.54	.49
300.	154.	14.64	3.82	2.34	1.67	1.30	1.06	.90	.78	.69	.61	.56
450.	154.	15.28	4.16	2.52	1.79	1.39	1.14	.96	.83	.74	.66	.60
700.	154.	15.53	4.49	2.67	1.89	1.47	1.20	1.01	.88	.78	.69	.63
1000.	154.	15.32	4.68	2.73	1.92	1.49	1.23	1.03	.89	.79	.70	.64
1500.	154.	14.55	4.46	2.62	1.86	1.45	1.19	1.01	.87	.77	.69	.62
2150.	154.	13.61	4.18	2.48	1.77	1.39	1.14	.97	.84	.74	.67	.60
3000.	154.	12.56	3.90	2.33	1.67	1.31	1.08	.92	.80	.71	.63	.58
4500.	154.	11.85	3.74	2.26	1.64	1.29	1.07	.91	.80	.71	.63	.57
6500.	154.	11.35	3.53	2.15	1.56	1.24	1.03	.88	.77	.68	.61	.56
10000.	154.	10.62	3.25	1.99	1.45	1.16	.97	.83	.72	.64	.58	.53
15000.	154.	9.93	3.05	1.86	1.36	1.09	.91	.78	.68	.61	.55	.50
20000.	154.	9.27	2.89	1.77	1.29	1.04	.87	.75	.65	.58	.52	.48

FIXED STORM AREA SIZE AND VARYING ORIENTATION

STORM AREA	ORIEN-	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS	
	TATION	14.81	4.56	2.66	1.87	1.45	1.18	1.00	.87	.76	.68	.62	.56
1000.	140.	14.81	4.56	2.66	1.87	1.45	1.18	1.00	.87	.76	.68	.62	.56
1000.	150.	15.19	4.64	2.71	1.91	1.48	1.21	1.02	.88	.78	.70	.63	.57
1000.	160.	15.41	4.72	2.75	1.94	1.50	1.23	1.04	.90	.79	.71	.64	.58
1000.	170.	15.24	4.71	2.75	1.94	1.50	1.23	1.04	.90	.79	.71	.64	.59
1000.	180.	14.59	4.59	2.69	1.90	1.47	1.20	1.01	.88	.77	.69	.63	.57
1000.	190.	13.69	4.39	2.58	1.82	1.41	1.15	.97	.84	.74	.66	.60	.55
1000.	200.	12.84	4.19	2.47	1.74	1.35	1.10	.93	.81	.71	.64	.58	.52
1000.	210.	12.18	4.02	2.38	1.68	1.30	1.06	.90	.78	.68	.61	.55	.50
1000.	220.	11.72	3.89	2.31	1.63	1.26	1.03	.87	.75	.66	.59	.54	.49
1000.	230.	11.48	3.82	2.27	1.60	1.24	1.01	.85	.74	.65	.58	.53	.48
1000.	240.	11.43	3.79	2.25	1.58	1.23	1.00	.85	.73	.65	.58	.52	.48
1000.	250.	11.54	3.81	2.26	1.59	1.23	1.01	.85	.74	.65	.58	.52	.48
1000.	260.	11.72	3.83	2.27	1.60	1.24	1.01	.85	.74	.65	.58	.53	.48
1000.	270.	11.93	3.87	2.28	1.61	1.25	1.02	.86	.74	.66	.59	.53	.48
1000.	280.	12.25	3.93	2.31	1.63	1.26	1.03	.87	.75	.66	.59	.54	.49
1000.	290.	12.87	4.09	2.40	1.69	1.31	1.07	.90	.78	.69	.62	.56	.51
1000.	300.	13.52	4.24	2.48	1.75	1.36	1.11	.93	.81	.71	.64	.58	.53
1000.	310.	14.21	4.41	2.58	1.82	1.41	1.15	.97	.84	.74	.66	.60	.55
1000.	315.	15.34	4.69	2.73	1.93	1.49	1.22	1.03	.89	.79	.70	.64	.58
1000.	316.	15.36	4.72	2.76	1.94	1.51	1.23	1.04	.90	.79	.71	.64	.59

1

PROBABLE MAXIMUM STORM FOR CPNPP
STORM AREA = 1000. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 328.0, Y = 196.0

ISOHYET	AREA WITHIN BASIN (SQ.MI.)	1	2	3	DEPTHs (INCHES) FOR 6-HOUR 4	5	6	7	8	9	10	11	12
A	10.	23.05	5.52	2.90	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
B	25.	21.65	5.33	2.86	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
C	50.	41.	20.26	5.17	2.83	1.96	1.52	1.24	1.05	.91	.80	.71	.65
D	100.	72.	18.87	5.00	2.80	1.96	1.52	1.24	1.05	.91	.80	.71	.65
E	175.	112.	17.48	4.90	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65
F	300.	174.	16.09	4.81	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65
G	450.	241.	15.00	4.71	2.77	1.96	1.52	1.24	1.05	.91	.80	.71	.65
H	700.	344.	13.77	4.62	2.76	1.96	1.52	1.24	1.05	.91	.80	.71	.65
I	1000.	457.	12.68	4.52	2.75	1.96	1.52	1.24	1.05	.91	.80	.71	.65
J	1500.	507.	9.28	3.62	2.28	1.62	1.25	1.02	.86	.75	.66	.59	.53
K	2150.	509.	6.81	3.00	1.85	1.31	1.02	.83	.70	.61	.54	.48	.43
L	3000.	509.	4.95	2.43	1.49	1.06	.82	.67	.57	.49	.43	.39	.32
M	4500.	509.	3.25	1.81	1.19	.84	.65	.53	.45	.39	.34	.31	.25
N	6500.	509.	1.86	1.14	.86	.61	.47	.38	.32	.28	.25	.22	.18
O	10000.	509.	.77	.60	.48	.34	.27	.22	.18	.16	.14	.13	.10
P	15000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		15.41	4.72	2.75	1.94	1.50	1.23	1.04	.90	.79	.71	.64	.58

1

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.83	1.64	2.45	4.71	8.03	12.16	15.79	23.05	28.57	31.46	33.42	34.94	36.18	37.23	38.13	38.93	39.65	40.29	40.88
B	.77	1.53	2.28	4.39	7.49	11.38	14.79	21.65	26.99	29.85	31.80	33.32	34.56	35.61	36.51	37.31	38.03	38.68	39.27
C	.72	1.43	2.12	4.09	6.98	10.62	13.80	20.26	25.43	28.26	30.22	31.74	32.97	34.02	34.93	35.73	36.44	37.09	37.68
D	.66	1.32	1.96	3.77	6.45	9.84	12.81	18.87	23.87	26.67	28.63	30.15	31.39	32.44	33.34	34.14	34.86	35.50	36.09
E	.61	1.21	1.80	3.47	5.94	9.08	11.82	17.48	22.38	25.17	27.13	28.64	29.88	30.93	31.84	32.63	33.35	34.00	34.59
F	.56	1.11	1.65	3.18	5.44	8.32	10.83	16.09	20.89	23.67	25.63	27.15	28.39	29.43	30.34	31.14	31.85	32.50	33.09
G	.52	1.03	1.53	2.95	5.06	7.74	10.07	15.00	19.72	22.48	24.44	25.96	27.20	28.24	29.15	29.95	30.66	31.31	31.90

Page 3

	SC 1 OUT																			
H	.47	.94	1.40	2.69	4.61	7.07	9.20	13.77	18.38	21.14	23.10	24.62	25.86	26.90	27.81	28.61	29.32	29.97	30.56	
I	.43	.86	1.28	2.46	4.23	6.49	8.44	12.68	17.21	19.95	21.91	23.43	24.67	25.72	26.62	27.42	28.14	28.78	29.37	
J	.16	.32	.48	.95	1.89	3.72	5.42	9.28	12.90	15.18	16.80	18.05	19.07	19.94	20.68	21.34	21.93	22.47	22.95	
K	.12	.23	.34	.69	1.37	2.68	3.92	6.81	9.81	11.66	12.97	13.99	14.82	15.52	16.13	16.66	17.14	17.58	17.97	
L	.08	.17	.25	.49	.98	1.92	2.81	4.95	7.38	8.87	9.93	10.75	11.42	11.98	12.47	12.91	13.29	13.64	13.96	
M	.05	.11	.16	.32	.63	1.24	1.81	3.25	5.06	6.25	7.09	7.74	8.28	8.73	9.12	9.46	9.77	10.04	10.30	
N	.03	.06	.09	.18	.35	.70	1.02	1.86	3.00	3.86	4.46	4.93	5.32	5.64	5.92	6.17	6.39	6.59	6.78	
O	.01	.02	.04	.07	.14	.28	.41	.77	1.37	1.85	2.20	2.46	2.68	2.86	3.02	3.16	3.28	3.40	3.50	
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.53	1.05	1.56	3.00	5.15	7.91	10.33	15.41	20.13	22.87	24.81	26.32	27.54	28.58	29.48	30.27	30.98	31.62	32.20	

1

PROBABLE MAXIMUM STORM FOR CPNPP											
DAY 1											
TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL
0100	.10	.10	0700	.12	.70	1300	.15	1.44	1900	.20	2.39
0200	.10	.19	0800	.12	.82	1400	.15	1.59	2000	.20	2.60
0300	.10	.29	0900	.12	.94	1500	.15	1.74	2100	.20	2.80
0400	.10	.39	1000	.12	1.06	1600	.15	1.89	2200	.20	3.01
0500	.10	.49	1100	.12	1.17	1700	.15	2.04	2300	.20	3.21
0600	.10	.58	1200	.12	1.29	1800	.15	2.19	2400	.20	3.42
6-HR TOTAL	.58			.71			.90				1.23
DAY 2											
TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL
0100	.29	3.70	0700	.60	5.96	1300	1.35	11.43	1900	.55	26.03
0200	.30	4.00	0800	.66	6.62	1400	1.96	13.39	2000	.51	26.54
0300	.31	4.31	0900	.73	7.34	1500	2.76	16.15	2100	.47	27.01
0400	.33	4.64	1000	.81	8.15	1600	5.15	21.30	2200	.43	27.44
0500	.35	4.99	1100	.91	9.06	1700	2.42	23.72	2300	.41	27.84
0600	.37	5.36	1200	1.01	10.07	1800	1.76	25.48	2400	.39	28.23
6-HR TOTAL	1.94			4.72			15.41				2.75
DAY 3											
TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL
0100	.25	28.48	0700	.17	29.91	1300	.13	30.90	1900	.11	31.67
0200	.25	28.73	0800	.17	30.08	1400	.13	31.03	2000	.11	31.77
0300	.25	28.98	0900	.17	30.25	1500	.13	31.17	2100	.11	31.88
0400	.25	29.23	1000	.17	30.42	1600	.13	31.30	2200	.11	31.99
0500	.25	29.48	1100	.17	30.60	1700	.13	31.43	2300	.11	32.09
0600	.25	29.73	1200	.17	30.77	1800	.13	31.56	2400	.11	32.20
6-HR TOTAL	1.50			1.04			.79				.64

1

BOUNDARY COORDINATES FOR BASIN4											
X	352.8	348.3	349.1	345.0	347.4	339.3	323.6	325.8	317.6	314.8	
Y	441.5	481.9	512.5	515.5	523.6	523.4	550.2	562.8	565.8	571.4	
X	317.4	315.6	306.5	302.1	295.4	295.4	289.7	284.2	279.7	267.3	
Y	574.4	579.2	582.4	600.0	600.5	612.0	617.3	640.0	644.0	640.7	
X	258.7	236.4	227.0	214.0	161.3	123.5	111.3	96.2	102.6	97.3	
Y	651.3	648.7	677.8	665.0	685.3	676.9	664.0	593.1	588.7	567.8	
X	81.5	85.2	76.9	85.9	75.6	77.8	82.6	84.8	70.6	66.1	
Y	554.6	547.9	530.6	505.2	501.2	486.1	484.7	480.1	471.4	460.5	
X	56.8	57.5	49.5	51.0	40.8	40.0	54.8	61.6	65.8	48.0	
Y	459.9	445.4	431.3	424.0	416.9	406.8	378.1	377.5	347.0	304.2	
X	62.3	35.0	36.6	46.9	55.1	63.7	73.8	72.7	84.0	92.2	
Y	290.4	242.8	238.1	240.0	236.2	238.7	233.3	225.3	226.6	224.0	
X	97.8	121.9	126.6	133.1	136.4	146.0	138.6	143.2	127.2	137.7	
Y	224.9	215.4	225.3	225.3	213.7	213.2	195.4	187.2	150.2	138.8	
X	139.1	151.0	157.4	164.1	200.1	219.9	230.6	240.8	246.7	251.9	
Y	127.7	120.3	124.3	115.4	125.3	135.2	153.3	156.6	153.6	154.8	
X	260.1	275.4	281.4	281.4	285.0	291.7	296.7	298.1	288.5	305.7	
Y	154.8	160.5	167.4	177.8	188.1	192.6	200.6	211.2	244.0	264.8	
X	294.8	330.1									
Y	331.2	425.4									

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 410.6 SQ. MI.

BASIN CENTROID COORDINATES, X = 193.4, Y = 409.2

1

PROBABLE MAXIMUM STORM FOR BASIN4
 STORM AREA = 1000. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
 Page 4

ISOHYET AREA (SQ.MI.)	AREA WITHIN BASIN (SQ.MI.)	STORM CENTER COORDINATES, X = 328.0, Y = 196.0												
		1	2	3	DEPTHs (INCHES)	FOR 6-HOUR	INCREMENTs	OF PMS	10	11	12			
		4	5	6	7	8	9							
A	10.	0.	23.05	5.52	2.90	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
B	25.	1.	21.65	5.33	2.86	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
C	50.	7.	20.26	5.17	2.83	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
D	100.	22.	18.87	5.00	2.80	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
E	175.	48.	17.48	4.90	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
F	300.	92.	16.09	4.81	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
G	450.	149.	15.00	4.71	2.77	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
H	700.	248.	13.77	4.62	2.76	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
I	1000.	358.	12.68	4.52	2.75	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
J	1500.	408.	9.28	3.62	2.28	1.62	1.25	1.02	.86	.75	.66	.59	.53	.49
K	2150.	411.	6.81	3.00	1.85	1.31	1.02	.83	.70	.61	.54	.48	.43	.40
L	3000.	411.	4.95	2.43	1.49	1.06	.82	.67	.57	.49	.43	.39	.35	.32
M	4500.	411.	3.25	1.81	1.19	.84	.65	.53	.45	.39	.34	.31	.28	.25
N	6500.	411.	1.86	1.14	.86	.61	.47	.38	.32	.28	.25	.22	.20	.18
O	10000.	411.	.77	.60	.48	.34	.27	.22	.18	.16	.14	.13	.11	.10
P	15000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		14.56	4.63	2.73	1.93	1.50	1.22	1.03	.90	.79	.71	.64	.58	
1														

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

ISOHYET	DEPTH VS. DURATION																		
	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.83	1.64	2.45	.71	8.03	12.16	15.79	23.05	28.57	31.46	33.42	34.94	36.18	37.23	38.13	38.93	39.65	40.29	40.88
B	.77	1.53	2.28	4.39	7.49	11.38	14.79	21.65	26.99	29.85	31.80	33.32	34.56	35.61	36.51	37.31	38.03	38.68	39.27
C	.72	1.43	2.12	4.09	6.98	10.62	13.80	20.26	25.43	28.26	30.22	31.74	32.97	34.02	34.93	35.73	36.44	37.09	37.68
D	.66	1.32	1.96	3.77	6.45	9.84	12.81	18.87	23.87	26.67	28.63	30.15	31.39	32.44	33.34	34.14	34.86	35.50	36.09
E	.61	1.21	1.80	3.47	5.94	9.08	11.82	17.48	22.38	25.17	27.13	28.64	29.88	30.93	31.84	32.63	33.35	34.00	34.59
F	.56	1.11	1.65	3.18	5.44	8.32	10.83	16.09	20.89	23.67	25.63	27.15	28.39	29.43	30.34	31.14	31.85	32.50	33.09
G	.52	1.03	1.53	2.95	5.06	7.74	10.07	15.00	19.72	22.48	24.44	25.96	27.20	28.24	29.15	29.95	30.66	31.31	31.90
H	.47	.94	1.40	2.69	4.61	7.07	9.20	13.77	18.38	21.14	23.10	24.62	25.86	26.90	27.81	28.61	29.32	29.97	30.56
I	.43	.86	1.28	2.46	4.23	6.49	8.44	12.68	17.21	19.95	21.91	23.43	24.67	25.72	26.62	27.42	28.14	28.78	29.37
J	.46	.32	.48	.95	1.89	3.72	5.42	9.28	12.90	15.18	16.80	18.05	19.07	19.94	20.68	21.34	21.93	22.47	22.95
K	.12	.23	.34	.69	1.37	2.68	3.92	6.81	9.81	11.66	12.97	13.99	14.82	15.52	16.13	16.66	17.14	17.58	17.97
L	.08	.17	.25	.49	.98	1.92	2.81	4.95	7.38	8.87	9.93	10.75	11.42	11.98	12.47	12.91	13.29	13.64	13.96
M	.05	.11	.16	.32	.63	1.24	1.81	3.25	5.06	6.25	7.09	7.74	8.28	8.73	9.12	9.46	9.77	10.04	10.30
N	.03	.06	.09	.18	.35	.70	1.02	1.86	3.00	3.86	4.46	4.93	5.32	5.64	5.92	6.17	6.39	6.59	6.78
O	.01	.02	.04	.07	.14	.28	.41	.77	1.37	1.85	2.20	2.46	2.68	2.86	3.02	3.16	3.28	3.40	3.50
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE	.49	.98	1.46	2.81	4.82	7.44	9.72	14.56	19.19	21.93	23.86	25.36	26.58	27.62	28.51	29.30	30.01	30.65	31.23
1																			

PROBABLE MAXIMUM STORM FOR BASIN4

DAY 1	TIME			PRECIPITATION			TIME			PRECIPITATION			TIME			PRECIPITATION		
	INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL	
0100	.10	.10		0700	.12	.70	1300	.15	1.44	1900	.20	2.39						
0200	.10	.19		0800	.12	.82	1400	.15	1.59	2000	.20	2.59						
0300	.10	.29		0900	.12	.94	1500	.15	1.74	2100	.20	2.80						
0400	.10	.39		1000	.12	1.05	1600	.15	1.89	2200	.20	3.00						
0500	.10	.49		1100	.12	1.17	1700	.15	2.03	2300	.20	3.20						
0600	.10	.58		1200	.12	1.29	1800	.15	2.18	2400	.20	3.41						
6-HR TOTAL		1.93				4.63			14.56			2.73						
DAY 2	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION	
0100	.29	3.69		0700	.60	5.94	1300	1.30	11.28	1900	.55	25.08						
0200	.30	3.99		0800	.65	6.59	1400	1.86	13.14	2000	.50	25.59						
0300	.31	4.30		0900	.72	7.31	1500	2.61	15.75	2100	.46	26.05						
0400	.33	4.63		1000	.80	8.10	1600	4.82	20.58	2200	.43	26.48						
0500	.35	4.98		1100	.89	8.99	1700	2.28	22.86	2300	.40	26.88						
0600	.37	5.34		1200	.99	9.98	1800	1.68	24.54	2400	.39	27.27						
6-HR TOTAL		1.93				4.63			14.56			2.73						
DAY 3	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION	
0100	.25	27.52		0700	.17	28.94	1300	.13	29.93	1900	.11	30.70						
0200	.25	27.77		0800	.17	29.11	1400	.13	30.06	2000	.11	30.80						
0300	.25	28.02		0900	.17	29.28	1500	.13	30.20	2100	.11	30.91						
0400	.25	28.27		1000	.17	29.46	1600	.13	30.33	2200	.11	31.02						
0500	.25	28.52		1100	.17	29.63	1700	.13	30.46	2300	.11	31.12						
0600	.25	28.77		1200	.17													

SC 1.OUT
SUBBASIN3

BOUNDARY COORDINATES FOR BASIN3										
X	296.7	291.7	285.0	281.4	281.4	275.4	260.1	251.9	246.6	240.8
Y	200.6	192.6	188.1	177.8	167.4	160.5	154.8	154.8	153.6	156.6
X	230.6	225.4	219.9	200.1	164.1	168.7	175.9	172.8	198.3	200.8
Y	153.3	145.6	135.2	125.3	115.4	94.9	88.6	82.9	85.1	92.2
X	217.9	233.5	244.0	247.2	254.0	261.8	272.2	277.1	287.2	290.7
Y	92.9	104.3	104.6	101.7	106.8	105.3	107.4	101.4	107.4	107.4
X	294.5	306.5	308.5	303.9	308.5	307.9	308.9			
Y	114.2	114.5	116.4	128.5	141.8	169.5	181.1			

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 24.2 SQ. MI.

BASIN CENTROID COORDINATES, X = 249.0, Y = 129.9

PROBABLE MAXIMUM STORM FOR BASIN3
STORM AREA = 1000. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 328.0, Y = 196.0

ISOHYET AREA (SQ.MI.)	WITHIN AREA (SQ.MI.)	DEPTHS (INCHES) FOR 6-HOUR INCREMENTS OF PMS												
		1	2	3	4	5	6	7	8	9	10	11	12	
A	10.	0.	23.05	5.52	2.90	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
B	25.	1.	21.65	5.33	2.86	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
C	50.	3.	20.26	5.17	2.83	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
D	100.	6.	18.87	5.00	2.80	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
E	175.	10.	17.48	4.90	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
F	300.	14.	16.09	4.81	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
G	450.	18.	15.00	4.71	2.77	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
H	700.	22.	13.77	4.62	2.76	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
I	1000.	24.	12.68	4.52	2.75	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
J	1500.	24.	9.28	3.62	2.28	1.62	1.25	1.02	.86	.75	.66	.59	.53	.49
K	2150.	24.	6.81	3.00	1.85	1.31	1.02	.83	.70	.61	.54	.48	.43	.40
L	3000.	24.	4.95	2.43	1.49	1.06	.82	.67	.57	.49	.43	.39	.35	.32
M	4500.	24.	3.25	1.81	1.19	.84	.65	.53	.45	.39	.34	.31	.28	.25
N	6500.	24.	1.86	1.14	.86	.61	.47	.38	.32	.28	.25	.22	.20	.18
O	10000.	24.	.77	.60	.48	.34	.27	.22	.18	.16	.14	.13	.11	.10
P	15000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		16.89	4.87	2.79	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59	

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.83	1.64	2.45	4.71	8.03	12.16	15.79	23.05	28.57	31.46	33.42	34.94	36.18	37.23	38.13	38.93	39.65	40.29	40.88
B	.77	1.53	2.28	4.39	7.49	11.38	14.79	21.65	26.99	29.85	31.80	33.32	34.56	35.61	36.51	37.31	38.03	38.68	39.27
C	.72	1.43	2.12	4.09	6.98	10.62	13.80	20.26	25.43	28.26	30.22	31.74	32.97	34.02	34.93	35.73	36.44	37.09	37.68
D	.66	1.32	1.96	3.77	6.45	9.84	12.81	18.87	23.87	26.67	28.63	30.15	31.39	32.44	33.34	34.14	34.86	35.50	36.09
E	.61	1.21	1.80	3.47	5.94	9.08	11.81	17.48	22.38	25.17	27.13	28.64	29.88	30.93	31.84	32.63	33.35	34.00	34.59
F	.56	1.11	1.65	3.18	5.44	8.32	10.83	16.09	20.89	23.67	25.63	27.15	28.39	29.43	30.34	31.14	31.85	32.50	33.09
G	.52	1.03	1.53	2.95	5.06	7.74	10.07	15.00	19.72	22.48	24.44	25.96	27.20	28.24	29.15	29.95	30.66	31.31	31.90
H	.47	.94	1.40	2.69	4.61	7.07	9.29	13.77	18.38	21.14	23.10	24.62	25.86	26.90	27.81	28.61	29.32	29.97	30.56
I	.43	.86	1.28	2.46	4.23	6.49	8.44	12.68	17.21	19.95	21.91	23.43	24.67	25.72	26.62	27.42	28.14	28.78	29.37
J	.36	.32	.48	1.89	3.72	5.42	9.28	12.90	15.18	16.80	18.05	19.07	19.94	20.68	21.34	21.93	22.47	22.95	
K	.12	.23	.34	.69	1.37	2.68	3.92	6.81	9.81	11.66	12.97	13.99	14.82	15.52	16.13	16.66	17.14	17.58	17.97
L	.08	.17	.25	.49	.98	1.92	2.81	4.95	7.38	8.87	9.93	10.75	11.42	11.98	12.47	12.91	13.29	13.64	13.96
M	.05	.11	.16	.32	.63	1.24	1.81	3.25	5.06	6.25	7.09	7.74	8.28	8.73	9.12	9.46	9.77	10.04	10.30
N	.03	.06	.09	.18	.35	.70	1.02	1.86	3.00	3.86	4.46	4.93	5.32	5.64	5.92	6.17	6.39	6.59	6.78
O	.01	.02	.04	.07	.14	.28	.41	.77	1.37	1.85	2.20	2.46	2.68	2.86	3.02	3.16	3.28	3.40	3.50
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE	.59	1.17	1.74	3.36	5.74	8.77	11.41	16.89	21.76	24.55	26.51	28.03	29.26	30.31	31.22	32.02	32.73	33.38	33.97

PROBABLE MAXIMUM STORM FOR BASIN3																			
DAY 1	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
	0100	.10	.10	0700	.12	.71	1300	.15	1.46	1900	.21	2.42							
	0200	.10	.20	0800	.12	.83	1400	.15	1.61	2000	.21	2.62							
	0300	.10	.30	0900	.12	.95	1500	.15	1.76	2100	.21	2.83							
	0400	.10	.39	1000	.12	1.07	1600	.15	1.91	2200	.21	3.04							
	0500	.10	.49	1100	.12	1.19	1700	.15	2.06	2300	.21	3.24							
	0600	.10	.59	1200	.12	1.30	1800	.15	2.21	2400	.21	3.45							
	6-HR TOTAL		.59			.71			.91			1.24							

SC 1.OUT													
DAY 2	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL	
	0100	.29	3.74	0700	.62	6.02	1300	1.44	11.72	1900	.56	27.73	
	0200	.30	4.04	0800	.67	6.70	1400	2.13	13.85	2000	.51	28.25	
	0300	.31	4.36	0900	.75	7.45	1500	3.02	16.88	2100	.47	28.72	
	0400	.33	4.69	1000	.84	8.28	1600	5.74	22.62	2200	.44	29.16	
	0500	.35	5.04	1100	.94	9.22	1700	2.64	25.26	2300	.41	29.57	
	0600	.37	5.41	1200	1.06	10.28	1800	1.91	27.17	2400	.39	29.96	
	6-HR TOTAL	1.96			4.87			16.89			2.79		
DAY 3	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL	
	0100	.25	30.21	0700	.17	31.65	1300	.13	32.66	1900	.11	33.43	
	0200	.25	30.46	0800	.17	31.82	1400	.13	32.79	2000	.11	33.54	
	0300	.25	30.72	0900	.17	32.00	1500	.13	32.92	2100	.11	33.65	
	0400	.25	30.97	1000	.17	32.17	1600	.13	33.06	2200	.11	33.75	
	0500	.25	31.22	1100	.17	32.35	1700	.13	33.19	2300	.11	33.86	
	0600	.25	31.48	1200	.17	32.52	1800	.13	33.32	2400	.11	33.97	
	6-HR TOTAL	1.52			1.05			.80			.65		
1	SUBBASIN2												
BOUNDARY COORDINATES FOR BASIN2													
X	367.4	365.0	356.2	322.0	318.8	308.9	307.9	308.5	303.9	308.5			
Y	181.9	179.7	177.0	180.6	183.7	181.1	169.5	141.8	128.5	116.4			
X	315.4	331.8	341.0	349.7	353.3	349.8	354.4	357.0	364.9	364.6			
Y	121.1	122.1	122.9	115.8	123.3	135.2	137.8	149.0	163.2	170.5			
X	367.2												
Y	172.2												
SCALE =	.0583 MILES PER COORDINATE UNIT												
BASIN AREA =	10.3 SQ. MI.												
BASIN CENTROID COORDINATES, X =	332.9, Y = 151.7												
PROBABLE MAXIMUM STORM FOR BASIN2													
STORM AREA = 1000. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.		STORM CENTER COORDINATES, X = 328.0, Y = 196.0											
ISOHYET	AREA WITHIN BASIN (SQ.MI.)	1	2	3	4	5	6	7	8	9	10	11	12
A	10.	3.	23.05	5.52	2.90	1.96	1.52	1.24	1.05	.91	.80	.71	.65
B	25.	8.	21.65	5.33	2.86	1.96	1.52	1.24	1.05	.91	.80	.71	.65
C	50.	10.	20.26	5.17	2.83	1.96	1.52	1.24	1.05	.91	.80	.71	.65
D	100.	10.	18.87	5.00	2.80	1.96	1.52	1.24	1.05	.91	.80	.71	.65
E	175.	10.	17.48	4.90	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65
F	300.	10.	16.09	4.81	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65
G	450.	10.	15.00	4.71	2.77	1.96	1.52	1.24	1.05	.91	.80	.71	.65
H	700.	10.	13.77	4.62	2.76	1.96	1.52	1.24	1.05	.91	.80	.71	.65
I	1000.	10.	12.68	4.52	2.75	1.96	1.52	1.24	1.05	.91	.80	.71	.65
J	1500.	10.	9.28	3.62	2.28	1.62	1.25	1.02	.86	.75	.66	.59	.53
K	2150.	10.	6.81	3.00	1.85	1.31	1.02	.83	.70	.61	.54	.48	.43
L	3000.	10.	4.95	2.43	1.49	1.06	.82	.67	.57	.49	.43	.39	.35
M	4500.	10.	3.25	1.81	1.19	.84	.65	.53	.45	.39	.34	.31	.25
N	6500.	10.	1.86	1.14	.86	.61	.47	.38	.32	.28	.25	.22	.18
O	10000.	10.	.77	.60	.48	.34	.27	.22	.18	.16	.14	.13	.10
P	15000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		22.08	5.40	2.87	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION													
ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR
A	.83	1.64	2.45	4.71	8.03	12.16	15.79	23.05	28.57	31.46	33.42	34.94	36.18
B	.77	1.53	2.28	4.39	7.49	11.38	14.79	21.65	26.99	29.85	31.80	33.32	34.56
C	.72	1.43	2.12	4.09	6.98	10.62	13.80	20.26	25.43	28.26	30.22	31.74	32.97
D	.66	1.32	1.96	3.77	6.45	9.84	12.81	18.87	23.87	26.67	28.63	30.15	31.39
E	.61	1.21	1.80	3.47	5.94	9.08	11.82	17.48	22.38	25.17	27.13	28.64	29.88
F	.56	1.11	1.65	3.18	5.44	8.32	10.83	16.09	20.89	23.67	25.63	27.15	28.39
G	.52	1.03	1.53	2.95	5.06	7.74	10.07	15.00	19.72	22.48	24.44	25.96	27.20
H	.47	.94	1.40	2.69	4.61	7.07	9.20	13.77	18.38	21.14	23.10	24.62	25.84
I	.43	.86	1.28	2.46	4.23	6.49	8.44	12.68	17.21	19.95	21.91	23.43	24.67
J	.46	.32	.48	.95	1.89	3.72	5.42	9.28	12.90	15.18	16.80	18.05	19.07
K	.42	.23	.34	.69	1.37	2.68	3.92	6.81	9.81	11.66	12.97	13.99	14.82
L	.48	.17	.25	.49	.98	1.92	2.81	4.95	7.38	8.87	9.93	10.75	11.42
M	.45	.11	.16	.32	.63	1.24	1.81	3.23	5.06	6.25	7.09	7.74	8.28
N	.43	.06	.09	.18	.35	.70	1.02	1.86	3.00	3.86	4.46	4.93	5.32
O	.41	.02	.04	.07	.14	.28	.41	.77	1.37	1.85	2.20	2.46	2.68
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

	SC 1 OUT																			
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE	.79	1.57	2.33	4.49	7.66	11.62	15.09	22.08	27.47	30.34	32.30	33.82	35.06	36.11	37.01	37.81	38.53	39.17	39.76	1

PROBABLE MAXIMUM STORM FOR BASIN2

DAY 1		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.10	.10		0700	.12	.71		1300	.15	1.46		1900	.21	2.42			
0200	.10	.20		0800	.12	.83		1400	.15	1.61		2000	.21	2.62			
0300	.10	.30		0900	.12	.95		1500	.15	1.76		2100	.21	2.83			
0400	.10	.39		1000	.12	1.07		1600	.15	1.91		2200	.21	3.04			
0500	.10	.49		1100	.12	1.19		1700	.15	2.06		2300	.21	3.24			
0600	.10	.59		1200	.12	1.30		1800	.15	2.21		2400	.21	3.45			
6-HR TOTAL		.59		.71				.91				1.24					
DAY 2		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.29	3.74		0700	.65	6.06		1300	1.77	12.57		1900	.59	33.47			
0200	.30	4.04		0800	.72	6.79		1400	2.76	15.33		2000	.53	34.01			
0300	.31	4.35		0900	.82	7.60		1500	3.96	19.29		2100	.49	34.49			
0400	.33	4.68		1000	.93	8.53		1600	7.66	26.95		2200	.45	34.94			
0500	.35	5.03		1100	1.06	9.59		1700	3.47	30.43		2300	.42	35.36			
0600	.38	5.41		1200	1.21	10.80		1800	2.45	32.88		2400	.40	35.75			
6-HR TOTAL		1.96		5.40				22.08				2.87					
DAY 3		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.25	36.01		0700	.17	37.44		1300	.13	38.45		1900	.11	39.22			
0200	.25	36.26		0800	.17	37.62		1400	.13	38.58		2000	.11	39.33			
0300	.25	36.51		0900	.17	37.79		1500	.13	38.72		2100	.11	39.44			
0400	.25	36.76		1000	.17	37.97		1600	.13	38.85		2200	.11	39.55			
0500	.25	37.02		1100	.17	38.14		1700	.13	38.98		2300	.11	39.66			
0600	.25	37.27		1200	.17	38.32		1800	.13	39.12		2400	.11	39.76			
6-HR TOTAL		1.52		1.05				.80				.65					

SUBBASIN1

BOUNDARY COORDINATES FOR BASIN1											
X	352.8	330.1	309.2	294.8	305.6	288.8	298.1	296.6	308.6	318.8	
Y	439.5	425.4	374.5	331.2	266.6	244.3	211.3	200.4	181.5	185.0	
X	322.0	356.2	365.0	366.5	386.2	392.3	377.5	398.6	380.8	385.9	
Y	180.9	177.0	179.7	181.0	198.6	228.2	249.8	273.8	307.0	320.9	
X	375.5	379.9	370.4	371.4	365.4	356.5	349.5	354.0	353.1	356.4	
Y	358.8	370.7	385.5	393.1	396.8	395.5	405.4	411.9	420.9	429.5	
X	352.8										
Y	441.2										

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 64.1 SQ. MI.

BASIN CENTROID COORDINATES, X = 342.0, Y = 290.5

PROBABLE MAXIMUM STORM FOR BASIN1														
STORM AREA = 1000. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.														
STORM CENTER COORDINATES, X = 328.0, Y = 196.0														
ISOHYET	AREA WITHIN BASIN (SQ.MI.)	1	2	3	4	5	6	7	8	9	10	11	12	
A	10.	7.	23.05	5.52	2.90	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
B	25.	15.	21.65	5.33	2.86	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
C	50.	21.	20.26	5.17	2.83	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
D	100.	33.	18.87	5.00	2.80	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
E	175.	45.	17.48	4.90	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
F	300.	57.	16.09	4.81	2.78	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
G	450.	64.	15.00	4.71	2.77	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
H	700.	64.	13.77	4.62	2.76	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
I	1000.	64.	12.68	4.52	2.75	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59
J	1500.	64.	9.28	3.62	2.28	1.62	1.25	1.02	.86	.75	.66	.59	.53	.49
K	2150.	64.	6.81	3.00	1.85	1.31	1.02	.67	.50	.41	.34	.28	.22	.18
L	3000.	64.	4.95	2.43	1.49	1.06	.82	.67	.57	.49	.39	.31	.28	.25
M	4500.	64.	3.25	1.81	1.19	.84	.65	.53	.45	.34	.22	.20	.18	
N	6500.	64.	1.86	1.14	.86	.61	.47	.38	.32	.28	.25			
O	10000.	64.	.77	.60	.48	.34	.27	.22	.18	.16	.14	.13	.11	.10
P	15000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		19.17	5.08	2.82	1.96	1.52	1.24	1.05	.91	.80	.71	.65	.59	

SC 1.OUT

TIME INTERVAL = 60, MINUTES
 1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.83	1.64	2.45	4.71	8.03	12.16	15.79	23.05	28.57	31.46	33.42	34.94	36.18	37.23	38.13	38.93	39.65	40.29	40.88
B	.77	1.53	2.28	4.39	7.49	11.38	14.79	21.65	26.99	29.85	31.80	33.32	34.56	35.61	36.51	37.31	38.03	38.68	39.27
C	.72	1.43	2.12	4.09	6.98	10.62	13.80	20.26	25.43	28.26	30.22	31.74	32.97	34.02	34.93	35.73	36.44	37.09	37.68
D	.66	1.32	1.98	3.77	6.45	9.84	12.81	18.87	23.87	26.67	28.63	30.15	31.39	32.44	33.34	34.14	34.86	35.50	36.09
E	.61	1.21	1.80	3.47	5.94	9.08	11.82	17.48	22.38	25.17	27.13	28.64	29.88	30.93	31.84	32.63	33.35	34.00	34.59
F	.56	1.11	1.65	3.18	5.54	8.32	10.83	16.09	20.89	23.67	25.63	27.15	28.39	29.43	30.34	31.14	31.85	32.50	33.09
G	.52	1.03	1.53	2.95	5.06	7.74	10.07	15.00	19.72	22.48	24.44	25.96	27.20	28.24	29.15	29.95	30.66	31.31	31.90
H	.47	.94	1.40	2.69	4.61	7.07	9.20	13.77	18.38	21.14	23.10	24.62	25.86	26.90	27.81	28.61	29.32	29.97	30.56
I	.43	.86	1.28	2.46	4.23	6.49	8.44	12.68	17.21	19.95	21.91	23.43	24.67	25.72	26.62	27.42	28.14	28.78	29.37
J	.16	.32	.48	.95	1.89	3.72	5.42	9.28	12.90	15.18	16.80	18.05	19.07	19.94	20.68	21.34	21.93	22.47	22.95
K	.12	.23	.34	.69	1.37	2.68	3.92	6.81	9.81	11.66	12.97	13.99	14.82	15.52	16.13	16.66	17.14	17.58	17.97
L	.08	.17	.25	.49	.98	1.92	2.81	4.95	7.38	8.87	9.93	10.75	11.42	11.98	12.47	12.91	13.29	13.64	13.96
M	.05	.11	.16	.32	.63	1.24	1.81	3.25	5.06	6.25	7.09	7.74	8.28	8.73	9.12	9.46	9.77	10.04	10.30
N	.03	.06	.09	.18	.35	.70	1.02	1.86	3.00	3.86	4.46	4.93	5.32	5.64	5.92	6.17	6.39	6.59	6.78
O	.01	.02	.04	.07	.14	.28	.41	.77	1.37	1.85	2.20	2.46	2.68	2.86	3.02	3.16	3.28	3.40	3.50
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.68	1.34	2.00	3.85	6.58	10.02	13.03	19.17	24.26	27.08	29.03	30.55	31.79	32.84	33.74	34.54	35.26	35.90	36.50

1

PROBABLE MAXIMUM STORM FOR BASIN1

DAY 1		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.10	.10	0700	.12	.71	1300	.15	1.46	1900	.21	2.42	2000	.21	2.62
0200	.10	.20	0800	.12	.83	1400	.15	1.61	2100	.21	2.83	2200	.21	3.04
0300	.10	.30	0900	.12	.95	1500	.15	1.76	2300	.21	3.24	2400	.21	3.45
0400	.10	.39	1000	.12	1.07	1600	.15	1.91						
0500	.10	.49	1100	.12	1.19	1700	.15	2.06						
0600	.10	.59	1200	.12	1.30	1800	.15	2.21						
6-HR TOTAL		.59		.71			.91							1.24
DAY 2		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.29	3.74	0700	.63	6.04	1300	1.58	12.08	1900	.58	30.24	2000	.52	30.76
0200	.30	4.04	0800	.69	6.73	1400	2.41	14.49	2100	.48	31.24	2200	.44	31.68
0300	.31	4.35	0900	.77	7.51	1500	3.44	17.93	2300	.41	32.09	2400	.39	32.48
0400	.33	4.69	1000	.87	8.38	1600	6.58	24.51						
0500	.35	5.04	1100	.99	9.37	1700	3.01	27.51						
0600	.37	5.41	1200	1.13	10.49	1800	2.15	29.67						
6-HR TOTAL		1.96		5.08			19.17							2.82
DAY 3		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.25	32.74	0700	.17	34.18	1300	.13	35.18	1900	.11	35.96	2000	.11	36.06
0200	.25	32.99	0800	.17	34.35	1400	.13	35.32	2100	.11	36.17	2200	.11	36.28
0300	.25	33.24	0900	.17	34.53	1500	.13	35.45	2300	.11	36.39	2400	.11	36.50
0400	.25	33.50	1000	.17	34.70	1600	.13	35.58						
0500	.25	33.75	1100	.17	34.87	1700	.13	35.72						
0600	.25	34.00	1200	.17	35.05	1800	.13	35.85						
6-HR TOTAL		1.52		1.05			.80							.65

1

SC2.0UT

 * PROBABLE MAXIMUM STORM (HMR52) *
 * NOVEMBER 1982 *
 * REVISED APRIL 91 *
 * RUN DATE 08/06/2009 TIME 20:09:12 *

 * U.S. ARMY CORPS OF ENGINEERS *
 * THE HYDROLOGIC ENGINEERING CENTER *
 * 609 SECOND STREET *
 * DAVIS, CALIFORNIA 95616 *
 * (916) 551-1748 OR (FTS) 460-1748 *

H H M M RRRRRR 5555555 22222
 H H MM MM R R S 5 2 2
 H H M M M M R R S 5 2
 HHHHHHH M M M RRRRRR 555555 2
 H H M M R R S 5 2
 H H M M R R S 5 2
 H H M M R R S 5 2
 H H M M R R S 5 2
 HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA PAGE 1

LINE ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10

1 ID HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
 2 ID ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
 3 ID STORM CENTER WITHIN SQUAW CREEK BASIN AT SC2

4 BN CPNPP
 5 ID CALCULATE STORM OVER ENTIRE AREA
 6 BS .05827
 7 BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
 8 BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
 9 BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 85.17
 10 BX 76.93 85.92 75.56 77.81 82.63 84.8 66.09 56.79 57.55 49.52
 11 BX 51.04 40.8 40.05 54.76 65.82 47.95 62.30 35.02 36.56 63.69
 12 BX 73.84 72.72 84.03 121.92 126.58 133.09 136.39 145.99 138.58 143.21
 13 BX 127.17 137.74 151.01 157.40 164.07 168.68 175.89 172.76 198.29 200.78
 14 BX 217.93 233.49 243.97 227.06 294.55 315.41 331.83 340.98 349.67 353.27
 15 BX 349.84 354.39 367.19 367.42 386.16 392.28 377.46 398.65 380.84 385.89
 16 BX 375.51 379.9 379.0 370.35 371.38 365.4 356.46 349.53 353.98 353.13 356.42
 17 BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
 18 BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
 19 BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 547.94
 20 BY 530.64 505.2 501.21 486.11 484.73 480.07 460.51 459.91 445.42 431.26
 21 BY 423.96 416.89 406.78 378.07 347.05 304.18 290.43 242.80 238.08 238.71
 22 BY 233.34 225.26 226.56 215.42 225.3 225.3 213.74 213.23 195.37 187.2
 23 BY 150.2 138.83 120.25 124.31 115.41 94.86 88.63 82.92 85.08 92.18
 24 BY 92.91 104.32 104.64 101.45 114.21 121.11 122.14 112.91 115.82 123.27
 25 BY 135.16 137.78 172.22 181.89 198.56 228.19 249.82 273.83 307.02 320.85
 26 BY 358.76 370.7 385.48 393.09 396.82 395.52 405.43 411.9 420.9 429.53
 27 HO 215
 28 HP 10 29.7 35.3 40.0 45.0 48.0
 29 HP 200 22.2 26.8 32.0 36.0 39.6
 30 HP 1000 15.9 20.7 25.8 30.0 33.4
 31 HP 5000 9.3 13.0 17.8 22.0 25.0
 32 HP 10000 7.1 10.3 14.4 18.5 21.0
 33 HP 20000 5.1 8.3 11.5 15.0 17.8
 34 SA 0 0 3
 35 SC 309 304
 36 ST 60 0.308 0 1
 37 PU ON

38 BN BASIN4
 39 BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
 40 BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
 41 BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 87.35
 42 BX 81.49 85.17 76.93 85.92 75.56 77.81 82.63 84.8 70.55 66.09
 43 BX 56.79 57.55 49.52 51.04 40.8 40.05 54.76 61.58 65.82 47.95
 44 BX 62.30 35.02 36.56 46.93 55.09 63.69 73.84 72.72 84.03 92.24
 45 BX 97.83 121.92 126.58 133.09 136.39 145.99 138.58 143.21 127.17 137.74
 46 BX 139.10 151.01 157.40 164.07 200.07 219.86 230.63 240.75 246.73 251.89
 47 BX 260.06 275.37 281.37 281.37 285.03 291.7 296.69 298.06 288.52 305.69
 48 BX 294.79 330.09
 49 BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
 50 BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
 51 BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 567.83
 52 BY 554.59 547.94 530.64 505.2 501.21 486.11 484.73 480.07 471.39 460.51
 53 BY 459.91 445.42 431.26 423.96 416.89 406.78 378.07 377.45 347.05 304.18

1 HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA PAGE 2

LINE ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10

54 BY 290.43 242.80 238.08 239.96 236.18 238.71 233.34 225.26 226.56 224.02
 55 BY 224.87 215.42 225.3 225.3 213.74 213.23 195.37 187.2 150.2 138.83
 56 BY 127.7 120.25 124.31 115.41 125.34 135.17 153.31 156.62 153.56 154.76
 57 BY 154.76 160.46 167.45 177.77 188.09 192.59 200.58 211.24 244 264.84
 58 BY 331.2 425.42

59 BN BASIN3
 60 ID SUBBASIN3
 61 BX 296.69 291.69 285.04 281.37 281.37 275.37 260.06 251.89 246.63 240.75
 62 BX 230.63 225.36 219.86 200.07 164.07 168.68 175.89 172.76 198.29 200.78
 63 BX 217.93 233.49 243.97 247.19 253.98 261.76 272.19 277.06 287.20 290.72
 64 BX 294.55 306.52 308.51 303.88 308.46 307.93 308.87
 65 BY 200.58 192.59 188.09 177.77 167.45 160.46 154.76 153.56 156.62
 66 BY 153.31 145.58 135.17 125.34 115.41 94.86 88.63 82.92 85.08 92.18
 67 BY 92.91 104.32 104.64 101.71 106.79 105.33 107.43 101.45 107.36 107.36
 68 BY 114.21 114.52 116.39 128.54 141.75 169.52 181.13

69 BN BASIN2
 70 ID SUBBASIN2
 71 BX 367.42 364.98 356.16 322.02 318.79 308.87 307.93 308.46 303.88 308.51
 72 BX 315.41 331.83 340.98 349.67 353.27 349.84 354.39 357.02 364.94 364.65
 73 BX 367.19

SC2.OUT

74	BY	181.89	179.72	177	180.58	183.71	181.13	169.52	141.75	128.54	116.39
75	BY	121.11	122.14	122.91	115.82	123.27	135.16	137.78	149	163.23	170.54
76	BY	172.22									

77	BN	BASIN1									
78	ID	SUBBASIN1									
79	BX	352.79	330.08	309.24	294.79	305.63	288.78	298.06	296.58	308.64	318.8
80	BX	322.02	356.16	364.98	366.54	386.16	392.28	377.46	398.65	380.84	385.89
81	BX	375.51	379.9	370.35	371.38	365.4	356.46	349.53	353.98	353.13	356.42
82	BX	352.83									
83	BY	439.49	425.42	374.54	331.2	266.57	244.31	211.25	200.39	181.51	185.02
84	BY	180.91	177	179.72	181.01	198.56	228.19	249.82	273.83	307.02	320.85
85	BY	358.76	370.7	385.48	393.09	396.82	395.52	405.43	411.9	420.9	429.53
86	BY	441.22									

87 ZZ

1*****
*
* PROBABLE MAXIMUM STORM (HMR52) *
* NOVEMBER 1982 *
* REVISED APRIL 91 *
* RUN DATE 08/06/2009 TIME 20:09:12 *

* U.S. ARMY CORPS OF ENGINEERS *
* THE HYDROLOGIC ENGINEERING CENTER *
* 609 SECOND STREET *
* DAVIS, CALIFORNIA 95616 *
* (916) 551-1748 OR (FTS) 460-1748 *

HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
STORM CENTER WITHIN SQUAW CREEK BASIN AT SC2
CALCULATE STORM OVER ENTIRE AREA

PMP DEPTHS FROM HMR 51

AREA (SQ. MI.)	DURATION				
	6-HR	12-HR	24-HR	48-HR	72-HR
10.	29.70	35.30	40.00	45.00	48.00
200.	22.20	26.80	32.00	36.00	39.60
1000.	15.90	20.70	25.80	30.00	33.40
5000.	9.30	13.00	17.80	22.00	25.00
10000.	7.10	10.30	14.40	18.50	21.00
20000.	5.10	8.30	11.50	15.00	17.80

STORM AREA	PMP DEPTHS FOR 6-HOUR INCREMENTS											
	10.	25.	50.	100.	175.	300.	450.	700.	1000.	1500.		
10.	29.67	5.40	2.99	2.08	1.59	1.29	1.09	.94	.83	.74	.67	.61
25.	27.92	5.22	2.95	2.06	1.59	1.29	1.09	.94	.83	.74	.67	.61
50.	26.45	5.09	2.91	2.05	1.58	1.29	1.09	.94	.83	.74	.67	.61
100.	24.29	4.91	2.86	2.02	1.57	1.28	1.08	.94	.82	.74	.67	.61
175.	22.55	4.75	2.81	2.00	1.56	1.28	1.08	.94	.83	.74	.67	.61
300.	20.55	4.76	2.81	2.00	1.55	1.27	1.08	.93	.82	.74	.67	.61
450.	18.97	4.79	2.82	2.00	1.56	1.27	1.08	.93	.82	.74	.67	.61
700.	17.24	4.83	2.83	2.00	1.56	1.27	1.07	.93	.82	.73	.66	.61
1000.	15.84	4.88	2.83	2.01	1.55	1.27	1.07	.93	.82	.73	.66	.60
1500.	14.17	4.63	2.76	1.97	1.53	1.26	1.06	.92	.81	.73	.66	.60
2150.	12.69	4.41	2.69	1.94	1.52	1.25	1.06	.92	.81	.73	.66	.60
3000.	11.31	4.23	2.62	1.91	1.50	1.23	1.05	.91	.81	.72	.66	.60
4500.	9.64	4.00	2.54	1.87	1.48	1.22	1.04	.91	.81	.72	.66	.60
6500.	8.38	3.73	2.41	1.78	1.42	1.18	1.00	.88	.78	.70	.63	.58
10000.	7.02	3.38	2.22	1.66	1.33	1.10	.95	.83	.74	.66	.60	.55
15000.	5.93	3.11	2.07	1.55	1.24	1.04	.89	.78	.69	.62	.57	.52
20000.	5.15	2.92	1.96	1.48	1.19	.99	.85	.75	.66	.60	.54	.50

1

X	Y	BOUNDARY COORDINATES FOR CPNPP									
		352.8	348.3	349.1	345.0	347.4	339.3	323.6	325.8	317.6	314.8
X	Y	441.5	481.9	512.5	515.5	523.6	523.4	550.2	562.8	565.8	571.4
X	Y	317.4	315.6	306.5	302.1	295.4	295.4	289.7	284.2	279.7	267.3
X	Y	258.7	236.4	227.0	214.0	161.3	123.5	111.3	96.2	102.6	85.2
X	Y	651.3	648.7	677.8	665.0	685.3	676.9	664.0	593.1	588.7	547.9
X	Y	76.9	85.9	75.6	77.8	82.6	84.8	66.1	56.8	57.5	49.5
X	Y	530.6	505.2	501.2	486.1	484.7	480.1	460.5	459.9	445.4	431.3
X	Y	51.0	40.8	40.0	54.8	65.8	48.0	62.3	35.0	36.6	63.7
X	Y	424.0	416.9	406.8	378.1	347.0	304.2	290.4	242.8	238.1	238.7
X	Y	73.8	72.7	84.0	121.9	126.6	133.1	136.4	146.0	138.6	143.2
X	Y	233.3	225.3	226.6	215.4	225.3	213.7	213.2	195.4	187.2	
X	Y	127.2	137.7	151.0	157.4	164.1	168.7	175.9	172.8	198.3	200.8
X	Y	150.2	138.8	120.3	124.3	115.4	94.9	88.6	82.9	85.1	92.2
X	Y	217.9	233.5	244.0	277.1	294.5	315.4	331.8	341.0	349.7	353.3
X	Y	92.9	104.3	104.6	101.4	114.2	121.1	122.1	112.9	115.8	123.3
X	Y	349.8	354.4	367.2	367.4	386.2	392.3	377.5	398.6	380.8	385.9
X	Y	135.2	137.8	172.2	181.9	198.6	228.2	249.8	273.8	307.0	320.9
X	Y	375.5	379.9	370.4	371.4	365.4	356.5	349.5	354.0	353.1	356.4
X	Y	358.8	370.7	385.5	393.1	396.8	395.5	405.4	411.9	420.9	429.5

SCALE = .0583 MILES PER COORDINATE UNIT

SC2.OUT

BASIN AREA = 509.4 SQ. MI.

BASIN CENTROID COORDINATES, X = 217.6, Y = 375.6
1

VARYING STORM AREA SIZE AND FIXED ORIENTATION

STORM AREA	ORIEN-	TATION	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS	
10.	152.	8.08	1.49	.83	.57	.44	.36	.30	.26	.23	.20	.18	.17	10.40
25.	152.	10.67	2.23	1.29	.90	.70	.57	.48	.41	.36	.32	.29	.27	14.19
50.	152.	12.54	2.78	1.64	1.16	.89	.73	.61	.53	.47	.42	.38	.34	16.96
100.	152.	13.99	3.26	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42	19.21
175.	152.	15.09	3.60	2.21	1.57	1.22	1.00	.85	.73	.65	.58	.52	.48	20.90
300.	152.	15.93	4.03	2.46	1.75	1.36	1.11	.94	.82	.72	.64	.58	.53	22.42
450.	152.	16.41	4.33	2.61	1.85	1.44	1.18	1.00	.86	.76	.68	.62	.56	23.35
700.	152.	16.33	4.59	2.71	1.92	1.49	1.21	1.03	.89	.78	.70	.63	.58	23.63
1000.	152.	15.89	4.72	2.73	1.92	1.49	1.21	1.03	.89	.78	.70	.63	.58	23.34
1500.	152.	15.04	4.48	2.61	1.85	1.44	1.18	1.00	.87	.76	.68	.62	.57	22.12
2150.	152.	14.03	4.18	2.46	1.76	1.37	1.13	.96	.83	.74	.66	.60	.55	20.67
3000.	152.	12.88	3.88	2.30	1.64	1.29	1.06	.91	.79	.70	.63	.57	.52	19.06
4500.	152.	12.15	3.72	2.24	1.61	1.27	1.05	.90	.78	.69	.62	.57	.52	18.11
6500.	152.	11.63	3.51	2.13	1.54	1.22	1.01	.87	.76	.67	.60	.55	.50	17.27
10000.	152.	10.88	3.23	1.97	1.43	1.14	.95	.82	.71	.63	.57	.52	.48	16.09
15000.	152.	10.17	3.03	1.84	1.34	1.07	.90	.77	.67	.60	.54	.49	.45	15.04
20000.	152.	9.49	2.87	1.75	1.28	1.02	.86	.73	.64	.57	.52	.47	.43	14.11

FIXED STORM AREA SIZE AND VARYING ORIENTATION

STORM AREA	ORIEN-	TATION	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS	
700.	140.	16.09	4.55	2.69	1.90	1.47	1.20	1.02	.88	.78	.70	.63	.58	23.32
700.	150.	16.29	4.58	2.70	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58	23.57
700.	160.	16.39	4.61	2.72	1.92	1.49	1.22	1.03	.89	.79	.70	.64	.58	23.71
700.	170.	16.27	4.59	2.71	1.92	1.49	1.21	1.03	.89	.78	.70	.64	.58	23.57
700.	180.	15.92	4.53	2.68	1.89	1.47	1.20	1.01	.88	.77	.69	.63	.57	23.12
700.	190.	15.44	4.43	2.62	1.85	1.44	1.17	.99	.86	.76	.68	.61	.56	22.48
700.	200.	14.98	4.33	2.57	1.82	1.41	1.15	.97	.84	.74	.66	.60	.55	21.88
700.	210.	14.63	4.25	2.52	1.78	1.38	1.13	.96	.83	.73	.65	.59	.54	21.40
700.	220.	14.39	4.20	2.49	1.76	1.37	1.12	.94	.82	.72	.65	.58	.53	21.08
700.	230.	14.26	4.17	2.48	1.75	1.36	1.11	.94	.81	.72	.64	.58	.53	20.90
700.	240.	14.22	4.16	2.47	1.75	1.36	1.11	.94	.81	.72	.64	.58	.53	20.86
700.	250.	14.27	4.17	2.48	1.75	1.36	1.11	.94	.81	.72	.64	.58	.53	20.92
700.	260.	14.35	4.19	2.49	1.76	1.37	1.12	.94	.82	.72	.64	.58	.53	21.02
700.	270.	14.42	4.20	2.49	1.76	1.37	1.12	.95	.82	.72	.65	.58	.53	21.11
700.	280.	14.58	4.23	2.51	1.77	1.38	1.12	.95	.82	.73	.65	.59	.54	21.31
700.	290.	14.93	4.31	2.55	1.81	1.40	1.15	.97	.84	.74	.66	.60	.55	21.79
700.	300.	15.34	4.40	2.61	1.84	1.43	1.17	.99	.86	.75	.68	.61	.56	22.34
700.	310.	15.73	4.48	2.65	1.88	1.46	1.19	1.01	.87	.77	.69	.62	.57	22.86
700.	155.	16.38	4.60	2.71	1.92	1.49	1.22	1.03	.89	.79	.70	.64	.58	23.70
700.	165.	16.36	4.61	2.72	1.92	1.49	1.22	1.03	.89	.79	.70	.64	.58	23.68

1

STORM AREA = 700. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 309.0, Y = 304.0

ISOHYET	AREA WITHIN BASIN (SQ.MI.)	1	2	3	4	5	6	7	8	9	10	11	12
A	10.	23.81	5.46	2.91	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
B	25.	22.45	5.24	2.87	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
C	50.	21.09	5.10	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
D	100.	98.	4.96	2.81	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
E	175.	155.	18.20	4.81	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66
F	300.	227.	16.67	4.72	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66
G	450.	304.	15.65	4.62	2.78	1.98	1.53	1.25	1.06	.92	.81	.72	.66
H	700.	408.	14.29	4.53	2.77	1.98	1.53	1.25	1.06	.92	.81	.72	.66
I	1000.	467.	10.71	3.72	2.37	1.68	1.30	1.07	.90	.78	.69	.62	.56
J	1500.	504.	8.16	3.12	1.97	1.39	1.08	.88	.75	.65	.57	.51	.46
K	2150.	509.	6.12	2.57	1.63	1.16	.90	.73	.62	.54	.47	.42	.38
L	3000.	509.	4.59	2.10	1.31	.93	.72	.59	.50	.43	.38	.34	.28
M	4500.	509.	3.06	1.53	1.03	.73	.57	.46	.39	.34	.30	.27	.22
N	6500.	509.	1.70	.93	.71	.50	.39	.32	.27	.23	.21	.18	.15
O	10000.	509.	.68	.43	.36	.26	.20	.16	.14	.12	.11	.09	.08
P	15000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		16.39	4.61	2.72	1.92	1.49	1.22	1.03	.89	.79	.70	.64	.58

1

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.83	2.73	5.25	8.86	13.05	16.67	23.81	29.27	32.17	34.15	35.69	36.94	38.00	38.92	39.73	40.45	41.11	41.71
B	.86	1.72	2.56	4.92	8.31	12.26	15.68	22.45	27.69	30.56	32.54	34.07	35.33	36.39	37.31	38.12	38.84	39.50	40.09
C	.81	1.61	2.39	4.60	7.77	11.49	14.70	21.09	26.19	29.02	31.00	32.54	33.79	34.85	35.77	36.58	37.30	37.96	38.56
D	.74	1.48	2.20	4.24	7.17	10.62	13.59	19.56	24.52	27.33	29.30	30.84	32.09	33.15	34.07	34.88	35.61	36.26	36.86
E	.69	1.37	2.04	3.93	6.64	9.85	12.61	18.20	23.01	25.81	27.78	29.32	30.57	31.63	32.55	33.36	34.08	34.74	35.34
F	.63	1.25	1.85	3.57	6.04	8.98	11.49	16.67	21.39	24.17	26.15	27.68	28.94	30.00	30.92	31.73	32.45	33.11	33.70
G	.58	1.16	1.73	3.33	5.65	8.40	10.76	15.65	20.27	23.05	25.03	26.56	27.81	28.87	29.79	30.60	31.33	31.98	32.58

	SC2.OUT																			
H	.53	1.06	1.57	3.02	5.13	7.64	9.78	14.29	18.81	21.58	23.56	25.09	26.35	27.41	28.32	29.13	29.86	30.51	31.11	
I	.19	.37	.56	1.11	2.21	4.35	6.34	10.71	14.43	18.80	18.48	19.79	20.85	21.75	22.54	23.22	23.84	24.40	24.91	
J	.14	.28	.42	.84	1.67	3.28	4.78	8.16	11.29	13.25	14.65	15.73	16.61	17.36	18.01	18.58	19.09	19.55	19.97	
K	.10	.21	.31	.62	1.24	2.43	3.55	6.12	8.70	10.33	11.48	12.38	13.12	13.74	14.27	14.75	15.17	15.55	15.90	
L	.08	.15	.23	.46	.92	1.80	2.63	4.59	6.69	8.00	8.93	9.65	10.24	10.74	11.17	11.55	11.89	12.20	12.48	
M	.05	.10	.15	.30	.61	1.19	1.74	3.06	4.59	5.62	6.35	6.92	7.38	7.77	8.11	8.41	8.68	8.92	9.15	
N	.03	.06	.08	.17	.33	.65	.95	1.70	2.63	3.34	3.85	4.24	4.56	4.83	5.06	5.27	5.45	5.62	5.77	
O	.01	.02	.03	.07	.13	.25	.37	.68	1.11	1.47	1.73	1.93	2.09	2.23	2.35	2.45	2.55	2.63	2.71	
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.59	1.17	1.75	3.37	5.75	8.66	11.19	16.39	20.99	23.71	25.63	27.12	28.34	29.37	30.26	31.05	31.75	32.39	32.97	

1

PROBABLE MAXIMUM STORM FOR CPNPP

DAY 1		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL	INCR	TOTAL												
0100	.10	.10		0700	.12	.70		1300	.15	1.43		1900	.20	2.38			
0200	.10	.19		0800	.12	.82		1400	.15	1.58		2000	.20	2.58			
0300	.10	.29		0900	.12	.93		1500	.15	1.73		2100	.20	2.79			
0400	.10	.39		1000	.12	1.05		1600	.15	1.88		2200	.20	2.99			
0500	.10	.48		1100	.12	1.17		1700	.15	2.03		2300	.20	3.19			
0600	.10	.58		1200	.12	1.28		1800	.15	2.18		2400	.20	3.39			
6-HR TOTAL		.58				.70				.89							1.22
DAY 2		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL	INCR	TOTAL												
0100	.28	3.68		0700	.59	5.90		1300	1.36	11.28		1900	.54	26.85			
0200	.30	3.97		0800	.64	6.54		1400	2.02	13.31		2000	.50	27.35			
0300	.31	4.28		0900	.70	7.25		1500	2.92	16.23		2100	.46	27.81			
0400	.32	4.61		1000	.79	8.03		1600	5.75	21.97		2200	.43	28.24			
0500	.34	4.95		1100	.89	8.92		1700	2.53	24.50		2300	.40	28.64			
0600	.36	5.31		1200	1.00	9.92		1800	1.81	26.31		2400	.38	29.02			
6-HR TOTAL		1.92				4.61				16.39							2.72
DAY 3		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL	INCR	TOTAL												
0100	.25	29.27		0700	.17	30.69		1300	.13	31.67		1900	.11	32.44			
0200	.25	29.52		0800	.17	30.86		1400	.13	31.81		2000	.11	32.54			
0300	.25	29.77		0900	.17	31.03		1500	.13	31.94		2100	.11	32.65			
0400	.25	30.02		1000	.17	31.20		1600	.13	32.07		2200	.11	32.75			
0500	.25	30.27		1100	.17	31.37		1700	.13	32.20		2300	.11	32.86			
0600	.25	30.51		1200	.17	31.54		1800	.13	32.33		2400	.11	32.97			
6-HR TOTAL		1.49				1.03				.79							.64

1

BOUNDARY COORDINATES FOR BASIN4

X	352.8	348.3	349.1	345.0	347.4	339.3	323.6	325.8	317.6	314.8
Y	441.5	481.9	512.5	515.5	523.6	523.4	550.2	562.8	565.8	571.4
X	317.4	315.6	306.5	302.1	295.4	295.4	289.7	284.2	279.7	267.3
Y	574.4	579.2	582.4	600.0	600.5	612.0	617.3	640.0	644.0	640.7
X	258.7	236.4	227.0	214.0	161.3	123.5	111.3	96.2	102.6	97.3
Y	651.3	648.7	677.8	665.0	685.3	676.9	664.0	593.1	588.7	567.8
X	81.5	85.2	76.9	85.9	75.6	77.8	82.6	84.8	70.6	66.1
Y	554.6	547.9	530.6	505.2	501.2	486.1	484.7	480.1	471.4	460.5
X	56.8	57.5	49.5	51.0	40.8	40.0	54.8	61.6	65.8	48.0
Y	459.9	445.4	431.3	424.0	416.9	406.8	378.1	377.5	347.0	304.2
X	62.3	35.0	36.6	46.9	55.1	63.7	73.8	72.7	84.0	92.2
Y	290.4	242.8	238.1	240.0	236.2	238.7	233.3	225.3	226.6	224.0
X	97.8	121.9	126.6	133.1	136.4	146.0	138.6	143.2	127.2	137.7
Y	224.9	215.4	225.3	213.7	213.2	195.4	187.2	150.2	150.2	138.8
X	139.1	151.0	157.4	164.1	200.1	219.9	230.6	240.8	246.7	251.9
Y	127.7	120.3	124.3	115.4	125.3	135.2	153.2	156.6	153.6	154.8
X	260.1	275.4	281.4	281.4	285.0	291.7	296.7	298.1	288.5	305.7
Y	154.8	160.5	167.4	177.8	188.1	192.6	200.6	211.2	244.0	264.8
X	294.8	330.1								
Y	331.2	425.4								

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 410.6 SQ. MI.

BASIN CENTROID COORDINATES, X = 193.4, Y = 409.2

1

PROBABLE MAXIMUM STORM FOR BASIN4
STORM AREA = 700. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
Page 4

ISOHYET (SQ.MI.)	AREA WITHIN AREA (SQ.MI.)	SC2.OUT												
		STORM CENTER COORDINATES, X = 309.0, Y = 304.0			DEPTHS (INCHES)			FOR 6-HOUR INCREMENTS			OF PMS			
		1	2	3	4	5	6	7	8	9	10	11	12	
A	10.	.2.	23.81	5.46	2.91	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
B	25.	.9.	22.45	5.24	2.87	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
C	50.	.21.	21.09	5.10	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
D	100.	.45.	19.56	4.96	2.81	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
E	175.	.82.	18.20	4.81	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
F	300.	.145.	16.67	4.72	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
G	450.	.216.	15.65	4.62	2.78	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
H	700.	.315.	14.29	4.53	2.77	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
I	1000.	.370.	10.71	3.72	2.37	1.68	1.30	1.07	.90	.78	.69	.62	.56	.51
J	1500.	.405.	8.16	3.12	1.97	1.39	1.08	.88	.75	.65	.57	.51	.46	.42
K	2150.	.411.	6.12	2.57	1.63	1.16	.90	.73	.62	.54	.47	.42	.38	.35
L	3000.	.411.	4.59	2.10	1.31	.93	.72	.59	.50	.43	.38	.34	.31	.28
M	4500.	.411.	3.06	1.53	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N	6500.	.411.	1.70	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O	10000.	.411.	.68	.43	.36	.26	.20	.16	.14	.12	.11	.09	.09	.08
P	15000.	.411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	.411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	.411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	.411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH			15.67	4.53	2.69	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58
1														

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

ISOHYET	DEPTH VS. DURATION																			
	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR	
A	.92	1.83	2.73	5.25	8.86	13.05	16.67	23.81	29.27	32.17	34.15	35.69	36.94	38.00	38.92	39.73	40.45	41.11	41.71	
B	.86	1.72	2.56	4.92	8.31	12.26	15.68	22.45	27.69	30.56	32.54	34.07	35.33	36.39	37.31	38.12	38.84	39.50	40.09	
C	.81	1.61	2.39	4.60	7.77	11.49	14.70	21.09	26.19	29.02	31.00	32.54	33.79	34.85	35.77	36.58	37.30	37.96	38.56	
D	.74	1.48	2.20	4.24	7.17	10.62	13.59	19.56	24.52	27.33	29.30	30.84	32.09	33.15	34.07	34.88	35.63	36.26	36.86	
E	.69	1.37	2.04	3.93	6.64	9.85	12.61	18.20	23.01	25.81	27.78	29.32	30.57	31.63	32.55	33.36	34.08	34.74	35.34	
F	.63	1.25	1.85	3.57	6.04	8.98	11.49	16.67	21.39	24.17	26.15	27.68	28.94	30.00	30.92	31.73	32.45	33.11	33.70	
G	.58	1.16	1.73	3.33	5.65	8.40	10.76	15.65	20.27	23.05	25.03	26.56	27.81	28.87	29.79	30.60	31.33	31.98	32.58	
H	.53	1.06	1.57	3.02	5.13	7.64	9.78	14.29	18.83	21.58	23.56	25.09	26.35	27.41	28.32	29.13	29.86	30.51	31.11	
I	.19	.37	.56	1.11	2.21	4.35	6.34	10.71	14.43	16.80	18.48	19.79	20.85	21.75	22.54	23.22	23.84	24.40	24.91	
J	.14	.28	.42	.84	1.67	3.28	4.78	8.16	11.23	13.25	14.65	15.73	16.61	17.36	18.01	18.58	19.09	19.55	19.97	
K	.10	.21	.31	.62	1.24	2.43	3.55	6.12	8.70	10.33	11.48	12.38	13.12	13.74	14.27	14.75	15.17	15.55	15.90	
L	.08	.15	.23	.46	.92	1.80	2.63	4.59	6.69	8.00	8.93	9.65	10.24	10.74	11.17	11.55	12.89	12.20	12.48	
M	.05	.10	.15	.30	.61	1.19	1.74	3.06	4.59	5.62	6.35	7.38	7.77	8.11	8.41	8.68	8.92	9.15		
N	.03	.06	.08	.17	.33	.65	.95	1.70	2.63	3.34	3.85	4.24	4.56	4.83	5.06	5.27	5.45	5.62	5.77	
O	.01	.02	.03	.07	.13	.25	.37	.68	1.11	1.47	1.73	1.93	2.09	2.23	2.35	2.45	2.55	2.63	2.71	
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE				.56	1.11	1.65	3.18	5.43	8.23	10.65	15.67	20.19	22.89	24.80	26.28	27.49	28.52	29.40	30.18	30.88
1																				

PROBABLE MAXIMUM STORM FOR BASIN4																
DAY 1	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL
	0100	.10	.10		0700	.12	.69		1300	.15	1.43		1900	.20	2.37	
	0200	.10	.19		0800	.12	.81		1400	.15	1.57		2000	.20	2.57	
	0300	.10	.29		0900	.12	.93		1500	.15	1.72		2100	.20	2.77	
	0400	.10	.39		1000	.12	1.04		1600	.15	1.87		2200	.20	2.97	
	0500	.10	.48		1100	.12	1.16		1700	.15	2.02		2300	.20	3.17	
	0600	.10	.58		1200	.12	1.28		1800	.15	2.17		2400	.20	3.38	
	6-HR TOTAL					.58		.70				.89				1.21
DAY 2	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL
	0100	.28	3.66		0700	.58	5.87		1300	1.32	11.14		1900	.54	26.02	
	0200	.29	3.95		0800	.63	6.50		1400	1.95	13.09		2000	.49	26.51	
	0300	.31	4.26		0900	.69	7.19		1500	2.79	15.88		2100	.46	26.97	
	0400	.32	4.58		1000	.77	7.97		1600	5.43	21.31		2200	.42	27.39	
	0500	.34	4.93		1100	.87	8.83		1700	2.42	23.74		2300	.40	27.79	
	0600	.36	5.29		1200	.98	9.81		1800	1.74	25.48		2400	.38	28.17	
	6-HR TOTAL					1.91		4.53				15.67				2.69
DAY 3	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL	TIME	PRECIPITATION	INCR	TOTAL
	0100	.25	28.42		0700	.17	29.83		1300	.13	30.81		1900	.11	31.57	
	0200	.25	28.67		0800	.17	30.00		1400	.13	30.94		2000	.11	31.67	
	0300	.25	28.92		0900	.17	30.17		1500	.13	31.07		2100	.11	31.78	
	0400	.25	29.16		1000	.17	30.34		1600	.13	31.20		2200	.11	31.88	
	0500	.25	29.41		1100	.17	30.51		1700	.13	31.33		2300	.11	31.99	
	0600	.25	29.66		1200	.17	30.68		1800	.13	31.46		2400	.11	32.10	
	6-HR TOTAL					1.48		1.02				.78				.63
1																

SC2.OUT
SUBBASIN3

	BOUNDARY	COORDINATES	FOR	BASIN3							
X	296.7	291.7	285.0	281.4	281.4	275.4	260.1	251.9	246.6	240.8	
Y	200.6	192.6	188.1	177.8	167.4	160.5	154.8	154.8	153.6	156.6	
X	230.6	225.4	219.9	200.1	164.1	168.7	175.9	172.8	198.3	200.8	
Y	153.3	145.6	135.2	125.3	115.4	94.9	88.6	82.9	85.1	92.2	
X	217.9	233.5	244.0	247.2	254.0	261.8	272.2	277.1	287.2	290.7	
Y	92.9	104.3	104.6	101.7	106.8	105.3	107.4	101.4	107.4	107.4	
X	294.5	306.5	308.5	303.9	308.5	307.9	308.9				
Y	114.2	114.5	116.4	128.5	141.8	169.5	181.1				

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 24.2 SQ. MI.

BASIN CENTROID COORDINATES, X = 249.0, Y = 129.9

PROBABLE MAXIMUM STORM FOR BASIN3
STORM AREA = 700. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 309.0, Y = 304.0

ISOHYET AREA (SQ.MI.)	WITHIN AREA (SQ.MI.)	DEPTHS (INCHES) FOR 6-HOUR INCREMENTS OF PMS											
		1	2	3	4	5	6	7	8	9	10	11	12
A 10.	0.	23.81	5.46	2.91	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
B 25.	0.	22.45	5.24	2.87	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
C 50.	0.	21.09	5.10	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
D 100.	0.	19.56	4.96	2.81	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
E 175.	3.	18.20	4.81	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
F 300.	8.	16.67	4.72	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
G 450.	13.	15.65	4.62	2.78	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
H 700.	18.	14.29	4.53	2.77	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
I 1000.	22.	10.71	3.72	2.37	1.68	1.30	1.07	.90	.78	.69	.62	.56	.51
J 1500.	24.	8.16	3.12	1.97	1.39	1.08	.88	.75	.65	.57	.51	.46	.42
K 2150.	24.	6.12	2.57	1.63	1.16	.90	.73	.62	.54	.47	.42	.38	.35
L 3000.	24.	4.59	2.10	1.31	.93	.72	.59	.50	.43	.38	.34	.31	.28
M 4500.	24.	3.06	1.53	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N 6500.	24.	1.70	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O 10000.	24.	.68	.43	.36	.26	.20	.16	.14	.12	.11	.09	.09	.08
P 15000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q 25000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R 40000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S 60000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		15.23	4.49	2.69	1.91	1.49	1.21	1.03	.89	.78	.70	.63	.58

TIME INTERVAL = 60. MINUTES

1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A .92	1.83	2.73	5.25	8.86	13.05	16.67	23.81	29.27	32.17	34.15	35.69	36.94	38.00	38.92	39.73	40.45	41.11	41.71	
B .86	1.72	2.56	4.92	8.31	12.26	15.68	22.45	27.69	30.56	32.54	34.07	35.33	36.39	37.31	38.12	38.84	39.50	40.09	
C .81	1.61	2.39	4.60	7.77	11.49	14.70	21.09	26.19	29.02	30.00	32.34	33.79	34.85	35.77	36.58	37.30	37.96	38.56	
D .74	1.48	2.20	4.24	7.17	10.62	13.59	19.56	24.52	27.33	29.30	30.84	32.09	33.15	34.07	34.88	35.61	36.26	36.86	
E .69	1.37	2.04	3.93	6.64	9.85	12.61	18.20	23.01	25.81	27.78	29.32	30.57	31.63	32.55	33.36	34.08	34.74	35.34	
F .63	1.25	1.85	3.57	6.04	8.98	11.49	16.67	21.39	24.17	26.15	27.68	28.91	30.00	30.95	31.73	32.45	33.11	33.70	
G .58	1.16	1.73	3.33	5.65	8.40	10.76	15.65	20.27	23.05	25.03	26.56	27.81	28.87	29.79	30.60	31.33	31.98	32.58	
H .53	1.06	1.57	3.02	5.13	7.64	9.78	14.29	18.81	21.58	23.56	25.09	26.35	27.41	28.32	29.13	29.86	30.51	31.11	
I .19	.37	.56	1.11	2.21	4.35	6.34	10.71	14.43	16.80	18.48	19.79	20.85	21.75	22.54	23.22	23.84	24.40	24.91	
J .14	.28	.42	.84	1.67	3.28	4.78	8.16	11.29	13.25	14.65	15.73	16.61	17.36	18.01	18.58	19.09	19.55	19.97	
K .10	.21	.31	.62	1.24	2.43	3.55	6.12	8.70	10.33	11.48	12.38	13.12	13.74	14.27	14.75	15.17	15.55	15.90	
L .08	.15	.23	.46	.92	1.80	2.63	4.59	6.69	8.00	8.93	9.65	10.24	10.74	11.17	11.55	11.89	12.20	12.48	
M .05	.10	.15	.30	.61	1.19	1.74	3.06	4.59	5.62	6.35	6.92	7.38	7.77	8.11	8.41	8.68	8.92	9.15	
N .03	.06	.08	.17	.33	.65	.95	1.70	2.63	3.34	3.85	4.24	4.56	4.83	5.06	5.27	5.45	5.62	5.77	
O .01	.02	.03	.07	.13	.25	.37	.68	1.11	1.47	1.73	1.93	2.09	2.23	2.35	2.45	2.55	2.63	2.71	
P .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.54	1.07	1.59	3.07	5.25	7.97	10.33	15.23	19.72	22.42	24.33	25.82	27.03	28.06	28.94	29.73	30.43	31.06	31.64

1

PROBABLE MAXIMUM STORM FOR BASIN3

DAY 1	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL
	0100	.10	.10	0700	.12	.70	1300	.15	1.43	1900	.20	2.37
	0200	.10	.19	0800	.12	.81	1400	.15	1.58	2000	.20	2.57
	0300	.10	.29	0900	.12	.93	1500	.15	1.72	2100	.20	2.78
	0400	.10	.39	1000	.12	1.05	1600	.15	1.87	2200	.20	2.98
	0500	.10	.48	1100	.12	1.16	1700	.15	2.02	2300	.20	3.18
	0600	.10	.58	1200	.12	1.28	1800	.15	2.17	2400	.20	3.38
	6-HR TOTAL	.58			.70			.89			1.21	

SC2.OUT														
DAY 2	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION			
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		
	0100	.28	3.67	0700	.58	5.88	1300	1.30	11.09	1900	.54	25.56		
	0200	.29	3.96	0800	.63	6.50	1400	2.72	12.99	2000	.49	26.05		
	0300	.31	4.27	0900	.69	7.19	1500	2.72	15.71	2100	.46	26.51		
	0400	.32	4.59	1000	.77	7.96	1600	5.25	20.96	2200	.43	26.93		
	0500	.34	4.93	1100	.86	8.82	1700	2.36	23.32	2300	.40	27.33		
	0600	.36	5.30	1200	.97	9.79	1800	1.70	25.02	2400	.38	27.71		
	6-HR TOTAL		1.91			4.49			15.23			2.69		
DAY 3	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION			
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		
	0100	.25	27.96	0700	.17	29.37	1300	.13	30.36	1900	.11	31.11		
	0200	.25	28.21	0800	.17	29.54	1400	.13	30.49	2000	.11	31.22		
	0300	.25	28.46	0900	.17	29.71	1500	.13	30.62	2100	.11	31.33		
	0400	.25	28.70	1000	.17	29.88	1600	.13	30.75	2200	.11	31.43		
	0500	.25	28.95	1100	.17	30.05	1700	.13	30.88	2300	.11	31.54		
	0600	.25	29.20	1200	.17	30.22	1800	.13	31.01	2400	.11	31.64		
	6-HR TOTAL		1.49			1.03			.78			.63		
1	SUBBASIN2													
BOUNDARY COORDINATES FOR BASIN2														
X	367.4	365.0	356.2	322.0	318.8	308.9	307.9	308.5	303.9	308.5				
Y	181.9	179.7	177.0	180.6	183.7	181.1	169.5	141.8	128.5	116.4				
X	315.4	331.8	341.0	349.7	353.3	349.8	354.4	357.0	364.9	364.6				
Y	121.1	122.1	122.9	115.8	123.3	135.2	137.8	149.0	163.2	170.5				
X	367.2													
Y	172.2													
SCALE =	.0583 MILES PER COORDINATE UNIT													
BASIN AREA =	10.3 SQ. MI.													
BASIN CENTROID COORDINATES, X =	332.9, Y = 151.7													
PROBABLE MAXIMUM STORM FOR BASIN2														
STORM AREA =	700. SQ. MI., ORIENTATION = 160., PREFERRED ORIENTATION = 215.													
STORM CENTER COORDINATES, X = 309.0, Y = 304.0														
ISOHYET AREA WITHIN BASIN (SQ.MI.)	AREA (SQ.MI.)	1	2	3	DEPTHS (INCHES)	4	5	6	7	8	9	10	11	12
A	10.	0.	23.81	5.46	2.91	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
B	25.	0.	22.45	5.24	2.87	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
C	50.	0.	21.09	5.10	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
D	100.	3.	19.56	4.96	2.81	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
E	175.	9.	18.20	4.81	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
F	300.	10.	16.67	4.72	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
G	450.	10.	15.65	4.62	2.78	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
H	700.	10.	14.29	4.53	2.77	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60
I	1000.	10.	10.71	3.72	2.37	1.68	1.30	1.07	.90	.78	.69	.62	.56	.51
J	1500.	10.	8.16	3.12	1.97	1.39	1.08	.88	.75	.65	.57	.51	.46	.42
K	2150.	10.	6.12	2.57	1.63	1.16	.90	.73	.62	.54	.47	.42	.38	.35
L	3000.	10.	4.59	2.10	1.31	.93	.72	.59	.50	.43	.38	.34	.31	.28
M	4500.	10.	3.06	1.53	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N	6500.	10.	1.70	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O	10000.	10.	.68	.43	.36	.26	.20	.16	.14	.12	.11	.09	.09	.08
P	15000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		18.97	4.90	2.80	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60	
1														

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION																			
ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.83	2.73	5.25	8.86	13.05	16.67	23.81	29.27	32.17	34.15	35.69	36.94	38.00	38.92	39.73	40.45	41.11	41.71
B	.86	1.72	2.56	4.92	8.31	12.26	15.68	22.45	27.69	30.56	32.54	34.07	35.33	36.39	37.31	38.12	38.84	39.50	40.09
C	.81	1.61	2.39	4.60	7.77	11.49	14.70	21.09	26.19	29.02	31.00	32.54	33.79	34.85	35.77	36.58	37.30	37.96	38.56
D	.74	1.48	2.20	4.24	7.17	10.62	13.59	19.56	24.52	27.33	29.30	30.84	32.09	33.15	34.07	34.88	35.61	36.26	36.86
E	.69	1.37	2.04	3.93	6.64	9.85	12.61	18.20	23.01	25.81	27.78	29.32	30.57	31.63	32.55	33.36	34.08	34.74	35.34
F	.63	1.25	1.85	3.57	6.04	8.98	11.49	16.67	21.39	24.17	26.15	27.68	28.94	30.00	30.92	31.73	32.45	33.11	33.70
G	.58	1.16	1.73	3.33	5.65	8.40	10.76	15.65	20.37	23.05	25.03	26.56	27.81	28.87	29.79	30.60	31.33	31.98	32.58
H	.53	1.06	1.57	3.02	5.13	7.64	9.78	14.29	18.81	21.58	23.56	25.09	26.35	27.41	28.32	29.13	29.86	30.51	31.11
I	.49	.37	.56	1.11	2.21	4.35	6.34	10.71	14.43	16.80	18.48	19.79	20.85	21.75	22.54	23.22	23.84	24.40	24.91
J	.44	.28	.42	.84	1.67	3.28	4.78	8.16	11.29	13.25	14.65	15.73	16.61	17.36	18.01	18.58	19.09	19.55	19.97
K	.40	.21	.31	.62	1.24	2.43	3.55	6.12	8.70	10.33	11.48	12.38	13.12	13.74	14.27	14.75	15.17	15.55	15.90
L	.38	.15	.23	.46	.92	1.80	2.63	4.59	6.69	8.00	8.93	9.65	10.24	10.74	11.17	11.55	11.89	12.20	12.48
M	.35	.10	.15	.30	.61	1.19	1.74	3.06	4.59	5.62	6.35	6.92	7.38	7.77	8.11	8.41	8.68	8.92	9.15
N	.30	.06	.08	.17	.33	.65	.95	1.70	2.63	3.34	3.85	4.24	4.56	4.83	5.06	5.27	5.45	5.62	5.77
O	.01	.02	.03	.07	.13	.25	.37	.68	1.11	1.47	1.73	1.93	2.09	2.23	2.35	2.45	2.55	2.63	2.71
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

	R	S	SC2. OUT																	
AVERAGE	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
1	.72	1.43	2.13	4.11	6.94	10.28	13.16	18.97	23.87	26.67	28.65	30.19	31.44	32.50	33.42	34.23	34.95	35.61	36.21	

PROBABLE MAXIMUM STORM FOR BASIN2

DAY 1										DAY 2										DAY 3												
	TIME	PRECIPITATION								TIME	PRECIPITATION																					
		INCR	TOTAL								INCR	TOTAL					INCR	TOTAL				INCR	TOTAL									
	0100	.10	.10			0700	.12	.72		1300	.15	1.48				1900	.21	2.45														
	0200	.10	.20			0800	.12	.84		1400	.15	1.63				2000	.21	2.66														
	0300	.10	.30			0900	.12	.96		1500	.15	1.78				2100	.21	2.87														
	0400	.10	.40			1000	.12	1.08		1600	.15	1.93				2200	.21	3.08														
	0500	.10	.50			1100	.12	1.20		1700	.15	2.09				2300	.21	3.29														
	0600	.10	.60			1200	.12	1.32		1800	.15	2.24				2400	.21	3.49														
	6-HR TOTAL		.60									.92																				
1																																
	SUBBASIN1																															
	BOUNDARY COORDINATES FOR BASIN1																															
X	352.8	330.1	309.2	294.8	305.6	288.8	298.1	296.6	308.6																							
Y	439.5	425.4	374.5	331.2	266.6	244.3	211.3	200.4	181.5																							
X	322.0	356.2	365.0	366.5	386.2	392.3	377.5	398.6	380.8																							
Y	180.9	177.0	179.7	181.0	198.6	228.2	249.8	273.8	307.0																							
X	375.5	379.9	370.4	371.4	365.4	356.5	349.5	354.0	353.1																							
Y	358.8	370.7	385.5	393.1	396.8	395.5	405.4	411.9	420.9																							
X	352.8																															
Y	441.2																															
SCALE =	.0583 MILES PER COORDINATE UNIT																															
BASIN AREA =	64.1 SQ. MI.																															
BASIN CENTROID COORDINATES, X =	342.0, Y = 290.5																															
STORM AREA =	700. SQ. MI., ORIENTATION = 160°, PREFERRED ORIENTATION = 215°.																															
STORM CENTER COORDINATES, X =	309.0, Y = 304.0																															
ISOHYET AREA (SQ.MI.)	WITHIN BASIN (SQ.MI.)	1	2	3	4	DEPTHs (INCHES) 5	6	7	8	9	10	11	12																			
A	10.	7.	23.81	5.46	2.91	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
B	25.	16.	22.45	5.24	2.87	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
C	50.	29.	21.09	5.10	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
D	100.	51.	19.56	4.96	2.81	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
E	175.	62.	18.20	4.81	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
F	300.	64.	16.67	4.72	2.79	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
G	450.	64.	15.65	4.62	2.78	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
H	700.	64.	14.29	4.53	2.77	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																		
I	1000.	64.	10.71	3.72	2.37	1.68	1.30	1.07	.90	.78	.69	.62	.56	.51																		
J	1500.	64.	8.16	3.12	1.97	1.39	1.08	.88	.75	.65	.57	.51	.46	.42																		
K	2150.	64.	6.12	2.57	1.63	1.16	.90	.73	.62	.54	.47	.42	.38	.34																		
L	3000.	64.	4.59	2.10	1.31	.93	.72	.59	.50	.43	.38	.34	.31	.28																		
M	4500.	64.	3.06	1.53	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22																		
N	6500.	64.	1.70	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15																		
O	10000.	64.	.68	.43	.36	.26	.20	.16	.14	.12	.11	.09	.09	.08																		
P	15000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00																		
Q	25000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00																		
R	40000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00																		
S	60000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00																		
AVERAGE DEPTH		21.04	5.12	2.84	1.98	1.53	1.25	1.06	.92	.81	.72	.66	.60																			

SC2.OUT

TIME INTERVAL = 60. MINUTES
 1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.83	2.73	5.25	8.86	13.05	16.67	23.81	29.27	32.17	34.15	35.69	36.94	38.00	38.92	39.73	40.45	41.11	41.71
B	.86	1.72	2.56	4.92	8.31	12.26	15.68	22.45	27.69	30.56	32.54	34.07	35.33	36.39	37.31	38.12	38.84	39.50	40.09
C	.81	1.61	2.39	4.60	7.77	11.49	14.70	21.09	26.19	29.02	31.00	32.54	33.79	34.85	35.77	36.58	37.30	37.96	38.56
D	.74	1.48	2.20	4.24	7.17	10.62	13.59	19.56	24.52	27.33	29.30	30.84	32.09	33.15	34.07	34.88	35.61	36.26	36.86
E	.69	1.37	2.04	3.93	6.64	9.85	12.61	18.20	23.01	25.81	27.78	29.32	30.57	31.63	32.52	33.36	34.08	34.74	35.34
F	.63	1.25	1.85	3.57	6.04	8.98	11.49	16.67	21.39	24.17	26.15	27.68	28.94	30.00	30.92	31.73	32.45	33.11	33.70
G	.58	1.16	1.73	3.33	5.65	8.40	10.76	15.65	20.27	23.05	25.03	26.56	27.81	28.87	29.72	30.60	31.33	31.98	32.58
H	.53	1.06	1.57	3.02	5.13	7.64	9.78	14.29	18.81	21.58	23.56	25.09	26.35	27.41	28.32	29.13	29.86	30.51	31.11
I	.49	.37	.56	1.11	2.21	4.35	6.34	10.71	14.43	16.80	18.48	19.79	20.85	21.75	22.52	23.22	23.84	24.40	24.91
J	.44	.28	.42	.84	1.67	3.28	4.78	8.16	11.29	13.25	14.65	15.73	16.61	17.36	18.01	18.58	19.09	19.55	19.97
K	.40	.21	.31	.62	1.24	2.43	3.55	6.12	8.70	10.33	11.48	12.38	13.12	13.74	14.27	14.75	15.17	15.55	15.90
L	.08	.15	.23	.46	.92	1.80	2.63	4.59	6.69	8.00	8.93	9.65	10.24	10.74	11.17	11.55	11.89	12.20	12.48
M	.05	.10	.15	.30	.61	1.19	1.74	3.06	4.59	5.62	6.35	6.92	7.38	7.77	8.11	8.41	8.68	8.92	9.15
N	.03	.06	.08	.17	.33	.65	.95	1.70	2.63	3.34	3.85	4.24	4.56	4.83	5.06	5.27	5.45	5.62	5.77
O	.01	.02	.03	.07	.13	.25	.37	.68	1.11	1.47	1.73	1.93	2.09	2.23	2.35	2.45	2.55	2.63	2.71
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.80	1.60	2.39	4.59	7.75	11.46	14.66	21.04	26.15	28.99	30.97	32.51	33.76	34.82	35.74	36.55	37.27	37.93	38.53

1

PROBABLE MAXIMUM STORM FOR BASIN1

DAY 1		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.10	.10			0700	.12	.72	1300	.15	1.48	1900	.21	2.45	
0200	.10	.20			0800	.12	.84	1400	.15	1.63	2000	.21	2.66	
0300	.10	.30			0900	.12	.96	1500	.15	1.78	2100	.21	2.87	
0400	.10	.40			1000	.12	1.08	1600	.15	1.93	2200	.21	3.08	
0500	.10	.50			1100	.12	1.20	1700	.15	2.09	2300	.21	3.29	
0600	.10	.60			1200	.12	1.32	1800	.15	2.24	2400	.21	3.49	
6-HR TOTAL		.60				.72			.92				1.25	
DAY 2		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.29	3.79			0700	.63	6.11	1300	1.63	12.21	1900	.58	32.20	
0200	.30	4.09			0800	.69	6.80	1400	2.52	14.73	2000	.53	32.73	
0300	.32	4.41			0900	.77	7.57	1500	3.71	18.44	2100	.48	33.21	
0400	.33	4.74			1000	.88	8.45	1600	7.75	26.19	2200	.44	33.65	
0500	.35	5.10			1100	1.00	9.45	1700	3.20	29.39	2300	.42	34.07	
0600	.38	5.47			1200	1.14	10.59	1800	2.23	31.62	2400	.40	34.47	
6-HR TOTAL		1.98				5.12			21.04				2.84	
DAY 3		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.26	34.72			0700	.18	36.18	1300	.13	37.20	1900	.11	37.98	
0200	.26	34.98			0800	.18	36.35	1400	.13	37.33	2000	.11	38.09	
0300	.26	35.23			0900	.18	36.53	1500	.13	37.47	2100	.11	38.20	
0400	.26	35.49			1000	.18	36.71	1600	.13	37.60	2200	.11	38.31	
0500	.26	35.74			1100	.18	36.88	1700	.13	37.74	2300	.11	38.42	
0600	.26	36.00			1200	.18	37.06	1800	.13	37.87	2400	.11	38.53	
6-HR TOTAL		1.53				1.06			.81				.66	

1

SC 3.OUT

```

1*****  

*  

* PROBABLE MAXIMUM STORM (HMR52) *  

* NOVEMBER 1982 *  

* REVISED APRIL 91 *  

*  

* RUN DATE 06/25/2008 TIME 09:55:35 *  

*  

*****
```

* U.S. ARMY CORPS OF ENGINEERS *
* THE HYDROLOGIC ENGINEERING CENTER *
* 609 SECOND STREET *
* DAVIS, CALIFORNIA 95616 *
* (916) 551-1748 OR (FTS) 460-1748 *

H H M M RRRRRR 5555555 22222
H H MM MM R R R 5 2 2
H H M M M M R R R 5 2
HHHHHHH M M M RRRRRR 555555 2
H H M M R R R 5 2
H H M M R R R 5 5 2
H H M M R R R 5 5 2
H H M M R R R 5 5 2
HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA

PAGE 1

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
1	ID HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
2	ID ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
3	ID STORM CENTER WITHIN SQUAW CREEK BASIN AT SC3
4	BN CPNPP
5	ID CALCULATE STORM OVER ENTIRE AREA
6	BS .05827
7	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
8	BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
9	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 85.17
10	BX 76.93 85.92 75.56 77.81 82.63 84.8 66.09 56.79 57.55 49.52
11	BX 51.04 40.8 40.05 54.76 65.82 47.95 62.30 35.02 36.56 63.69
12	BX 73.84 72.72 84.03 121.92 126.58 133.09 136.39 145.99 138.58 145.21
13	BX 127.17 137.74 151.01 157.40 164.07 168.68 175.89 172.76 198.29 200.78
14	BX 217.93 233.49 243.97 277.06 294.55 315.41 331.83 340.98 349.67 353.27
15	BX 349.84 354.39 367.19 367.42 386.16 392.28 377.46 398.65 380.84 385.89
16	BX 375.51 379.9 370.35 371.38 365.4 356.46 349.53 353.98 353.13 356.42
17	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
18	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
19	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 547.94
20	BY 530.64 505.2 501.21 486.11 484.73 480.07 460.51 459.91 445.42 431.26
21	BY 423.96 416.89 406.78 378.07 347.05 304.18 290.43 242.80 238.08 238.71
22	BY 233.34 225.26 226.56 215.42 225.3 225.3 213.74 213.23 195.37 187.2
23	BY 150.2 138.83 120.25 124.31 115.41 94.86 88.63 82.92 85.08 92.18
24	BY 92.91 104.32 104.64 101.45 114.21 121.11 122.14 112.91 115.82 123.27
25	BY 135.16 137.78 172.22 181.89 198.56 228.19 249.82 273.83 307.02 320.85
26	BY 358.76 370.7 385.48 393.09 396.82 395.52 405.43 411.9 420.9 429.53
27	HO 215
28	HP 10 29.7 35.3 40.0 45.0 48.0
29	HP 200 22.2 26.8 32.0 36.0 39.6
30	HP 1000 15.9 20.7 25.8 30.0 33.4
31	HP 5000 9.3 13.0 17.8 22.0 25.0
32	HP 10000 7.1 10.3 14.4 18.5 21.0
33	HP 20000 5.1 8.3 11.5 15.0 17.8
34	SA 0 0 3
35	SC 313 304
36	ST 60 0.308 0 1
37	PU ON
38	BN BASIN4
39	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
40	BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
41	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 87.35
42	BX 81.49 85.17 76.93 85.92 75.56 77.81 82.63 84.8 70.55 66.09
43	BX 56.79 57.55 49.52 51.04 40.8 40.05 54.76 61.58 65.82 47.95
44	BX 62.30 35.02 36.56 46.93 55.09 63.69 73.84 72.72 84.03 92.24
45	BX 97.83 121.92 126.58 133.09 136.39 145.99 138.58 143.21 127.17 137.74
46	BX 139.10 151.01 157.40 164.07 200.07 219.86 230.63 240.75 246.73 251.89
47	BX 260.06 275.37 281.37 285.03 291.7 296.69 298.06 288.52 305.69
48	BY 294.79 330.09
49	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
50	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
51	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 567.83
52	BY 554.59 547.94 530.64 505.2 501.21 486.11 484.73 480.07 471.39 460.51
53	BY 459.91 445.42 431.26 423.96 416.89 406.78 378.07 377.45 347.05 304.18
1	HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA
1	PAGE 2
LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
54	BY 290.43 242.80 238.08 239.96 236.18 238.71 233.34 225.26 226.56 224.02
55	BY 224.87 215.42 225.3 225.3 213.74 213.23 195.37 187.2 150.2 138.83
56	BY 127.7 120.25 124.31 115.41 125.34 135.17 153.31 156.62 153.56 154.76
57	BY 154.76 160.46 167.45 177.77 188.09 192.59 200.58 211.24 244 264.84
58	BY 331.2 425.42
59	BN BASIN3
60	ID SUBBASIN3
61	BX 296.69 291.69 285.04 281.37 281.37 275.37 260.06 251.89 246.63 240.75
62	BX 230.63 225.36 219.86 200.07 164.07 168.68 175.89 172.76 198.29 200.78
63	BX 217.93 233.49 243.97 247.19 253.98 261.76 272.19 277.06 287.20 290.72
64	BX 294.53 306.52 308.51 303.88 308.46 307.93 308.87
65	BX 200.58 192.59 188.09 177.77 167.45 160.46 154.76 154.76 153.56 156.62
66	BX 153.31 145.58 135.17 125.34 115.41 94.86 88.63 82.92 85.08 92.18
67	BX 92.91 104.32 104.64 101.71 106.79 105.33 107.43 101.45 107.36 107.36
68	BY 114.21 114.52 116.39 128.54 141.75 169.52 181.13
69	BN BASIN2
70	ID SUBBASIN2
71	BX 367.42 364.98 356.16 322.02 318.79 308.87 307.93 308.46 303.88 308.51
72	BX 315.41 331.83 340.98 349.67 353.27 349.84 354.39 357.02 364.94 364.65
73	BX 367.19

SC 3.OUT

74	BY	181.89	179.72	177	180.58	183.71	181.13	169.52	141.75	128.54	116.39
75	BY	121.11	122.14	122.91	115.82	123.27	135.16	137.78	149	163.23	170.54
76	BY	172.22									

77	BN	BASIN1									
78	ID	SUBBASIN1									
79	BX	352.79	330.08	309.24	294.79	305.63	288.78	298.06	296.58	308.64	318.8
80	BX	322.02	356.16	364.98	366.54	386.16	392.28	377.46	398.65	380.84	385.89
81	BX	375.51	379.9	370.35	371.38	365.4	356.46	349.53	353.98	353.13	356.42
82	BX	352.83									
83	BY	439.49	425.42	374.54	331.2	266.57	244.31	211.25	200.39	181.51	185.02
84	BY	180.91	177	179.72	181.01	198.56	228.19	249.82	273.83	307.02	320.85
85	BY	358.76	370.7	385.48	393.09	396.82	395.52	405.43	411.9	420.9	429.53
86	BY	441.22									

87 ZZ

* PROBABLE MAXIMUM STORM (HMR52) *
* NOVEMBER 1982 *
* REVISED APRIL 91 *
* RUN DATE 06/25/2008 TIME 09:55:35 *
* *****

* U.S. ARMY CORPS OF ENGINEERS *
* THE HYDROLOGIC ENGINEERING CENTER *
* 609 SECOND STREET *
* DAVIS, CALIFORNIA 95616 *
* (916) 551-1748 OR (FTS) 460-1748 *
* *****

HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
STORM CENTER WITHIN SQUAW CREEK BASIN AT SC3
CALCULATE STORM OVER ENTIRE AREA

PMP DEPTHS FROM HMR 51

AREA (SQ. MI.)	6-HR	12-HR	24-HR	48-HR	72-HR
10.	29.70	35.30	40.00	45.00	48.00
200.	22.20	26.80	32.00	36.00	39.60
1000.	15.90	20.70	25.80	30.00	33.40
5000.	9.30	13.00	17.80	22.00	25.00
10000.	7.10	10.30	14.40	18.50	21.00
20000.	5.10	8.30	11.50	15.00	17.80

STORM AREA	PMP DEPTHS FOR 6-HOUR INCREMENTS
10.	29.67 5.40 2.99 2.08 1.59 1.29 1.09 .94 .83 .74 .67 .61
25.	27.92 5.22 2.95 2.06 1.59 1.29 1.09 .94 .83 .74 .67 .61
50.	26.45 5.09 2.91 2.05 1.58 1.29 1.09 .94 .83 .74 .67 .61
100.	24.29 4.91 2.86 2.02 1.57 1.28 1.08 .94 .82 .74 .67 .61
175.	22.55 4.75 2.81 2.00 1.56 1.28 1.08 .94 .83 .74 .67 .61
300.	20.55 4.76 2.81 2.00 1.55 1.27 1.08 .93 .82 .74 .67 .61
450.	18.97 4.79 2.82 2.00 1.56 1.27 1.08 .93 .82 .74 .67 .61
700.	17.24 4.83 2.83 2.00 1.56 1.27 1.07 .93 .82 .73 .66 .61
1000.	15.84 4.88 2.83 2.01 1.55 1.27 1.07 .93 .82 .73 .66 .60
1500.	14.17 4.63 2.76 1.97 1.53 1.26 1.06 .92 .81 .73 .66 .60
2150.	12.69 4.41 2.69 1.94 1.52 1.25 1.06 .92 .81 .73 .66 .60
3000.	11.31 4.23 2.62 1.91 1.50 1.23 1.05 .91 .81 .72 .66 .60
4500.	9.64 4.00 2.54 1.87 1.48 1.22 1.04 .91 .81 .72 .66 .60
6500.	8.38 3.73 2.41 1.78 1.42 1.18 1.00 .88 .78 .70 .63 .58
10000.	7.02 3.38 2.22 1.66 1.33 1.10 .95 .83 .74 .66 .60 .55
15000.	5.93 3.11 2.07 1.55 1.24 1.04 .89 .78 .69 .62 .57 .52
20000.	5.15 2.92 1.96 1.48 1.19 .99 .85 .75 .66 .60 .54 .50

1

X	Y	BOUNDARY COORDINATES FOR CPNPP
352.8	348.3	349.1 345.0 347.4 339.3 323.6 325.8 317.6 314.8
441.5	481.9	512.5 515.5 523.6 525.4 550.2 562.8 565.8 571.4
317.4	315.6	306.5 302.1 295.4 295.4 289.7 284.2 279.7 267.3
574.4	579.2	582.4 600.0 600.5 612.0 617.3 640.0 644.0 640.7
258.7	236.4	227.0 214.0 161.3 123.5 111.3 96.2 102.6 85.2
651.3	648.7	677.8 665.0 685.3 676.9 664.0 593.1 588.7 547.9
76.9	85.9	75.6 77.8 82.6 84.8 66.1 56.8 57.5 49.5
530.6	505.2	501.2 486.1 484.7 480.1 460.5 459.9 445.4 431.3
51.0	40.8	40.0 54.8 65.8 48.0 62.3 35.0 36.6 63.7
424.0	416.9	406.8 378.1 347.0 304.2 290.4 242.8 238.1 238.7
73.8	72.7	84.0 121.9 126.6 133.1 136.4 146.0 138.6 143.2
233.3	225.3	226.6 215.4 225.3 225.3 213.7 213.2 195.4 187.2
127.2	137.7	151.0 157.4 164.1 168.7 175.9 172.8 198.3 200.8
150.2	138.8	120.3 124.3 115.4 94.9 88.6 82.9 85.1 92.2
217.9	233.5	244.0 277.1 294.5 315.4 331.8 341.0 349.7 353.3
92.9	104.3	104.6 101.4 114.2 121.1 122.1 112.9 115.8 123.3
349.8	354.4	367.2 367.4 386.2 392.3 377.5 398.6 380.8 385.9
135.2	137.8	172.2 181.9 198.6 228.2 249.8 273.8 307.0 320.9
375.5	379.9	370.4 371.4 365.4 356.5 349.5 354.0 353.1 356.4
358.8	370.7	385.5 393.1 396.8 395.5 405.4 411.9 420.9 429.5

SCALE = .0583 MILES PER COORDINATE UNIT

Page 2

SC 3.OUT

BASIN AREA = 509.4 SQ. MI.

BASIN CENTROID COORDINATES, X = 217.6, Y = 375.6

1

VARYING STORM AREA SIZE AND FIXED ORIENTATION

STORM AREA	ORIEN-	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS		
	TATION	8.01	1.47	.82	.57	.44	.35	.30	.26	.23	.20	.18	.17	10.30
10.	151.													
25.	151.	10.58	2.21	1.28	.90	.69	.56	.47	.41	.36	.32	.29	.27	14.07
50.	151.	12.42	2.76	1.63	1.15	.89	.72	.61	.53	.46	.41	.37	.34	16.81
100.	151.	13.86	3.23	1.95	1.38	1.07	.87	.74	.64	.56	.50	.46	.42	19.04
175.	151.	14.96	3.57	2.19	1.56	1.21	.99	.84	.73	.64	.58	.52	.48	20.73
300.	151.	15.80	4.01	2.44	1.74	1.35	1.11	.94	.81	.72	.64	.58	.53	22.26
450.	151.	16.29	4.31	2.60	1.84	1.43	1.17	.99	.86	.76	.68	.61	.56	23.20
700.	151.	16.22	4.57	2.70	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58	23.49
1000.	151.	15.79	4.71	2.72	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58	23.22
1500.	151.	14.92	4.45	2.60	1.84	1.43	1.17	1.00	.86	.76	.68	.62	.56	21.98
2150.	151.	13.89	4.15	2.45	1.75	1.37	1.12	.95	.83	.73	.66	.59	.54	20.49
3000.	151.	12.72	3.84	2.28	1.63	1.28	1.06	.90	.78	.69	.62	.56	.51	18.84
4500.	151.	12.00	3.68	2.22	1.60	1.26	1.05	.89	.78	.69	.62	.56	.51	17.90
6500.	151.	11.48	3.48	2.11	1.53	1.21	1.01	.86	.75	.67	.60	.54	.50	17.07
10000.	151.	10.75	3.20	1.95	1.42	1.13	.94	.81	.71	.63	.57	.51	.47	15.90
15000.	151.	10.04	3.00	1.82	1.33	1.06	.89	.76	.67	.59	.53	.49	.45	14.87
20000.	151.	9.38	2.84	1.73	1.26	1.01	.85	.73	.64	.57	.51	.47	.43	13.95

FIXED STORM AREA SIZE AND VARYING ORIENTATION

STORM AREA	ORIEN-	BASIN-AVERAGED INCREMENTAL DEPTHS FOR 6-HR PERIODS										SUM OF DEPTHS FOR 3 PEAK 6-HR PERIODS		
	TATION	16.03	4.54	2.68	1.90	1.47	1.20	1.02	.88	.78	.70	.63	.57	23.26
700.	140.													
700.	150.	16.20	4.57	2.70	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58	23.47
700.	160.	16.28	4.59	2.71	1.92	1.49	1.21	1.03	.89	.78	.70	.63	.58	23.57
700.	170.	16.13	4.57	2.70	1.91	1.48	1.21	1.02	.89	.78	.70	.63	.58	23.40
700.	180.	15.77	4.50	2.66	1.88	1.46	1.19	1.01	.87	.77	.69	.62	.57	22.93
700.	190.	15.29	4.40	2.61	1.84	1.43	1.17	.99	.86	.76	.68	.61	.56	22.30
700.	200.	14.85	4.30	2.55	1.81	1.40	1.14	.97	.84	.74	.66	.60	.55	21.70
700.	210.	14.51	4.23	2.51	1.78	1.38	1.13	.95	.82	.73	.65	.59	.54	21.25
700.	220.	14.29	4.18	2.48	1.76	1.36	1.11	.94	.81	.72	.64	.58	.53	20.95
700.	230.	14.17	4.15	2.47	1.75	1.35	1.11	.94	.81	.71	.64	.58	.53	20.79
700.	240.	14.16	4.15	2.47	1.74	1.35	1.11	.93	.81	.71	.64	.58	.53	20.77
700.	250.	14.22	4.16	2.48	1.75	1.36	1.11	.94	.81	.72	.64	.58	.53	20.86
700.	260.	14.31	4.18	2.49	1.76	1.36	1.11	.94	.82	.72	.64	.58	.53	20.97
700.	270.	14.40	4.19	2.49	1.76	1.37	1.12	.94	.82	.72	.65	.58	.53	21.08
700.	280.	14.55	4.22	2.51	1.77	1.38	1.12	.95	.82	.73	.65	.59	.54	21.29
700.	290.	14.90	4.30	2.55	1.81	1.40	1.15	.97	.84	.74	.66	.60	.55	21.76
700.	300.	15.31	4.39	2.61	1.84	1.43	1.17	.99	.86	.75	.68	.61	.56	22.31
700.	310.	15.70	4.47	2.65	1.88	1.45	1.19	1.00	.87	.77	.69	.62	.57	22.82
700.	320.	15.5	4.59	2.70	1.91	1.48	1.21	1.03	.89	.78	.70	.63	.58	23.57
700.	330.	16.28	4.58	2.71	1.91	1.49	1.21	1.03	.89	.78	.70	.63	.58	23.53

1

PROBABLE MAXIMUM STORM FOR CPNPP
STORM AREA = 700. SQ. MI., ORIENTATION = 155., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 313.0, Y = 304.0

ISOHYET AREA (SQ.MI.)	WITHIN BASIN (SQ.MI.)	1	2	3	4	DEPTHs (INCHES) FOR 6-HOUR PERIODS	5	6	7	8	INCREMENTs OF PMS	9	10	11	12
A	10.	23.70	5.43	2.89	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60		
B	25.	22.35	5.22	2.86	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60		
C	50.	20.99	5.08	2.82	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60		
D	100.	19.47	4.93	2.80	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60		
E	175.	14.8	4.79	2.78	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60		
F	300.	221.	16.59	4.70	2.77	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
G	450.	298.	15.58	4.60	2.76	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
H	700.	414.	14.22	4.51	2.75	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
I	1000.	466.	10.67	3.70	2.36	1.67	1.30	1.06	.90	.78	.69	.61	.55	.51	
J	1500.	504.	8.13	3.11	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42	
K	2150.	509.	8.10	2.56	1.62	1.15	.89	.73	.62	.53	.47	.42	.38	.35	
L	3000.	509.	4.57	2.09	1.30	.93	.72	.59	.50	.43	.38	.34	.31	.28	
M	4500.	509.	3.05	1.52	1.03	.73	.37	.46	.39	.34	.30	.27	.24	.22	
N	6500.	509.	1.69	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15	
O	10000.	509.	.68	.43	.36	.26	.20	.16	.14	.12	.10	.09	.08	.08	
P	15000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	25000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	40000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	60000.	509.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE DEPTH		16.28	4.59	2.70	1.91	1.48	1.21	1.03	.89	.78	.70	.63	.58		

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.82	2.72	5.23	8.82	12.99	16.60	23.70	29.14	32.03	34.00	35.53	36.77	37.83	38.74	39.55	40.27	40.92	41.52
B	.86	1.71	2.55	4.90	8.27	12.21	15.61	22.35	27.57	30.42	32.39	33.92	35.17	36.22	37.14	37.94	38.67	39.32	39.91
C	.80	1.60	2.38	4.58	7.74	11.44	14.63	20.99	26.07	28.89	30.86	32.39	33.64	34.69	35.61	36.41	37.14	37.79	38.38
D	.74	1.47	2.19	4.22	7.14	10.57	13.53	19.47	24.41	27.20	29.17	30.70	31.95	33.00	33.92	34.72	35.44	36.10	36.69
E	.69	1.36	2.03	3.91	6.61	9.80	12.55	18.12	22.91	25.69	27.66	29.19	30.43	31.49	32.40	33.21	33.93	34.58	35.18
F	.62	1.24	1.85	3.55	6.01	8.94	11.44	16.59	21.29	24.06	26.03	27.56	28.81	29.86	30.78	31.58	32.30	32.96	33.55
G	.58	1.16	1.72	3.32	5.62	8.36	10.71	15.58	20.18	22.94	24.91	26.44	27.69	28					

	SC 3 .OUT																							
H	.53	1.05	1.56	3.01	5.11	7.60	9.74	14.22	18.73	21.48	23.45	24.98	26.23	27.28	28.20	29.00	29.72	30.38	30.97					
I	.18	.37	.55	1.11	2.20	4.33	6.31	10.67	14.37	16.73	18.40	19.70	20.76	21.66	22.43	23.12	23.73	24.29	24.79					
J	.14	.28	.42	.83	1.66	3.26	4.76	8.13	11.23	13.19	14.58	15.66	16.54	17.28	17.93	18.49	19.00	19.46	19.88					
K	.10	.21	.31	.62	1.23	2.42	3.53	6.10	8.66	10.28	11.43	12.33	13.06	13.67	14.21	14.68	15.10	15.48	15.83					
L	.08	.15	.23	.46	.91	1.79	2.62	4.57	6.66	7.96	8.89	9.61	10.19	10.69	11.12	11.50	11.84	12.14	12.42					
M	.05	.10	.15	.30	.60	1.18	1.73	3.05	4.57	5.59	6.32	6.89	7.35	7.74	8.08	8.38	8.64	8.89	9.10					
N	.03	.06	.08	.17	.33	.65	.95	1.69	2.62	3.33	3.83	4.22	4.54	4.81	5.04	5.24	5.43	5.59	5.75					
O	.01	.02	.03	.06	.13	.25	.37	.68	1.10	1.47	1.72	1.92	2.08	2.22	2.34	2.44	2.54	2.62	2.70					
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00					
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00					
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00					
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00					
AVERAGE		.59	1.17	1.74	3.36	5.72	8.62	11.12	16.28	20.87	23.57	25.49	26.97	28.19	29.21	30.10	30.88	31.59	32.22	32.80				

1

PROBABLE MAXIMUM STORM FOR CPNPP

DAY 1		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.10	.10			0700	.12	.70	1300	.15	1.43	1900	.20	2.37	
0200	.10	.19			0800	.12	.81	1400	.15	1.58	2000	.20	2.57	
0300	.10	.29			0900	.12	.93	1500	.15	1.72	2100	.20	2.77	
0400	.10	.39			1000	.12	1.05	1600	.15	1.87	2200	.20	2.98	
0500	.10	.48			1100	.12	1.16	1700	.15	2.02	2300	.20	3.18	
0600	.10	.58			1200	.12	1.28	1800	.15	2.17	2400	.20	3.38	
6-HR TOTAL		.58				.70			.89					1.21
DAY 2		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.28	3.66			0700	.59	5.88	1300	1.35	11.24	1900	.54	26.71	
0200	.29	3.96			0800	.64	6.52	1400	2.01	13.25	2000	.50	27.21	
0300	.31	4.27			0900	.70	7.22	1500	2.90	16.14	2100	.46	27.66	
0400	.32	4.59			1000	.78	8.00	1600	5.72	21.86	2200	.43	28.09	
0500	.34	4.93			1100	.88	8.89	1700	2.51	24.37	2300	.40	28.49	
0600	.36	5.30			1200	1.00	9.88	1800	1.80	26.17	2400	.38	28.87	
6-HR TOTAL		1.91				4.59			16.28					2.70
DAY 3		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	
0100	.25	29.12			0700	.17	30.53	1300	.13	31.51	1900	.11	32.27	
0200	.25	29.37			0800	.17	30.70	1400	.13	31.64	2000	.11	32.38	
0300	.25	29.61			0900	.17	30.87	1500	.13	31.77	2100	.11	32.48	
0400	.25	29.86			1000	.17	31.04	1600	.13	31.90	2200	.11	32.59	
0500	.25	30.11			1100	.17	31.21	1700	.13	32.03	2300	.11	32.69	
0600	.25	30.36			1200	.17	31.38	1800	.13	32.16	2400	.11	32.80	
6-HR TOTAL		1.48				1.03			.78					.63

1

BOUNDARY COORDINATES FOR BASIN4

X	352.8	348.3	349.1	345.0	347.4	339.3	323.6	325.8	317.6	314.8
Y	441.5	481.9	512.5	515.5	523.6	523.4	550.2	562.8	565.8	571.4
X	317.4	315.6	306.5	302.1	295.4	295.4	289.7	284.2	279.7	267.3
Y	574.4	579.2	582.4	600.0	600.5	612.0	617.3	640.0	644.0	640.7
X	258.7	236.4	227.0	214.0	161.3	123.5	111.3	96.2	102.6	97.3
Y	651.3	648.7	677.8	665.0	685.3	676.9	664.0	593.1	588.7	567.8
X	81.5	85.2	76.9	85.9	75.6	77.8	82.6	84.8	70.6	66.1
Y	554.6	547.9	530.6	505.2	501.2	486.1	484.7	480.1	471.4	460.5
X	56.8	57.5	49.5	51.0	40.8	40.0	54.8	61.6	65.8	48.0
Y	459.9	445.4	431.3	424.0	416.9	406.8	378.1	377.5	347.0	304.2
X	62.3	35.0	36.6	46.9	55.1	63.7	73.8	72.7	84.0	92.2
Y	290.4	242.8	238.1	240.0	236.2	238.7	233.3	225.3	226.6	224.0
X	97.8	121.9	126.6	133.1	136.4	146.0	138.6	143.2	127.2	137.7
Y	224.9	215.4	225.3	225.3	213.7	213.2	195.4	187.2	150.2	138.8
X	139.1	151.0	157.4	164.1	200.1	219.9	230.6	240.8	246.7	251.9
Y	127.7	120.3	124.3	115.4	125.3	135.2	153.2	156.6	153.6	154.8
X	260.1	275.4	281.4	281.4	285.0	291.7	296.7	298.1	288.5	305.7
Y	154.8	160.5	167.4	177.8	188.1	192.6	200.6	211.2	244.0	264.8
X	294.8	330.1								
Y	331.2	425.4								

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 410.6 SQ. MI.

BASIN CENTROID COORDINATES, X = 193.4, Y = 409.2

1

STORM AREA = 700. SQ. MI., ORIENTATION = 155., PREFERRED ORIENTATION = 215.
Page 4

ISOHYET AREA (SQ.MI.)	AREA WITHIN BASIN (SQ.MI.)	STORM CENTER COORDINATES, X = SC 3 OUT 313.0, Y = 304.0												
		1	2	3	DEPTHS (INCHES)	FOR 6-HOUR INCREMENTS	OF PMS	10	11	12				
4	5	6	7	8	9									
A	10.	2.	23.70	5.43	2.89	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
B	25.	8.	22.35	5.22	2.86	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
C	50.	19.	20.99	5.08	2.82	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
D	100.	42.	19.47	4.93	2.80	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
E	175.	79.	18.12	4.79	2.78	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
F	300.	141.	16.59	4.70	2.77	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
G	450.	214.	15.58	4.60	2.76	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
H	700.	323.	14.22	4.51	2.75	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
I	1000.	371.	10.67	3.70	2.36	1.67	1.30	1.06	.90	.78	.69	.61	.55	.51
J	1500.	405.	8.13	3.11	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42
K	2150.	411.	6.10	2.56	1.62	1.15	.89	.73	.62	.53	.47	.42	.38	.35
L	3000.	411.	4.57	2.09	1.30	.93	.72	.59	.50	.43	.38	.34	.31	.28
M	4500.	411.	3.05	1.52	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N	6500.	411.	1.69	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O	10000.	411.	.68	.43	.36	.26	.20	.16	.14	.12	.10	.09	.08	.08
P	15000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	411.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH			15.60	4.51	2.69	1.91	1.48	1.21	1.02	.88	.78	.70	.63	.58
1														

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

ISOHYET	DEPTH VS. DURATION																		
	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.82	2.72	5.23	8.82	12.99	16.60	23.70	29.14	32.03	34.00	35.53	36.77	37.83	38.74	39.55	40.27	40.92	41.52
B	.86	1.71	2.55	4.90	8.27	12.21	15.61	22.35	27.57	30.42	32.39	33.92	35.17	36.23	37.14	37.94	38.67	39.32	39.91
C	.80	1.60	2.38	4.58	7.74	11.44	14.63	20.99	26.07	28.89	30.86	32.39	33.64	34.69	35.61	36.41	37.14	37.79	38.38
D	.74	1.47	2.19	4.22	7.14	10.57	13.53	19.47	24.41	27.20	29.17	30.70	31.95	33.00	33.92	34.72	35.44	36.10	36.69
E	.69	1.36	2.03	3.91	6.61	9.80	12.55	18.12	22.91	25.69	27.66	29.19	30.43	31.49	32.40	33.21	33.93	34.58	35.18
F	.62	1.24	1.85	3.55	6.01	8.94	11.44	16.59	21.29	24.06	26.03	27.56	28.81	29.86	30.78	31.58	32.30	32.96	33.55
G	.58	1.16	1.72	3.32	5.62	8.36	10.71	15.58	20.18	22.94	24.91	26.24	27.69	28.74	29.66	30.46	31.19	31.84	32.43
H	.53	1.05	1.56	3.01	5.11	7.60	9.74	14.22	18.73	21.48	23.45	24.98	26.23	27.28	28.20	29.00	29.72	30.38	30.97
I	.48	.37	.55	1.11	2.20	4.33	6.31	10.67	14.37	16.73	18.40	19.70	20.76	21.66	22.43	23.12	23.73	24.29	24.79
J	.44	.28	.42	.83	1.66	3.26	4.76	8.13	11.23	13.19	14.58	15.66	16.54	17.28	17.93	18.49	19.00	19.46	19.88
K	.40	.21	.31	.62	1.23	2.42	3.53	6.10	8.66	10.28	11.43	12.33	13.06	13.67	14.21	14.68	15.10	15.48	15.83
L	.38	.15	.23	.46	.91	1.79	2.62	4.57	6.66	7.96	8.89	9.61	10.19	10.69	11.12	11.50	11.84	12.14	12.42
M	.35	.10	.15	.30	.60	1.18	1.73	3.05	4.57	5.59	6.32	6.89	7.35	7.74	8.08	8.38	8.64	8.88	9.10
N	.30	.06	.08	.17	.33	.65	.95	1.69	2.62	3.33	3.83	4.22	4.54	4.81	5.04	5.24	5.43	5.59	5.75
O	.01	.02	.03	.06	.13	.25	.37	.68	1.10	1.47	1.72	1.92	2.08	2.22	2.34	2.44	2.54	2.62	2.70
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE																			
1																			

DAY 1	PROBABLE MAXIMUM STORM FOR BASIN4																			
	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR
0100	.10	.10	0700	.12	.69	1300	.15	1.42	1900	.20	2.36									
0200	.10	.19	0800	.12	.81	1400	.15	1.57	2000	.20	2.56									
0300	.10	.29	0900	.12	.93	1500	.15	1.72	2100	.20	2.76									
0400	.10	.38	1000	.12	1.04	1600	.15	1.86	2200	.20	2.97									
0500	.10	.48	1100	.12	1.16	1700	.15	2.01	2300	.20	3.17									
0600	.10	.58	1200	.12	1.27	1800	.15	2.16	2400	.20	3.37									
6-HR TOTAL		.58			.70			.88			1.21									
DAY 2	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR
0100	.28	3.65	0700	.58	5.85	1300	1.32	11.10	1900	.54	25.92									
0200	.29	3.94	0800	.63	6.48	1400	1.94	13.04	2000	.49	26.42									
0300	.31	4.25	0900	.69	7.17	1500	2.78	15.82	2100	.46	26.87									
0400	.32	4.57	1000	.77	7.95	1600	5.43	21.24	2200	.42	27.30									
0500	.34	4.91	1100	.87	8.81	1700	2.41	23.65	2300	.40	27.69									
0600	.36	5.27	1200	.98	9.79	1800	1.73	25.39	2400	.38	28.07									
6-HR TOTAL		1.91			4.51			15.60			2.69									
DAY 3	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR	TIME	PRECIPITATION INCR
0100	.25	28.32	0700	.17	29.72	1300	.13	30.70	1900	.11	31.46									
0200	.25	28.57	0800	.17	29.89	1400	.13	30.83	2000	.11	31.57									
0300	.25	28.81	0900	.17	30.06	1500	.13	30.96	2100	.11	31.67									
0400	.25	29.06	1000	.17	30.23	1600	.13	31.09	2200	.11	31.78									
0500	.25	29.31	1100	.17	30.40	1700	.13	31.22	2300											

SC 3.OUT
SUBBASIN3

	BOUNDARY COORDINATES FOR BASIN3										
X	296.7	291.7	285.0	281.4	281.4	275.4	260.1	251.9	246.6	240.8	
Y	200.6	192.6	188.1	177.8	167.4	160.5	154.8	154.8	153.6	156.6	
X	230.6	225.4	219.9	200.1	164.1	168.7	175.9	172.8	198.3	200.8	
Y	153.3	145.6	135.2	125.3	115.4	94.9	88.6	82.9	85.1	92.2	
X	217.9	233.5	244.0	247.2	254.0	261.8	272.2	277.1	287.2	290.7	
Y	92.9	104.3	104.6	101.7	106.8	105.3	107.4	101.4	107.4	107.4	
X	294.5	306.5	308.5	303.9	308.5	307.9	308.9				
Y	114.2	114.5	116.4	128.5	141.8	169.5	181.1				

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 24.2 SQ. MI.

BASIN CENTROID COORDINATES, X = 249.0, Y = 129.9

PROBABLE MAXIMUM STORM FOR BASIN3
STORM AREA = 700. SQ. MI., ORIENTATION = 155., PREFERRED ORIENTATION = 215.
STORM CENTER COORDINATES, X = 313.0, Y = 304.0

ISOHYET AREA AREA (SQ.MI.)	WITHIN BASIN (SQ.MI.)	DEPTHs (INCHES) FOR 6-HOUR INCREMENTS OF PMS											
		1	2	3	4	5	6	7	8	9	10	11	12
A 10.	0.	23.70	5.43	2.89	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
B 25.	0.	22.35	5.22	2.86	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
C 50.	0.	20.99	5.08	2.82	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
D 100.	0.	19.47	4.93	2.80	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
E 175.	1.	18.12	4.79	2.78	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
F 300.	5.	16.59	4.70	2.77	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
G 450.	10.	15.58	4.60	2.76	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
H 700.	16.	14.22	4.51	2.75	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
I 1000.	20.	10.67	3.70	2.36	1.67	1.30	1.06	.90	.78	.69	.61	.55	.51
J 1500.	24.	8.13	3.11	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42
K 2150.	24.	6.10	2.56	1.62	1.15	.89	.73	.62	.53	.47	.42	.38	.35
L 3000.	24.	4.57	2.09	1.30	.93	.72	.59	.50	.43	.38	.34	.31	.28
M 4500.	24.	3.05	1.52	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N 6500.	24.	1.69	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O 10000.	24.	.68	.43	.36	.26	.20	.16	.14	.12	.10	.09	.08	.08
P 15000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q 25000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R 40000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S 60000.	24.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		14.44	4.36	2.64	1.88	1.46	1.19	1.01	.87	.77	.69	.62	.57

TIME INTERVAL = 60. MINUTES

1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A .92	1.82	2.72	5.23	8.82	12.99	16.60	23.70	29.14	32.03	34.00	35.53	36.77	37.83	38.74	39.55	40.27	40.92	41.52	
B .86	1.71	2.55	4.90	8.27	12.21	15.61	22.35	27.57	30.42	32.39	33.92	35.17	36.22	37.14	37.94	38.67	39.32	39.91	
C .80	1.60	2.38	4.58	7.74	11.44	14.63	20.99	26.07	28.89	30.86	32.39	33.64	34.69	35.61	36.41	37.14	37.79	38.38	
D .74	1.47	2.19	4.22	7.14	10.57	13.53	19.47	24.41	27.20	29.17	30.70	31.95	33.00	33.92	34.72	35.44	36.10	36.69	
E .69	1.36	2.03	3.91	6.61	9.80	12.55	18.12	22.91	25.69	27.66	29.19	30.43	31.49	32.40	33.21	33.93	34.58	35.18	
F .62	1.24	1.85	3.55	6.01	8.94	11.44	16.59	21.29	24.06	26.03	27.56	28.81	29.86	30.78	31.58	32.30	32.96	33.55	
G .58	1.16	1.72	3.32	5.62	8.36	10.71	15.58	20.18	22.94	24.91	26.44	27.69	28.74	29.66	30.46	31.19	31.84	32.43	
H .53	1.05	1.56	3.01	5.11	7.60	9.74	14.22	18.73	21.48	23.45	24.98	26.23	27.28	28.20	29.00	29.72	30.38	30.97	
I .18	.37	.55	1.11	2.20	4.33	6.31	10.67	14.37	17.83	18.40	19.70	20.74	21.66	22.43	23.12	23.73	24.29	24.79	
J .14	.28	.42	.83	1.66	3.26	4.76	8.13	11.23	13.19	14.58	15.66	16.54	17.28	17.93	18.49	19.00	19.46	19.88	
K .10	.21	.31	.62	1.23	2.42	3.53	6.10	8.66	10.28	11.43	13.00	13.67	14.23	14.68	15.10	15.48	15.83		
L .08	.15	.23	.46	.91	1.79	2.62	4.57	6.66	7.89	9.61	10.19	10.69	11.12	11.50	11.84	12.14	12.42		
M .05	.10	.15	.30	.60	1.18	1.73	3.05	4.57	5.59	6.32	6.89	7.35	7.74	8.08	8.38	8.64	8.88	9.10	
N .03	.06	.08	.17	.33	.65	.95	1.69	2.62	3.33	3.83	4.22	4.54	4.81	5.04	5.24	5.43	5.59	5.75	
O .01	.02	.03	.06	.13	.25	.37	.68	1.10	1.47	1.72	1.92	2.08	2.22	2.34	2.44	2.54	2.62	2.70	
P .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S .00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.49	.98	1.46	2.82	4.86	7.45	9.71	14.44	18.80	21.44	23.32	24.77	25.96	26.97	27.84	28.61	29.29	29.92	30.48

PROBABLE MAXIMUM STORM FOR BASIN3

DAY 1	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL	TIME	PRECIPITATION INCR	PRECIPITATION TOTAL
	0100	.09	.09	0700	.11	.68	1300	.15	1.40	1900	.20	2.32
	0200	.09	.19	0800	.11	.80	1400	.15	1.54	2000	.20	2.52
	0300	.09	.28	0900	.11	.91	1500	.15	1.69	2100	.20	2.72
	0400	.09	.38	1000	.11	1.03	1600	.15	1.84	2200	.20	2.92
	0500	.09	.47	1100	.11	1.14	1700	.15	1.98	2300	.20	3.12
	0600	.09	.57	1200	.11	1.25	1800	.15	2.13	2400	.20	3.31
	6-HR TOTAL	.57			.69			.87			1.19	

SC 3.OUT														
DAY 2	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION			
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		
	0100	.28	3.59	0700	.57	5.76	1300	1.26	10.81	1900	.53	24.52		
	0200	.29	3.88	0800	.61	6.37	1400	1.83	12.64	2000	.48	25.00		
	0300	.30	4.18	0900	.67	7.04	1500	2.59	15.24	2100	.45	25.45		
	0400	.32	4.50	1000	.74	7.78	1600	4.86	20.09	2200	.42	25.87		
	0500	.34	4.84	1100	.83	8.62	1700	2.26	22.35	2300	.39	26.26		
	0600	.35	5.19	1200	.94	9.55	1800	1.64	24.00	2400	.37	26.63		
6-HR TOTAL		1.88			4.36			14.44			2.64			
DAY 3	TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION		TIME	PRECIPITATION			
		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		INCR	TOTAL		
	0100	.24	26.88	0700	.17	28.26	1300	.13	29.22	1900	.10	29.97		
	0200	.24	27.12	0800	.17	28.42	1400	.13	29.35	2000	.10	30.07		
	0300	.24	27.36	0900	.17	28.59	1500	.13	29.48	2100	.10	30.17		
	0400	.24	27.60	1000	.17	28.76	1600	.13	29.61	2200	.10	30.28		
	0500	.24	27.85	1100	.17	28.93	1700	.13	29.73	2300	.10	30.38		
	0600	.24	28.09	1200	.17	29.09	1800	.13	29.86	2400	.10	30.48		
6-HR TOTAL		1.46			1.01			.77			.62			
1		SUBBASIN2												
BOUNDARY COORDINATES FOR BASIN2														
X	367.4	365.0	356.2	322.0	318.8	308.9	307.9	308.5	303.9	308.5				
Y	181.9	179.7	177.0	180.6	183.7	181.1	169.5	141.8	128.5	116.4				
X	315.4	331.8	341.0	349.7	353.3	349.8	354.4	357.0	364.9	364.6				
Y	121.1	122.1	122.9	115.8	123.3	135.2	137.8	149.0	163.2	170.5				
X	367.2													
Y	172.2													
SCALE = .0583 MILES PER COORDINATE UNIT														
BASIN AREA = 10.3 SQ. MI.														
BASIN CENTROID COORDINATES, X = 332.9, Y = 151.7														
STORM AREA = 700.50 SQ. MI., ORIENTATION = 155°, PREFERRED ORIENTATION = 215°.														
STORM CENTER COORDINATES, X = 313.0, Y = 304.0														
ISOHYET AREA WITHIN BASIN (SQ.MI.)	(SQ.MI.)	1	2	3	DEPTHs (INCHES)	4	5	6	7	8	9	10	11	12
A	10.	0.	23.70	5.43	2.89	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
B	25.	0.	22.35	5.22	2.86	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
C	50.	0.	20.99	5.08	2.82	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
D	100.	1.	19.47	4.93	2.80	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
E	175.	7.	18.12	4.79	2.78	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
F	300.	10.	16.59	4.70	2.77	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
G	450.	10.	15.58	4.60	2.76	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
H	700.	10.	14.22	4.51	2.75	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60
I	1000.	10.	10.67	5.70	2.36	1.67	1.30	1.06	.90	.78	.69	.61	.55	.51
J	1500.	10.	8.13	3.11	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42
K	2150.	10.	6.10	2.56	1.62	1.15	.89	.73	.62	.53	.47	.42	.38	.35
L	3000.	10.	4.57	2.09	1.30	.93	.72	.59	.50	.43	.38	.34	.31	.28
M	4500.	10.	3.05	1.52	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22
N	6500.	10.	1.69	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15
O	10000.	10.	.68	.43	.36	.26	.20	.16	.14	.12	.10	.09	.08	.08
P	15000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	25000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
R	40000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	60000.	10.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE DEPTH		18.38	4.83	2.79	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
1														

TIME INTERVAL = 60. MINUTES
1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION															
ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR
A	.92	1.82	2.72	5.23	8.82	12.99	16.60	23.70	29.14	32.03	34.00	35.53	36.77	37.83	38.74
B	.86	1.71	2.55	4.90	8.27	12.21	15.61	22.35	27.57	30.42	32.39	33.92	35.17	36.22	37.14
C	.80	1.60	2.38	4.58	7.74	11.44	14.63	20.99	26.07	28.89	30.86	32.39	33.64	34.69	35.61
D	.74	1.47	2.19	4.22	7.14	10.57	13.53	19.47	24.41	27.20	29.17	30.70	31.95	33.00	33.92
E	.69	1.36	2.03	3.91	6.61	9.80	12.55	18.12	22.91	25.69	27.66	29.19	30.43	31.49	32.40
F	.62	1.24	1.85	3.55	6.01	8.94	11.44	16.59	21.29	24.06	26.03	27.56	28.81	29.86	30.78
G	.58	1.16	1.72	3.32	5.62	8.36	10.71	15.58	20.18	22.49	24.91	26.44	27.69	28.74	29.66
H	.53	1.05	1.56	3.01	5.11	7.60	9.74	14.22	18.73	21.48	23.45	24.98	26.23	27.28	28.20
I	.48	.37	.55	1.11	2.20	4.33	6.31	10.67	14.37	16.73	18.40	19.70	20.76	21.66	22.43
J	.44	.28	.42	.83	1.66	3.26	4.76	8.13	11.23	13.19	14.58	15.66	16.54	17.28	17.93
K	.40	.21	.31	.62	1.23	2.42	3.53	6.10	8.66	10.28	11.43	12.33	13.05	13.67	14.21
L	.38	.15	.23	.46	.91	1.79	2.62	4.57	6.66	7.96	9.61	10.19	10.69	11.12	11.50
M	.35	.10	.15	.30	.60	1.18	1.73	3.05	4.57	5.59	6.32	6.89	7.35	7.74	8.08
N	.33	.06	.08	.17	.33	.65	.95	1.69	2.62	3.33	3.83	4.22	4.54	5.04	5.24
O	.31	.02	.03	.06	.13	.25	.37	.68	1.10	1.47	1.72	1.92	2.08	2.22	2.34
P	.30	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
Q	.28	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

	SC 3. OUT																				
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
AVERAGE	.70	1.38	2.06	3.97	6.71	9.95	12.74	18.38	23.21	25.99	27.96	29.49	30.74	31.79	32.71	33.51	34.24	34.89	35.48		
1																					

PROBABLE MAXIMUM STORM FOR BASIN2

DAY 1		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.10	.10	0700	.12	.72	1300	.15	1.47	1900	.21	2.44						
0200	.10	.20	0800	.12	.84	1400	.15	1.62	2000	.21	2.65						
0300	.10	.30	0900	.12	.96	1500	.15	1.77	2100	.21	2.86						
0400	.10	.40	1000	.12	1.08	1600	.15	1.93	2200	.21	3.06						
0500	.10	.50	1100	.12	1.20	1700	.15	2.08	2300	.21	3.27						
0600	.10	.60	1200	.12	1.32	1800	.15	2.23	2400	.21	3.48						
6-HR TOTAL		.60			.72			.91			1.25						
1																	

DAY 2		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.29	3.77	0700	.61	6.06	1300	1.46	11.74	1900	.56	29.22						
0200	.30	4.07	0800	.66	6.72	1400	2.21	13.95	2000	.51	29.73						
0300	.32	4.39	0900	.74	7.46	1500	3.24	17.19	2100	.47	30.20						
0400	.33	4.72	1000	.83	8.29	1600	6.71	23.90	2200	.44	30.64						
0500	.35	5.08	1100	.93	9.22	1700	2.79	26.69	2300	.41	31.05						
0600	.37	5.45	1200	1.06	10.28	1800	1.97	28.66	2400	.39	31.44						
6-HR TOTAL		1.97			4.83			18.38			2.79						
1																	

DAY 3		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION		TIME		PRECIPITATION	
		INCR	TOTAL			INCR	TOTAL			INCR	TOTAL			INCR	TOTAL		
0100	.25	31.70	0700	.18	33.15	1300	.13	34.16	1900	.11	34.94						
0200	.25	31.95	0800	.18	33.32	1400	.13	34.29	2000	.11	35.05						
0300	.25	32.21	0900	.18	33.50	1500	.13	34.43	2100	.11	35.16						
0400	.25	32.46	1000	.18	33.67	1600	.13	34.56	2200	.11	35.27						
0500	.25	32.72	1100	.18	33.85	1700	.13	34.70	2300	.11	35.38						
0600	.25	32.97	1200	.18	34.03	1800	.13	34.83	2400	.11	35.48						
6-HR TOTAL		1.53			1.06			.81			.65						
1																	

SUBBASIN1

BOUNDARY COORDINATES FOR BASIN1										
X	352.8	330.1	309.2	294.8	305.6	288.8	298.1	296.6	308.6	318.8
Y	439.5	425.4	374.5	331.2	266.6	244.3	211.3	200.4	181.5	185.0
X	322.0	356.2	365.0	366.5	386.2	392.3	377.5	398.6	380.8	385.9
Y	180.9	177.0	179.7	181.0	198.6	228.2	249.8	273.8	307.0	320.9
X	375.5	379.9	370.4	371.4	365.4	356.5	349.5	354.0	353.1	356.4
Y	358.8	370.7	385.5	393.1	396.8	395.5	405.4	411.9	420.9	429.5
X	352.8									
Y	441.2									

SCALE = .0583 MILES PER COORDINATE UNIT

BASIN AREA = 64.1 SQ. MI.

BASIN CENTROID COORDINATES, X = 342.0, Y = 290.5

PROBABLE MAXIMUM STORM FOR BASIN1														
STORM AREA = 700. SQ. MI., ORIENTATION = 155., PREFERRED ORIENTATION = 215.			STORM CENTER COORDINATES, X = 313.0, Y = 304.0											
ISOHYET AREA (SQ.MI.)	WITHIN BASIN (SQ.MI.)	1	2	3	DEPTHs (INCHES) FOR 6-HOUR INCREMENTs OF PMS							10	11	12
					4	5	6	7	8	9	10			
A 10.	8.	23.70	5.43	2.89	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
B 25.	17.	22.35	5.22	2.86	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
C 50.	31.	20.99	5.08	2.82	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
D 100.	52.	19.47	4.93	2.80	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
E 175.	61.	18.12	4.79	2.78	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
F 300.	64.	16.59	4.70	2.77	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
G 450.	64.	15.58	4.60	2.76	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
H 700.	64.	14.22	4.51	2.75	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
I 1000.	64.	10.67	3.70	2.36	1.67	1.30	1.06	.90	.78	.69	.61	.55	.51	
J 1500.	64.	8.13	3.11	1.96	1.39	1.08	.88	.74	.64	.57	.51	.46	.42	
K 2150.	64.	6.10	2.56	1.62	1.15	.89	.73	.62	.53	.47	.42	.38	.35	
L 3000.	64.	4.57	2.09	1.30	.93	.72	.59	.50	.43	.38	.34	.31	.28	
M 4500.	64.	3.05	1.52	1.03	.73	.57	.46	.39	.34	.30	.27	.24	.22	
N 6500.	64.	1.69	.93	.71	.50	.39	.32	.27	.23	.21	.18	.17	.15	
O 10000.	64.	.68	.43	.36	.26	.20	.16	.14	.12	.10	.09	.08	.08	
P 15000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q 25000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R 40000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S 60000.	64.	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE DEPTH		21.02	5.10	2.83	1.97	1.53	1.25	1.06	.91	.81	.72	.65	.60	
1														

SC 3.OUT

TIME INTERVAL = 60. MINUTES
 1-HR TO 6-HR RATIO FOR ISOHYET A AT 20000 SQ. MI. = .308

DEPTH VS. DURATION

ISOHYET	5MIN	10MIN	15MIN	30MIN	1-HR	2-HR	3-HR	6-HR	12-HR	18-HR	24-HR	30-HR	36-HR	42-HR	48-HR	54-HR	60-HR	66-HR	72-HR
A	.92	1.82	2.72	5.23	8.82	12.99	16.60	23.70	29.14	32.03	34.00	35.53	36.77	37.83	38.74	39.55	40.27	40.92	41.52
B	.86	1.71	2.55	4.90	8.27	12.21	15.61	22.35	27.57	30.42	32.39	33.92	35.17	36.22	37.14	37.94	38.67	39.32	39.91
C	.80	1.60	2.38	4.58	7.74	11.44	14.63	20.99	26.07	28.89	30.86	32.39	33.64	34.69	35.61	36.41	37.14	37.79	38.38
D	.74	1.47	2.19	4.22	7.14	10.57	13.53	19.47	24.43	27.20	29.17	30.70	31.93	33.00	33.92	34.72	35.44	36.10	36.69
E	.69	1.36	2.03	3.91	6.61	9.80	12.55	18.12	22.91	25.69	27.66	29.19	30.43	31.49	32.49	33.21	33.93	34.58	35.18
F	.62	1.24	1.85	3.55	6.01	8.94	11.44	16.59	21.29	24.06	26.03	27.56	28.81	29.86	30.78	31.58	32.30	32.96	33.55
G	.58	1.16	1.72	3.32	5.62	8.36	10.71	15.58	20.18	22.94	24.91	26.44	27.69	28.74	29.68	30.46	31.19	31.84	32.43
H	.53	1.05	1.56	3.01	5.11	7.60	9.74	14.22	18.73	21.48	23.45	24.98	26.23	27.28	28.29	29.00	29.72	30.38	30.97
I	.48	.37	.55	1.11	2.20	4.33	6.31	10.67	14.37	16.73	18.40	19.70	20.76	21.66	22.43	23.12	23.73	24.29	24.79
J	.44	.28	.42	.83	1.66	3.26	4.76	8.13	11.23	13.19	14.58	15.66	16.54	17.28	17.93	18.49	19.00	19.46	19.88
K	.40	.21	.31	.62	1.23	2.42	3.53	6.10	8.66	10.28	11.43	12.33	13.06	13.67	14.21	14.68	15.10	15.48	15.83
L	.08	.15	.23	.46	.91	1.79	2.62	4.57	6.66	7.96	8.89	9.61	10.19	10.69	11.12	11.50	11.84	12.14	12.42
M	.05	.10	.15	.30	.60	1.18	1.73	3.05	4.57	5.59	6.32	7.35	7.74	8.08	8.38	8.64	8.88	9.10	
N	.03	.06	.08	.17	.33	.65	.95	1.69	2.62	3.33	3.83	4.22	4.54	4.81	5.04	5.24	5.43	5.59	5.75
O	.01	.02	.03	.06	.13	.25	.37	.68	1.10	1.47	1.72	1.92	2.08	2.22	2.34	2.44	2.54	2.62	2.70
P	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
Q	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
R	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
S	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	
AVERAGE	.80	1.60	2.39	4.59	7.75	11.46	14.65	21.02	26.12	28.95	30.92	32.45	33.70	34.75	35.67	36.47	37.20	37.85	38.44

1

PROBABLE MAXIMUM STORM FOR BASIN1

DAY 1		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.10	.10	0700	.12	.72	1300	.15	1.47	1900	.21	2.44	2000	.21	2.65
0200	.10	.20	0800	.12	.84	1400	.15	1.62	2100	.21	2.86	2200	.21	3.06
0300	.10	.30	0900	.12	.96	1500	.15	1.77	2300	.21	3.27	2400	.21	3.48
0400	.10	.40	1000	.12	1.08	1600	.15	1.93						
0500	.10	.50	1100	.12	1.20	1700	.15	2.08						
0600	.10	.60	1200	.12	1.32	1800	.15	2.23						
6-HR TOTAL		.60			.72			.91						1.25
DAY 2		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.29	3.77	0700	.63	6.08	1300	1.62	12.17	1900	.58	32.15	2000	.52	32.67
0200	.30	4.07	0800	.69	6.77	1400	2.52	14.69	2100	.48	33.15	2200	.44	33.59
0300	.32	4.39	0900	.77	7.54	1500	3.70	18.39	2300	.41	34.01	2400	.39	34.40
0400	.33	4.72	1000	.87	8.42	1600	7.75	26.15						
0500	.35	5.07	1100	1.00	9.41	1700	3.20	29.34						
0600	.37	5.45	1200	1.14	10.55	1800	2.23	31.57						
6-HR TOTAL		1.97			5.10			21.02						2.83
DAY 3		TIME	PRECIPITATION INCR	PRECIPITATION TOTAL										
0100	.25	34.66	0700	.18	36.11	1300	.13	37.12	1900	.11	37.90	2000	.11	38.01
0200	.25	34.91	0800	.18	36.28	1400	.13	37.25	2100	.11	38.12	2200	.11	38.23
0300	.25	35.17	0900	.18	36.46	1500	.13	37.39	2300	.11	38.33	2400	.11	38.44
0400	.25	35.42	1000	.18	36.63	1600	.13	37.52						
0500	.25	35.68	1100	.18	36.81	1700	.13	37.66						
0600	.25	35.93	1200	.18	36.98	1800	.13	37.79						
6-HR TOTAL		1.53			1.06			.81						.65

1

SC 4.OUT

```

1*****  

*  

* PROBABLE MAXIMUM STORM (HMR52) *  

* NOVEMBER 1982 *  

* REVISED APRIL 91 *  

* RUN DATE 06/25/2008 TIME 09:57:04 *  

* *****  

* U.S. ARMY CORPS OF ENGINEERS *  

* THE HYDROLOGIC ENGINEERING CENTER *  

* 609 SECOND STREET *  

* DAVIS, CALIFORNIA 95616 *  

* (916) 551-1748 OR (FTS) 460-1748 *  

*****
```

H H M M RRRRRR 5555555 22222
H H MM MM R R 5 2 2
H H M M M M R R 5 2
HHHHHHHH M M M RRRRRR 5555555 2
H H M M R R 5 2
H H M M R R 5 5 2
H H M M R R 555555 2222222
HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA

1

PAGE 1

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
1	ID HMR52 INPUT DATA FOR CPNPP UNITS 3 & 4 PMP CALCULATION
2	ID ANALYSIS PERFORMED BY ANUBHAV GAUR ENERCON SERVICES INC 02-14-2008
3	ID STORM CENTER WITHIN SQUAW CREEK BASIN AT SCA
4	BN CPNPP
5	ID CALCULATE STORM OVER ENTIRE AREA
6	BS .05827
7	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
8	BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
9	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 85.17
10	BX 76.93 85.92 75.56 77.81 82.63 84.8 66.09 56.79 57.55 49.52
11	BX 51.04 40.8 40.05 54.76 65.82 47.95 62.30 35.02 36.56 63.69
12	BX 73.84 72.72 84.03 121.92 126.58 133.09 136.39 145.99 138.58 143.21
13	BX 127.17 137.74 151.01 157.40 164.07 168.68 175.89 172.76 198.29 200.78
14	BX 217.93 233.49 243.97 277.06 294.55 315.41 331.83 340.98 349.67 353.27
15	BX 349.84 354.39 367.19 367.42 386.16 392.28 377.46 398.65 380.84 385.89
16	BX 375.51 379.9 370.35 371.38 365.4 356.46 349.53 353.98 353.13 356.42
17	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
18	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
19	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 547.94
20	BY 530.64 505.2 501.21 486.11 484.73 480.07 460.51 459.91 445.42 431.26
21	BY 423.96 416.89 406.78 378.07 347.05 304.18 290.43 242.80 238.08 238.71
22	BY 233.34 225.26 226.56 215.42 225.3 225.3 213.74 213.23 195.37 187.2
23	BY 150.2 138.83 120.25 124.31 115.41 94.86 88.63 82.92 85.08 92.18
24	BY 92.91 104.32 104.64 101.45 114.21 121.11 122.14 112.91 115.82 123.27
25	BY 135.16 137.78 172.22 181.89 198.56 228.19 249.82 273.83 307.02 320.85
26	BY 358.76 370.7 385.48 393.09 396.82 395.52 405.43 411.9 420.9 429.53
27	HO 215
28	HP 10 29.7 35.3 40.0 45.0 48.0
29	HP 200 22.2 26.8 32.0 36.0 39.6
30	HP 1000 15.9 20.7 25.8 30.0 33.4
31	HP 5000 9.3 13.0 17.8 22.0 25.0
32	HP 10000 7.1 10.3 14.4 18.5 21.0
33	HP 20000 5.1 8.3 11.5 15.0 17.8
34	SA 0 0 3
35	SC 337 304
36	ST 60 0.308 0 1
37	PU ON
38	BN BASIN4
39	BX 352.83 348.27 349.06 345.02 347.40 339.30 323.65 325.81 317.65 314.81
40	BX 317.41 315.60 306.50 302.11 295.40 295.40 289.69 284.22 279.71 267.30
41	BX 258.73 236.42 226.97 213.99 161.34 123.53 111.32 96.22 102.62 87.35
42	BX 81.49 85.17 76.93 85.92 75.56 77.81 82.63 84.8 70.55 66.09
43	BX 56.79 57.55 49.52 51.04 40.8 40.05 54.76 61.58 65.82 47.95
44	BX 62.30 35.02 36.56 46.93 55.09 63.69 73.84 72.72 84.03 92.24
45	BX 97.83 121.92 126.58 133.09 136.39 145.99 138.58 143.21 127.17 137.74
46	BX 139.10 151.01 157.40 164.07 200.07 219.86 230.63 240.75 246.73 251.89
47	BX 260.06 275.37 281.37 285.03 291.7 296.69 298.06 288.52 305.69
48	BX 294.79 330.09
49	BY 441.55 481.91 512.52 515.46 523.63 523.40 550.24 562.78 565.85 571.38
50	BY 574.39 579.23 582.39 600.03 600.45 611.99 617.28 639.95 643.97 640.65
51	BY 651.35 648.71 677.81 664.96 685.28 676.86 664.03 593.06 588.7 567.83
52	BY 554.59 547.94 530.64 505.2 501.21 486.11 484.73 480.07 471.39 460.51
53	BY 459.91 445.42 431.26 423.96 416.89 406.78 378.07 377.45 347.05 304.18
1	HEC PROBABLE MAXIMUM STORM (HMR52) INPUT DATA
1	PAGE 2
LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
54	BY 290.43 242.80 238.08 239.96 236.18 238.71 233.34 225.26 226.56 224.02
55	BY 224.87 215.42 225.3 225.3 213.74 213.23 195.37 187.2 150.2 138.83
56	BY 127.7 120.25 124.31 115.41 125.34 135.17 153.31 156.62 153.56 154.76
57	BY 154.76 160.46 167.45 177.77 188.09 192.59 200.58 211.24 244 264.84
58	BY 331.2 425.42
59	BN BASIN3
60	ID SUBBASIN3
61	BX 296.69 291.69 285.04 281.37 281.37 275.37 260.06 251.89 246.63 240.75
62	BX 230.63 225.36 219.86 200.07 164.07 168.68 175.89 172.76 198.29 200.78
63	BX 217.93 233.49 243.97 247.19 253.98 261.76 272.19 277.06 287.20 290.72
64	BX 294.55 306.52 308.51 303.88 308.46 307.93 308.87
65	BX 200.58 192.59 188.09 177.77 167.45 160.46 154.76 154.76 153.56 156.62
66	BX 153.31 145.58 135.17 125.34 115.41 94.86 88.63 82.92 85.08 92.18
67	BX 92.91 104.32 104.64 101.71 106.79 105.33 107.43 101.45 107.36 107.36
68	BX 114.21 114.52 116.39 128.54 141.75 169.52 181.13
69	BN BASIN2
70	ID SUBBASIN2
71	BX 367.42 364.98 356.16 322.02 318.79 308.87 307.93 308.46 303.88 308.51
72	BX 315.41 331.83 340.98 349.67 353.27 349.84 354.39 357.02 364.94 364.65
73	BX 367.19