ISOMETRIC OF CVCS SEAL INJECTION LINE #41 INSIDE CONTAINMENT SHT 2 OF 2	INDIAN POINT #2 B206687

VALVE BONNET BOLTING

VALVE NO.	VALVE TYPE	NO. OF BOLTS	BOLT DIA.	BOLT TYPE	VALVE MANUFACTURER	MANUFACTURER DWG. NO.
251A	2-C58	NONE			ROCKWELL-EDWARDS	C-70819

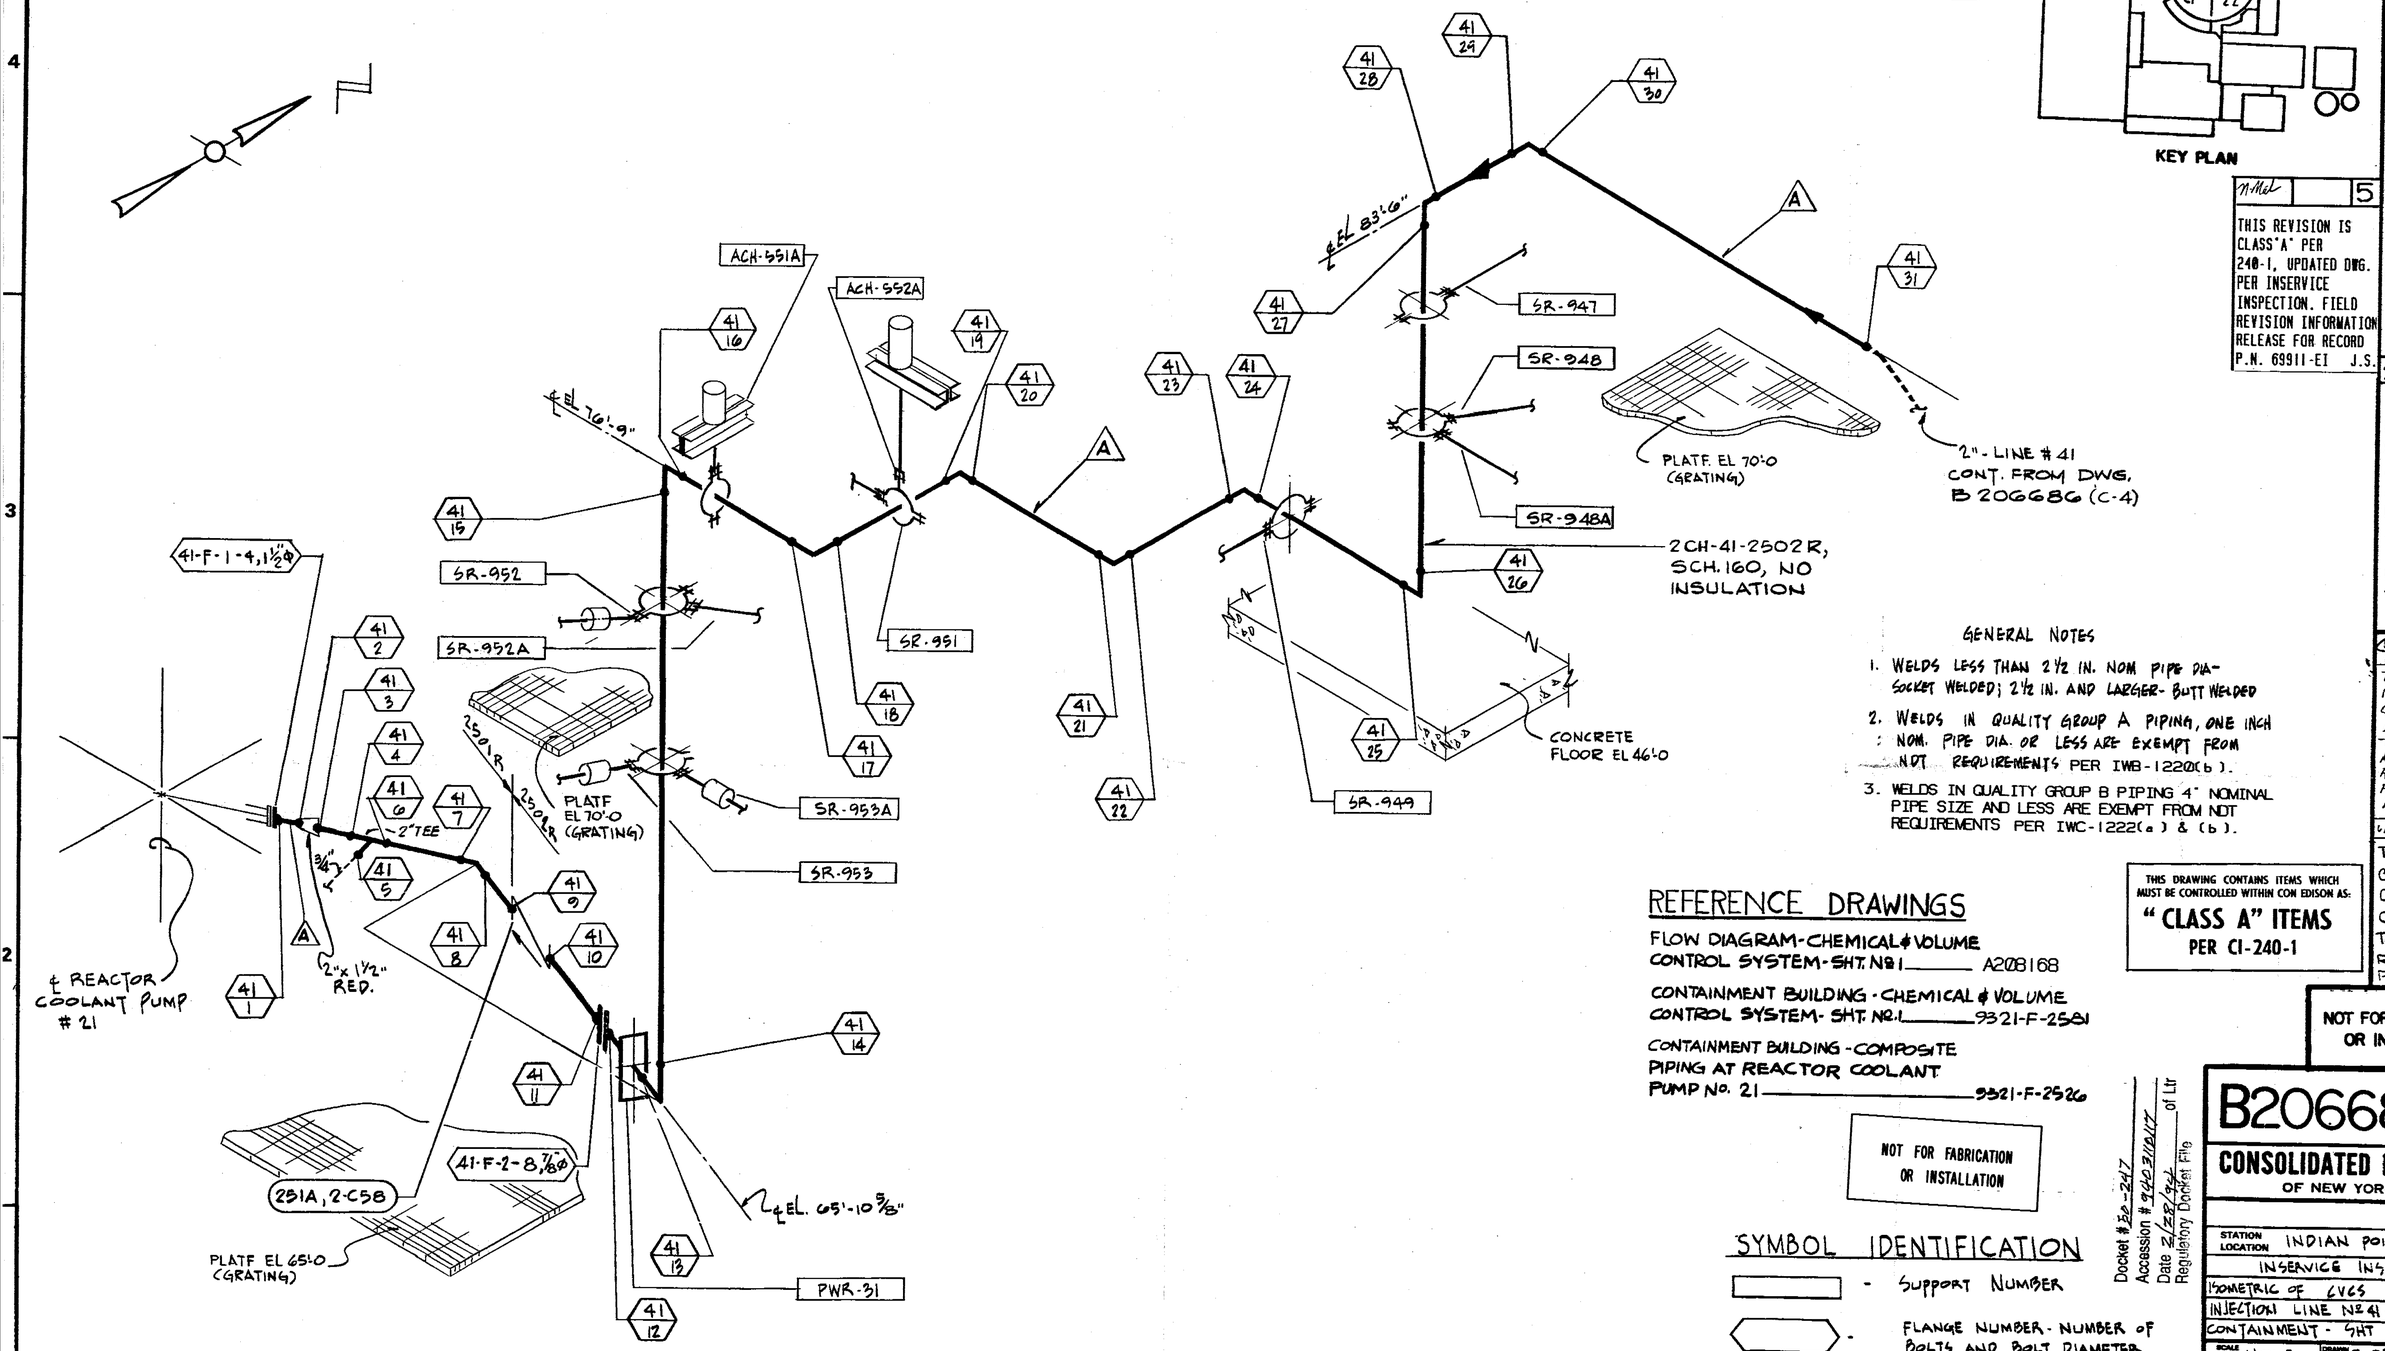

GENERAL NOTES

1. WELDS LESS THAN 2½ IN. NOM PIPE DIA- SOCKET WELDED; 2½ IN. AND LARGER- BUTT WELDED
2. WELDS IN QUALITY GROUP A PIPING, ONE INCH NOM. PIPE DIA. OR LESS ARE EXEMPT FROM NDT REQUIREMENTS PER IWB-1220(b).
3. WELDS IN QUALITY GROUP B PIPING 4" NOMINAL PIPE SIZE AND LESS ARE EXEMPT FROM NDT REQUIREMENTS PER IWC-1222(a) & (b).

REFERENCE DRAWINGS

FLOW DIAGRAM-CHEMICAL & VOLUME CONTROL SYSTEM-SHT. Nº 1 ——— A208168

CONTAINMENT BUILDING-CHEMICAL & VOLUME CONTROL SYSTEM-SHT. Nº 1 ——— 9321-F-2581

CONTAINMENT BUILDING-COMPOSITE PIPING AT REACTOR COOLANT PUMP Nº 21 ——— 9321-F-2526

THIS DRAWING CONTAINS ITEMS WHICH MUST BE CONTROLLED WITHIN CON EDISON AS: **"CLASS A" ITEMS PER CI-240-1**

NOT FOR FABRICATION OR INSTALLATION

NOT FOR FABRICATION OR INSTALLATION

SYMBOL IDENTIFICATION

- SUPPORT NUMBER
- FLANGE NUMBER - NUMBER OF BOLTS AND BOLT DIAMETER
- VALVE NUMBER
- WELD NUMBER
- QUALITY GROUP CLASSIFICATION
- INTEGRAL SUPPORT WELD NUMBER

Docket # 50-247
Accession # 9403310117
Date 3/28/94 of Ltr
Regulatory Docket File

ANSTEC APERTURE CARD

REVISIONS

0 — THIS ISSUE IS NON-CLASS "A" PER CI 240-1. RELEASE FOR RECORD. P.N. 7076 11-3-78

1 — THIS REVISION IS NON-CLASS "A" PER CI-240-1, UPDATED DWG TO SHOW WORK ON DWG. 9321-F-2526, THRU REV. 16. ADDED LATEST REV. NO. TO REF. DWG'S RELEASE FOR RECORD. P.N. 7076 EBASCO SERVICES, INC. 1-10-80

2 — THIS REVISON IS NON-CLASS "A" PER CI-240-1 ADDED LATEST REV. Nº TO REF. DWG'S. RELEASE FOR RECORD. P.N. 21368 TREADWELL CORP. 11-12-81

3 — THIS REVISION IS NON-CLASS PER CI-240-1. UPDATED DWG. PER 01R-91-05-685, PKG. #6537. RELEASE FOR RECORD P.N. 69911-EI

4 — THIS REV IS NON-CLASS PER CI-240-1 CHANGED DISC. CODE FROM MJ TO ML. REL. FOR RECORD P/N 69911-EI

5 — THIS REVISION IS CLASS "A" PER 240-1, UPDATED DWG. PER INSERVICE INSPECTION. FIELD REVISION INFORMATION RELEASE FOR RECORD P.N. 69911-EI J.S.

B206687-5

CONSOLIDATED EDISON CO. OF NEW YORK, INC.

STATION LOCATION	INDIAN POINT Nº 2
	INSERVICE INSPECTION
	ISOMETRIC OF CVCS SEAL
	INJECTION LINE Nº 41 - INSIDE
	CONTAINMENT - SHT 2 OF 2
SCALE NONE	DRAWN BY P DENE — RECORDED 11/2/78
P.N. 7076	CHECKED BY M. STEINAUER — ENGL.
DIAG / ELECT	MECH / STRUCT / DIST

APPROVALS: GENERAL ENGINEERING — CHIEF DESIGN ENGINEER; MECHANICAL ENGINEERING — MECH PWR ENGINEER; CIVIL ENGINEERING — PLANT STRUCT ENGINEER; T & D STRUCT. ENGINEER; ELECTRICAL ENGINEERING — STATION ELECT ENGINEER; T & D ENGINEER; GAS & STEAM OPERATIONS — STRUCT ENGINEER; PRODUCTION — CONVENTIONAL POWER; NUCLEAR POWER

ML