


VALVE BONNET BOLTING						
VALVE NO.	VALVE TYPE	NO. OF BOLTS	BOLT DIA.	BOLT TYPE	VALVE MANUFACTURER	MANUFACTURER DWG. NO.
B94D	10-VM88FM	10	1 1/8"	STUD BOLTS	DARLING	11603
B95D	10-C48Z	10			DARLING	11542
B97D	10-C48Z	10			DARLING	11542

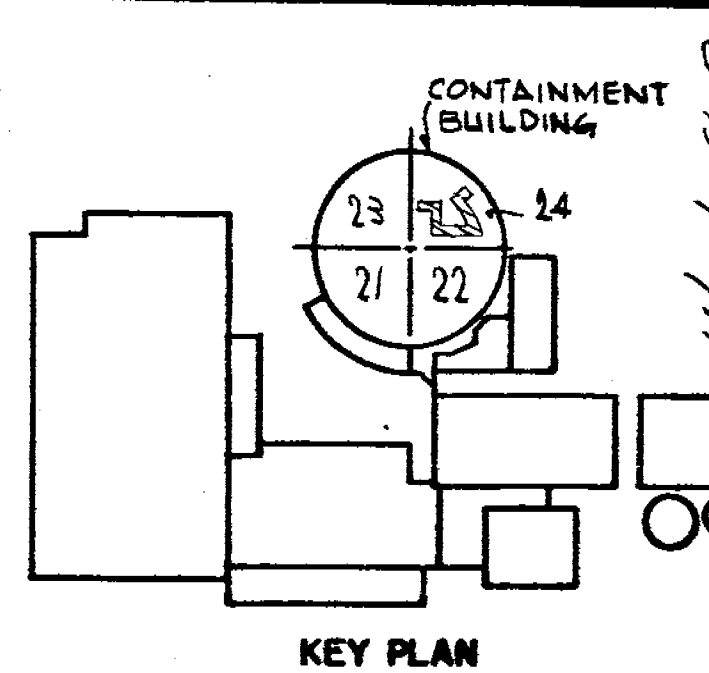

REVISIONS	
1	THIS ISSUE IS NON-CLASS 'A' PER CI-240-1. RELEASE FOR RECORD. P.N. 7076 11-3-78
2	THIS REVISION IS NON-CLASS 'A' PER CI-240-1. UPDATED DWG. TO SHOW WORK ON DWG. 9321-F-2617, THRU REV. 22. ADDED REF. DRAWINGS. ADDED LATEST REV. NO. TO REF. DRAWINGS. RELEASE FOR RECORD. P.N. 7076 RT/AS EBASCO SERVICES, INC. 1-10-80
3	THIS REVISION IS NON-CLASS 'A' PER CI-240-1. ADDED LATEST REV. NO. TO REF. DRAWINGS. RELEASE FOR RECORD. P.N. 21368 TREADWELL CORP. 11-12-82.
4	THIS REV. IS NON-CLASS PER CI-240-1 CHANGED DISCIPLINE CODE FROM WJ TO ML. RELEASE FOR RECORD P.N. 6994E1 AL.

THIS REVISION IS CLASS 'A' PER 240-1, UPDATED DWG. PER INSERVICE INSPECTION. FIELD REVISION INFORMATION RELEASE FOR RECORD P.N. 69911-EI J.S.

NOT FOR FABRICATION OR INSTALLATION

NOT FOR FABRICATION OR INSTALLATION

B206901-4
CONSOLIDATED EDISON CO.
 OF NEW YORK, INC.

STATION LOCATION INDIAN POINT NO 2
 INSERVICE INSPECTION ISOMETRIC OF SAFETY INJECTION LINE NO 350
 INSIDE CONTAINMENT
 ACCUMULATOR NO 24 DISCHARGE

DATE 2/28/74
 REGULARITY DOCKET FILE

APPROVALS	
MECHANICAL ENGINEER	W. ANDRUSHKO
CIVIL ENGINEER	M. STEINAUER
ELECTRICAL ENGINEER	
PLANT SAFETY ENGINEER	
STRUCT. ENGR.	
INSURANCE	
OPERATIONS	
PRODUCTION	
NUCLEAR POWER	

THIS DRAWING CONTAINS ITEMS WHICH MUST BE CONTROLLED WITHIN CON EDISON AS:
"CLASS A" ITEMS
 PER CI-240-1

- GENERAL NOTES**
- QUALITY GROUP B PORTION OF LINE NO 350 FROM VALVE B95 D TO AND INCLUDING ACCUMULATOR NO 24 EXEMPT FROM NDT REQUIREMENTS PER IWC-1221(c), STATICALLY PRESSURIZED, PASSIVE PWR S.I. SYSTEM.
 - WELDS LESS THAN 2 1/2" NOM. PIPE DIA - SOCKET-WELDED 2 1/2" AND LARGER - BUTT WELDED
 - WELDS IN QUALITY GROUP A PIPING, ONE INCH NOM. PIPE DIA OR LESS EXEMPT FROM NDT REQUIREMENTS PER IWB-1220(b).
 - (A) INDICATES REMOVABLE INSULATION
 - WELDS IN QUALITY GROUP B PIPING 4" NOM. PIPE DIA OR LESS ARE EXEMPT FROM NDT REQUIREMENTS PER IWC-1221(c)

REFERENCE DRAWINGS

FLOW DIAGRAM-SAFETY INJECTION SYSTEM _____ A235296
 CONTAINMENT BUILDING SAFETY INJECTION SYSTEM-PLAN-SHEET No 2 _____ 9321-F-2617
 CONTAINMENT BUILDING SAFETY INJECTION SYSTEM-SECTIONS-SHEET No 2 _____ 9321-F-2626

- SYMBOL IDENTIFICATION**
- SUPPORT NUMBER
 - VALVE NUMBER
 - WELD NUMBER
 - QUALITY GROUP CLASSIFICATION
 - INTEGRAL SUPPORT WELD NUMBER

TYPICAL WELD DETAIL DRAWINGS

10" CLASS 2501, SCH 140S - D208025
 10" CLASS 601, SCH 40S - D208024

ANSTEC APERTURE CARD

INCHES