


Monitoring Well Sample Results

6/24/2009

(b)(4)



6/24

	H-3 _____ pCi/L
MW-30	400,000-600,000
MW-31	4,000
MW-32	3,200
MW-33	142,000-232,000
MW-34	64,000-211,000
MW-35	42,000-104,000
MW-36	47,500
MW-37	
MW-38	985-1,008
MW-111	113,000-300,000
MW-108	ND


Information in this record was deleted in accordance with the Freedom of Information Act.  
 Exemptions 4  
 FOIAPA 2010-0209

6-2

MW-109	ND
U3-1	417
U3-2	512-960
U3-3	439-471
U3-T1	500-800
U3-T2	1,200-2,500

Site Storm Drain Sample Results

(b)(4)

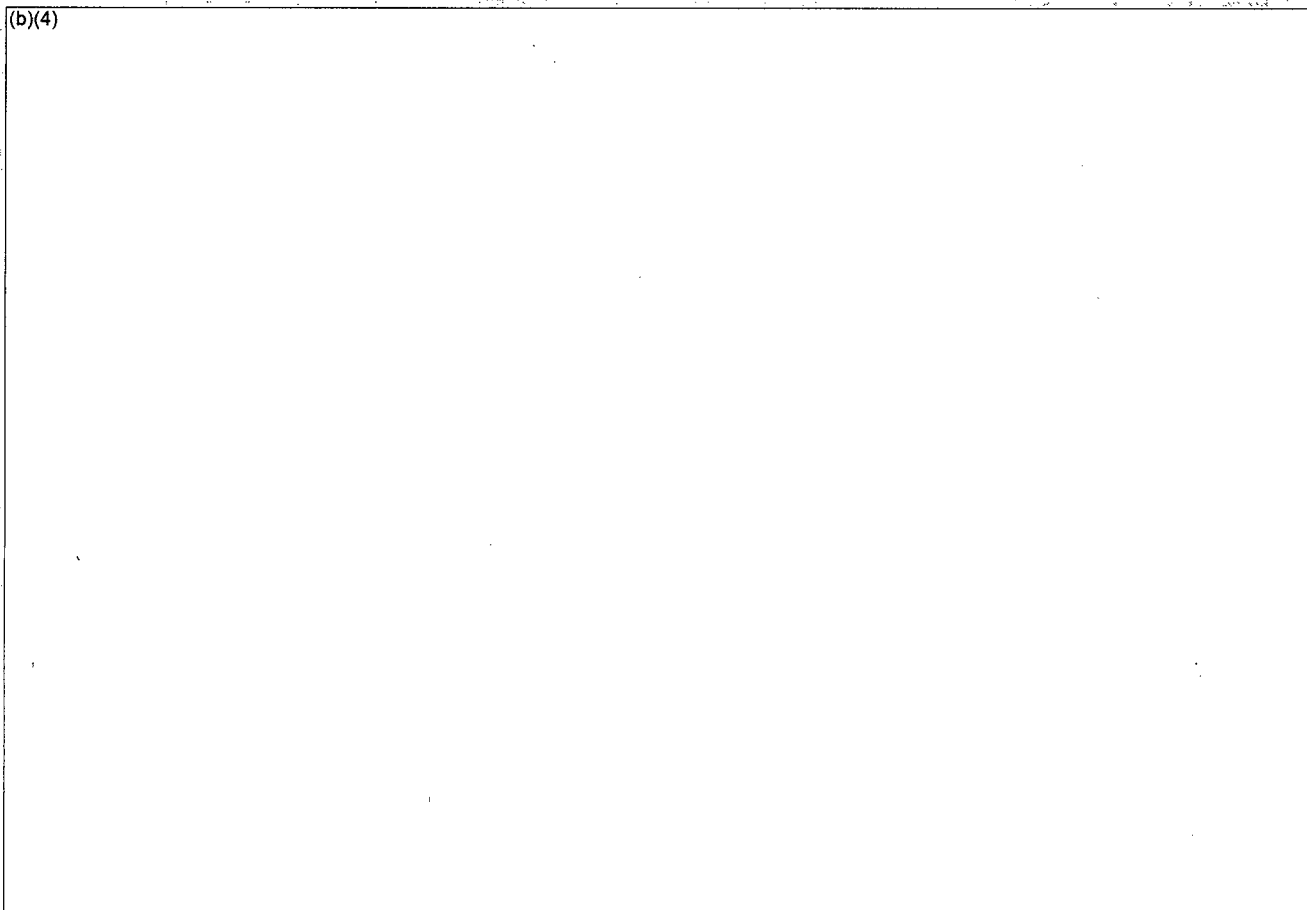

Unit 2 Storm Drains	H-3	pCi/L
Riverfront: 2, 12, 14, CB15		ND
3, 4, 5		2,000-7,000
Transformer yard: 6		12,000-51,300

Transformer yard: 7, 8	3200-8140
Transformer yard: 17-19	900-1800
80' MOB hill: 9, 10	2140-3000
Unit 3 Storm Drains	
A4	1200
B1-B7	3200-6280
B8	1000
C1	1000
D2	ND
E1-E7	ND