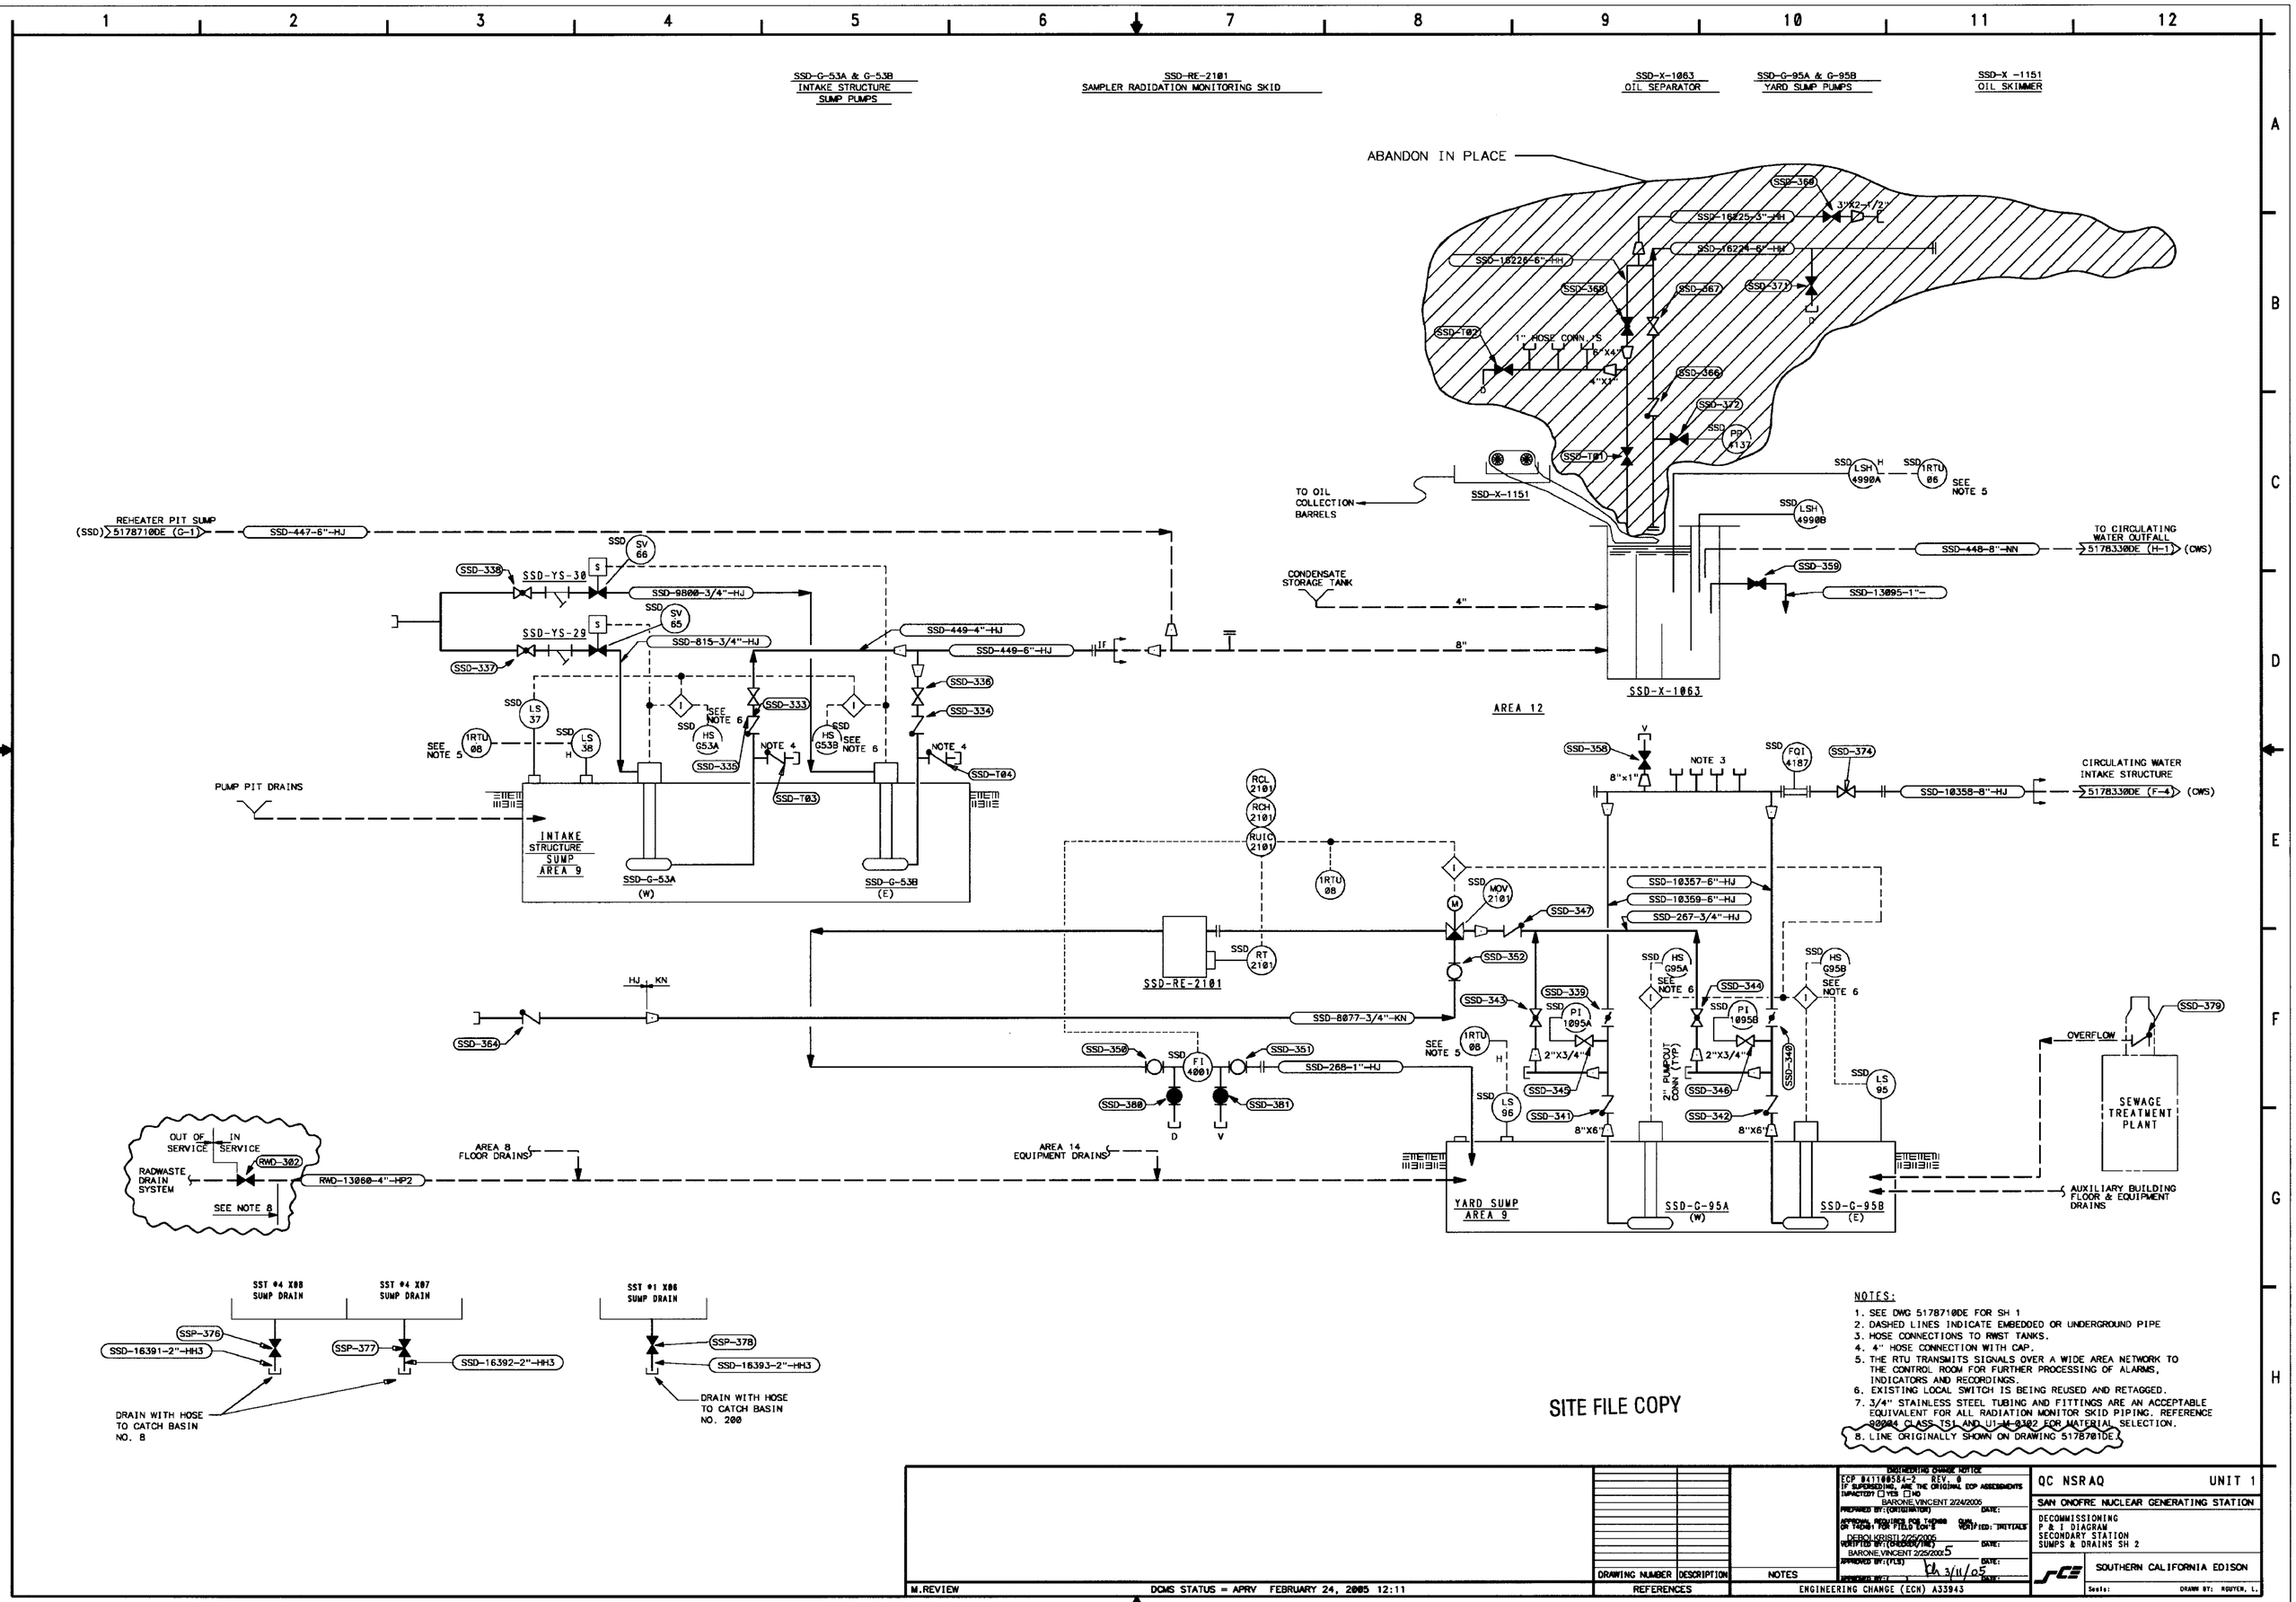

NOTES:

1. SEE DWG 5178710DE FOR SH 1
2. DASHED LINES INDICATE EMBEDDED OR UNDERGROUND PIPE
3. HOSE CONNECTIONS TO RWST TANKS.
4. 4" HOSE CONNECTION WITH CAP.
5. THE RTU TRANSMITS SIGNALS OVER A WIDE AREA NETWORK TO THE CONTROL ROOM FOR FURTHER PROCESSING OF ALARMS, INDICATORS AND RECORDINGS.
6. EXISTING LOCAL SWITCH IS BEING REUSED AND RETAGGED.
7. 3/4" STAINLESS STEEL TUBING AND FITTINGS ARE AN ACCEPTABLE EQUIVALENT FOR ALL RADIATION MONITOR SKID PIPING. REFERENCE 90004 CLASS TS1 AND U1-M-0302 FOR MATERIAL SELECTION.
8. LINE ORIGINALLY SHOWN ON DRAWING 5178701DE.

Amended: June 2010

Site File Copy