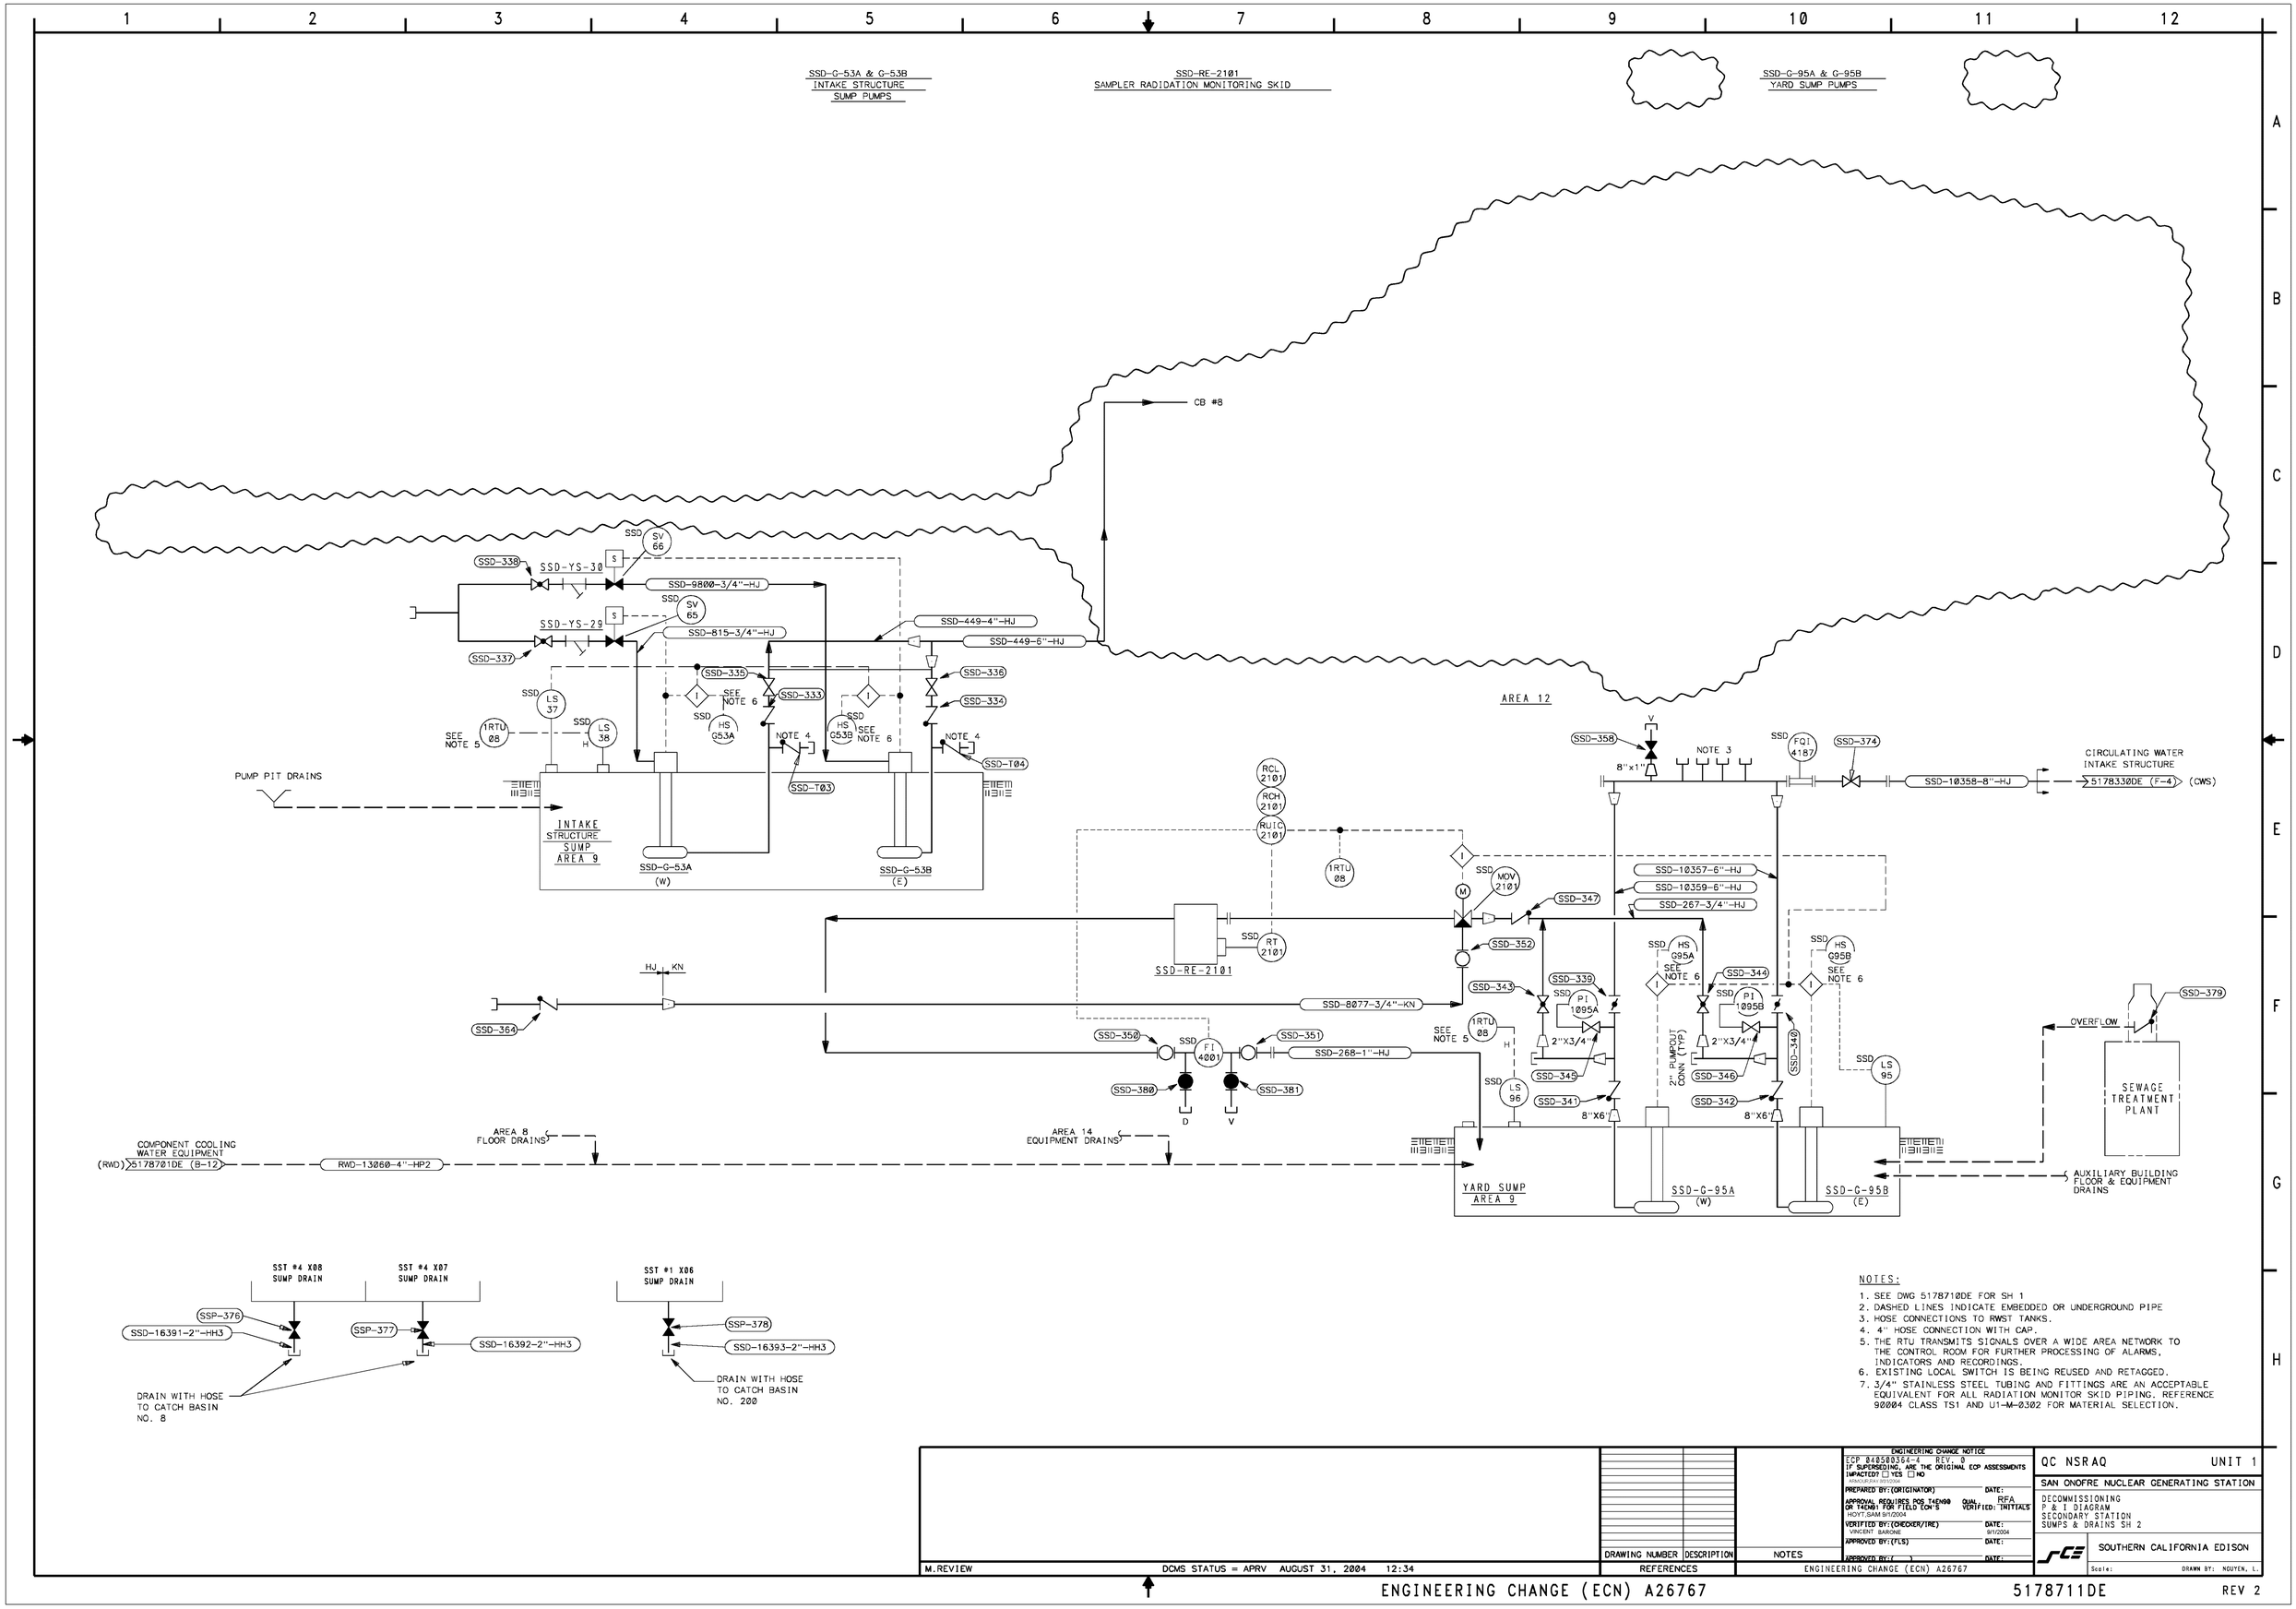

NOTES:

1. SEE DWG 5178710DE FOR SH 1
2. DASHED LINES INDICATE EMBEDDED OR UNDERGROUND PIPE
3. HOSE CONNECTIONS TO RWST TANKS.
4. 4" HOSE CONNECTION WITH CAP.
5. THE RTU TRANSMITS SIGNALS OVER A WIDE AREA NETWORK TO THE CONTROL ROOM FOR FURTHER PROCESSING OF ALARMS, INDICATORS AND RECORDINGS.
6. EXISTING LOCAL SWITCH IS BEING REUSED AND RETAGGED.
7. 3/4" STAINLESS STEEL TUBING AND FITTINGS ARE AN ACCEPTABLE EQUIVALENT FOR ALL RADIATION MONITOR SKID PIPING. REFERENCE 90004 CLASS TS1 AND U1-M-0302 FOR MATERIAL SELECTION.

DRAWING NUMBER	DESCRIPTION	NOTES
REFERENCES		

ENGINEERING CHANGE NOTICE
ECP 040500364-4 REV. 0
IF SUPERSEDING, ARE THE ORIGINAL ECP ASSESSMENTS IMPACTED? ☐ YES ☐ NO
MRAGUE:FAX:8/31/2004
PREPARED BY:(ORIGINATOR) DATE:
APPROVAL REQUIRES POS T4EN90 OR T4EN91 FOR FIELD ECN'S QUAL. VERIFIED: RFA INITIALS
HOYT,SAM 9/1/2004
VERIFIED BY:(CHECKER/IRE) DATE:
VINCENT BARONE 9/1/2004
APPROVED BY:(FLS) DATE:
APPROVED BY:( ) DATE:
ENGINEERING CHANGE (ECN) A26767

QC NSRAQ UNIT 1
SAN ONOFRE NUCLEAR GENERATING STATION
DECOMMISSIONING
P & I DIAGRAM
SECONDARY STATION
SUMPS & DRAINS SH 2
SOUTHERN CALIFORNIA EDISON
Scale: DRAWN BY: NGUYEN, L.

M.REVIEW DCMS STATUS = APRV AUGUST 31, 2004 12:34

ENGINEERING CHANGE (ECN) A26767 5178711DE REV 2

Site File Copy