
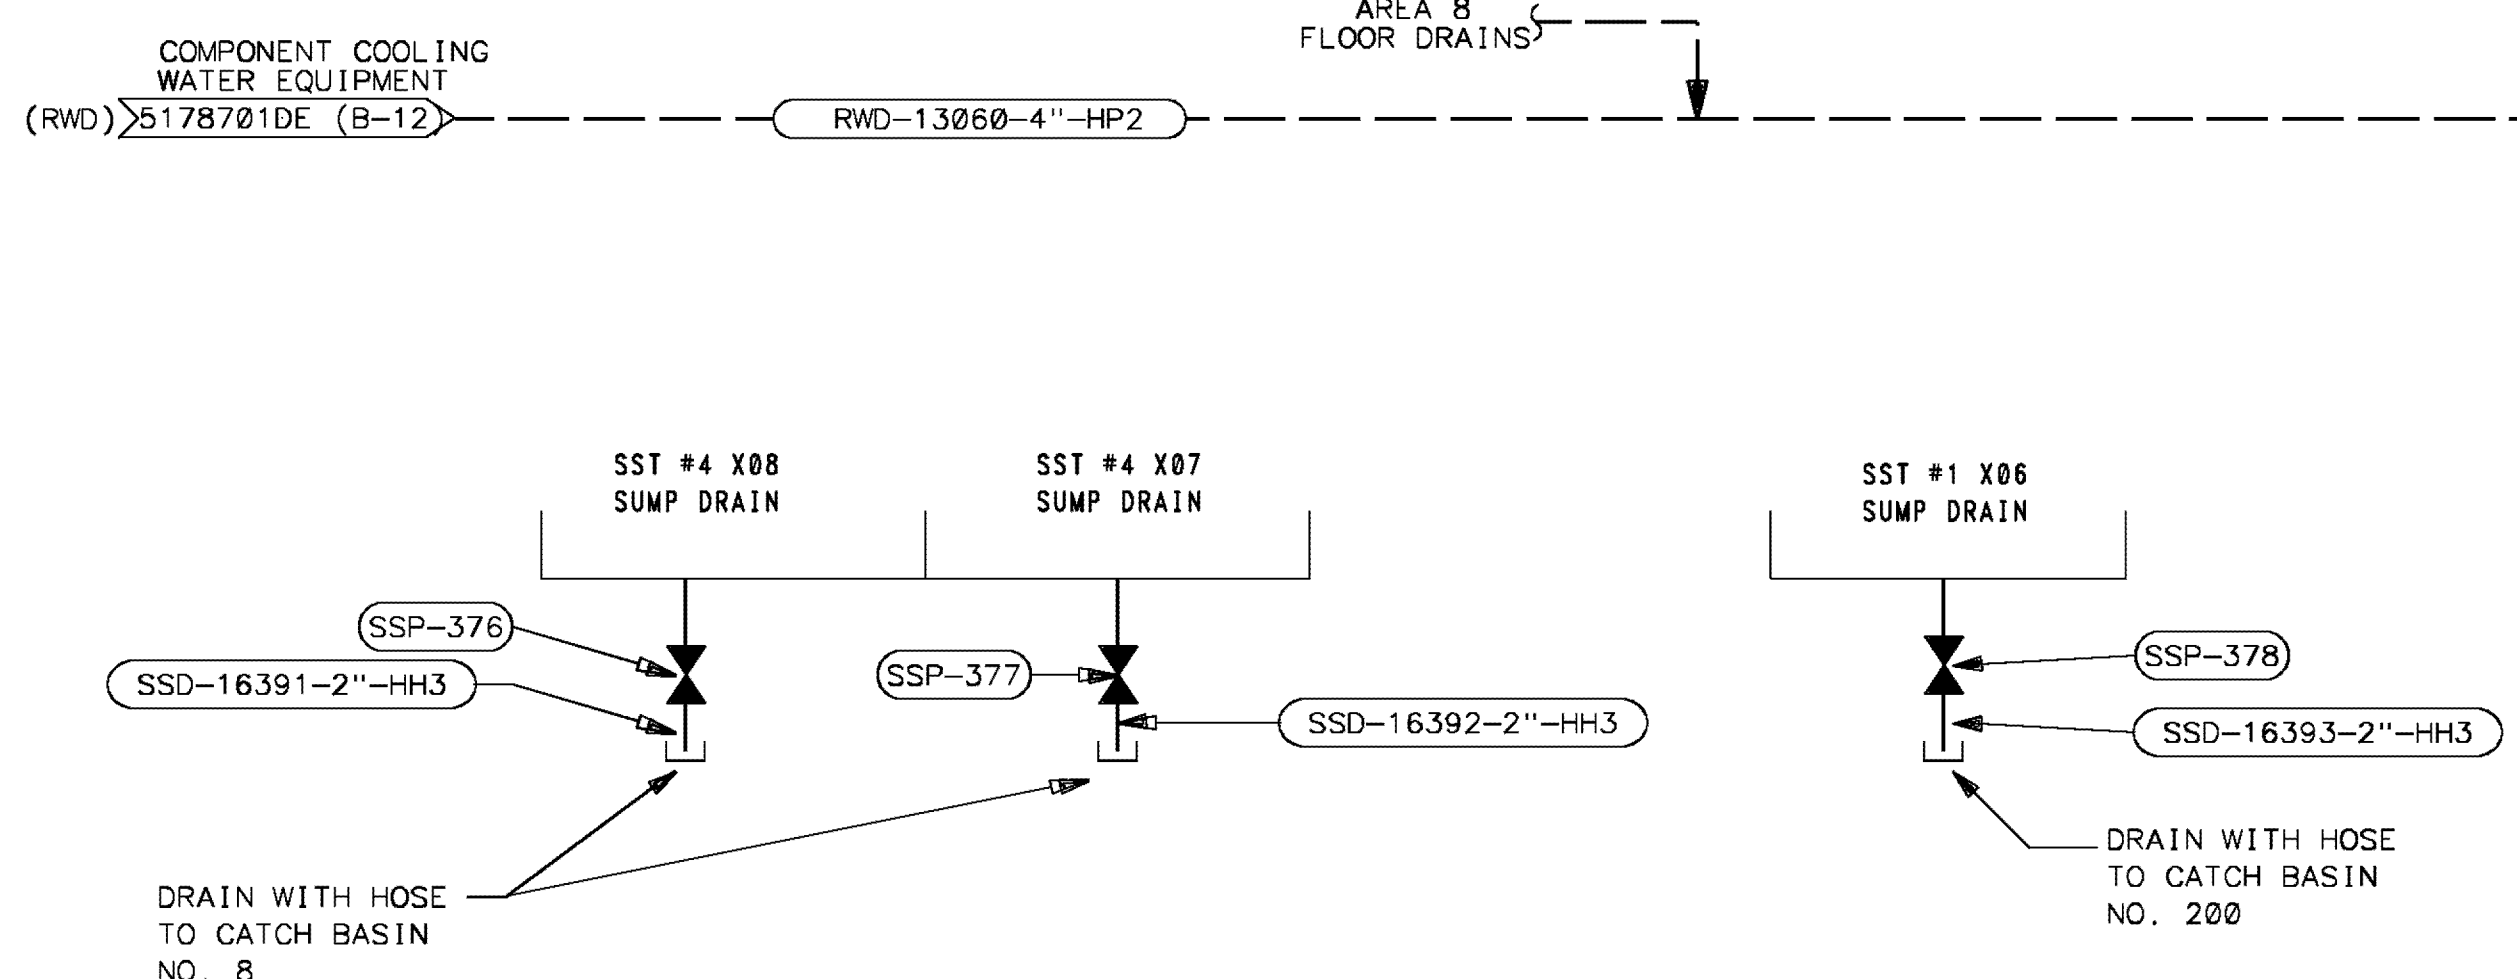


SSD-G-53A & G-53B  
INTAKE STRUCTURE  
SUMP PUMPS

SSD-RE-2101  
SAMPLER RADIATION MONITORING SKID

SSD-G-95A & G-95B  
YARD SUMP PUMPS

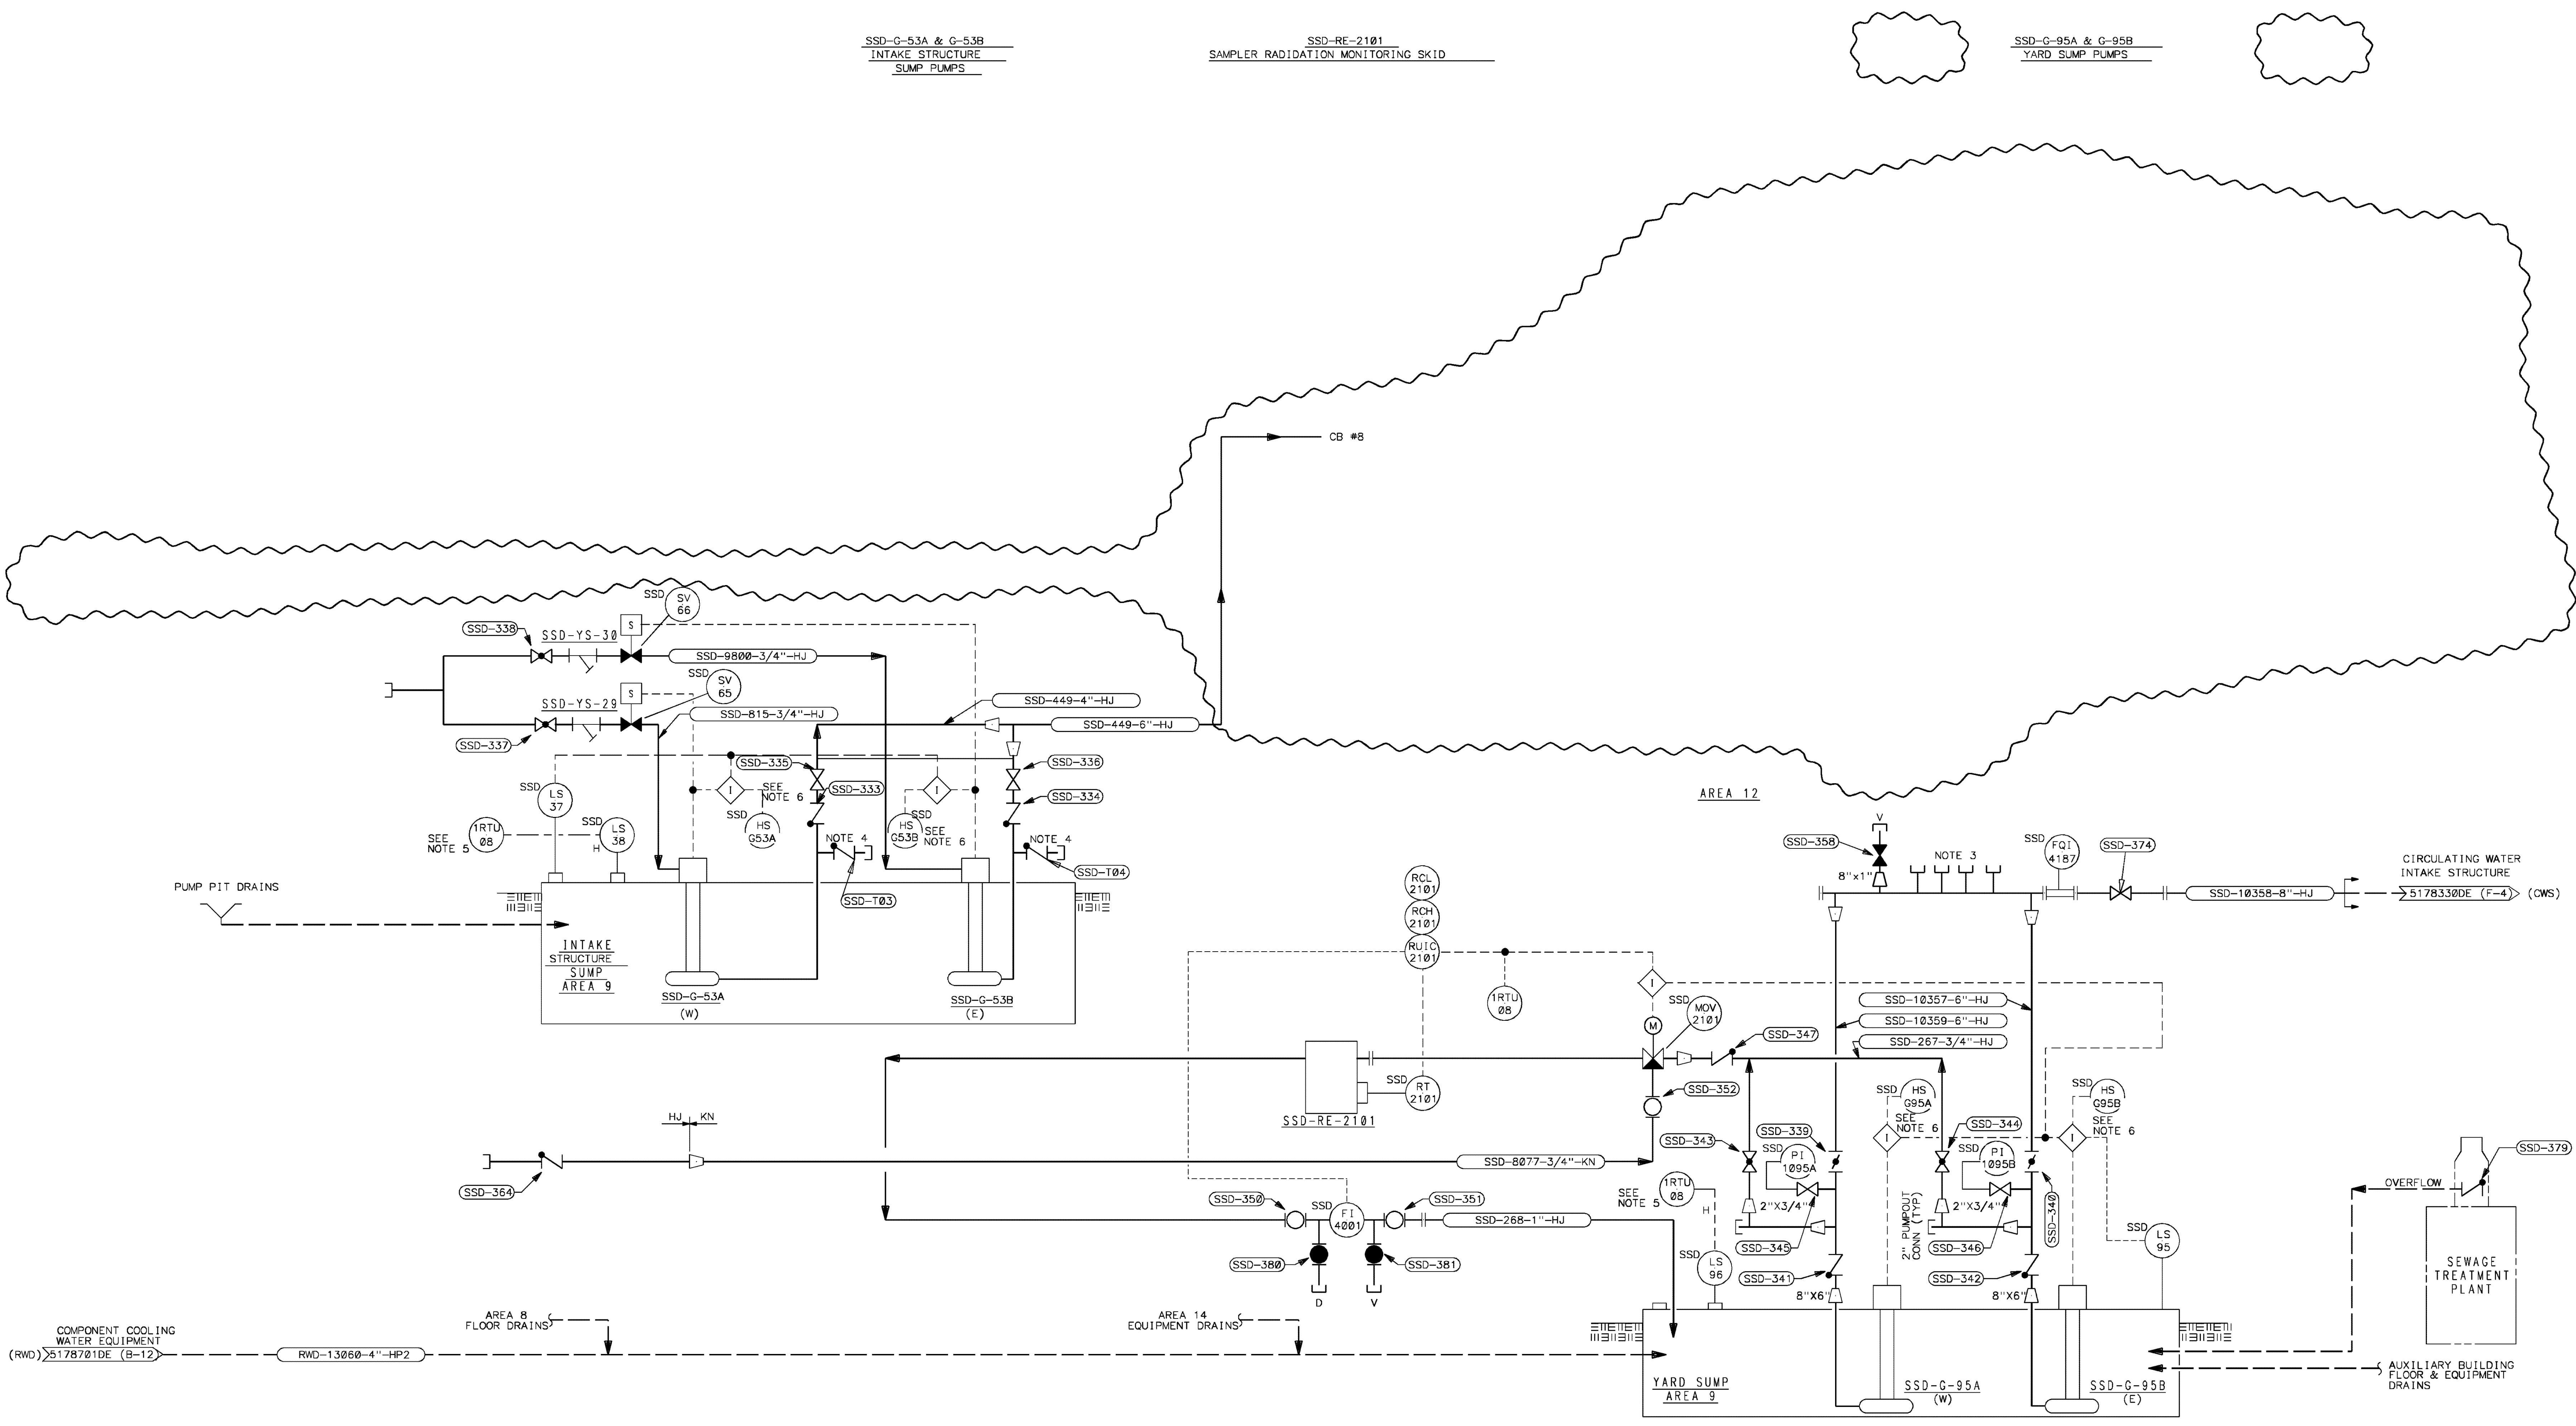

- NOTES:
1. SEE DWG 5178710DE FOR SH 1
  2. DASHED LINES INDICATE EMBEDDED OR UNDERGROUND PIPE
  3. HOSE CONNECTIONS TO RWST TANKS.
  4. 4" HOSE CONNECTION WITH CAP.
  5. THE RTU TRANSMITS SIGNALS OVER A WIDE AREA NETWORK TO THE CONTROL ROOM FOR FURTHER PROCESSING OF ALARMS, INDICATORS AND RECORDINGS.
  6. EXISTING LOCAL SWITCH IS BEING REUSED AND RETAGGED.
  7. 3/4" STAINLESS STEEL TUBING AND FITTINGS ARE AN ACCEPTABLE EQUIVALENT FOR ALL RADIATION MONITOR SKID PIPING. REFERENCE 92004 CLASS TS1 AND U1-M-0302 FOR MATERIAL SELECTION.

M REVIEW		DCMS STATUS = APRV AUGUST 31, 2004 12:34		ENGINEERING CHANGE (ECN) A26767		ENGINEERING CHANGE NOTICE ECP 84500364-4 REV 0 IF SUPERSEDES ARE THE ORIGINAL ECP ASSESSMENTS IMPACTED? <input type="checkbox"/> YES <input type="checkbox"/> NO PREPARED BY: (ORIGINATOR) DATE: APPROVAL REQUIRED FOR THE ECP? <input type="checkbox"/> YES <input type="checkbox"/> NO QUAL. REFA. VERIFIED: INITIALS HOYT, SAM 01/2004 VERIFIED BY: (CHECKER/IRE) DATE: VICENT, BARON 01/2004 APPROVED BY: (PLS) DATE: APPROVED BY: DATE:		QC NSRAQ UNIT 1 SAN ONOFRE NUCLEAR GENERATING STATION DECOMMISSIONING P & I DIAGRAM SECONDARY STATION SUMPS & DRAINS SH 2 SOUTHERN CALIFORNIA EDISON Scale: DRAWN BY: NGUYEN, L.	
REFERENCES		NOTES		REFERENCES		NOTES		REFERENCES	