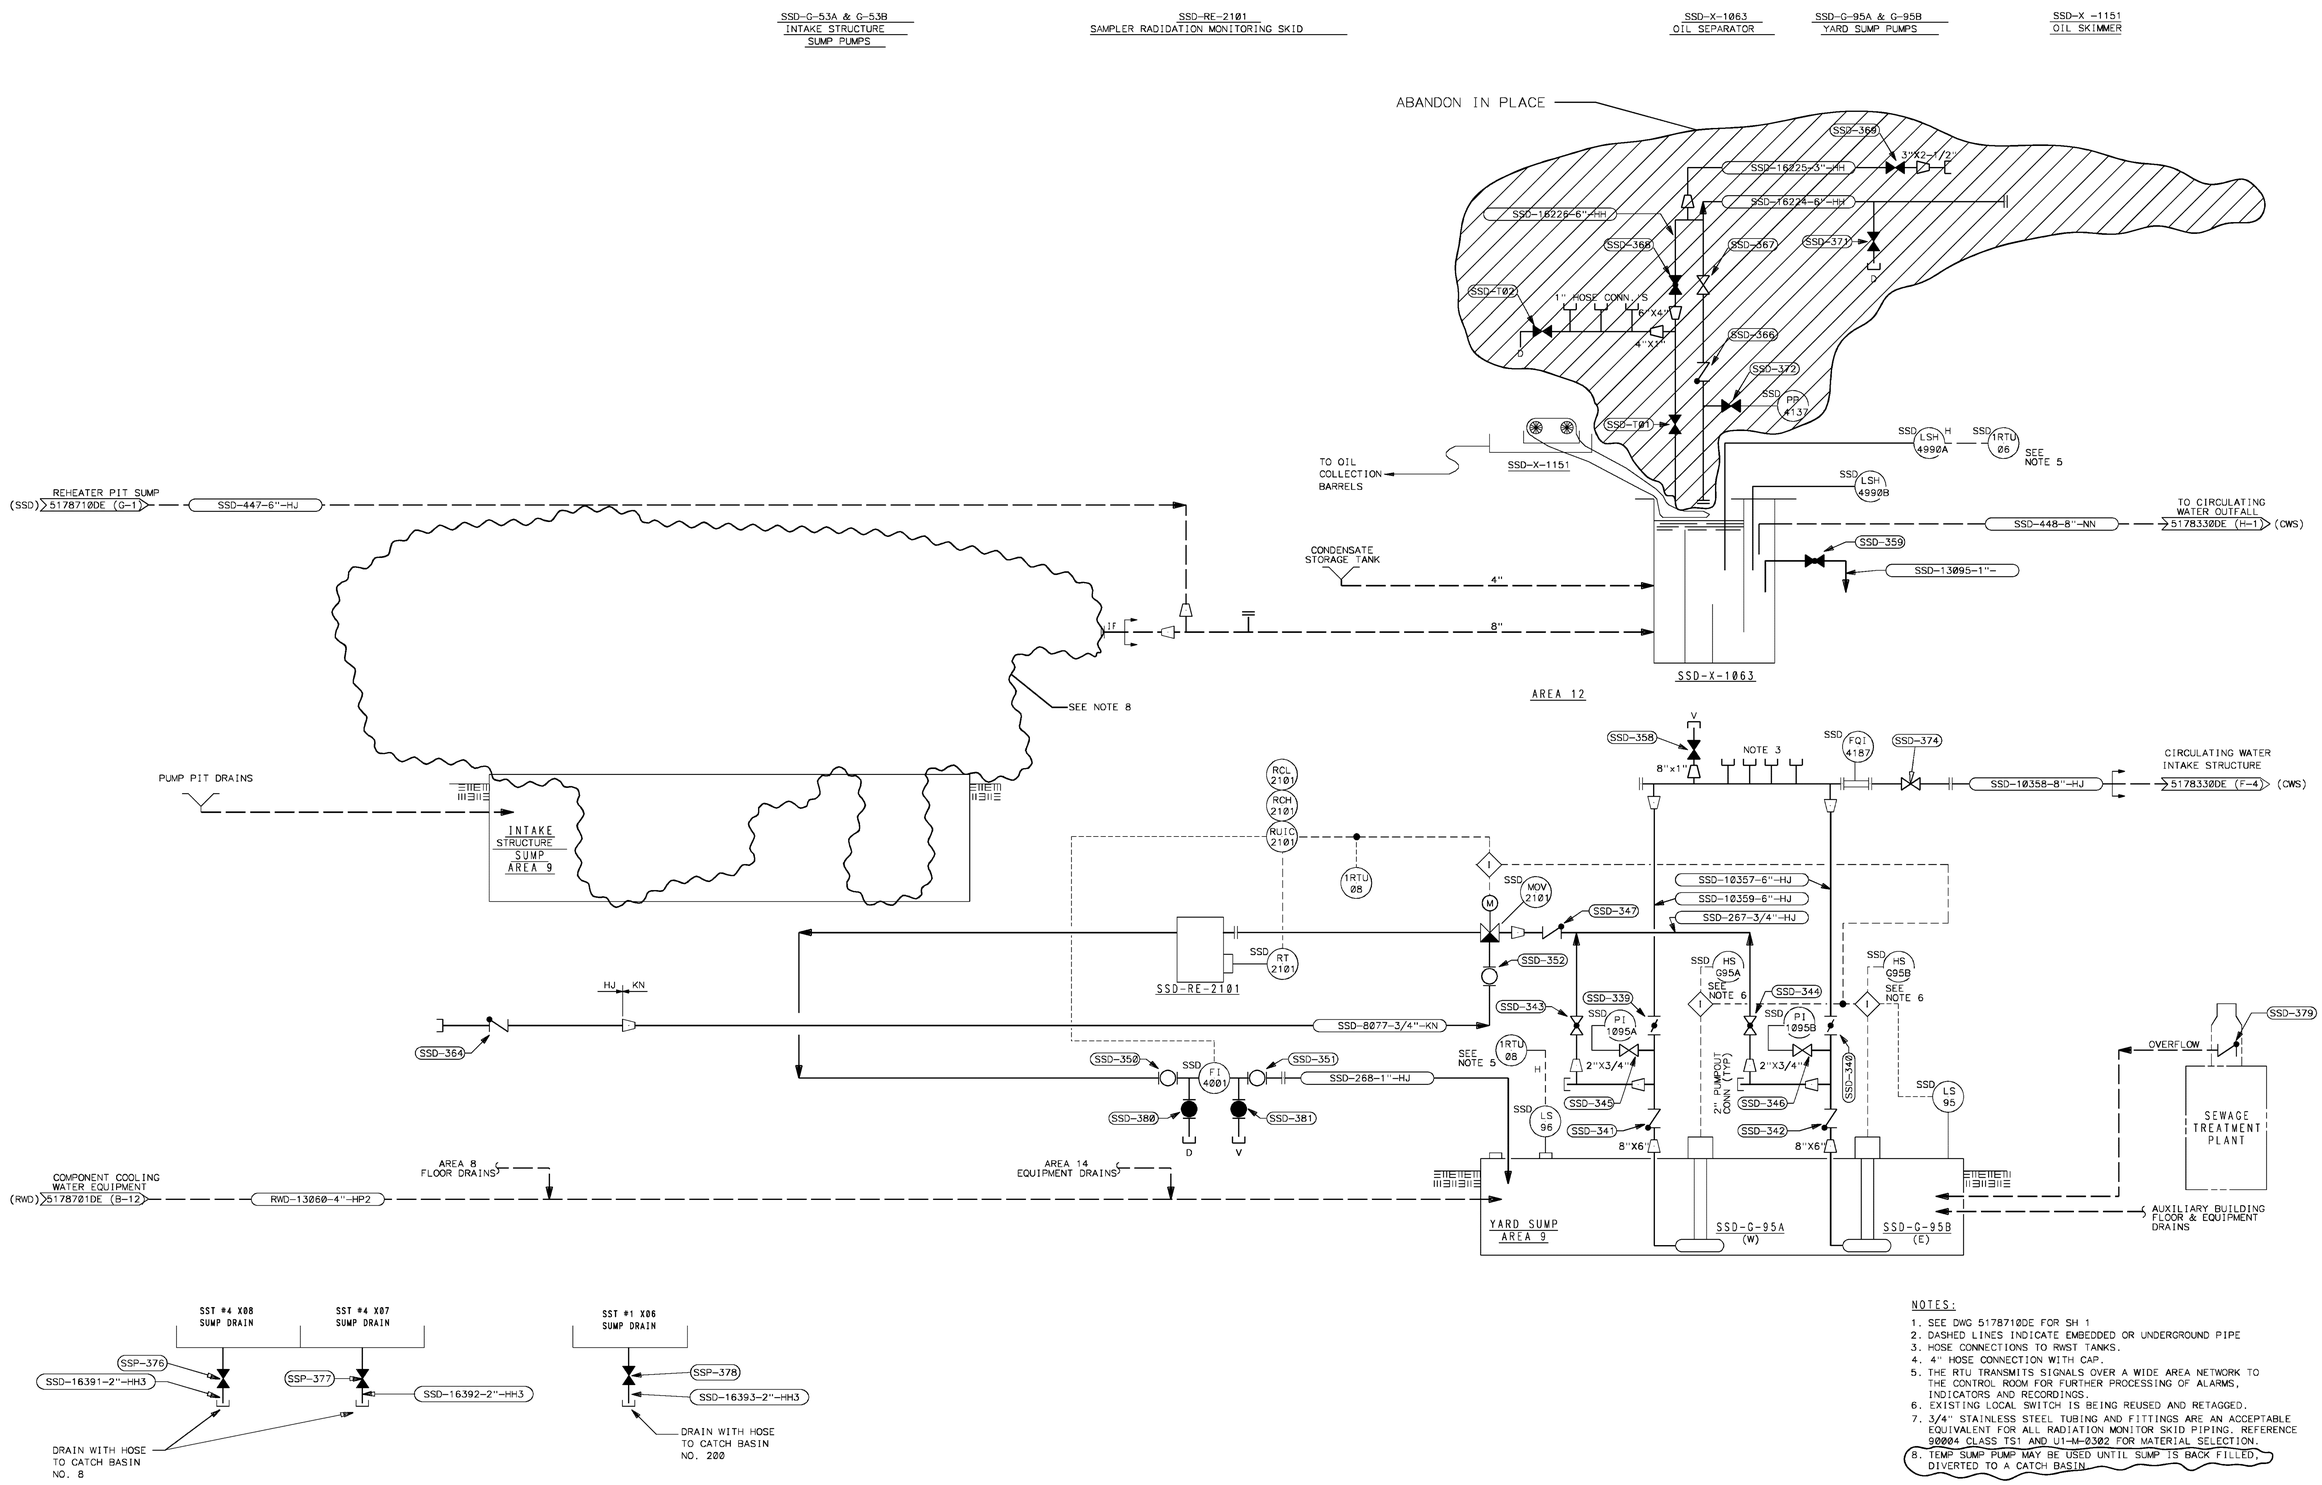


NOTES:

1. SEE DWG 5178710DE FOR SH 1
2. DASHED LINES INDICATE EMBEDDED OR UNDERGROUND PIPE
3. HOSE CONNECTIONS TO RWST TANKS.
4. 4" HOSE CONNECTION WITH CAP.
5. THE RTU TRANSMITS SIGNALS OVER A WIDE AREA NETWORK TO THE CONTROL ROOM FOR FURTHER PROCESSING OF ALARMS, INDICATORS AND RECORDINGS.
6. EXISTING LOCAL SWITCH IS BEING REUSED AND RETAGGED.
7. 3/4" STAINLESS STEEL TUBING AND FITTINGS ARE AN ACCEPTABLE EQUIVALENT FOR ALL RADIATION MONITOR SKID PIPING. REFERENCE 90004 CLASS TS1 AND U1-M-0302 FOR MATERIAL SELECTION.
8. TEMP SUMP PUMP MAY BE USED UNTIL SUMP IS BACK FILLED, DIVERTED TO A CATCH BASIN.

| | | | |
|---|---|---|---|
| M.REVIEW | DCMS STATUS = APRV JUNE 16, 2006 14:04 | REFERENCES | ENGINEERING CHANGE (ECN) A42286 |

DRAWING NUMBER | DESCRIPTION | NOTES

ENGINEERING CHANGE NOTICE
ECP 86028191-1 REV 0
IF SUPERSEDING, ARE THE ORIGINAL ECP ASSESSMENTS IMPACTED? ☐ YES ☐ NO
BROWN,DONALD A 6/19/2006
PREPARED BY/DATE:(ORIGINATOR)
APPROVAL REQUIRES POS T4EN00 OR T4EN01 FOR FIELD ECN'S — QUAL VERIF.BY: INITIALS
ARMOUR,RAY 6/19/2006
VERIFIED BY/DATE:(CHECKER/IRE)
BARONE,VINCENT 6/19/2006
APPROVED BY/DATE:(FLS)
APPROVED BY/DATE:( )

QC NSRAQ — UNIT 1

SAN ONOFRE NUCLEAR GENERATING STATION

DECOMMISSIONING
P & I DIAGRAM
SECONDARY STATION
SUMPS & DRAINS SH 2

SOUTHERN CALIFORNIA EDISON

Scale: — DRAWN BY: NGUYEN, L.

ENGINEERING CHANGE (ECN) A42286 — 5178711DE — REV 2

Site File Copy

Amended: June 2010