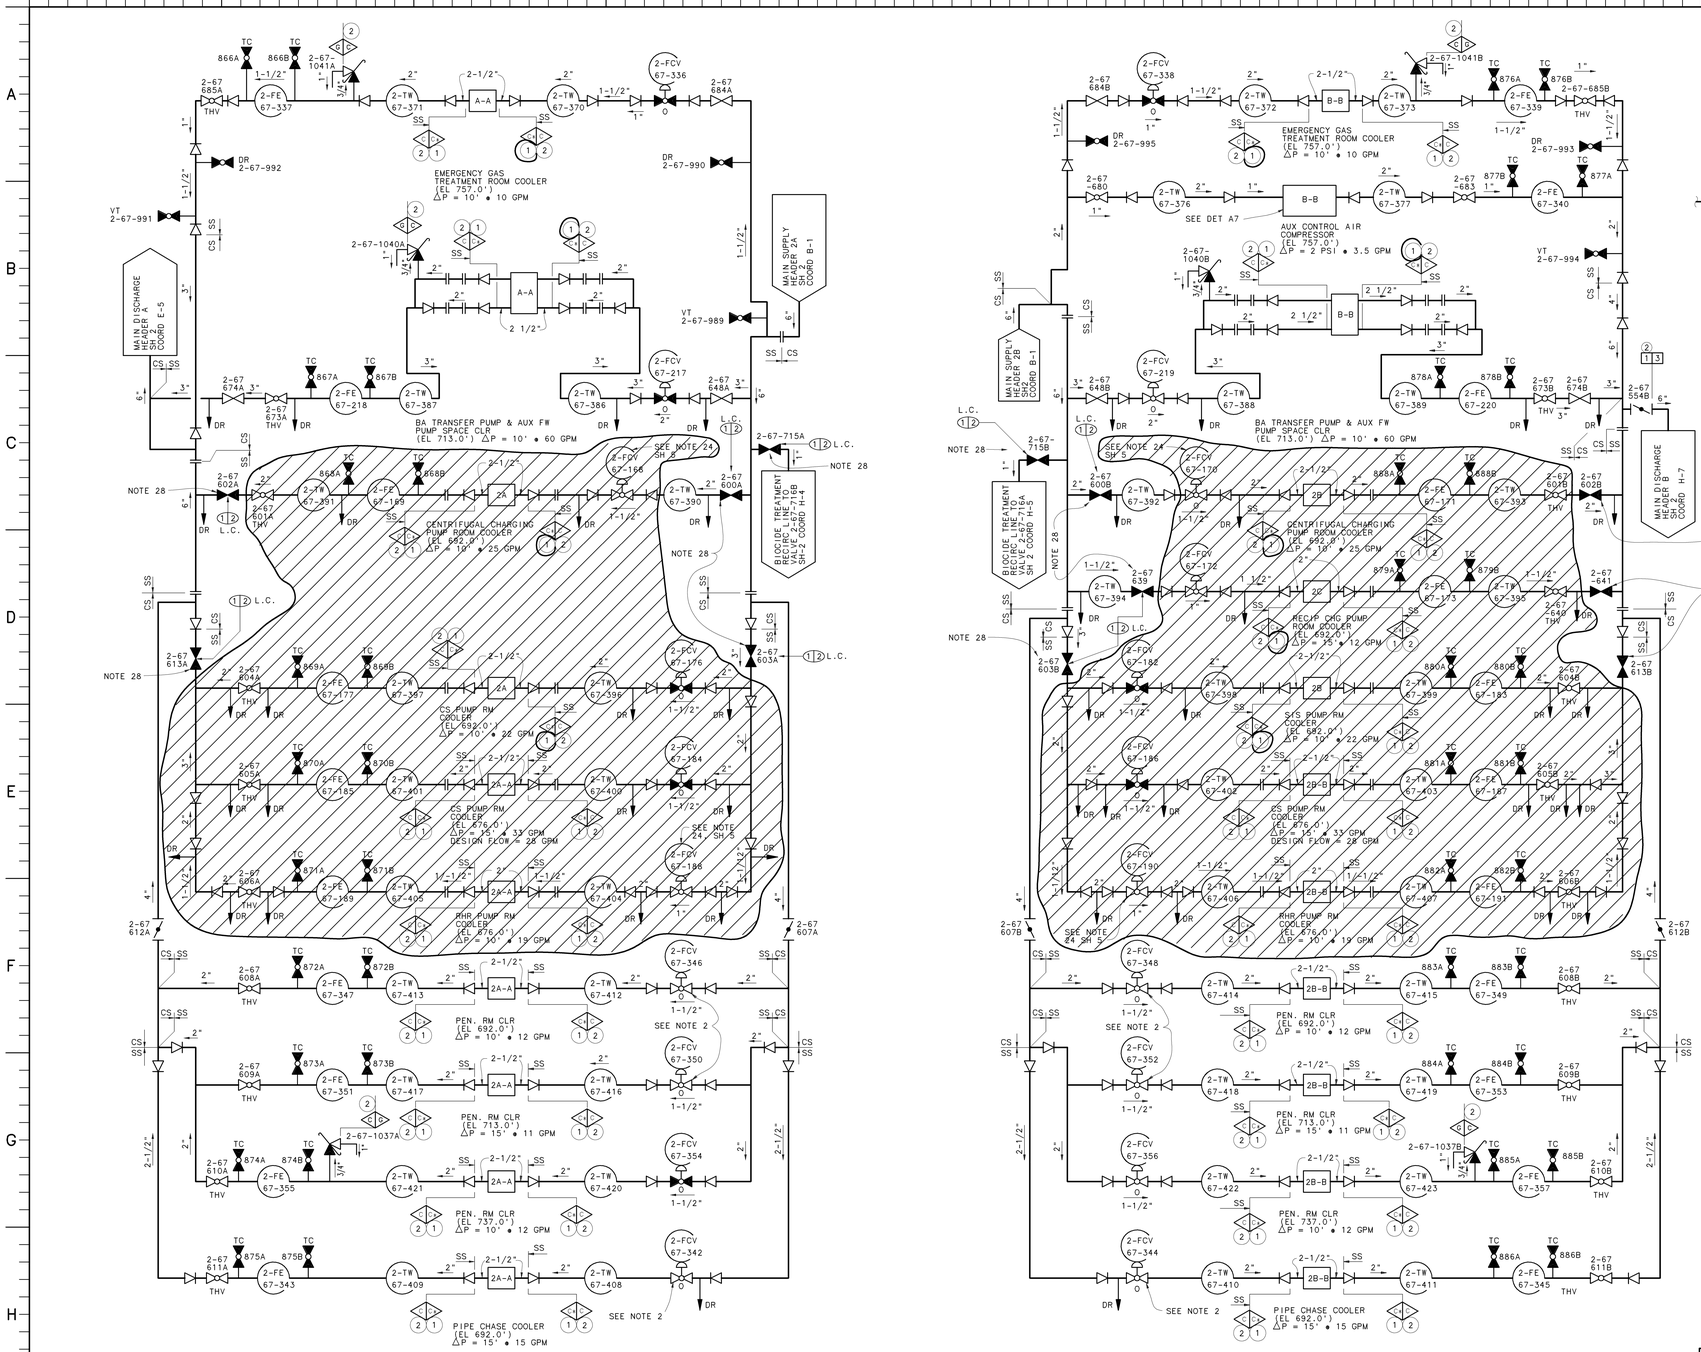

AUXILIARY CONTROL AIR COMPRESSOR B
DETAIL A7
(EL 757.0)

✱ SEE NOTE 13 SH 1 AND NOTE 19 ON SH 5.

NOTE:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS, SEE SH. 1
2. FLOW CONTROL VALVES (FCV) 2-FCV-67-342, -344, -346, -348, -350 AND -352 HAVE BEEN DISABLED (INTO THEIR FAILURE MODE (FULLY OPEN). THIS PROVIDES FLOW FOR LAYUP OF THE ASSOCIATED COOLERS WHICH ARE NOT REQUIRED FOR UNIT 1 OPERATION.
3. 1 2 & 1 2 DENOTES UNIT 1 & UNIT 2 INTERFACE POINTS.

NOTE: INTERFACE HOLD ORDER H.O. 20011, 20015 PLACED ON INDICATED VALVES TO MAINTAIN CLOSED CONFIGURATION.

THIS CONFIGURATION CONTROL DRAWING SUPERSEDES UNIT 1 AS-CONSTRUCTED DRAWING 47W845-4 REVISION X.

14	ADMIN	MAF	PDH	DLO	11-16-00
REVISED HYDROSTATIC TEST PRESSURE SYMBOL FROM ↓ TO 1.					
REV	CHANGE REF	PREPARER	CHECKER	APPROVED	DATE

SCALE: NTS — EXCEPT AS NOTED

PROJECT FACILITY
POWERHOUSE
AUX BLDG UNIT 2

TITLE
MECHANICAL
FLOW DIAGRAM - ESSENTIAL
RAW COOLING WATER SYSTEM

1 — WATTS BAR NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY — Q

DESIGN		INITIAL ISSUE	ENGINEERING APPROVAL
DRAFTER S.R. HANCOCK	CHECKER C.E. THOMPSON	RO ISSUE PER WBEP 5.17 & RIMS B26 '89 1019 375	1 S.W. HUNGATE
DESIGNER M.L. CHAPMAN	REVIEWER J.F. LUND		2 S.W. HUNGATE
			3 F.A. KOONTZ

COMPANION DRAWINGS: 1-47W845-1, 2, 3, 4, & 5

FSAR FIG. 9.2-4B

ISSUED BY: J. EDWARD GIBBS

DATE 1-26-90 | 85 | M | 1-47W845-7 | R14

PRINTS REQ'D R ____ PRINT SIZE F BR OR PROJ AB CE EE ME NE FE HE SE TE BL BF WB SQ — PRINT SIZE H BR OR PROJ AB CE EE ME NE FE HE SE TE BL BF WB SQ

CAD MAINTAINED DRAWING

CONFIGURATION CONTROL DRAWING