NOTES:

1. FOR NOTES SEE DRAWING M573-1.

LR NOTES:

A. FOR GENERAL LICENSE RENEWAL NOTES, SEE LR-M501-2.
B. ALL HIGHLIGHTED COMPONENTS SHOWN ON THIS DRAWING ARE EVALUATED IN THE FIRE PROTECTION SYSTEM.
C. COMPONENTS HIGHLIGHTED ON THIS DRAWING ARE IN SCOPE FOR (A)(3)-FIRE PROTECTION. THEREFORE, ONLY COMPONENTS IN THE MAIN FLOW PATHS AND BRANCH LINES TO THE FIRST ISOLATION VALVE ARE HIGHLIGHTED.
D. FILL AND VENT LINES DO NOT SUPPORT OR PREVENT THE ACCOMPLISHMENT OF THE (A)(3)-FIRE PROTECTION FUNCTION. THEREFORE, THEY ARE NOT IN SCOPE.

E. DURING WINTER MONTHS fp-p-112 RUNS CONTINUOUSLY AND FP-V-339 AND FP-V-354 ARE OPEN WITH FP-V-354 THROTTLED PER PPM 2.8.7. (THIS IS NOTE 6 FROM M573-1 REVISION 68)

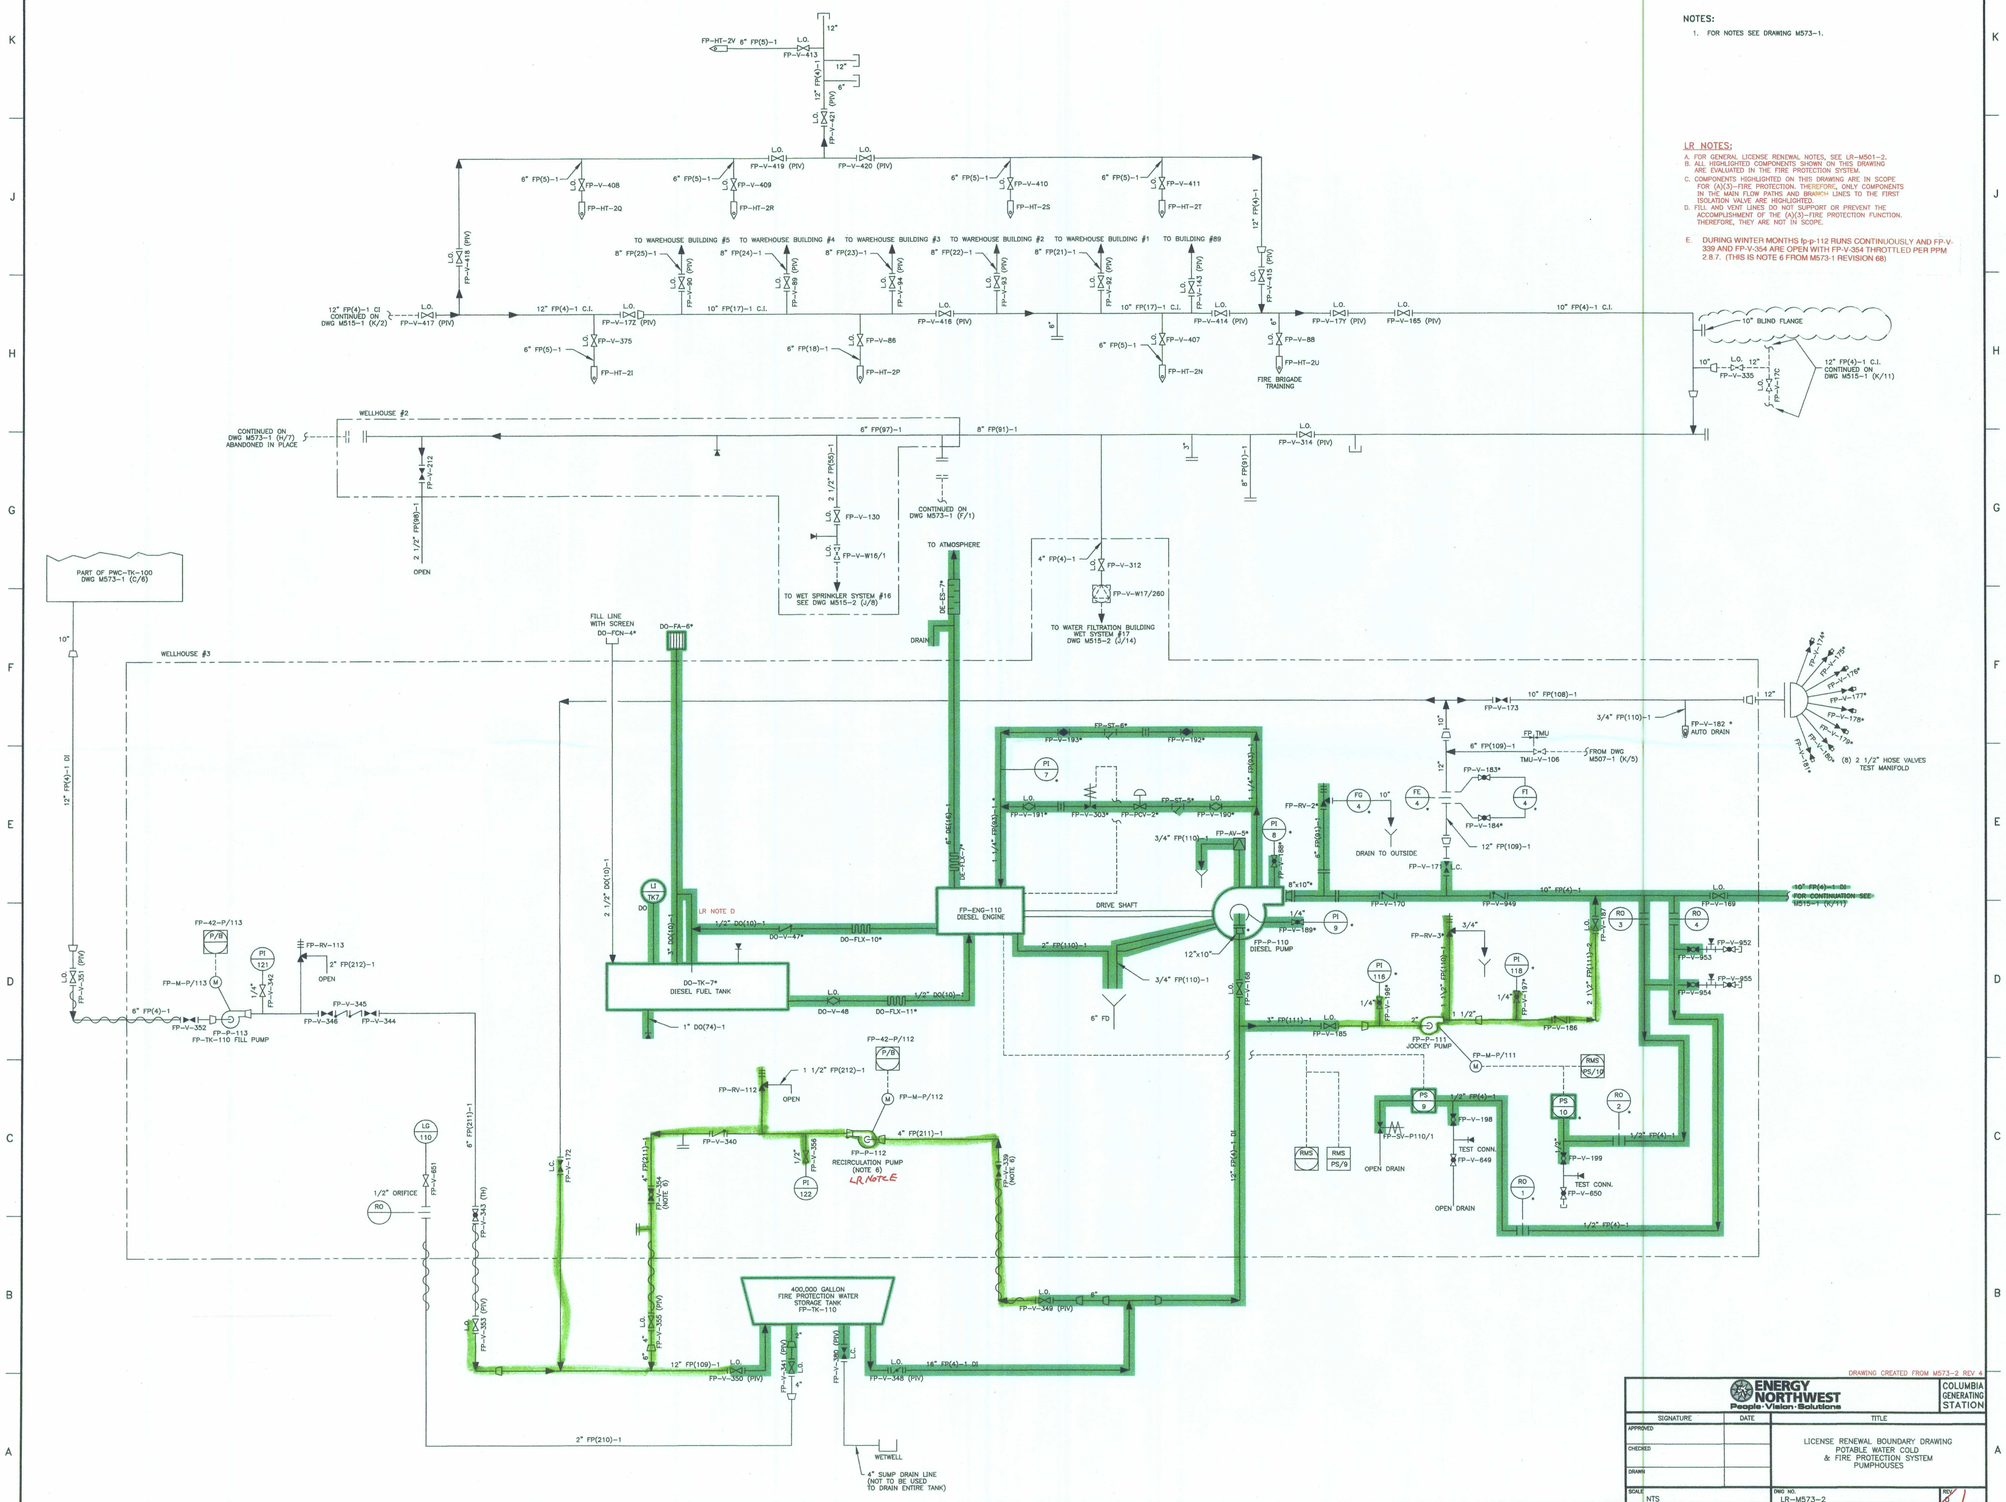

DRAWING CREATED FROM M573-2 REV 4

ENERGY NORTHWEST People·Vision·Solutions		COLUMBIA GENERATING STATION
SIGNATURE	DATE	TITLE
APPROVED		LICENSE RENEWAL BOUNDARY DRAWING POTABLE WATER COLD & FIRE PROTECTION SYSTEM PUMPHOUSES
CHECKED		
DRAWN		
SCALE NTS	FRAME	DWG NO. LR-M573-2 REV 1

TOP TIER
2017