

- NOTES**
- FOR GENERAL NOTES, PIPING SYMBOLS AND P.I.D. INDEX SEE DWG. M-001.
 - FOR INSTRUMENTATION SYMBOLS SEE DWG. M-002.
 - ELEVATIONS SHOWN AT HOSE CONNECTIONS REFER TO FLOOR LEVELS TO BE SERVICED.
 - FOR TYPICAL QUICK DISCONNECT HOSE COUPLING ARRANGEMENT SEE DETAIL "A".
 - DELETED
 - FOR INSTALLATION OF DOMESTIC HOT WATER HEATER SEE LESLIE CO. DWG. 71-12685-1.
 - FOR STATION PLUMBING SEE DWGS. M-160, M-161, & M-192.
 - UNLESS OTHERWISE NOTED, ALL DRAIN CONN. ARE 1" AND ALL VENT CONN. ARE 3/4". LINE IDENTIFICATION SAME AS HEADER.
 - FOR TYPICAL HEAT TRACING CIRCUIT SEE DETAIL "B" THIS DWG.
 - THE ONLY VENT OR DRAIN LINE CAPS REQUIRED TO BE SHOWN ON PIPING AND INSTRUMENTATION DIAGRAMS ARE THOSE CONTROLLED UNDER DB-OP-0009 (FORMERLY AD1839.03). THE ACTUAL TERMINATION OF ALL OTHER VENTS OR DRAINS ARE NOT SHOWN AND INSTEAD, AN OPEN ENDED PIPE IS DISPLAYED.
 - POSITIONABLE COMPONENTS FOR THIS SYSTEM ARE SHOWN IN AN ACCEPTABLE LINE UP. THE ACTUAL FIELD LINE UP MAY VARY AND IS CONTROLLED BY PROCEDURES.
 - VALVE HAS ABOVE GROUND OPERATOR.

LR NOTES:


- FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01.
- COMPONENTS BEYOND THE HIGHLIGHTING ARE OUTSIDE IN THE TURBINE BUILDING, OR IN THE WATER TREATMENT BUILDING, AND THEREFORE NOT IN SCOPE.
- PORTIONS OF THE DOMESTIC WATER SUPPLY AND RECIRCULATION LOOP PIPING (JDD) ARE ROUTED THROUGH THE AUXILIARY BUILDING, AND IS THEREFORE IN SCOPE.

LICENSE RENEWAL BOUNDARY DRAWING
LR-M011 REV. 0

SYSTEMS SHOWN ON THIS DRAWING:
24: NONSAFETY AFFECTING SAFETY

BECHTEL COMPANY GATHERSBURG, MARYLAND		
DAVIS-BESSE NUCLEAR POWER STATION THE TOLEDO EDISON COMPANY THE CLEVELAND ELECTRIC ILLUMINATING COMPANY		
PIPING & INSTRUMENT DIAGRAM DOMESTIC WATER SYSTEM		
JOB NO. 7749	DRAWING NO. M-011	REV. 61

DETAIL "B"
TYPICAL HEAT TRACING CIRCUIT
FOR H/T INSTRUMENTATION & DETAIL.
SEE THERMON DWG. 75-258A.

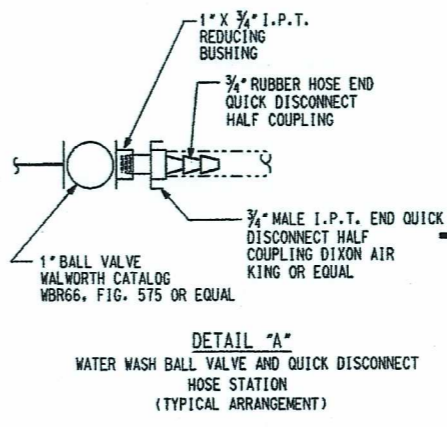

Handwritten signature/initials: O.D. 14