RC=CEL:(55,100)FORMATS.CEL AC=E7749

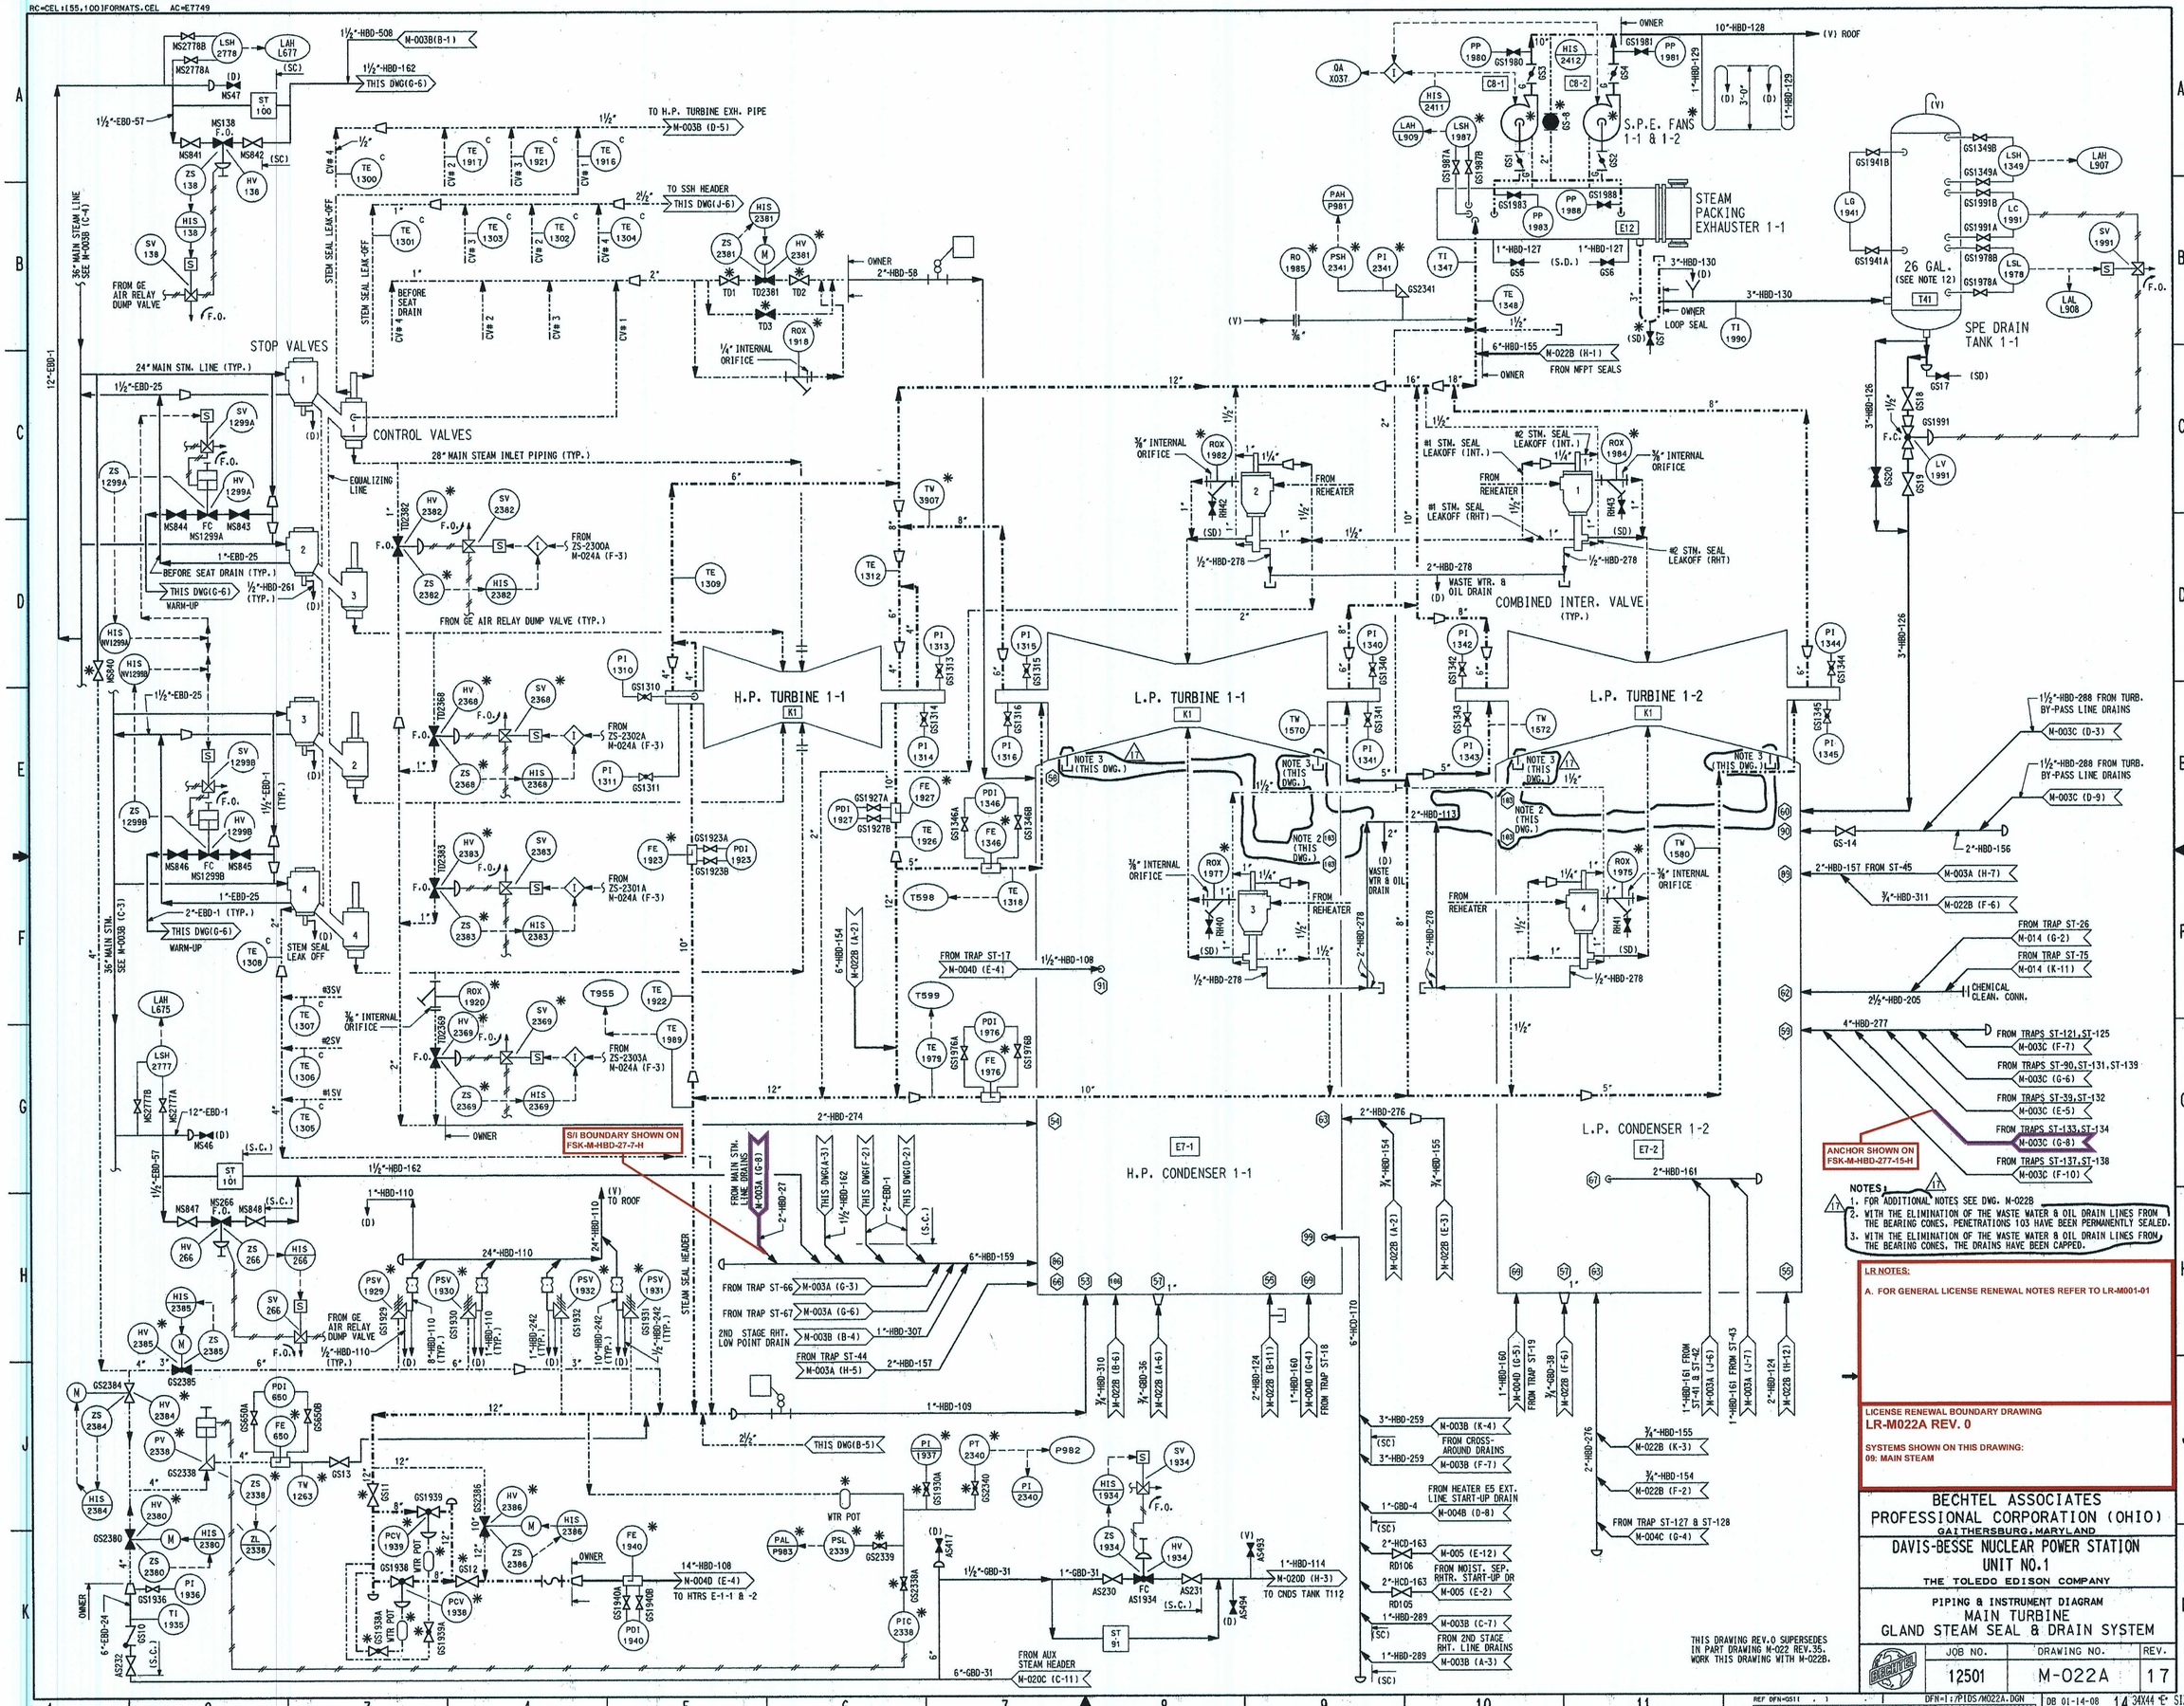

NOTES:
1. FOR ADDITIONAL NOTES SEE DWG. M-022B
2. WITH THE ELIMINATION OF THE WASTE WATER & OIL DRAIN LINES FROM THE BEARING CONES, PENETRATIONS 103 HAVE BEEN PERMANENTLY SEALED.
3. WITH THE ELIMINATION OF THE WASTE WATER & OIL DRAIN LINES FROM THE BEARING CONES, THE DRAINS HAVE BEEN CAPPED.

LR NOTES:

A. FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01

LICENSE RENEWAL BOUNDARY DRAWING
LR-M022A REV. 0

SYSTEMS SHOWN ON THIS DRAWING:
09: MAIN STEAM

BECHTEL ASSOCIATES PROFESSIONAL CORPORATION (OHIO)
GAITHERSBURG, MARYLAND

DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1
THE TOLEDO EDISON COMPANY

PIPING & INSTRUMENT DIAGRAM
MAIN TURBINE
GLAND STEAM SEAL & DRAIN SYSTEM

JOB NO.	DRAWING NO.	REV.
12501	M-022A	17

34X44 "E" SIZE

DB 01-14-08

01D29