

Sengupta, Abhijit

From: Williams, Charles R. [Charles.Williams@pgnmail.com]
Sent: Thursday, December 17, 2009 11:19 AM
To: Lake, Louis; Thomas, George; nausdj@ornl.gov; Carrion, Robert
Cc: Miller, Craig L
Subject: Draft FM 2.2 for Review
Attachments: FM 2.2 .pptx; FM2.2 x 1 - pump and bucket - Pour729RB.pdf; FM2.2 x 2 - SP5618.pdf; FM2.2 x 3 - Pour data summary CR3.pdf; FM2.2 x 4 - photos.pdf; FM2.2 x 5 - Pour528RBElev103-joints.pdf; FM2.2 x 6 pouring in Pour712RBElev210.pdf

Mr Lake and Others,

Attached for you review is the draft of FM 2.2 with attachments. If you have any questions, please contact me or Craig Miller.

Thank you,
Charles Williams

PROJECT: CRYSTAL RIVER UNIT NO. 3	FLORIDA POWER CORPORATION NONCONFORMANCE AND CORRECTIVE ACTION REPORT		DISTRIBUTION: White: Quality Engineer Green: Dir. Gen. Construction Pink: Mgr. Gen. Q. & S. Blue: Extra Copy Goldenerod: Extra Copy
ITEM: Pour #528 RB.	QTY: 1	VENDOR/CONTRACTOR: J A Jones	
P. O. NO. NA	RMR NO.: NA	R.O. / SPEC. NO.: SP 5618	DWG. NO.: SC-421-036 Rev 8
NONCONFORMING CHARACTERISTICS:	NONCONFORMANCE DESCRIPTION: Grout layer on construction joints of Reactor Bldg exterior walls Concrete with slump of 1½" was mixed with the second yard of grout and applied to the 98' level construction joint between buttress 3 and 7. The grout and concrete mixture covered the joint for about 15'. This violates paragraph 9.01.2 of SP 5618 Pd&P		
	INSPECTOR: C C MacLean		DATE: 7-25-72
REQUIRED DISPOSITION AND CORRECTIVE ACTION:			
DISPOSITION:	Accept concrete/grout mixture as applied. It has been standard construction practice to alternate concrete and grout to facilitate the pumping of the grout applied to construction joints.		
CORRECTIVE ACTION: Instruct superintendents to insure that only grout is placed on construction joints per JAJ work procedure W-5. (See attached letter.)			
ATTACH REQUEST FOR WAIVER FORM NO. Q-01C IF APPLICABLE		WAIVER SER. NO.	
SITE ACCEPTANCE: 13 SEP 72 C. Paclay DIR. GEN CONST.	SITE REVIEW APPROVAL: DIR. GEN. CONST.	BOARD REVIEW APPROVAL: DIR. GEN CONST.	
QUALITY ENGR: J. H. Reid, Jr. 9-13-72	QUALITY ENGR. CONTR. - MGR.	DIR. GEN. ENG'G. MGR. GEN. Q. & S.	
REPAIR/REWORK-ENGRG. APPROVAL: N/A	REPAIR COMPLETE-QUALITY ACCEPTANCE BY: INSPECTOR: C. C. MacLean DATE: 9/10/72		
REPAIR/REWORK PROCEDURE REQUIRED. N/A	REPAIR/REWORK PROCEDURE NO.: N/A		
FILE - ORIG & PKG. WITH POUR #528 RB ✓			
		NO. 0099	
FORM NO: Q-008 - Rev. December 15, 1971			

J. A. JONES CONSTRUCTION COMPANY
CONTRACTORS AND ENGINEERS

To: All Concerned

From: E. P. Shows

Date: July 28, 1972



Re: Placement of Grout
on Construction Joints.

Work Procedure JAJ W-5 requires 1/2" of Lean Grout on Concrete Construction Joints on the exterior wall of the Reactor Containment Building. If concrete is used to facilitate pumping grout care must be taken by Labor Crews to insure concrete and grout mixture is placed on top of grout and not on concrete.


E. P. Shows

cc: J. Hobbs
B. Browne
B. Miller
R. Griffis

EPS:jc

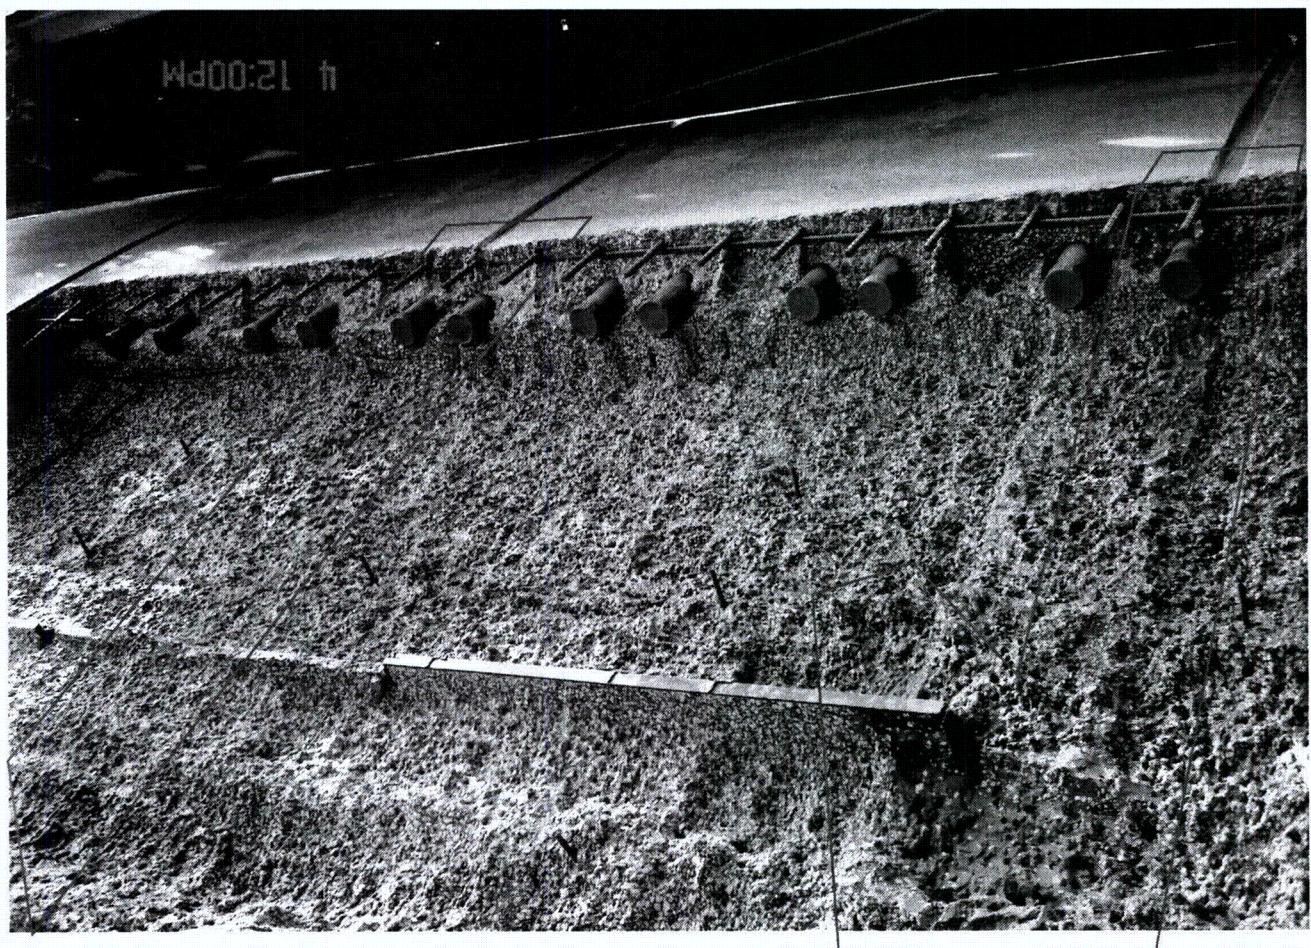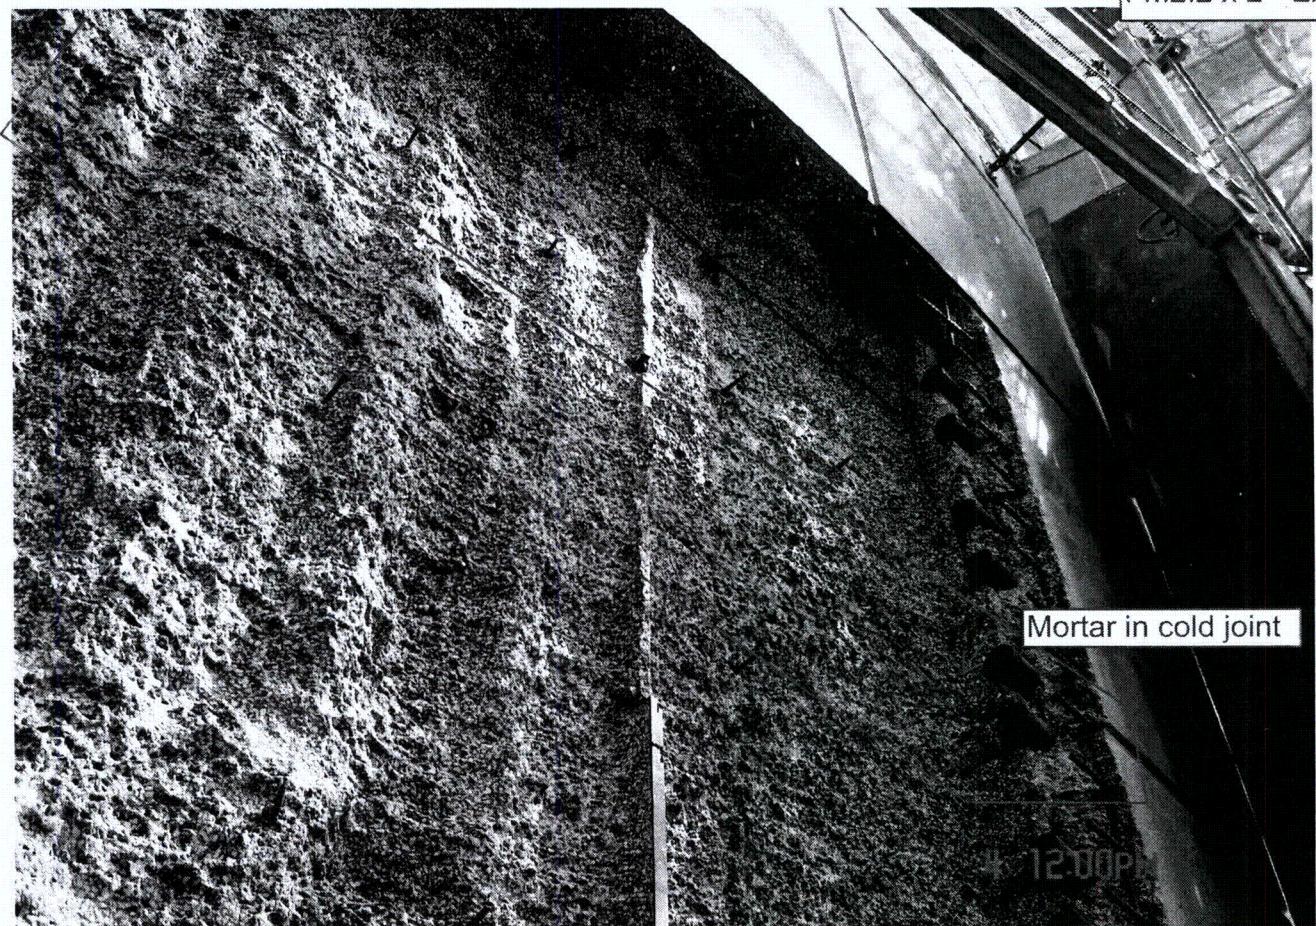



FM2.2 x 2 - Exhibit 4



4:01.2 Horizontal and vertical construction joints in the reactor building cylindrical shell and dome shall be prepared for receiving the next pour by either sandblasting, air water jet, bush hammering, or other means to remove all coatings, stains, debris or other foreign material. The horizontal joints shall be dampened (but not saturated), then thoroughly covered with a coat of neat cement mortar of similar proportions to the mortar in the concrete. The mortar shall be at least 1/2 inch thick and fresh concrete shall be placed before the mortar has attained its initial set. The vertical joints shall be dampened (but not saturated) before concrete is placed.

4:02 Expansion Joints

4:02.1 Premolded expansion joint filler shall conform to "Spec. for Pre-formed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Non-bituminous Types)," ASTM D 1752-66.

4:02.2 The location size and detail of fillers shall be as shown on the Drawings.

4:02.3 The expansion joints shall be sealed with a material compatible with the premolded expansion joint filler.

4:03 Water Stops

4:03.1 Water stops shall be polyvinyl chloride water stop of the dumbbell, bulb or serrated type as manufactured by W. R. Grace & Co. or approved equal. The location, size and detail of water stops will be as shown on the Drawings.

4:03.2 Vulcanizing of water stop shall be inspected and approved by the Inspector or OWNER. Nailing of water stop shall be free of oil, grease, grout, or any other material that prevents good seal.

5:00 QUALITY CONTROL

5:01 Concrete

5:01.1 Each week the CONTRACTOR shall submit to the ENGINEER a concrete pour schedule. (This schedule will give the ENGINEER advance notice so he may check the drawings ahead of time and help eliminate possible problems before pour time.)

The CONTRACTOR shall initiate a concrete pour checkout form to assure that all crafts have completed their work prior to concrete placement. After the form has been signed by each craft, it shall be given to the TESTING LABORATORY and/or ENGINEER prior to concrete placement. This form shall be kept as a record for that pour. Each pour shall have a checkout form.

*See add. A

*See addendum B

See add E. * * * * *

- 5:01.2 The CONTRACTOR shall be responsible for the preparation of written procedure(s) to set forth how the work to be performed under the specification will be carried out. The party performing the work shall also prepare a written quality control procedure setting forth what tests will be executed to substantiate compliance with the specification. Such written procedures shall be submitted to the ENGINEER for review and comment. These procedures shall be written prior to the starting of any of the work.
- 5:01.3 Prior to placing of concrete on compacted fill, the fill shall be checked for the percentage compaction required under Section 2:01.1. The subgrade shall be free of debris and organic material and shall be wetted thoroughly.
- 5:01.4 Before concrete is placed on a hardened concrete surface, it shall be free of laitance and foreign material. Horizontal and vertical construction joints in the reactor building cylindrical shell and dome shall be prepared for receiving the next pour by either sand-blasting, air water jet, bush hammering, or other means to remove all coatings, stain, debris, or other foreign material.
- 5:01.5 In conveying of concrete from mixer to concrete in place, only those methods and arrangements of equipment should be used which will reduce to a minimum any separation of coarse aggregate from the concrete. Equipment should be capable of expeditiously handling and placing concrete of such a proper consistency, grading, and maximum size of aggregate, at the rate most favorable to good quality and workmanship. The conveying equipment shall be in accordance with ACI 301-67, Chapter 8 and ASTM C-94-67.
- 5:01.6 If concrete is deposited on a hardened concrete surface, a 1/2 inch layer of neat grout shall be applied before concrete is deposited. Concrete shall be deposited continuously and in horizontal layers not exceeding 18 inches, avoiding inclined construction joints. It is important that each layer be shallow enough so as to be placed while the previous layer is still soft and that the two layers be vibrated together. No concrete shall be deposited in concrete which has hardened sufficiently to cause the formation of seams or planes of weakness within the section. Concrete shall be placed with the required consistency to assure proper workability. The placing of concrete around reinforcing and embedded items shall be by methods that will not cause movement or damage. The maximum free fall of concrete shall be three feet.
- 5:01.7 All concrete shall be consolidated by vibration, spading, or rodding so that the concrete is thoroughly worked around the reinforcement, embedded items, and into corners of forms, eliminating all air or rock pockets which may cause honeycombing, pitting, or planes of weakness. If vibrators are used, they shall have adequate power and be of high frequency, rugged, and reliable. When immersed in concrete, the vibrator shall have a minimum frequency of 7000 rpm's. Over-vibrating and the use of vibrators to transport concrete within the

★ ★ ★ ★ file add. 5
- 3 -

DWP → Pour 712
120410GILBERT ASSOCIATES, INC.
QUALITY ASSURANCE REPORT

SURVEILLANCE OF CONCRETE PLACEMENT

CLIENT FLA. POWER CORP
UNIT CRYSTAL RIVER No. 3

PREPARED BY T. SOKACI

SHEET 1 OF 3

DATE FEB. 16, 1973 CONTRACTOR PTL, J.A. JONES

AREA OF PLACEMENT REACT. BLDG EXT., BUTT 3-4

COMPLIANCE

A. EQUIPMENT

YES NO

1. Are hoppers spaced close enough to prevent concrete from moving laterally more than a short distance N/A
2. Are conveyors free of dry mortar and foreign matter N/A
3. Are chutes rounded and clean (no build-up on sides) N/A
4. Are wheelbarrows and buggies clean N/A
5. Are buckets clean and free of old concrete in corners N/A
6. Is equipment placed to cover entire placement without delay for repositioning equipment X
7. Are pump hoppers free of concrete build-up X
8. Are elephant trunks long enough to reach bottom of a deep wall form X
9. Are vibrators of proper size for this type of placement X
10. Are sufficient numbers of vibrators at placement site X
11. Are spare vibrators available X

COMPLIANCE

YES NO

1. Are the old surfaces and forms wetted down before placement Not Checked
2. Is grout used before placement on old surface Not Checked
3. Are personnel watching for form movement X
4. Is area clear for placement (no stored material or other debris that may cause delays or hinder the operation) X
5. If chutes are used, is the slope approximately 1:2 or 2% N/A
6. If conveyor belts are used are baffles placed at the end of each section N/A
7. Are long lines of belts covered to prevent drying N/A
8. When chutes and belts are flushed, is the water diverted away from the forms N/A
9. When concrete is pumped, is the concrete at the point of ejection of a uniform consistency X
10. When concrete is pumped is a communication system set-up between the pump and point of placement X
11. Is concrete placed on a slope placed from the bottom to the top of the slope. N/A

PITTSBURGH TESTING LABORATORY

FM2.2 Exhibit 1

ESTABLISHED 1911
PITTSBURGH, PA.

Order No. TA-7732

ALL MATERIAL TESTED BY US IS THE PROPERTY OF OUR CLIENTS. ALL REPORTS ARE SUBMITTED AS THE CONFIDENTIAL PROPERTY OF CLIENTS, AND AUTHORIZATION FOR PUBLICATION OF STATEMENTS, CONCLUSIONS OR EXTRACES FROM OR REGARDING OUR REPORTS IS RESERVED PENDING OUR WRITTEN APPROVAL.

**REPORT
of CONCRETE PLACEMENT**

REPORTED TO: FLORIDA POWER CORP.
PROJECT: CRYSTAL RIVER PLANT UNIT NO. 3
Concrete Supplier: West Coast Concrete, Inc.
Arch-Engineer: Gilbert Assoc., Inc.
General Contractors: J. A. Jones

Inspector: *Frank G. Gibbons*
T. GIBBONNEY, P.T.E.

Location: _____ POUR: 729 RB Date 3-1-73

SUBGRADE INSPECTION: NA

JOINT PREPARATION: OK

FORMS:

Properly Coated
 Free From Holes
 Seams Tight
 Clean
 Proper Shoring & Supports
 Alignment

REINFORCEMENTS:

Proper Clearance
 Proper Support
 Clean
 No. Tie Rods OK
 Location Tie Rods varied

EMBEDDED ITEMS: (List)

Conforms to dwgs.

EQUIPMENT:

No. & Size of Vibrators 6 - 10,500 Frequency plus

Placement Equipment 2 - 6" Whiteman Concrete Pumps and 1 - 5 yd. bucket

Tremie Pipes - Number NA Size NA Location NA

PLACEMENT:

Consolidation Procedure Mechanical Vibration

Grouted Yes Time 12:30 - 12:45 PM Location Lower Const. Jt.

Concrete - Lift Depth 18" max. Direction of Pour N to S; S to N.

REMARKS: Exceptions: None

CC: 2 - J.W. Quality Records

3 - P.T.L.

T:3-5-3-4

PITTSBURGH TESTING LABORATORY

Ross T. McGillivray
Ross T. McGillivray, P.T.E.

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used
						Cement	Total water		Ambient	Concrete					
RB-0015	7/19/1972	522	DM-5 mod	150	926				79	59	7.00			Rejected due to over slump	0.00
RB-0015	7/19/1972	522	DM-5 mod	149	950	4080	1658	0.41	82	64	3.00	3.4			5.98
RB-0015	7/19/1972	522	DM-5 mod	183	1010	4068	1668	0.41	82	67	2.25				5.96
RB-0015	7/19/1972	522	DM-5 mod	152	1042	4110	1661	0.40	83	67	2.75	3.5	1926		6.03
RB-0015	7/19/1972	522	DM-5 mod	150	1112	4098	1665	0.41	85	63	2.75				6.01
RB-0015	7/19/1972	522	DM-5 mod	147	1132	4092	1652	0.40	86	62	3.00				6.00
RB-0015	7/19/1972	522	DM-5 mod	154	1149	4092	1652	0.40	86	63	3.75			Rejected due to over slump	0.00
RB-0015	7/19/1972	522	DM-5 mod	183	1207	4092	1655	0.40	88	65	2.25				6.00
RB-0015	7/19/1972	522	DM-5 mod	149	1221	4092	1652	0.40	88	62	2.00			added 24# cement manually	6.00
RB-0015	7/19/1972	522	DM-5 mod	152	1240	4086	1658	0.41	88	67	1.75			added 60# cement manually	5.99
RB-0015	7/19/1972	522	DM-5 mod	150	1246	4086	1652	0.40	88	64	2.75				5.99
RB-0015	7/19/1972	522	DM-5 mod	147	1257	4092	1655	0.40	86	65	2.00	3.4	1927		6.00
RB-0015	7/19/1972	522	DM-5 mod	154	1306	4092	1661	0.41	86	65	2.50				6.00
RB-0015	7/25/1972	528	SCM	149	813	6960	2760	0.40	78	56				G100 Grout	6.00
RB-0015	7/25/1972	528	DM-5 mod	150	803	4092	1664	0.41	78	59	2.75			Projected due to over slump	0.00
RB-0015	7/25/1972	528	DM-5 mod	154	830	4080	1658	0.41	78	59	1.50			5 yd Rejected as unworkable	1.43
RB-0015	7/25/1972	528	DM-5 mod	183	857	4080	1658	0.41	78	62	1.75				5.98
RB-0015	7/25/1972	528	DM-5 mod	181	922	4098	1658	0.40	82	63	1.00				6.01
RB-0015	7/25/1972	528	DM-5 mod	147	956	4104	1655	0.40	82	61	2.25				6.02
RB-0015	7/25/1972	528	DM-5 mod	152	1021	4086	1660	0.41	84	60	5.00			Rejected due to over slump	0.00
RB-0015	7/25/1972	528	DM-5 mod	156	1046	4086	1658	0.41	88	63	2.50	3.6	1932		5.99
RB-0015	7/25/1972	528	DM-5 mod	149	1052	4092	1655	0.40	88	62	2.50				6.00
RB-0015	7/25/1972	528	DM-5 mod	154	1136	4092	1664	0.41	88	66	2.75				6.00
RB-0015	7/25/1972	528	DM-5 mod	183	1200	4086	1658	0.41	88	64	1.50				5.99
RB-0015	7/25/1972	528	DM-5 mod	158	1247	4098	1658	0.40	88	66	2.50				6.01
RB-0015	7/25/1972	528	DM-5 mod	150	1331	4098	1657	0.40	90	64	2.50	3.7	1934		6.01
RB-0015	12/6/1972	634	727550-2	140	1016	4512	1714	0.38	70	60	2.50			Grout	0.00
RB-0015	12/6/1972	634	727550-2	148	1023	4500	1717	0.38	80	60	3.00				6.00
RB-0015	12/6/1972	634	727550-2	151	1026	4512	1714	0.38	80	63	3.25				6.02
RB-0015	12/6/1972	634	727550-2	150	1037	4512	1722	0.38	80	62	3.75				6.02
RB-0015	12/6/1972	634	727550-2	152	1049	4488	1716	0.38	80	60	4.00				5.98
RB-0015	12/6/1972	634	727550-2	182	1103	4488	1716	0.38	80	57	7.00			Rejected due to over slump	0.00
RB-0015	12/6/1972	634	727550-2	147	1125	4548	1716	0.38	80	59	8.00			Rejected due to over slump	0.00
RB-0015	12/6/1972	634	727550-2	181	1134	4512	1716	0.38	82	62	3.75				6.02
RB-0015	12/6/1972	634	727550-2	154	1144	4524	1716	0.38	82	60	4.25			Rejected due to over slump	0.00
RB-0015	12/6/1972	634	727550-2	183	1206	4500	1724	0.38	82	58	4.00	4.3	2064		6.00
RB-0015	12/6/1972	634	727550-2	152	1217	4512	1718	0.38	82	58	4.00				6.02
RB-0015	12/6/1972	634	727550-2	182	1235	4506	1742	0.39	82	58	4.00				6.01
RB-0015	12/6/1972	634	727550-2	149	1231	4530	1718	0.38	82	58	3.25				6.04
RB-0015	12/6/1972	634	727550-2	147	1200	4512	1747	0.39	82	58	3.00				6.02
RB-0015	12/6/1972	634	727550-2	150	1250	4494	1728	0.38	82	58	2.00	3.2	2065	3 yd rejected for overtime	2.99
RB-0015	12/6/1972	634	727550-2	148	1258	4512	1714	0.38	82	59	4.00			2 yd rejected for overtime	4.02
RB-0015	12/6/1972	634	727550-2	181	1304	4500	1717	0.38	80	58	2.75			4 yd rejected for overtime	2.00
RB-0015	12/6/1972	634	727550-2	151	1309	4494	1717	0.38	82	60	2.50			1 yd rejected for overtime	4.99
RB-0015	12/6/1972	634	727550-2	154	1321	4512	1720	0.38	81	65	1.50			Rejected due to under slump	0.00
RB-0015	12/6/1972	634	727550-2	183	1327	4494	1715	0.38	82	59	2.75			3 yd rejected for overtime	2.99
RB-0015	12/6/1972	634	727550-2	182	1429	4506	1715	0.38	82	54	3.50				6.01
RB-0015	12/6/1972	634	727550-2	152	1444	4494	1715	0.38	82	54	3.25				5.99
RB-0015	12/6/1972	634	727550-2	149	1448	4482	1721	0.38	80	54	3.50				5.98
RB-0015	12/6/1972	634	727550-2	147	1455	4550	1715	0.38	75	54	3.75				6.07
RB-0015	12/6/1972	634	727550-2	150	1515	4488	1718	0.38	78	54	3.25	3.0	2066		5.98
RB-0015	12/6/1972	634	727550-2	148	1535	4494	1715	0.38	78	52	3.00				5.99
RB-0015	12/6/1972	634	727550-2	181	1550	4494	1714	0.38	78	53	3.75				5.99
RB-0015	12/6/1972	634	727550-2	151	1355	4506	1717	0.38	78	51	3.75				6.01
RB-0015	12/6/1972	634	727550-2	182	1427	4506	1717	0.38	69	55	3.75				6.01
RB-0015	12/6/1972	634	727550-2	152	1442	4512	1717	0.38	69	52	4.00			3 yd not used- pour complete	3.02
RB-0015	12/9/1972	641	SCM	183	628	6966	2753	0.40	65					Grout	6.01
RB-0015	12/9/1972	641	727550-2	190	905	4500	1742	0.38	65	50	0.50			2 yd rejected for overtime	0.04
RB-0015	12/9/1972	641	727550-2	150	649	4566	1722	0.38	65	54	3.00			2 yd rejected for overtime	4.09
RB-0015	12/9/1972	641	727550-2	180	654	4500	1719	0.38	65	55	3.25				6.00
RB-0015	12/9/1972	641	727550-2	148	700	4530	1722	0.38	68	57	2.50			1 yd rejected for overtime	5.04
RB-0015	12/9/1972	641	727550-2	151	706	4512	1722	0.38	67	56	3.00	3.5	2071	1 yd rejected for overtime	5.02
RB-0015	12/9/1972	641	727550-2	147	748	4494	1718	0.38	67	57	3.75				5.99
RB-0015	12/9/1972	641	727550-2	149	803	4506	1723	0.38	67	54	4.25				6.01
RB-0015	12/9/1972	641	727550-2	152	817	4500	1717	0.38	68	55	4.50			1 yd rejected for overtime	5.00
RB-0015	12/9/1972	641	727550-2	183	830	4500	1720	0.38	68	57	3.50			1 yd rejected for overtime	5.00
RB-0015	12/9/1972	641	727550-2	182	834	4512	1720	0.38	72	54	4.00	4.00	2072	2 yd rejected for overtime	4.02
RB-0015	12/9/1972	641	727550-2	180	846	4506	1714	0.38	76	56	4.25			1 yd rejected for overtime	6.01
RB-0015	12/9/1972	641	727550-2	150	853	4506	1717	0.38	76	54	3.75				6.03
RB-0015	12/9/1972	641	727550-2	148	900	4524	1717	0.38	78	53	4.00			1 yd rejected for overtime	5.04
RB-0015	12/9/1972	641	727550-2	151	904	4530	1720	0.38	78	54	4.00			3 yd rejected for overtime	3.05
RB-0015	12/9/1972	641	727550-2	147	923	4536	1713	0.38	78	59	3.00			1 yd rejected for overtime	1.98
RB-0015	12/9/1972	641	727550-2	149	1008	4482	1716	0.38	80	59	4.00			4 yd rejected for overtime	4.00
RB-0015	12/9/1972	641	727550-2	180	1011	4500	1719	0.38	80	58	4.50			2 yd rejected for overtime	4.00
RB-0015	12/9/1972	641	727550-2	154	1026	4518	1716	0.38	80	59	3.00			3 yd rejected for overtime	3.02
RB-0015	1														

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used
						Cement	Total water		Ambient	Concrete					
RB-0015	12/9/1972	641	727550-2	151	1111	4512	1715	0.38	82	58	3.25	3.0	2073	3 yd rejected for overtime	3.02
RB-0015	12/9/1972	641	727550-2	147	1121	4506	1715	0.38	82	57	3.50			4 yd rejected for overtime	2.01
RB-0015	12/9/1972	641	727550-2	144	1135	4500	1709	0.38	82	59	4.25			3 yd rejected for overtime	3.00
RB-0015	12/9/1972	641	727550-2	150	1209	4512	1717	0.38	82	58	4.50			4 yd rejected for overtime	2.02
RB-0015	12/9/1972	641	727550-2	182	1226	4500	1720	0.38	82	58	4.50			3 yd rejected for overtime	3.00
RB-0015	12/9/1972	641	727550-2	180	1239	4512	1719	0.38	82	58	4.00			2 yd rejected for overtime	4.02
RB-0015	12/9/1972	641	727550-2	168	1249	4500	1716	0.38	84	58	4.25			5 yd rejected for overtime	1.00
RB-0015	12/9/1972	641	727550-2	174	1309	4510	1722	0.38	84	56	4.25			3 yd rejected for overtime	3.01
RB-0015	12/9/1972	641	727550-2	148	1323	4512	1716	0.38	84	57	4.50			5 yd rejected for overtime	1.02
RB-0015	12/9/1972	641	727550-2	151	1342	4506	1716	0.38	86	57	4.50			2 yd rejected for overtime	4.01
RB-0015	12/9/1972	641	727550-2	149	1358	4500	1716	0.38	84	58	3.75				6.00
RB-0015	12/9/1972	641	727550-2	152	1413	4524	1716	0.38	84	57	3.75				6.03
RB-0015	12/9/1972	641	727550-2	150	1427	4506	1716	0.38	84	58	3.50			1 yd rejected for overtime	5.01
RB-0015	12/9/1972	641	727550-2	147	1434	4506	1721	0.38	83	58	3.75			4 yd rejected for overtime	2.01
RB-0015	12/9/1972	641	727550-2	180	1449	4524	1716	0.38	84	58	3.25				6.03
RB-0015	12/9/1972	641	727550-2	154	1503	4496	1716	0.38	84	58	4.50			3 yd rejected for overtime	2.99
RB-0015	12/9/1972	641	727550-2	182	1524	4494	1757	0.39	84	58	4.00				5.99
RB-0015	12/9/1972	641	727550-2	148	1534	4500	1715	0.38	84	58	4.00			3 yd rejected for overtime	3.00
RB-0015	12/9/1972	641	727550-2	151	1550	4500	1715	0.38	84	58	4.50			1 yd rejected for overtime	5.00
RB-0015	12/9/1972	641	727550-2	149	1610	4512	1715	0.38	84	56	4.50				6.02
RB-0015	12/9/1972	641	727550-2	183	1621	4482	1715	0.38	82	57	4.00				5.98
RB-0015	12/9/1972	641	727550-2	152	1636	4488	1715	0.38	82	55	3.50				5.98
RB-0015	12/9/1972	641	727550-2	180	1643	4512	1715	0.38	75	58	7.75				6.02
RB-0015	12/9/1972	641	727550-2	147	1633	4506	1715	0.38	74	57	4.00				6.01
RB-0015	12/9/1972	641	727550-2	150	1716	4512	1718	0.38	75	53	4.50				6.02
RB-0015	12/9/1972	641	727550-2	154	1727	4542	1739	0.38	75	53	3.75				6.06
RB-0015	12/9/1972	641	727550-2	182	1742	4512	1717	0.38	74	58	3.75				6.02
RB-0015	12/9/1972	641	727550-2	149	1757	4536	1714	0.38	72	52	4.00				6.05
RB-0015	12/9/1972	641	727550-2	183	1825	4518	1714	0.38	55	55	3.75				6.02
RB-0015	12/9/1972	641	727550-2	151	1833	4518	1711	0.38	71	55	3.00			3.0	2074
RB-0015	12/9/1972	641	727550-2	183	1825	4518	1714	0.38	71	55	3.75				6.02
RB-0015	12/9/1972	641	727550-2	151	1833	4518	1711	0.38	71	55	3.00			3.0	2075
RB-0015	12/9/1972	641	727550-2	147	1840	4512	1717	0.38	72	55	3.50				6.02
RB-0015	12/9/1972	641	727550-2	152	1850	4524	1717	0.38	71	55	3.00				6.03
RB-0015	12/9/1972	641	727550-2	180	1909	4494	1714	0.38	72	55	3.75			2 yd rejected for overtime	3.99
RB-0015	12/9/1972	641	727550-2	150	1927	4500	1716	0.38	71	53	4.50				6.00
RB-0015	12/9/1972	641	727550-2	154	1940	4506	1719	0.38	72	56	3.25				6.01
RB-0015	12/9/1972	641	727550-2	149	2015	4506	1719	0.38	72	52	3.00				6.01
RB-0015	12/9/1972	641	727550-2	182	2055	4476	1716	0.38				Rejected			0.00
RB-0015	12/9/1972	641	727550-2	183	2127	4500	1719	0.38	70	56	3.00			3 yd not used- pour complete	3.00
RB-0015	1/7/1973	666	SCM	183	712	3474	1386	0.40	67			Grout			2.99
RB-0015	1/7/1973	666	SCM	180	722	3492	1394	0.40	67			Grout			3.01
RB-0015	1/7/1973	666	727550-2	148	735	4470	1728	0.39				Projected due to under dump			0.50
RB-0015	1/7/1973	666	727550-2	147	748	4476	1758	0.39	67	56	4.50			Rejected	0.00
RB-0015	1/7/1973	666	727550-2	149	802	4476	1736	0.39	67	55	4.25				5.97
RB-0015	1/7/1973	666	727550-2	268	806	4482	1727	0.39	67	55					5.97
RB-0015	1/7/1973	666	727550-2	301	810	4470	1715	0.38	67	56	3.75				5.98
RB-0015	1/7/1973	666	727550-2	256	815	4512	1715	0.38	67	56	4.50				5.96
RB-0015	1/7/1973	666	727550-2	181	820	4524	1718	0.38	67	55	4.25				6.02
RB-0015	1/7/1973	666	727550-2	180	828	4482	1720	0.38	67	55	4.50			4 yd rejected	1.98
RB-0015	1/7/1973	666	727550-2	150	832	4476	1711	0.38	68	55	4.50			6 yd rejected for overtime	0.00
RB-0015	1/7/1973	666	727550-2	147	924	4470	1715	0.38	68	55	3.75				5.96
RB-0015	1/7/1973	666	727550-2	182	940	4506	1718	0.38	68	55	4.00				6.01
RB-0015	1/7/1973	666	727550-2	256	955	4476	1718	0.38	68	54	4.00				5.97
RB-0015	1/7/1973	666	727550-2	301	1000	4476	1715	0.38	68	52	4.00				5.97
RB-0015	1/7/1973	666	727550-2	183	1016	4518	1713	0.38	69	53	4.25				6.02
RB-0015	1/7/1973	666	727550-2	181	1028	4506	1718	0.38	67	54	4.25				6.01
RB-0015	1/7/1973	666	727550-2	180	1033	4470	1721	0.39	67	55	4.50				5.96
RB-0015	1/7/1973	666	727550-2	150	1039	4470	1715	0.38	67	54	3.75				5.96
RB-0015	1/7/1973	666	727550-2	182	1044	4482	1711	0.38	67	55	3.75				5.98
RB-0015	1/7/1973	666	727550-2	256	1058	4482	1715	0.38	66	54	4.50				5.98
RB-0015	1/7/1973	666	727550-2	147	1116	4506	1712	0.38	66	54	4.00				6.01
RB-0015	1/7/1973	666	727550-2	268	1128	4506	1715	0.38	67	55	4.00			1 yd rejected for overtime	5.01
RB-0015	1/7/1973	666	727550-2	183	1134	4470	1715	0.38	67	54	4.50				5.96
RB-0015	1/7/1973	666	727550-2	301	1143	4470	1814	0.41	69	55	3.75				5.96
RB-0015	1/7/1973	666	727550-2	153	1148	4482	1715	0.38	69	56	4.25				3.98
RB-0015	1/7/1973	666	727550-2	180	1154	4494	1715	0.38	70	56	4.50				5.99
RB-0015	1/7/1973	666	727550-2	150	1204	4506	1715	0.38	69	53	4.00				6.01
RB-0015	1/7/1973	666	727550-2	181	1214	4454	1712	0.38	69	55	4.00			2 yd rejected for overtime	3.94
RB-0015	1/7/1973	666	727550-2	256	1223	4494	1712	0.38	69	53	4.00				5.99
RB-0015	1/7/1973	666	727550-2	147	1232	4572	1715	0.38	69	54	4.50				6.10
RB-0015	1/7/1973	666	727550-2	182	1242	4512	1715	0.38	70	54	4.00			1 yd rejected for overtime	5.02
RB-0015	1/7/1973	666	727550-2	183	1250	4500	1718	0.38	70	54	3.50				6.00
RB-0015	1/7/1973	666	727550-2	301	1326	4518	1716	0.38	70	54	3.75				6.02
RB-0015	1/7/1973	666	727550-2	210	1334	4476	1719	0.38	70	57	4.50				5.97
RB-0015	1/7/1973	666	727550-2	268											

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used	
						Cement	Total water		Ambient	Concrete						
RB-0015	1/7/1973	666	727550-2	147	1500	4500	1716	0.38	70	54	4.00				6.00	
RB-0015	1/7/1973	666	727550-2	183	1506	4482	1716	0.38	70	54	4.50	3.4	2121		5.98	
RB-0015	1/7/1973	666	727550-2	182	1513	4524	1707	0.38	70	54	4.00				6.03	
RB-0015	1/7/1973	666	727550-2	301	1521	4482	1710	0.38	70	57	3.75				5.98	
RB-0015	1/7/1973	666	727550-2	180	1533	4506	1716	0.38	70	57	3.75				6.01	
RB-0015	1/7/1973	666	727550-2	150	1547	4500	1710	0.38	70	55	3.75				6.00	
RB-0015	1/7/1973	666	727550-2	268	1558	4500	1710	0.38	70	56	4.00				6.00	
RB-0015	1/7/1973	666	727550-2	256	1610	4500	1716	0.38	70	55	4.50				6.00	
RB-0015	1/7/1973	666	727550-2	153	1622	4454	1716	0.39	70	55	4.00				5.94	
RB-0015	1/7/1973	666	727550-2	147	1635	4506	1713	0.38	70	55	4.50				6.01	
RB-0015	1/7/1973	666	727550-2	181	1648	4482	1710	0.38	70	54	4.25				5.98	
RB-0015	1/7/1973	666	727550-2	183	1652	4494	1707	0.38	70	54	4.00				5.99	
RB-0015	1/7/1973	666	727550-2	301	1655	4494	1713	0.38	68	55	4.00	3.5	2122		5.99	
RB-0015	1/7/1973	666	727550-2	180	1700	4524	1710	0.38	68	54	3.75				6.03	
RB-0015	1/7/1973	666	727550-2	268	1708	4506	1716	0.38	68	55	4.25				6.01	
RB-0015	1/7/1973	666	727550-2	153	1713	4476	1710	0.38	68	55	4.50				5.97	
RB-0015	1/7/1973	666	727550-2	150	1717	4506	1719	0.38	68	55	4.50				6.01	
RB-0015	1/7/1973	666	727550-2	182	1727	4500	1707	0.38	68	56	4.50	3.6	2123		6.00	
RB-0015	1/7/1973	666	727550-2	256	1735	4470	1713	0.38			6.50			Rejected due to over slump	0.00	
RB-0015	1/7/1973	666	727550-2	149	1744	4482	1710	0.38	67	54	4.25				5.98	
RB-0015	1/7/1973	666	727550-2	181	1552	4482	1716	0.38	65	52	5.00			Rejected due to over slump	0.00	
RB-0015	1/7/1973	666	727550-2	183	1803	4500	1707	0.38	65	52	3.50				6.00	
RB-0015	1/7/1973	666	727550-2	268	1807	4506	1713	0.38	65	52	3.25				6.01	
RB-0015	1/7/1973	666	727550-2	180	1822	4494	1785	0.40	65	53	3.25				5.99	
RB-0015	1/7/1973	666	727550-2	153	1827	4512	1716	0.38	65	54	3.50				6.02	
RB-0015	1/7/1973	666	727550-2	150	1842	4494	1719	0.38	64	53	3.75				5.99	
RB-0015	1/7/1973	666	727550-2	181	1848	4494	1720	0.38	64	54	3.75				5.99	
RB-0015	1/7/1973	666	727550-2	182	1853	4494	1719	0.38	65	54	4.00	3.4	2124	2 yd rejected- pour complete	3.99	
RB-0015																
RB-0015	1/19/1973	681	SCM	153	1420	3480	1379	0.40	70	54				Grout	3.00	
RB-0015	1/19/1973	681	SCM	147	1425	3504	1380	0.39	70	54				Grout	3.02	
RB-0015	1/19/1973	681	DM-5	148	1436	4092	1657	0.40	70	58	3.00				6.00	
RB-0015	1/19/1973	681	DM-5	183	1450	4116	1657	0.40	70	61	2.50				6.04	
RB-0015	1/25/1973	685	SCM	153	950	3486	1380	0.40	58					Grout	3.01	
RB-0015	1/25/1973	685	SCM	150	958	3480	1383	0.40	58					Grout	3.00	
RB-0015	1/25/1973	685	DM-5 mod	149	1003	4086	1656	0.41	58	50	3.00					5.99
RB-0015	1/25/1973	685	DM-5 mod	154	1016	4092	1656	0.40						Truck Rejected	0.00	
RB-0015	1/25/1973	685	DM-5 mod	182	1023	4086	1658	0.41	58	51	2.75				5.99	
RB-0015	1/25/1973	685	DM-5 mod	150	1105	4092	1656	0.40	60	51	2.25				6.00	
RB-0015	1/25/1973	685	DM-5 mod	153	1105	4092	1653	0.40	60	50	2.50	3.5	2157	4 yd rejected	2.00	
RB-0015	1/25/1973	685	DM-5 mod	149	1120	4086	1653	0.40	60	50	2.50				5.99	
RB-0015	1/25/1973	685	DM-5 mod	182	1130	4092	1652	0.40	60	52	2.50				6.00	
RB-0015	1/25/1973	685	DM-5 mod	150	1155	4104	1659	0.40	60	52	3.00				6.02	
RB-0015	1/25/1973	685	DM-5 mod	152	1230	4110	1656	0.40	64	56	3.00				6.03	
RB-0015	1/25/1973	685	DM-5 mod	149	1237	4104	1653	0.40	64	53	3.00				6.02	
RB-0015	1/25/1973	685	DM-5 mod	153	1242	4110	1662	0.40	66						6.03	
RB-0015	1/25/1973	685	DM-5 mod	154	1251	4113	1662	0.40	66	54	2.75				6.03	
RB-0015	1/25/1973	685	DM-5 mod	182	1303	4086	1656	0.41	68	52	3.00	3.2	2158		5.99	
RB-0015	1/25/1973	685	DM-5 mod	150	1320	4092	1653	0.40	68	53	3.00				6.00	
RB-0015	1/25/1973	685	DM-5 mod	152	1332	4102	1653	0.40	68	53	3.00				6.01	
RB-0015	1/25/1973	685	DM-5 mod	149	1337	4098	1650	0.40	70	53	3.00				6.01	
RB-0015	1/25/1973	685	DM-5 mod	153	1356	4104	1656	0.40	70	55	2.75				6.02	
RB-0015	1/25/1973	685	DM-5 mod	154	1418	4092	1656	0.40	70	54	3.00			3 yd not used	3.00	
RB-0015	1/31/1973	695	SCM	182	1217	6958	2765	0.40	66					Grout	6.00	
RB-0015	1/31/1973	695	DM-5 mod	150	1300	4110	1660	0.40	61	58	2.50				6.03	
RB-0015	1/31/1973	695	DM-5 mod	154	1310	4086	1654	0.40	67	60	1.25			Rejected- Unworkable	0.00	
RB-0015	1/31/1973	695	DM-5 mod	149	1327	4116	1657	0.40	67	60	2.00				6.04	
RB-0015	1/31/1973	695	DM-5 mod	147	1333	4074	1660	0.41	67	60	2.00				5.97	
RB-0015	1/31/1973	695	DM-5 mod	182	1355	4086	1655	0.41	68	57	1.50				5.99	
RB-0015	1/31/1973	695	DM-5 mod	150	1410	4080	1657	0.41	67	57	1.75	3.6	2166		5.98	
RB-0015	1/31/1973	695	DM-5 mod	154	1429	4080	1663	0.41	66	56	3.00				5.98	
RB-0015	1/31/1973	695	DM-5 mod	149	1440	4080	1660	0.41	66	58	3.00				5.98	
RB-0015	1/31/1973	695	DM-5 mod	147	1455	4092	1657	0.40	65	58	2.75				6.00	
RB-0015	1/31/1973	695	DM-5 mod	153	1458	4074	1663	0.41	65	58	2.50				5.97	
RB-0015	1/31/1973	695	DM-5 mod	182	1503	4116	1663	0.40	65	58	2.50				6.04	
RB-0015	1/31/1973	695	DM-5 mod	150	1513	4080	1654	0.41	65	56	2.75				5.98	
RB-0015	1/31/1973	695	DM-5 mod	153	1535	4086	1662	0.41	64	57	3.00	3.5	2167		5.99	
RB-0015	1/31/1973	695	DM-5 mod	154	1550	4116	1657	0.40	64	56	2.75				6.04	
RB-0015	1/31/1973	695	DM-5 mod	147	1609	4110	1654	0.40	63	54	3.00				6.03	
RB-0015	1/31/1973	695	DM-5 mod	149	1617	4092	1657	0.40	63	55	3.00				6.00	
RB-0015	1/31/1973	695	DM-5 mod	182	1633	4086	1657	0.41	63	54	2.50				5.99	
RB-0015	1/31/1973	695	DM-5 mod	153	1725	4092	1660	0.41	67	53	3.00				6.00	
RB-0015	2/12/1973	700	SCM	149	1055	6960	2762	0.40	57					Grout	6.00	
RB-0015	2/12/1973	700	DM-5 mod	148	1104	3474	1381	0.40	48	57				GRB-0015 Grout -????	2.99	
RB-0015	2/12/1973	700	DM-5 mod	150	1110	4086	1654	0.40	48	54	3.00	3.0	2171		5.99	
RB-0015	2/12/1973	700	DM-5 mod	147	1125	4180	1657	0.40	52	54	3.00				6.13	
RB-0015	2/12/1973	700	DM-5 mod	151	1147	4086	1657	0.41	64	56	2.75				5.99	
RB-0015	2/12/1973	700	DM-5 mod	154	1225	4092	1657	0.40	65	56						

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)	w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used
								Ambient	Concrete					
RB-0015	2/12/1973	700	DM-5 mod	152	1250	4110	0.40	66	57	3.00				6.03
RB-0015	2/12/1973	700	DM-5 mod	149	1303	4128	0.40	66	58	3.00				6.05
RB-0015	2/12/1973	700	DM-5 mod	148	1322	4086	0.41	66	60	3.00				5.99
RB-0015	2/12/1973	700	DM-5 mod	150	1332	4086	0.41	66	58	3.25			Rejected- Overslump	0.00
RB-0015	2/12/1973	700	DM-5 mod	151	1345	4086	0.40	65	60	2.50				5.99
RB-0015	2/12/1973	700	DM-5 mod	154	1358	4086	0.41	65	58	3.00	3.0	2172		5.99
RB-0015	2/12/1973	700	DM-5 mod	182	1412	4068	0.41	65	58	3.00				5.96
RB-0015	2/12/1973	700	DM-5 mod	152	1425	4080	0.41	65	58	3.00				5.98
RB-0015	2/12/1973	700	DM-5 mod	148	1440	4080	0.41	64	58	2.75				5.98
RB-0015	2/12/1973	700	DM-5 mod	149	1449	4068	0.41	64	58	2.75				5.96
RB-0015	2/12/1973	700	DM-5 mod	154	1504	4068	0.41	64	58	3.00				5.96
RB-0015	2/12/1973	700	DM-5 mod	151	1520	4092	0.40	63	59	2.50				6.00
RB-0015	2/12/1973	700	DM-5 mod	150	1539	4098	0.41	64	60	2.50				6.01
RB-0012	9/18/1971	262	SCM	154	900	3486	0.40						Grout- Rejected sent to Unit 2	
RB-0012	9/18/1971	263	SCM	152	1030	3486	0.40	86	70	7.00	401		Grout - 3 yards	3.01
RB-0012	9/18/1971	263	SCM	151	1224	3510	0.39	92	70	3.00			Grout - 3 yards	3.03
RB-0012	9/18/1971	263	DM-5	147	826	5076	0.44						Rejected- sent to Unit 2	
RB-0012	9/18/1971	263	DM-5	150	1028	5080	0.43	87	70	4.00			Rejected- 4" Slump- Overslump	
RB-0012	9/18/1971	263	DM-5	154	1133	5052	0.44	88	70	2.25				7.96
RB-0012	9/18/1971	263	DM-5	183	1215	5080	0.43	92	70	2.75	4.0	1404		8.00
RB-0012	9/18/1971	263	DM-5	147	1305	5058	0.44	84	68	2.75				7.97
RB-0012	9/18/1971	263	DM-5	151	1345	5080	0.24	84	70	2.50				8.00
RB-0012	9/18/1971	263	DM-5	152	1420	5046	0.44	84	68	3.00				7.95
RB-0012	9/18/1971	263	DM-5	147	1445	5052	0.44	84	68	3.00				7.96
RB-0012	9/18/1971	263	DM-5	183	1524	5076	0.43	88	68	2.75	3.8	1405		7.99
RB-0012	9/18/1971	263	DM-5	151	1554	5070	0.43	88	67	3.00				7.98
RB-0012	9/18/1971	263	DM-5	152	1615	5070	0.44	88	68	3.00			5 yd not used	7.98
RB-0012	10/29/1971	296	SCM	152	813	2316	0.40	78					Grout	2.00
RB-0012	10/29/1971	296	SCM	147	1150	3480	0.40						Grout	3.00
RB-0012	10/29/1971	296	DM-5	151	820	5430	0.41	70	64	3.00				8.55
RB-0012	10/29/1971	296	DM-5	183	920	5070	0.44	70	64	2.25				7.98
RB-0012	10/29/1971	296	DM-5	182	1000	5064	0.44	72	66	2.00	4.2	1485		7.97
RB-0012	10/29/1971	296	DM-5	151	1158	5094	0.43	78	66	3.00				8.02
RB-0012	10/29/1971	296	DM-5	183	1245	5070	0.43	78	66	2.50				7.98
RB-0012	10/29/1971	296	DM-5	147	1320	5082	0.44	78	66	1.50				8.00
RB-0012	10/29/1971	296	DM-5	182	1420	5058	0.44	78	66	1.75				7.97
RB-0012	10/29/1971	296	DM-5	151	1503	5070	0.44	78	66	3.00	4.4	1486	1 1/4 yd used on another pour	7.98
RB-0012	10/29/1971	296	DM-5	183	1543	5094	0.43	2212		5.00			Rejected for overslump	8.02
RB-0012	10/29/1971	296	DM-5	182	1600	5064	0.44	80	64	5.50			Rejected for overslump	7.97
RB-0012	10/29/1971	296	DM-5	149	1640	5064	0.44	80	66	2.25			2 yd rejected for overtime	7.97
RB-0012	11/23/1971	326	SCM	153	1200	4638	0.40	68			G.32		Grout	4.00
RB-0012	11/23/1971	326	DM-5	182	1215	5076	0.44	72	60	3.00	5.0			7.99
RB-0012	11/23/1971	326	DM-5	152	1250	5046	0.44	72	62	1.50				7.95
RB-0012	11/23/1971	326	DM-5	154	1315	5076	0.44	72	62	3.00	4.0	1527		7.99
RB-0012	11/23/1971	326	DM-5	149	1345	5088	0.43	72	62	1.75				8.01
RB-0012	11/23/1971	326	DM-5	153	1407	5070	0.43	72	60	2.50				7.98
RB-0012	11/23/1971	326	DM-5	182	1426	5070	0.44	72	64	1.75				7.98
RB-0012	11/23/1971	326	DM-5	150	1448	5052	0.44	72	59	2.25				7.96
RB-0012	11/23/1971	326	DM-5	152	1507	5064	0.44	2207	60	2.00	3.6	1528		7.97
RB-0012	11/23/1971	326	DM-5	154	1530	5046	0.44	70	62	1.25			6 yd returned- pour complete	7.95
RB-0012	1/26/1972	362	SCM	182	1300	3486	0.40	80					Grout	
RB-0012	1/26/1972	362	DM-5	149	1240	5070	0.44	80	64	0.75				7.00
RB-0012	1/26/1972	362	DM-5	148	1333	5052	0.44	80	66	1.00	3.6	1577	2 yd sent to another pour	7.96
RB-0012	1/26/1972	362	DM-5	149	1422	5058	0.44	82	66	2.75				7.97
RB-0012	1/26/1972	362	DM-5	182	1455	5052	0.44	82	65	3.00				7.96
RB-0012	1/26/1972	362	DM-5	181	1525	5070	0.44	2207	65	5.50			Rejected for overslump	7.98
RB-0012	1/26/1972	362	DM-5	148	1545	5064	0.44	78	68	1.25			2 yds returned- pour complete	7.97
RB-0012	1/26/1972	362	DM-5	149	1620	5046	0.44	2200					Pour sent to outflow canal- pour compl	7.95
RB-0012	8/3/1972	535	SCM	149	648	3474	0.40	70	65					
RB-0012	8/3/1972	535	SCM	148	625	3473	0.40	70	65				Grout	2.99
RB-0012	8/3/1972	535	DM-5 ??	160	640	4231	0.41	70	59	3.25	5.2			0.01
RB-0012	8/3/1972	535	DM-5 ??	183	655	4218	0.41	70	60	3.75				5.98
RB-0012	8/3/1972	535	DM-5 ??	152	721	4230	0.41	73	61	4.00			3 yd rejected- ?? Reason	3.00
RB-0012	8/3/1972	535	DM-5 ??	154	735	4224	0.41	74	61	2.50	3.2	1951	4 yd rejected- ?? Reason	1.99
RB-0012	8/3/1972	535	DM-5 ??	148	803	4219	0.41	78	65	3.50			3 yd rejected for overtime	2.98
RB-0012	8/3/1972	535	DM-5 ??	180	817	4218	0.41	78	60	2.50				5.98
RB-0012	8/3/1972	535	DM-5 ??	183	918	4224	0.41	78	66	2.50			2 yd rejected for overtime	3.99
RB-0012	8/3/1972	535	DM-5 ??	148	958	4212	0.41	79	65	3.75			2 yd rejected for overtime	3.97
RB-0012	8/3/1972	535	DM-5 ??	153	1045	4212	0.41	78	64	3.75			2 yd rejected for overtime	3.97
RB-0012	8/3/1972	535	DM-5 ??	152	1133	4218	0.42	80	64	4.00				5.98
RB-0012	8/3/1972	535	DM-5 ??	180	1245	4212	0.41	82	63	2.75				5.97
RB-0012	12/11/1972	642	DM-5 ??	182	1111	4494	0.38	80	56	2.75	3.0		Rejected for under slump	0.00
RB-0012	12/11/1972	642	DM-5 ??	154	1123	4494	0.38	80	58	2.50				5.99
RB-0012	12/11/1972	642	DM-5 ??	183	1155	4494	0.38	80	57	3.25				5.99
RB-0012	12/11/1972	642	DM-5 ??	150	1204	4494	0.38	80	56	3.00			4 yd Rejected as unworkable	1.99
RB-0012	12/11/1972	642	DM-5 ??	147	1220	4518	0.38	80	56	3.75	3.2	2077	4 yd rejected for overtime	2.02

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used	
						Cement	Total water		Ambient	Concrete						
RB-0012	12/11/1972	642	DM-5 ??	182	1230	4506	1717	0.38	80	55	4.00			5 yd rejected for overtime	1.01	
RB-0012	12/11/1972	642	DM-5 ??	149	1237	4506	1714	0.38	80	56	3.75			1 yd rejected for overtime	5.01	
RB-0012	12/11/1972	642	DM-5 ??	154	1244	4500	1720	0.38	80	55	4.50			3 yd rejected for overtime	3.00	
RB-0012	12/11/1972	642	DM-5 ??	152	1323	4512	1714	0.38	79	55	4.25			3 yd rejected for overtime	3.02	
RB-0012	12/11/1972	642	DM-5 ??	183	1340	4512	1714	0.38	79	59	4.50	3.4	2078	4 yd rejected- ?? Reason	2.02	
RB-0012	12/11/1972	642	DM-5 ??	150	1414	4506	1714	0.38	79	60	4.00			3 yd sent elsewhere	3.01	
RB-0012	12/11/1972	642	DM-5 ??	147	1423	4500	1714	0.38	79	56	4.25			6 yd sent elsewhere	0.00	
RB-0012	12/11/1972	642	DM-5 ??	182	1515	4506	1717	0.38	79	56	4.50			4 yd rejected- ?? Reason	2.01	
RB-0012	12/11/1972	642	DM-5 ??	149	1527	4500	1711	0.38	79	59	3.75			3 yd rejected for overtime	3.00	
RB-0012	12/11/1972	642	DM-5 ??	154	1602	4512	1717	0.38	78	58	4.00			4 yd rejected for overtime	2.02	
RB-0012	12/11/1972	642	DM-5 ??	152	1644	4500	1719	0.38	78	60	4.25				6.00	
RB-0012	12/11/1972	642	DM-5 ??	183	1711	4518	1716	0.38	74	56	4.25			3 yd Reject- pour complete	3.02	
RB-0012	12/11/1972	642	DM-5 ??	150	1535	4500	1722	0.38	74	56	4.25			not used- pour complete	0.00	
RB-0012	12/11/1972	642	DM-5 ??	149	1810	4506	1716	0.38	74					not used- pour complete	0.00	
RB-0012	1/3/1973	658	SCM	149	855	2406	925	0.38	69					Grout	2.07	
RB-0012	1/3/1973	658	SCM	149	1105	1160	460	0.40	74					Grout	1.00	
RB-0012	1/3/1973	658	DM-5 ??	150	904	4530	1715	0.36	69	52	2.50	3.0		2 yd Rejected as unworkable	4.04	
RB-0012	1/3/1973	658	DM-5 ??	180	915	4512	1854	0.41	70	52	3.50			3 yd Rejected as unworkable	3.02	
RB-0012	1/3/1973	658	DM-5 ??	154	943	4530	1719	0.38	70	54	3.50	3.2	2107	2 yd Rejected as unworkable	4.04	
RB-0012	1/3/1973	658	DM-5 ??	183	1005	4512	1721	0.38	70	56	4.25			2 yd rejected for overtime	4.02	
RB-0012	1/3/1973	658	DM-5 ??	182	1036	4494	1721	0.38	70	56	4.00			3 yd rejected for overtime	2.99	
RB-0012	1/3/1973	658	DM-5 ??	147	1054	4530	1713	0.38	74	54	4.25			1 yd rejected for overtime	5.04	
RB-0012	1/3/1973	658	DM-5 ??	150	1110	4530	1713	0.38	78	56	3.75			3 yd rejected for overtime	3.04	
RB-0012	1/3/1973	658	DM-5 ??	180	1143	4500	1716	0.38	80	60	4.00			2 yd rejected for overtime	4.00	
RB-0012	1/3/1973	658	DM-5 ??	149	1154	4494	1714	0.38	80	58	4.25				5.99	
RB-0012	1/3/1973	658	DM-5 ??	154	1215	4518	1714	0.38	80	58	4.25			3 yd rejected for overtime	3.02	
RB-0012	1/3/1973	658	DM-5 ??	183	1300	4506	1723	0.38	81	57	4.50				6.01	
RB-0012	1/3/1973	658	DM-5 ??	182	1335	4476	1725	0.39	81	58	4.25				5.97	
RB-0012	1/3/1973	658	DM-5 ??	150	1350	4506	1716	0.38	81	54	4.00			2 yd rejected for overtime	4.01	
RB-0012	1/3/1973	658	DM-5 ??	149	1359	4482	1716	0.38	80	56	4.50	3.5	2108		5.98	
RB-0012	1/3/1973	658	DM-5 ??	180	1418	4470	1716	0.38	80	56	4.00			3 yd sent elsewhere	2.96	
RB-0012	1/3/1973	658	DM-5 ??	154	1440	4488	1722	0.38	80	56	3.25			4 yd sent elsewhere	1.98	
RB-0012	1/3/1973	658	DM-5 ??	183	1512	4482	1722	0.38						all sent elsewhere	0.00	
RB-0012	1/16/1973	674	SCM	147	1302	3480	1382	0.40	68					Grout	3.00	
RB-0012	1/16/1973	674	SCM	182	1312	3480	1382	0.40	68					Grout	3.00	
RB-0012	1/16/1973	674	DM-5 (mod ?)	154	1326	4080	1654	0.41	68	55	2.00			2 yd Rejected as unworkable	3.98	
RB-0012	1/16/1973	674	DM-5 (mod ?)	181	1344	4062	1657	0.41	68	55	3.00				5.96	
RB-0012	1/16/1973	674	DM-5 (mod ?)	183	1400	4086	1654	0.40	69	56	3.00			1 yd lost to ground	5.99	
RB-0012	1/16/1973	674	DM-5 (mod ?)	150	1415	4056	1654	0.41	68	56	2.75				5.95	
RB-0012	1/16/1973	674	DM-5 (mod ?)	147	1440	4056	1658	0.41	68	56	3.00				5.95	
RB-0012	1/16/1973	674	DM-5 (mod ?)	154	1455	4088	1658	0.41	67	56	2.50				5.99	
RB-0012	1/16/1973	674	DM-5 (mod ?)	181	1522	4080	1664	0.41	67	56	2.50				5.98	
RB-0012	1/16/1973	674	DM-5 (mod ?)	183	1535	4062	1658	0.41	68	57	2.25	3.3	2139	1 yd lost to ground	4.96	
RB-0012	1/16/1973	674	DM-5 (mod ?)	182	1552	4074	1658	0.41	65	57	3.00				5.97	
RB-0012	1/16/1973	674	DM-5 (mod ?)	154	1622	4092	1659	0.41	66	55	3.00				6.00	
RB-0012	1/16/1973	674	DM-5 (mod ?)	150	1636	4092	1656	0.40	63	54	3.00				6.00	
RB-0012	1/16/1973	674	DM-5 (mod ?)	147	1650	4092	1656	0.40	64	53	3.00				6.00	
RB-0012	1/16/1973	674	DM-5 (mod ?)	181	1659	4116	1656	0.40	64	56	2.75				6.04	
RB-0012	1/16/1973	674	DM-5 (mod ?)	183	1710	4122	1656	0.40	64	53	2.50				6.04	
RB-0012	1/16/1973	674	DM-5 (mod ?)	154	1751	4094	1656	0.40	62	53	2.75				6.00	
RB-0012	1/16/1973	674	DM-5 (mod ?)	150	1800	4116	1656	0.40	62	53	3.00			2yd rejected- pour over	4.04	
RB-0012	1/16/1973	674	DM-5 (mod ?)	147	1809	4116	1656	0.40	62					rejected- pour complete	0.00	
RB-0012	1/23/1973	683	SCM	182	834	3474	1385	0.40	53	50				G-152	Grout	2.99
RB-0012	1/23/1973	683	SCM	149	840	3486	1382	0.40	53	50				Grout	3.01	
RB-0012	1/23/1973	683	DM-5 (mod ?)	150	947	4086	1655	0.41	56	51	3.00					3.99
RB-0012	1/23/1973	683	DM-5 (mod ?)	153	901	4080	1658	0.41	56	51	2.75					5.98
RB-0012	1/23/1973	683	DM-5 (mod ?)	183	925	4086	1666	0.41	56	52	2.50					5.99
RB-0012	1/23/1973	683	DM-5 (mod ?)	147	941	4086	1660	0.41	56	53	2.75	3.4	2154			5.99
RB-0012	1/23/1973	683	DM-5 (mod ?)	182	950	4080	1663	0.41	56	52	2.75					5.98
RB-0012	1/23/1973	683	DM-5 (mod ?)	149	1000	4080	1665	0.41	56	53	2.75					5.98
RB-0012	1/23/1973	683	DM-5 (mod ?)	150	1012	4080	1659	0.41	56	52	4.50			All Rejected- overslump	0.00	
RB-0012	1/23/1973	683	DM-5 (mod ?)	147	1035	4080	1656	0.41	57	52	6.00			All Rejected- overslump	0.00	
RB-0012	1/23/1973	683	DM-5 (mod ?)	183	1050	4086	1662	0.41	58	51	3.00					5.99
RB-0012	1/23/1973	683	DM-5 (mod ?)	182	1105	4074	1659	0.41	58	52	2.75					5.97
RB-0012	1/23/1973	683	DM-5 (mod ?)	181	1117	4092	1665	0.41	60	53	2.75					6.00
RB-0012	1/23/1973	683	DM-5 (mod ?)	149	1130	4068	1656	0.41	61	51	3.00	3.4	2155			5.96
RB-0012	1/23/1973	683	DM-5 (mod ?)	150	1143	4068	1653	0.41	63	52	3.00					5.96
RB-0012	1/23/1973	683	DM-5 (mod ?)	147	1204	4104	1656	0.40	68	52	3.00					6.02
RB-0012	1/23/1973	683	DM-5 (mod ?)	183	1225	4104	1653	0.40	64	53	2.50					6.02
RB-0012	1/23/1973	683	DM-5 (mod ?)	182	1228	4098	1656	0.40	64	52	3.00					6.01
RB-0012	1/23/1973	683	DM-5 (mod ?)	181	1244	4092	1653	0.40	66	54	2.75					6.00
RB-0012	1/23/1973	683	DM-5 (mod ?)	149	1300	4080	1656	0.41	66	55	2.75					5.98
RB-0012	1/23/1973	683	DM-5 (mod ?)	183	1410	4074	1656	0.41						not used- sent elsewhere	0.00	
RB-0012	1/27/1973	690	SCM	183	657	3474	1381	0.40	62					Grout	2.99	
RB-0012	1/27/1973	690	SCM	154	705	3480	1384	0.40	62					Grout	3.00	
RB-0012	1/27/1973	690	DM-5 Mod	153	712	4098	1659	0.40	62	53	3.00	4.0		3 yd Rejected for		

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used	
						Cement	Total water		Ambient	Concrete						
RB-0012	1/27/1973	690	DM-5- Mod	183	820	4098	1653	0.40	63	52	3.00				6.01	
RB-0012	1/27/1973	690	DM-5- Mod	154	830	4092	1656	0.40	64	52	3.00				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	147	842	4092	1656	0.40	64	53	3.00				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	150	848	4092	1656	0.40	64	53	3.00	4.2	2065	Rejected- overslump	6.00	
RB-0012	1/27/1973	690	DM-5- Mod	182	900	4110	1655	0.40	64	53	4.50				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	183	915	4116	1653	0.40	64	53	3.00				6.04	
RB-0012	1/27/1973	690	DM-5- Mod	154	927	4092	1650	0.40	64	53	2.75				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	150	948	4098	1656	0.40	65	54	3.00				6.01	
RB-0012	1/27/1973	690	DM-5- Mod	147	952	4098	1659	0.40	65	54	3.00				6.01	
RB-0012	1/27/1973	690	DM-5- Mod	182	958	4110	1659	0.40	66	55	2.50				6.03	
RB-0012	1/27/1973	690	DM-5- Mod	149	1002	4092	1656	0.40	66	55	2.25				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	183	1042	4092	1653	0.40	66	53	3.00				6.00	
RB-0012	1/27/1973	690	DM-5- Mod	150	1053	4104	1653	0.40	67	54	2.50	3.7	2063		6.02	
RB-0012	1/27/1973	690	DM-5- Mod	142	1108	4122	1656	0.40	67	55	3.00				6.04	
RB-0012	1/27/1973	690	DM-5- Mod	182	1115	4086	1659	0.41	67	55	3.00			Pour Complete	5.99	
RB-0012	1/27/1973	690	DM-5- Mod	183	1200	4086	1653	0.40						Not used on this pour- pour complete	0.00	
RB-0012	26697	699	SCM	153	733	3480	1382	0.40	70	59				Grout	3.00	
RB-0012	26697	699	SCM	183	739	3474	1385	0.40	70	59				Grout	2.99	
RB-0012	2/2/1973	699	DM-5- Mod	154	746	4092	1657	0.40	70	62	1.25			Rejected ??	0.00	
RB-0012	2/2/1973	699	DM-5- Mod	182	802	4092	1657	0.40	70	61	1.50			Rejected ??	0.00	
RB-0012	2/2/1973	699	DM-5- Mod	150	816	4086	1657	0.41	70	61	1.50				5.99	
RB-0012	2/2/1973	699	DM-5- Mod	149	830	4092	1655	0.40	70					Rejected- Underslump	0.00	
RB-0012	2/2/1973	699	DM-5- Mod	153	850	4086	1652	0.40	70						5.99	
RB-0012	2/2/1973	699	DM-5- Mod	183	908	4074	1659	0.41	73	56	3.00				5.97	
RB-0012	2/2/1973	699	DM-5- Mod	154	930	4068	1662	0.41	70	60	1.75	3.2	2170		5.96	
RB-0012	2/2/1973	699	DM-5- Mod	182	935	4098	1656	0.40	70	58				6 yd not used	0.00	
RB-0012	2/2/1973	699	DM-5- Mod	150	950	4098	1656	0.40						Pour not used	0.00	
RB-0012	26708	702	SCM	150	842	3480	1382	0.40	50	60				Grout	3.00	
RB-0012	26708	702	SCM	148	849	3480	1391	0.40	50	61				Grout	3.00	
RB-0012	2/13/1973	702	DM-5- Mod	151	855	4086	1661	0.41	50	57	4.50			Rejected- Overslump	0.00	
RB-0012	2/13/1973	702	DM-5- Mod	153	910	4086	1655	0.41	50	59	2.75				5.99	
RB-0012	2/13/1973	702	DM-5- Mod	149	921	4098	1658	0.40	50	58	2.75				6.01	
RB-0012	2/13/1973	702	DM-5- Mod	154	944	4116	1653	0.40	62	57	3.00				6.04	
RB-0012	2/13/1973	702	DM-5- Mod	150	1012	4098	1653	0.40	67	57	2.75	3.8	2174		6.01	
RB-0012	2/13/1973	702	DM-5- Mod	148	1030	4092	1653	0.40	68	56	3.00				6.00	
RB-0012	2/13/1973	702	DM-5- Mod	153	1035	4092	1653	0.40	69	56	3.00				6.00	
RB-0012	2/13/1973	702	DM-5- Mod	151	1044	4062	1651	0.41	69	55	3.00				5.96	
RB-0012	2/13/1973	702	DM-5- Mod	149	1113	4086	1720	0.42	69	57	2.75				5.99	
RB-0012	2/13/1973	702	DM-5- Mod	150	1133	4104	1654	0.40	69	55	3.00				6.02	
RB-0012	2/13/1973	702	DM-5- Mod	153	1140	4092	1657	0.40	69	56	3.00	3.2	2175		6.00	
RB-0012	2/13/1973	702	DM-5- Mod	151	1153	4092	1654	0.40	69	59	2.25				6.00	
RB-0012	2/13/1973	702	DM-5- Mod	149	1215	4068	1654	0.41	69	60	3.00			5 yd Rejected- Overtime	0.96	
RB-0012	2/13/1973	702	DM-5- Mod	150	1232	4074	1655	0.41	70	58	2.50			5 yd Rejected- Overtime	0.97	
RB-0012	26711	713	SCM	153	1050	3474	1377	0.40						Grout	2.99	
RB-0012	26711	713	SCM	154	1055	3474	1386	0.40						Grout	2.99	
RB-0012	2/16/1973	713	DM-5- Mod	150	1058	4074	1655	0.41	50	59	2.75				5.97	
RB-0012	2/16/1973	713	DM-5- Mod	152	1112	4068	1688	0.41	50	58	3.00				5.96	
RB-0012	2/16/1973	713	DM-5- Mod	182	1205	4074	1653	0.41	52	54	2.75				5.97	
RB-0012	2/16/1973	713	DM-5- Mod	148	1220	4086	1653	0.40	52	54	2.50				5.99	
RB-0012	2/16/1973	713	DM-5- Mod	181	1239	4086	1656	0.41	52	53	3.00				5.99	
RB-0012	2/16/1973	713	DM-5- Mod	149								2183		Missing Truck Ticket S/N02450	0.00	
RB-0012	2/16/1973	713	DM-5- Mod	148	1325	4086	1653	0.40	50	56	2.75				5.99	
RB-0012	2/16/1973	713	DM-5- Mod	152	1336	4062	1659	0.41	48	58	2.50				5.96	
RB-0012	2/16/1973	713	DM-5- Mod	150	1341	4104	1659	0.40	49	58	2.50				6.02	
RB-0012	2/16/1973	713	DM-5- Mod	181	1357	4096	1656	0.40	49	57	2.75				6.01	
RB-0012	2/16/1973	713	DM-5- Mod	147	1425	4092	1656	0.40						Rejected- truck broke	0.00	
RB-0012	2/16/1973	713	DM-5- Mod	149	1432	4092	1653	0.40	49	58	2.75	3.5	2184			6.00
RB-0012	2/16/1973	713	DM-5- Mod	148	1455	4086	1653	0.40	48						5.99	
RB-0012	2/16/1973	713	DM-5- Mod	154	1505	4080	1650	0.40	48	56	3.00				5.98	
RB-0012	2/16/1973	713	DM-5- Mod	152	1523	4080	1659	0.41	46	56	3.00				5.98	
RB-0012	2/16/1973	713	DM-5- Mod	150	1528	4062	1659	0.41	45	56	3.00				5.96	
RB-0012	2/16/1973	713	DM-5- Mod	149	1553	4074	1662	0.41	45	55	3.00				5.97	
RB-0012	2/16/1973	713	DM-5- Mod	154	1604	4086	1653	0.40	45	54	2.50				5.99	
RB-0012	26717	719	SCM	149	840	3480	1385	0.40	48					Grout	3.00	
RB-0012	26717	719	SCM	153	847	3468	1385	0.40	48					Grout	2.99	
RB-0012	2/22/1973	719	DM-5- Mod	147	931	4066	1650	0.41	46	56	3.00				5.99	
RB-0012	2/22/1973	719	DM-5- Mod	148	904	4092	1649	0.40	48						6.00	
RB-0012	2/22/1973	719	DM-5- Mod	154	915	4080	1655	0.41	52	56	2.50				5.98	
RB-0012	2/22/1973	719	DM-5- Mod	150	931	4068	1653	0.41	54	56	2.75	3.5	2191			5.96
RB-0012	2/22/1973	719	DM-5- Mod	149	948	4098	1653	0.40	58	54	2.75				6.01	
RB-0012	2/22/1973	719	DM-5- Mod	153	1000	4110	1653	0.40	61	56	2.00				6.03	
RB-0012	2/22/1973	719	DM-5- Mod	147	1008	4062	1653	0.41	61	55	3.00				5.96	
RB-0012	2/22/1973	719	DM-5- Mod	148	1015	4092	1656	0.40	61	58	2.50				6.00	
RB-0012	2/22/1973	719	DM-5- Mod	150	1035	4092	1659	0.41	61	58	2.50				6.00	
RB-0012	2/22/1973	719	DM-5- Mod	154	1041	4092	1659	0.41	61	58	3.00	3.5	2192			6.00
RB-0012	2/22/1973	719	DM-5- Mod	153	1114	4098	1656	0.40	61	59	3.00				6.01	
RB-0012	2/22/1973	719	DM-5- Mod	147	1132	4098	1656	0.40	62	59	2.75				6.01	
RB-0012	2/22/1973	719	DM-5- Mod	148	1145	4098	1660	0.41	62	57	3.00				6.01	

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used	
						Cement	Total water		Ambient	Concrete						
RB -0012	2/22/1973	719	DM-5- Mod	154	1201	4092	1655	0.40	64	56	2.75					6.00
RB -0012	2/22/1973	719	DM-5- Mod	149	1213	4086	1655	0.41	66	53	2.75					5.99
RB -0012	2/22/1973	719	DM-5- Mod	150	1220	4080	1652	0.40	66	54	3.00					5.98
RB -0012	2/22/1973	719	DM-5- Mod	153	1255	4086	1652	0.40	66	54	3.00				3 yd not used	2.99
RB -0012	3/1/1973	729	SCM	147	1203	6966	2763	0.40								6.01
RB -0012	3/1/1973	729	DM-5- Mod	149	1210	4080	1657	0.41	76	55	4.00				Rejected- overslump	0.00
RB -0012	3/1/1973	729	DM-5- Mod	150	1225	4092	1726	0.42	76	55	3.00					6.00
RB -0012	3/1/1973	729	DM-5- Mod	148	1236	4080	1657	0.41	76	55	3.00					5.98
RB -0012	3/1/1973	729	DM-5- Mod	147	1300	4086	1654	0.40	77	55	3.00					5.99
RB -0012	3/1/1973	729	DM-5- Mod	149	1307	4092	1657	0.40	75	54	3.00					6.00
RB -0012	3/1/1973	729	DM-5- Mod	183	1316	4092	1657	0.40	75	58	2.50					6.00
RB -0012	3/1/1973	729	DM-5- Mod	150	1329	4092	1654	0.40	75	59	3.00					6.00
RB -0012	3/1/1973	729	DM-5- Mod	148	1335	4086	1654	0.40	75	57	3.50				Rejected- overslump	0.00
RB -0012	3/1/1973	729	DM-5- Mod	147	1343	4092	1648	0.40	75	56	4.00				Rejected- overslump	0.00
RB -0012	3/1/1973	729	DM-5- Mod	149	1358	4098	1654	0.40	75	54	3.00					6.01
RB -0012	3/1/1973	729	DM-5- Mod	183	1412	4092	1658	0.41	74	56	2.25					6.00
RB -0012	3/1/1973	729	DM-5- Mod	150	1427	4086	1658	0.41	74	56	2.25					5.99
RB -0012	3/1/1973	729	DM-5- Mod	148	1433	4092	1652	0.40	74	58	1.75				Rejected- unworkable	0.00
RB -0012	3/1/1973	729	DM-5- Mod	149	1441	4086	1655	0.41	74	56	2.50					5.99
RB -0012	3/1/1973	729	DM-5- Mod	147	1505	4092	1655	0.40	74	55	2.50					6.00
RB -0012	3/1/1973	729	DM-5- Mod	183	1506	4092	1658	0.41	73	54	3.50				Rejected- overslump	0.00
RB -0012	3/1/1973	729	DM-5- Mod	150	1520	4086	1655	0.41	73	55	3.00					5.99
RB -0012	3/1/1973	729	DM-5- Mod	149	1527	4092	1655	0.40	73	55	3.00				2 yd sent elsewhere	4.00
RB -0012	3/1/1973	729	DM-5- Mod	147	1546	4086	1655	0.41	73	56	1.75					5.99
RB -0012	3/1/1973	729	DM-5- Mod	148	1559	4092	1658	0.41	72	57	2.75					6.00
RB -0012	3/1/1973	729	DM-5- Mod	150	1606	4080	1655	0.41	73	55	3.00					5.98
RB -0012	3/1/1973	729	DM-5- Mod	183	1637	4080	1658	0.41	71	55	3.00				2 yd not used- pour over	3.98
RB -0012	3/1/1973	729	DM-5- Mod	147	1655	4086	1658	0.41							Not used- pour over	0.00
RB -0012	26751	745	SCM	153	819	6978	2760	0.40							Grout	6.02
RB -0012	3/28/1973	745	727550-2-Mod	149	821	4500	1716	0.38	70	52	4.00					6.00
RB -0012	3/28/1973	745	727550-2-Mod	149	843	4500	1719	0.38	70	52	4.00					6.00
RB -0012	3/28/1973	745	727550-2-Mod	183	902	4488	1716	0.38	70	52	3.50					5.98
RB -0012	3/28/1973	745	727550-2-Mod	154	915	4482	1716	0.38	70	52	4.00					5.98
RB -0012	3/28/1973	745	727550-2-Mod	153	935	4482	1719	0.38	71	53	4.00				2228	5.98
RB -0012	3/28/1973	745	727550-2-Mod	148	952	4506	1721	0.38	72	55	3.50					6.01
RB -0012	3/28/1973	745	727550-2-Mod	181	958	4494	1718	0.38	72	53	4.25					5.99
RB -0012	3/28/1973	745	727550-2-Mod	149	1008	4566	1718	0.38	72	53	4.00					6.09
RB -0012	3/28/1973	745	727550-2-Mod	183	1020	4500	1712	0.38	72	55	3.75					6.00
RB -0012	3/28/1973	745	727550-2-Mod	154	1100	4512	1716	0.38	72	56	4.00					6.02
RB -0012	3/28/1973	745	727550-2-Mod	153	1115	4500	1719	0.38	72	55	4.00				2229	6.00
RB -0012	3/28/1973	745	727550-2-Mod	181	1135	4488	1719	0.38	72	55	4.00					5.98
RB -0012	3/28/1973	745	727550-2-Mod	151	1150	4494	1722	0.38	72	57						5.99
RB -0012	3/28/1973	745	727550-2-Mod	148	1156	4482	1719	0.38	72	58	4.25					5.98
RB -0012	3/28/1973	745	727550-2-Mod	183	1201	4470	1719	0.38	72	58	4.00					5.96
RB -0012	3/28/1973	745	727550-2-Mod	149	1214	4488	1719	0.38	70	59	3.25					5.98
RB -0012	3/28/1973	745	727550-2-Mod	154	1254	4488	1722	0.38	72	56	3.25				2230	5.98
RB -0012	3/28/1973	745	727550-2-Mod	153	1300	4470	1716	0.38	72	54	4.50					5.96
RB -0012	3/28/1973	745	727550-2-Mod	151	1340	4500	1722	0.38	72	57	4.00				3 yd not used- pour complete	3.00
RB -0012	26763	749	SCM	149	1015	6980	2761	0.40							Grout	6.00
RB -0012	4/9/1973	749	727550-2-Mod	151	1041	4506	1716	0.38	76	55	4.00					6.00
RB -0012	4/9/1973	749	727550-2-Mod	181	1058	4482	1714	0.38	76	55	3.75					6.01
RB -0012	4/9/1973	749	727550-2-Mod	153	1124	4482	1772	0.40	76	56	4.00					5.98
RB -0012	4/9/1973	749	727550-2-Mod	183	1138	4506	1719	0.38	77	57	3.50				2235	6.01
RB -0012	4/9/1973	749	727550-2-Mod	149	1145	4500	1713	0.38	77	55	4.00					6.00
RB -0012	4/9/1973	749	727550-2-Mod	154	1152	4476	1716	0.38	77	58	8.00				Rejected- Overslump	0.00
RB -0012	4/9/1973	749	727550-2-Mod	151	1157	4518	1713	0.38	77	56	4.25					6.02
RB -0012	4/9/1973	749	727550-2-Mod	181	1216	4536	1714	0.38	77	57	3.25					6.05
RB -0012	4/9/1973	749	727550-2-Mod	153	1232	4506	1714	0.38	77	58	4.00					6.01
RB -0012	4/9/1973	749	727550-2-Mod	183	1250	4482	1719	0.38	77	58	3.75					5.98
RB -0012	4/9/1973	749	727550-2-Mod	154	1300	4512	1711	0.38	78	55	3.00					6.02
RB -0012	4/9/1973	749	727550-2-Mod	151	1312	4408	1714	0.39	78	55	4.00					5.88
RB -0012	4/9/1973	749	727550-2-Mod	149	1319	4500	1764	0.39	78	58	3.50				2236	6.00
RB -0012	4/9/1973	749	727550-2-Mod	181	1323	4484	1719	0.38	78	56	4.25					5.98
RB -0012	4/9/1973	749	727550-2-Mod	153	1330	4488	1716	0.38	78	55	3.75					5.98
RB -0012	4/9/1973	749	727550-2-Mod	183	1336	4500	1721	0.38	78	56	3.50					6.00
RB -0012	4/9/1973	749	727550-2-Mod	154	1419	4488	1717	0.38	77	52	4.50				2 yd rejected- pour complete	3.98
RB -0012	26781	762	SCM	153	1237	6460	2754	0.43	76						Grout	5.57
RB -0012	4/27/1973	762	727550-2-Mod	154	1250	4488	1714	0.38	75	60	0.75				Rejected- Underlump	
RB -0012	4/27/1973	762	727550-2-Mod	150	1305	4482	1720	0.38	75	60	2.75				3 yd Sent elsewhere	2.98
RB -0012	4/27/1973	762	727550-2-Mod	151	1320	4488	1723	0.38	75	59	3.00					5.98
RB -0012	4/27/1973	762	727550-2-Mod	148	1338	4512	1716	0.38	75	59	3.75					6.02
RB -0012	4/27/1973	762	727550-2-Mod	147	1356	4506	1721	0.38	75	56	4.00					6.01
RB -0012	4/27/1973	762	727550-2-Mod	183	1414	4536	1723	0.38	75	58	3.25					6.05
RB -0012	4/27/1973	762	727550-2-Mod	153	1420	4512	1723	0.38	75							

Bay/Panel	Date	Pour	Mix Design	Truck Number	Time Loaded	Actual Weights per Truck (6 yd)		w/c Ratio	Temperature		Slump	Air %	Cylinder #	Comments	Total Yards Used
						Cement	Total water		Ambient	Concrete					
RB-0012	4/27/1973	762	727550-2-Mod	150	1515	4512	1732	0.38	72	55	3.75				6.02
RB-0012	4/27/1973	762	727550-2-Mod	183	1525	4494	1714	0.38	72	56	2.75				5.99
RB-0012	4/27/1973	762	727550-2-Mod	154	1535	4500	1717	0.38	72	54	4.25				6.00
RB-0012	4/27/1973	762	727550-2-Mod	147	1550	4476	1717	0.38	71	54	4.25				5.97
RB-0012	4/27/1973	762	727550-2-Mod	153	1605	4482	1717	0.38	71	54	3.50				5.98
RB-0012	4/27/1973	762	727550-2-Mod	150	1615	4512	1717	0.38	71	52	3.75	3.4	2252		6.02
RB-0012	4/27/1973	762	727550-2-Mod	183	1625	4500	1717	0.38	70	52	3.25				6.00
RB-0012	4/27/1973	762	727550-2-Mod	154	1631	4488	1717	0.38	70	52	3.75				5.98
RB-0012	4/27/1973	762	727550-2-Mod	147	1645	4488	1723	0.38	70	51	3.25	3.4	2253		5.98
RB-0012	4/27/1973	762	727550-2-Mod	153	1655	4524	1717	0.38	70	51	3.75			Pour over- not used	0.00
RB-0012	4/27/1973	762	727550-2-Mod	150	1717	4506	1723	0.38						Pour over- not used	0.00
RB-0012	26787	769	SCM	153	1003	6978	2762	0.40	75					Grout	6.02
RB-0012	5/3/1973	769	727550-2-Mod	150	1010	4500	1713	0.38	75	56	3.25				6.00
RB-0012	5/3/1973	769	727550-2-Mod	149	1025	4482	1713	0.38	75	56	3.75				5.98
RB-0012	5/3/1973	769	727550-2-Mod	148	1045	4500	1724	0.38	76	57	3.00				6.00
RB-0012	5/3/1973	769	727550-2-Mod	154	1058	4488	1717	0.38	76	58	3.50				5.98
RB-0012	5/3/1973	769	727550-2-Mod	150	1113	4500	1720	0.38	76	56	3.50	3.5	2262		6.00
RB-0012	5/3/1973	769	727550-2-Mod	149	1124	4500	1717	0.38	77	56	4.25				6.00
RB-0012	5/3/1973	769	727550-2-Mod	148	1141	4494	1714	0.38	77	58	3.25				5.99
RB-0012	5/3/1973	769	727550-2-Mod	151	1149	4512	1717	0.38	77	58	4.00				6.02
RB-0012	5/3/1973	769	727550-2-Mod	154	1154	4524	1717	0.38	77	55	4.25				6.03
RB-0012	5/3/1973	769	727550-2-Mod	150	1158	4512	1717	0.38	77	56	4.00				6.02
RB-0012	5/3/1973	769	727550-2-Mod	149	1205	4500	1720	0.38	77	58	3.50				6.00
RB-0012	5/3/1973	769	727550-2-Mod	148	1225	4488	1720	0.38	82	58	3.50				5.98
RB-0012	5/3/1973	769	727550-2-Mod	151	1232	4488	1717	0.38	82	58	4.50	3.0	2263		5.98
RB-0012	5/3/1973	769	727550-2-Mod	154	1241	4494	1720	0.38	82	58	4.00				5.99
RB-0012	5/3/1973	769	727550-2-Mod	150	1250	4512	1717	0.38	82	58	4.00				6.02
RB-0012	5/3/1973	769	727550-2-Mod	149	1300	4506	1717	0.38	82	58	4.00				6.01
RB-0012	5/3/1973	769	727550-2-Mod	148	1310	4512	1717	0.38	82	58	3.50			3 yd not used- pour over	3.02