


34

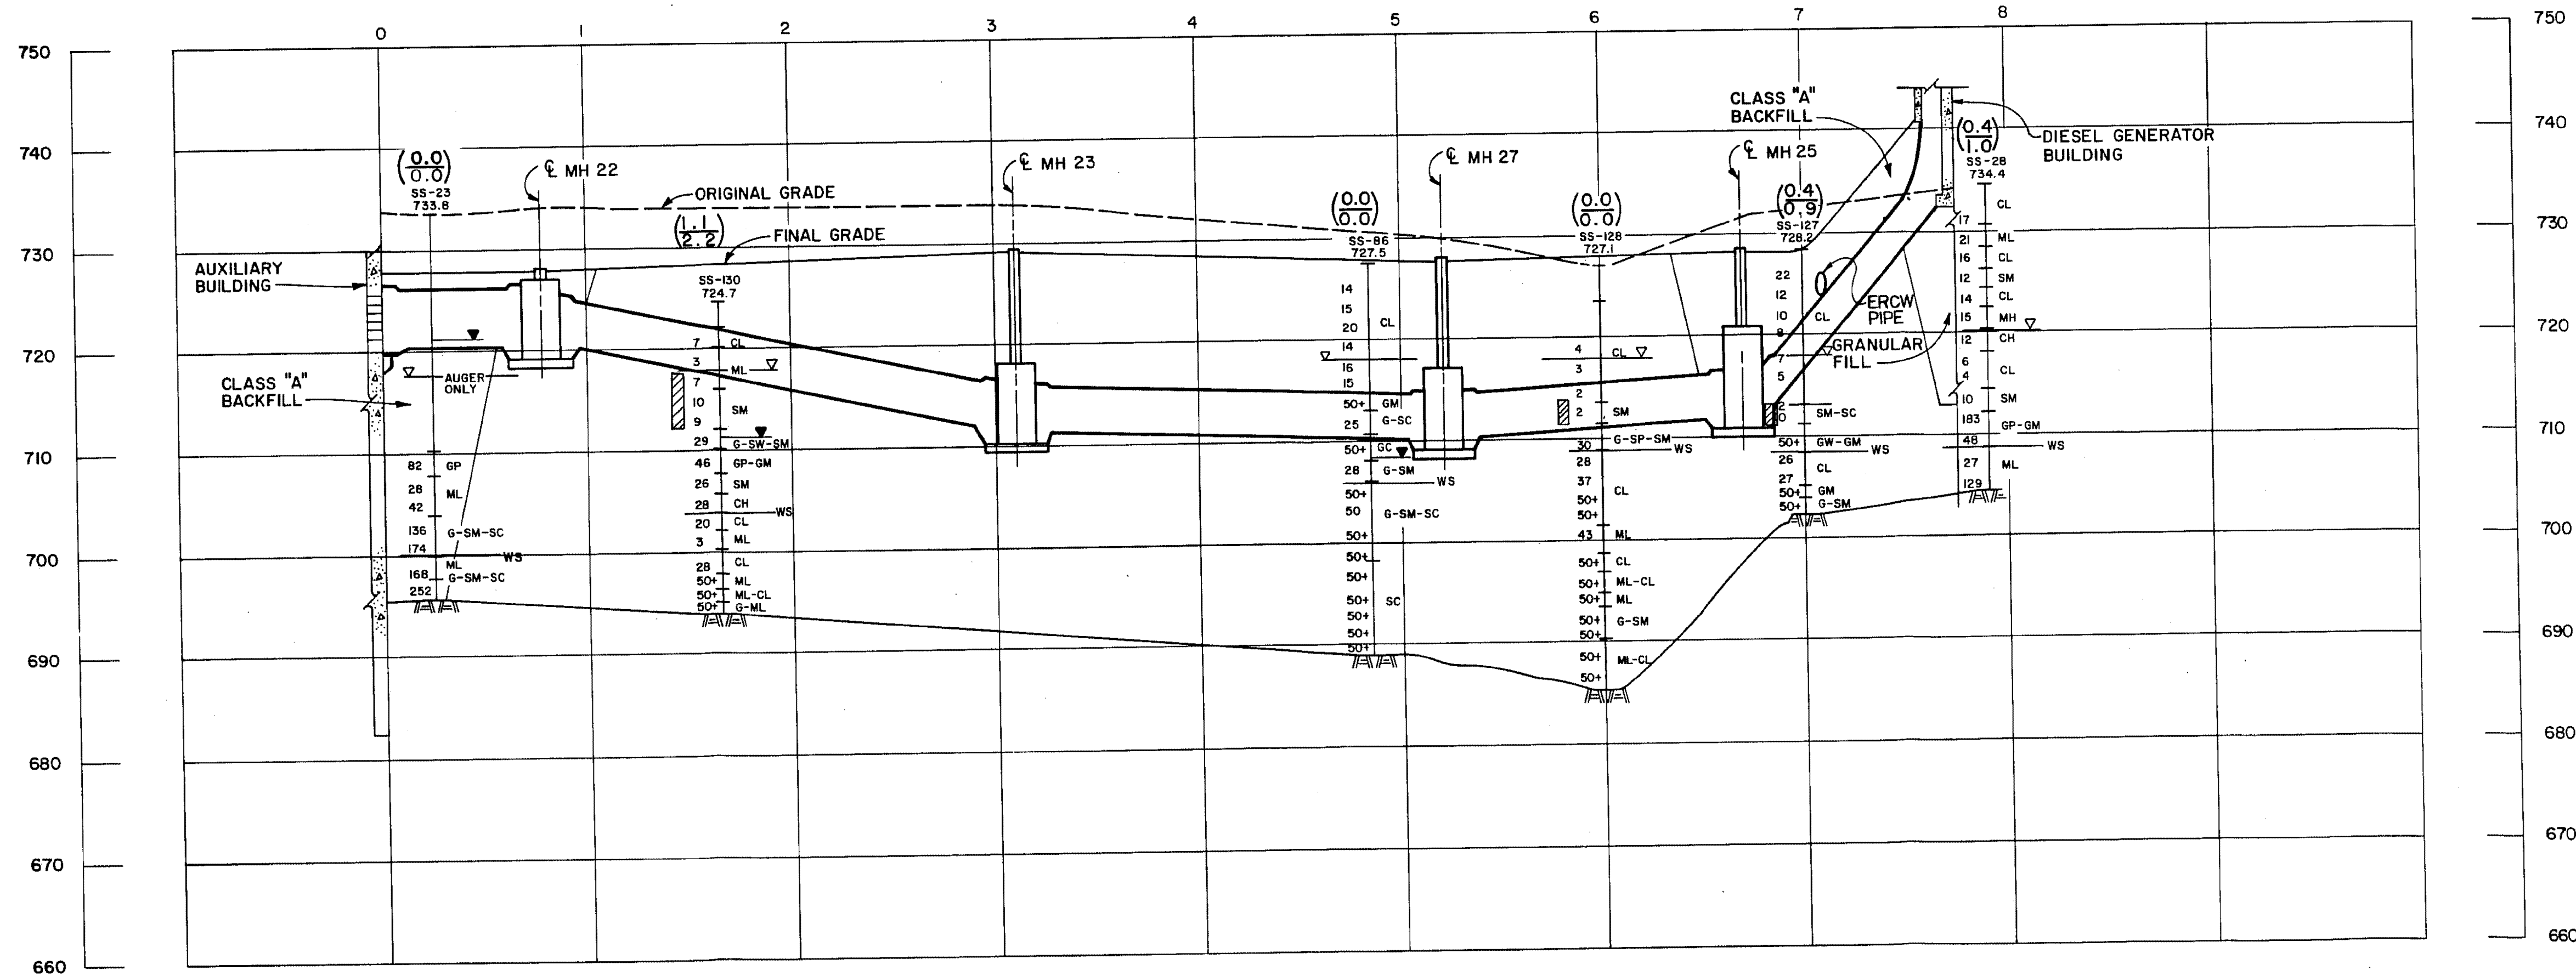

POTENTIAL SETTLEMENT BASED ON  
 1.5%  $\epsilon$  CRITERIA (INCHES)  
 (0.4)  
 (1.0) POTENTIAL SETTLEMENT BASED ON  
 6%  $\epsilon$  CRITERIA (INCHES)

- $\nabla$  DESIGN WATER TABLE
- $\blacktriangledown$  WATER TABLE (24HR)
- MH SOIL CLASSIFICATION
- 13 BLOW COUNT
- POTENTIALLY LIQUEFIABLE SOIL
- (SEE NOTE)
- WS WEATHERED SHALE

NOTE:  
 1. LIQUEFACTION BASED ON TOP OF  
 GROUND ACCELERATION OF 0.4g  
 AND SEED - IDRIS (1971)  
 CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT  
 FINAL SAFETY  
 ANALYSIS REPORT

---

CATEGORY I ELECTRICAL CONDUITS  
 SECTION H-H  
 FIGURE 2.5-578

H-H