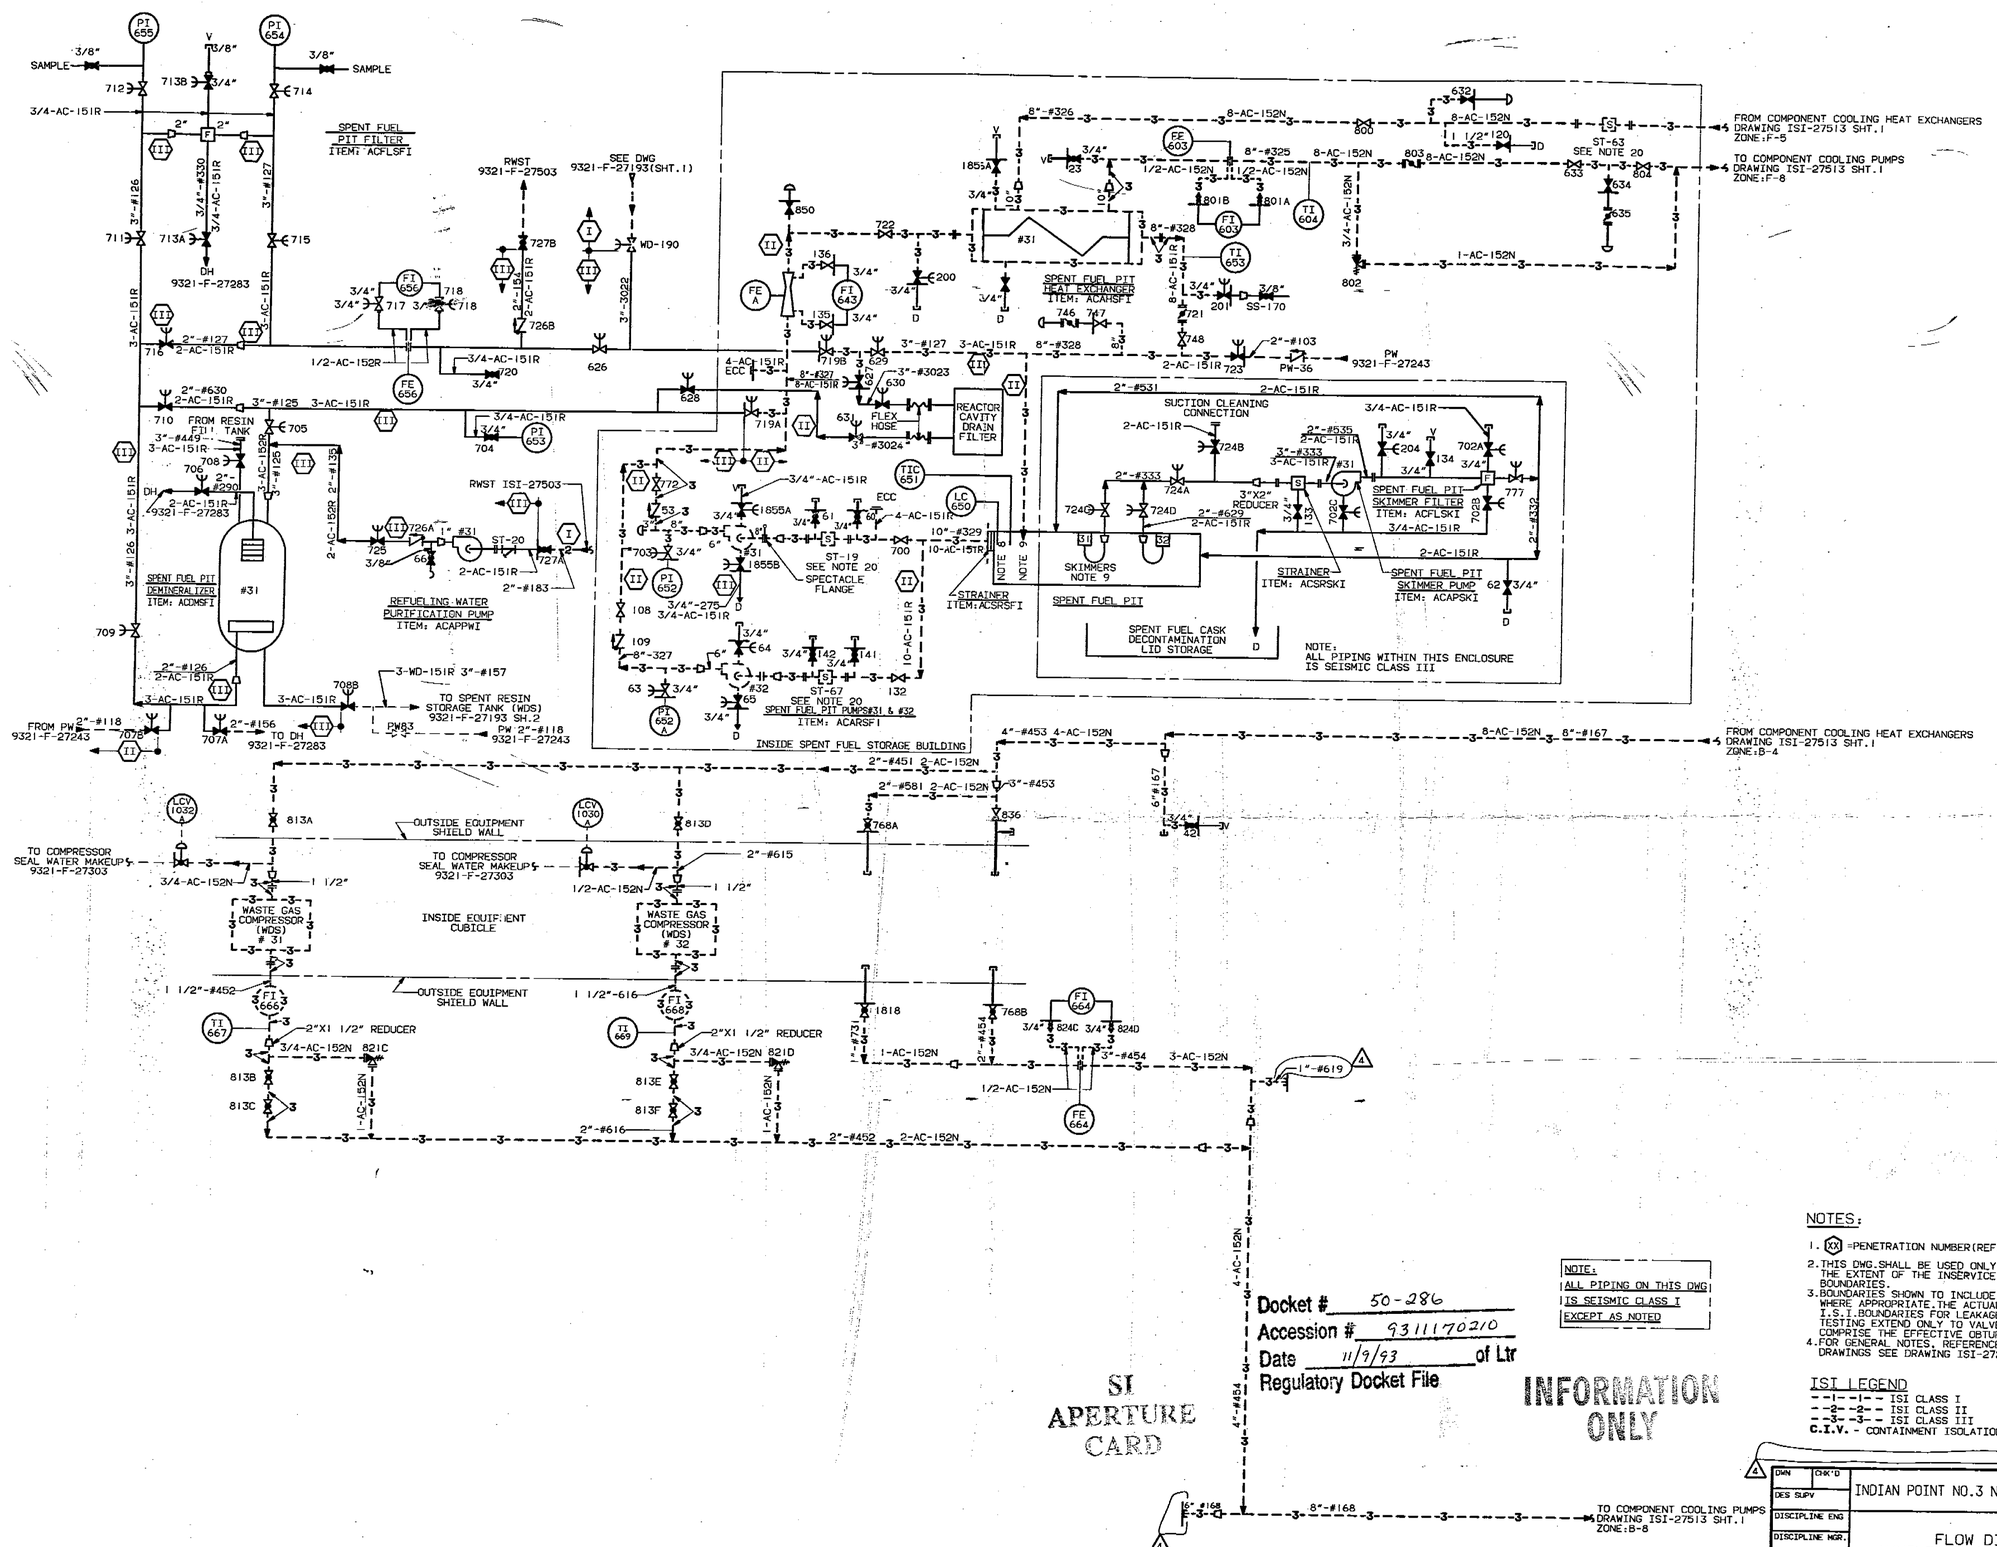

NOTES:

1. (XX) =PENETRATION NUMBER(REF.F.S.A.R.)
2. THIS DWG.SHALL BE USED ONLY FOR DETERMINING THE EXTENT OF THE INSERVICE INSPECTION BOUNDARIES.
3. BOUNDARIES SHOWN TO INCLUDE BOUNDARY VALVES WHERE APPROPRIATE.THE ACTUAL PRESSURE RETAINING I.S.I.BOUNDARIES FOR LEAKAGE AND HYDROSTATIC TESTING EXTEND ONLY TO VALVE INTERNALS THAT COMPRISE THE EFFECTIVE OBTURATOR ASSEMBLY.
4. FOR GENERAL NOTES, REFERENCES AND REFERENCE DRAWINGS SEE DRAWING ISI-27203

ISI LEGEND

- -1- -1- - ISI CLASS I
- -2- -2- - ISI CLASS II
- -3- -3- - ISI CLASS III

C.I.V. - CONTAINMENT ISOLATION VALVE

NOTE:
ALL PIPING ON THIS DWG
IS SEISMIC CLASS I
EXCEPT AS NOTED

Docket # 50-286
Accession # 9311170210
Date 11/9/93 of Ltr
Regulatory Docket File

SI APERTURE CARD

INFORMATION ONLY

REV NO	DATE	DESCRIPTION				
4	7/16/93	UPDATED TO 9321-F-27513.SH.2.REV.24 & 25.	PH	RCG		
3	5/1/90	UPDATED TO 9321-F-27513.SH.2.REV.23.	KB	MM		JMI
			JMS	DS	DE	PROJ APP.

REVISIONS

DWN | CHK'D
DES SUPV
DISCIPLINE ENG
DISCIPLINE MGR.
PROJ APPROVAL
DATE

INDIAN POINT NO.3 NUCLEAR POWER PLANT

FLOW DIAGRAM
AUXILIARY COOLANT SYSTEM
IN PAB & FSB SHEET NO.2

NewYorkPower Authority

SCALE NONE
DWG NO ISI-27513 SHEET 2
REV 4