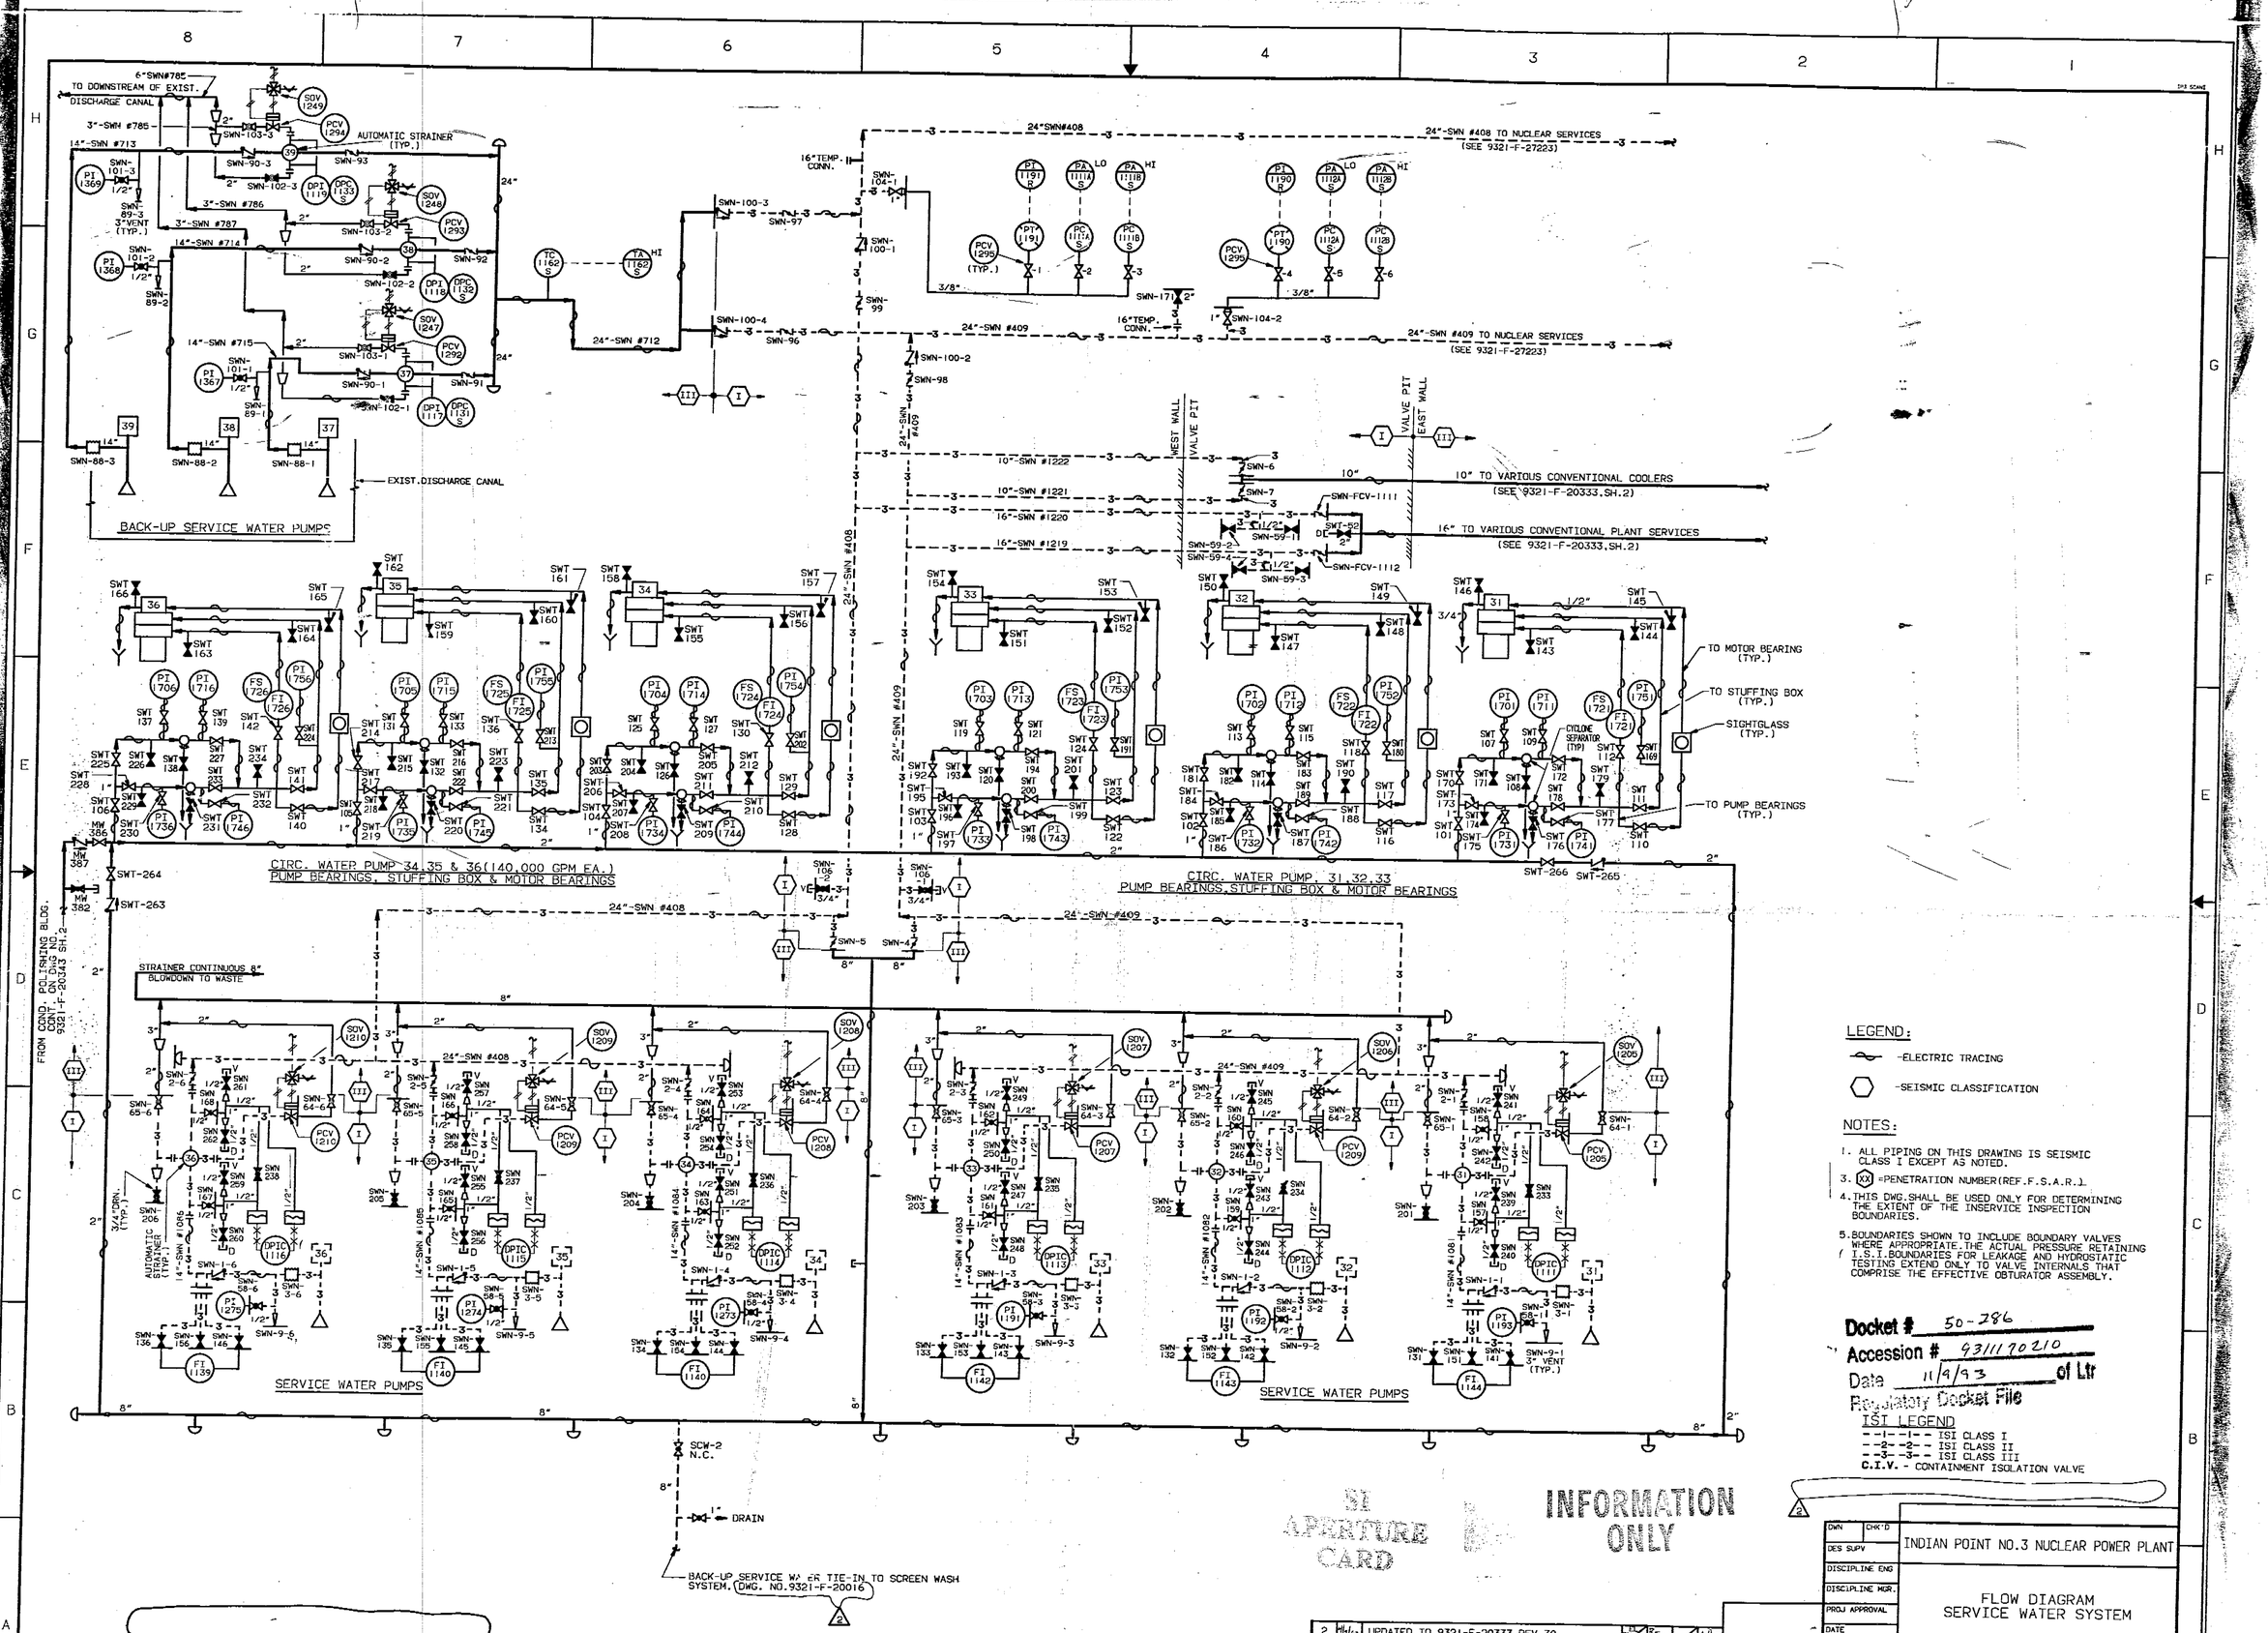

LEGEND:

-ELECTRIC TRACING

-SEISMIC CLASSIFICATION

NOTES:

1. ALL PIPING ON THIS DRAWING IS SEISMIC CLASS I EXCEPT AS NOTED.
3. (XX) =PENETRATION NUMBER(REF.F.S.A.R.)
4. THIS DWG.SHALL BE USED ONLY FOR DETERMINING THE EXTENT OF THE INSERVICE INSPECTION BOUNDARIES.
5. BOUNDARIES SHOWN TO INCLUDE BOUNDARY VALVES WHERE APPROPRIATE.THE ACTUAL PRESSURE RETAINING I.S.I.BOUNDARIES FOR LEAKAGE AND HYDROSTATIC TESTING EXTEND ONLY TO VALVE INTERNALS THAT COMPRISE THE EFFECTIVE OBTURATOR ASSEMBLY.

Docket # 50-286
Accession # 9311170210
Date 11/9/93 of Ltr
Regulatory Docket File

ISI LEGEND
--1--1-- ISI CLASS I
--2--2-- ISI CLASS II
--3--3-- ISI CLASS III
C.I.V. - CONTAINMENT ISOLATION VALVE

SI APERTURE CARD

INFORMATION ONLY

REV NO	DATE	DESCRIPTION	DWN	CHK'D	DS	DE DM	PROJ APP.
2	11/19/93	UPDATED TO 9321-F-20333 REV.30		RE			KJ
1	8/26/93	THIS DWG.SUPERSEDES DWG.ISI-27223,SH.1 OF 2,REV.3 AND UPDATED TO 9321-F-20333,SH.1 OF 2,THRU REV.29.	PM	NV			KJ

REVISIONS

DWN | CHK'D
DES SUPV
DISCIPLINE ENG
DISCIPLINE MGR.
PROJ APPROVAL
DATE

INDIAN POINT NO.3 NUCLEAR POWER PLANT

FLOW DIAGRAM
SERVICE WATER SYSTEM

New York Power Authority

SCALE: NONE
DWG NO ISI-20333
REV 2
SHEET