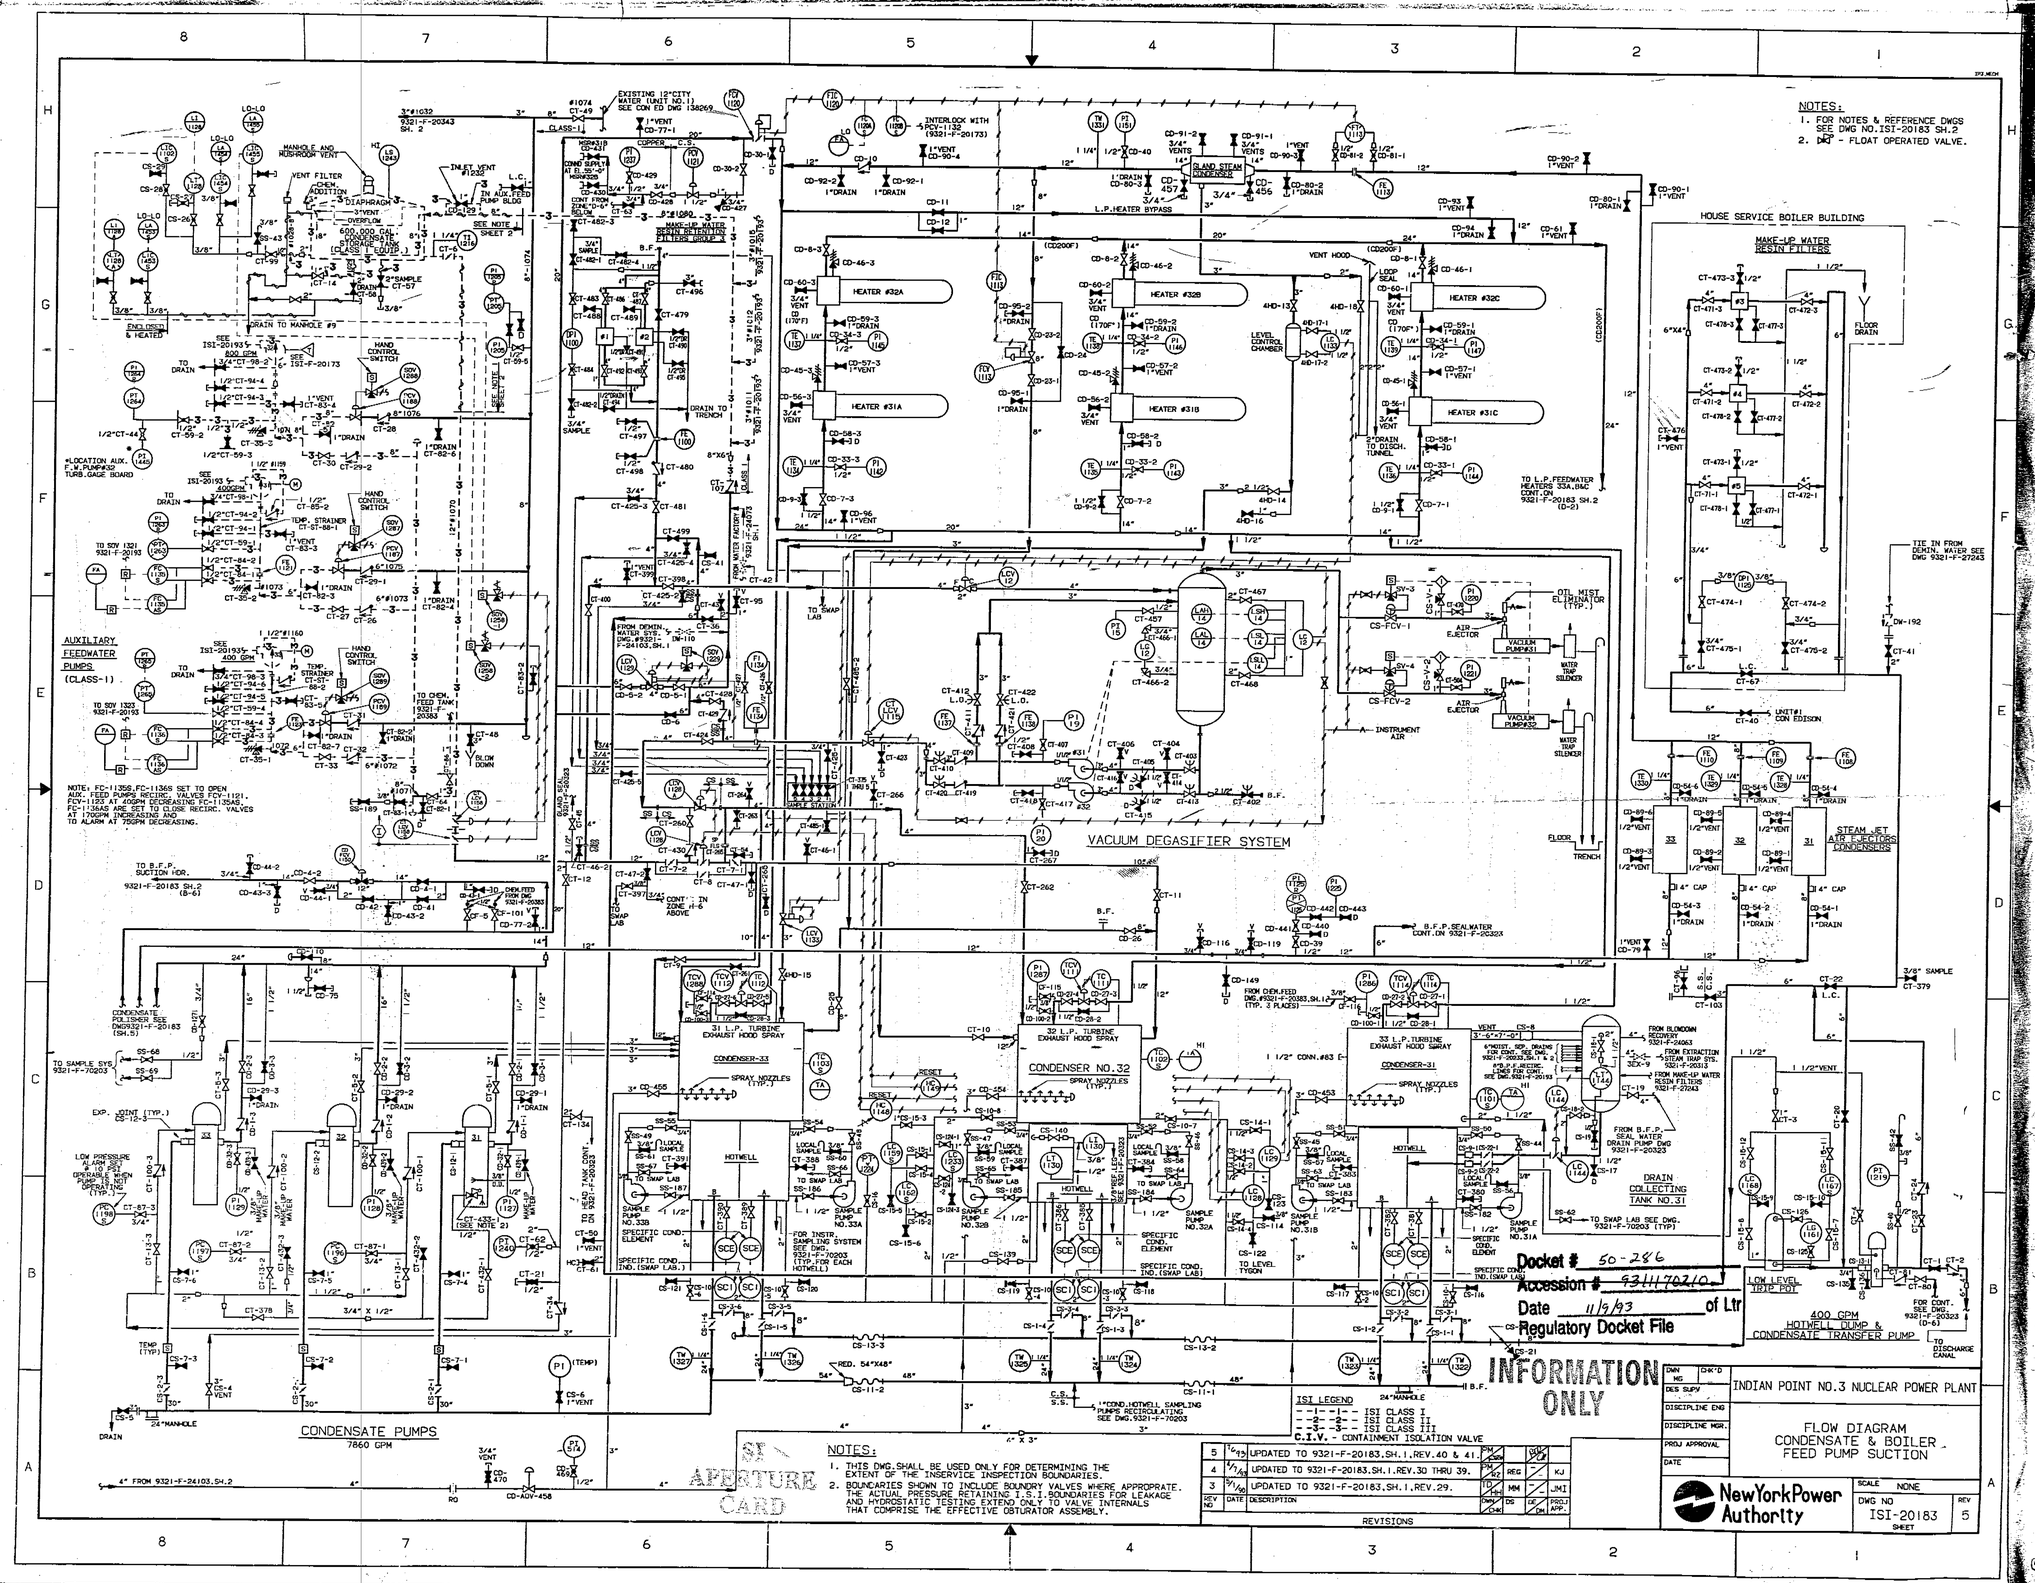
NOTES:
1. FOR NOTES & REFERENCE DWGS SEE DWG NO. ISI-20183 SH.2
2. - FLOAT OPERATED VALVE.
HOUSE SERVICE BOILER BUILDING
MAKE-UP WATER RESIN FILTERS
HEATER #32A
HEATER #32B
HEATER #32C
HEATER #31A
HEATER #31B
HEATER #31C
GLAND STEAM CONDENSER
L.P. HEATER BYPASS
VACUUM DEGASIFIER SYSTEM
STEAM JET AIR EJECTORS CONDENSERS
AUXILIARY FEEDWATER PUMPS (CLASS-1)
CONDENSATE PUMPS
7860 GPM
CONDENSER NO.32
HOTWELL
400 GPM HOTWELL DUMP & CONDENSATE TRANSFER PUMP
DRAIN COLLECTING TANK NO.31
INFORMATION ONLY
Docket # 50-286
Accession # 9311170210
Date 11/9/93 of Ltr
Regulatory Docket File
APERTURE CARD
ISI LEGEND
- -1- -1- - ISI CLASS I
- -2- -2- - ISI CLASS II
- -3- -3- - ISI CLASS III
C.I.V. - CONTAINMENT ISOLATION VALVE
NOTES:
1. THIS DWG.SHALL BE USED ONLY FOR DETERMINING THE EXTENT OF THE INSERVICE INSPECTION BOUNDARIES.
2. BOUNDARIES SHOWN TO INCLUDE BOUNDRY VALVES WHERE APPROPRATE. THE ACTUAL PRESSURE RETAINING I.S.I.BOUNDARIES FOR LEAKAGE AND HYDROSTATIC TESTING EXTEND ONLY TO VALVE INTERNALS THAT COMPRISE THE EFFECTIVE OBTURATOR ASSEMBLY.
REV NO | DATE | DESCRIPTION
5 | 12/15/92 | UPDATED TO 9321-F-20183.SH.1,REV.40 & 41
4 | 8/1/89 | UPDATED TO 9321-F-20183.SH.1,REV.30 THRU 39.
3 | 3/1/86 | UPDATED TO 9321-F-20183.SH.1,REV.29.
REVISIONS
INDIAN POINT NO.3 NUCLEAR POWER PLANT
FLOW DIAGRAM
CONDENSATE & BOILER FEED PUMP SUCTION
NewYorkPower Authority
SCALE NONE
DWG NO. ISI-20183
REV 5